CITY OF LINCOLN
NEBRASKA
MAYOR CHRIS BEUTLER
lincoln.ne.gov

Lincoln-Lancaster County
Health Department
Bruce D. Dart, Ph.D., Health Director
3140 "N" Street
Lincoln, Nebraska 68510-1514
402-441-8000
TDD: 402-441-6284
fax: 402-441-8323
health@lincoln.ne.gov

September 11, 2008

Dick Wolf
4027 Mohawk Street
Lincoln, NE 68510

Mr. Wolf:

On September 4, 2008 an inspection was made of the construction of the new water well constructed at 1445 SW 15th Circle in Lancaster County. Well construction appeared to meet construction standards and the location was just outside of allowed distances to water ways.

The results of bacterial and nitrate nitrogen water samples taken both meet the requirements of a satisfactory drinking water supply at the time of sampling. Nitrate nitrogen was less than 0.05 ppm, below the drinking water limit of 10 ppm. The bacteria analysis came back negative for the presence of coliform bacteria.

Due to the location of the well in relation to surface water drainage it is the Department's recommendation that the well be inspected for erosion and tested sampled by the owner for bacteriological and nitrate nitrogen on an annual basis or after any flash flooding events issued by the national whether service for the immediate area. I have enclosed a photo for your reference.

In addition, the lagoon is not yet fenced and must be prior to receiving any waste water from the premises. I have attached photos for your reference.

If there are any questions, please contact the Health Department at (402) 441-8030.

Sincerely,

James Newman, Water Section
Lincoln-Lancaster County Health Department

Encl.

Permit no. HW000333

14445 SW 15th Street



14445SW15a.JPG
09/04/2008 (Thu), 1:22 PM



14445SW15b.JPG
09/04/2008 (Thu), 1:48 PM

LLCHD HS000043

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8022

A

Permit Number HS000043

Onsite Wastewater Treatment System
Request for Site Clearance and Permit

Include Form B and C. Submit correct fee with this Application

3 acres or more required for: ❑ Septic System ☒ Lagoon ❑ Other (Refer to Form C)

The undersigned hereby requests site clearance and permit to construct a Wastewater Treatment System in conformance with appropriate regulations.

PLEASE PRINT OR TYPE

A. Onsite System Location

Address 14445 SW 15th Cir. City Lincoln, NE Zip _____
(no rural route)

Legal Description 9, 8, 6 Benzigers Pleasant Acres Addition Block [redacted] Lot 4
1/4 1/4 Section Township Range Subdivison

Geographical Location (if known): Longitude: _____ Latitude: _____

❑ Check if system mail address is not the same as the owner's address Total Acres: _____

B. Owner

Name Dick Wolf Construction Signature Joan Wolf Per Dick Wolf

Address 4027 Mohawk City/State/Zip Lincoln NE 68510

❑ Check if owner designed system Home Phone 436-3399 Work Phone 730-7288

C. Contractor

Name: Dirtworks Plus Inc Company Name Pat Strohmyer

Address 6607 NW 48th St #1 City/State/Zip Lincoln NE 68524

❑ Check if contractor designed system Work Phone 890-6388

D. Engineer/Installer ❑ Check and complete if engineer designed system

Designer Name _____ Firm _____ Work Phone _____

E. This system will serve a

☒ Residential Dwelling Number of Bedrooms 3 Is there a Whirlpool Bathtub? ❑ Yes ☒ No

❑ Commercial Establishment/Other Facility Specify _____ Design flow in gallons per day _____

Type of Wastewater ❑ Domestic ❑ Non-Domestic Well Permit Applied for ❑ Yes ❑ No ❑ Not Applicable

DO NOT WRITE BELOW THIS LINE

Approval Process ❑ Municipal Code 24.38 ☒ County Resolution No. 02-30

1. Health Department
Site visits _____
Date rec'd 11/15/07
Date frwd _____
ACTION ☒ Approved ❑ Disapproved
Signature _____

2. Supt. Bldg. Insp. or Village Clerk
Comments Top of Dike must be built 1ft above flood plain
Date rec'd 11/26/07
Date frwd 11/26/07
ACTION ☒ Approved ❑ Disapproved
Signature as per Mike Peterson

3. City or County Engineer
Comments _____
Date rec'd 11-16-07
Date frwd 11-16-07
ACTION ☒ Approved ❑ Disapproved
Signature Jim Plauzek

Installation Final Written Approval
By _____
Date _____


Business Office Use Only
Date Received _____ Amount Paid _____
Received By _____ Cash/Check No. _____

White - Health Department Yellow - Engineer Pink - Building & Safety

Form A Updated: 5-07

11-26-2007 12:17:46

LLCHD HS000043

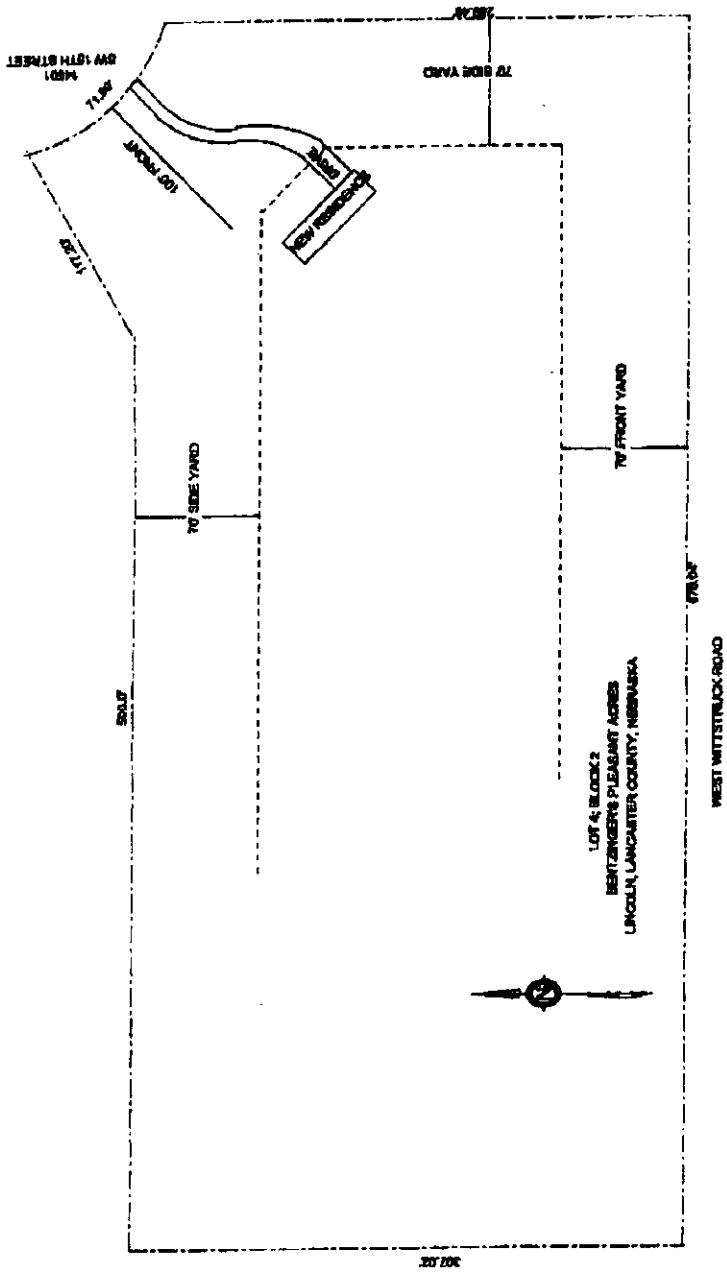

Lincoln-Lancaster County Health Department
Environmental Public Health Division (402) 441-8027
3140 N Street Lincoln, NE 68510-1514

ON-SITE WASTE WATER SYSTEM
CONSTRUCTION - INSTALLATION PERMIT

No. HS000043

System Type:	LAGOON
Situs:	14445 SW 15th
Legal Description:	T08N-R06E-S09-BENZIGER PLEASANT ACRES-
Owner:	JEAN SCALI 14445 SW 15 CIRCLE LINCOLN NE 68522

Permit Fee:	$305.00
Variance Fee:	$0.00
Extension Fee:	$0.00
Total Fees:	$305.00
Issued:	11/20/2007
Expires:	11/19/2008


Bruce D. Dart, PhD, Health Director

On-site Waste System Permit Holder:

The above document is your permit to construct a new On-site Waste Water System at the location listed. Please contact this office once the sytem is complete in order to schedule a final inspection before use.

Bruce D. Dart, PhD
Health Director

JEAN SCALI
14445 SW 15 CIRCLE
LINCOLN NE 68522

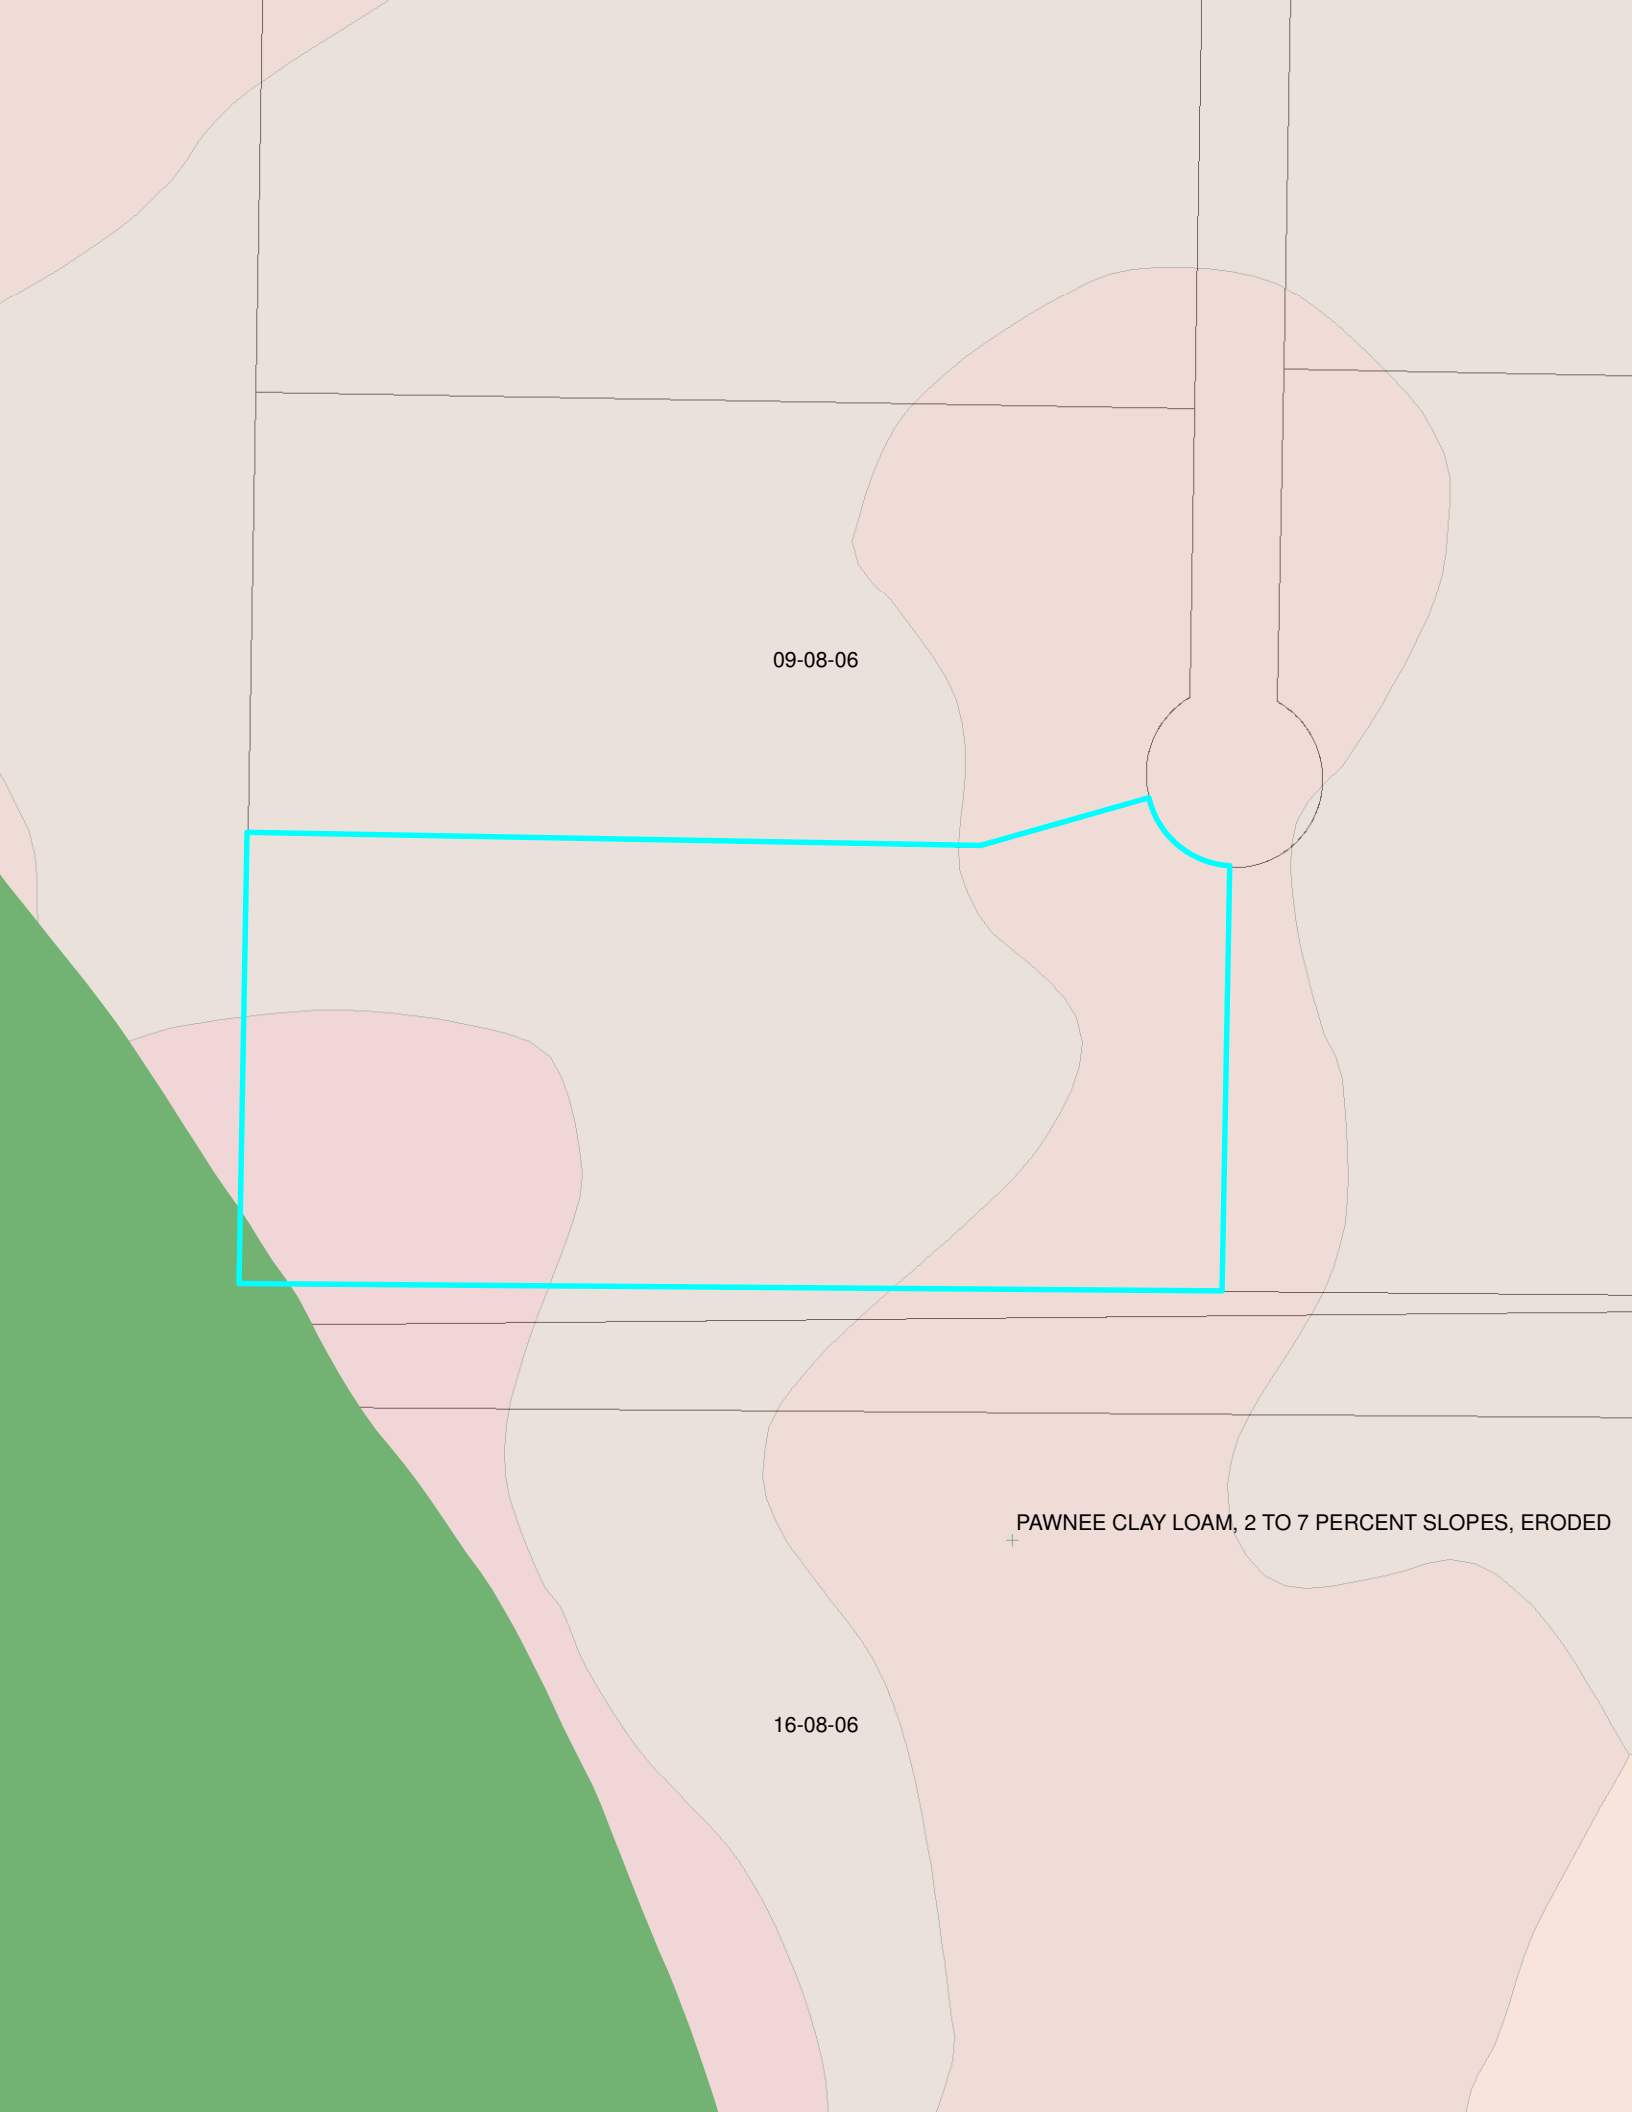
09-08-06
PAWNEE CLAY LOAM, 2 TO 7 PERCENT SLOPES, ERODED
16-08-06