Lincoln-Lancaster County Health Department
Environmental Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

B

Permit Number: HS000116

Sewage Disposal System

Soil Absorption Test Data Report

Annex to Application

PLEASE PRINT OR TYPE

System Location (Indicate correct number and street)

Address 6980 S. 148 (no rural route) City Walton NE, Zip 68461

Owner Larry Martinez Address 703 Anthony Ln Lincoln

Soil Type (SCS): WTC Percolation Rate: _____ min./inch

Date of Tests _____ to _____ Weather: Precipitation _____ Temperature _____

Percolation Test Data Table

A.	B.	C. D. E. F. Pre-Saturation Period				G. H. I. J. K. Percolation Readings					L. M. N. Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Water Lev (in.)	Date (Mo/Da)	Time (Hr/Min)	Elapsed Time (Min)	Water Level Drop (in)	Percolation Rates (Min/in)
1	30	4/29	3/30	4/30	12/00	4/30	2/45	26 3/4	4/30	3/15	30	5/8	48
2			P		noon		P	24 1/4		P		3/4	40
3								25 1/4				3/4	40
4								24 1/4				3/4	40
5								26 1/8				5/8	48
6								25 5/8				5/8	48

Sum of Percolation Rates: 26 4

Average of Rates: 44

Rate Used for Calculation: 50

Person Conducting Percolation Tests

Name: Brad Southwick

Phone: 430-7606

Address 105 Locust P.O. Box 191

Hickman, Ne 68372

DO NOT WRITE BELOW THIS LINE

Reviewing Action

Remarks _____

Signature of Reviewing Official _____ Date _____

FORM 23-101 10-96

Lincoln-Lancaster County Health Department
Environmental Public Health Division (402) 441-8027
3140 N Street Lincoln, NE 68510-1514

ON-SITE WASTE WATER SYSTEM
CONSTRUCTION - INSTALLATION PERMIT

No. HS000116

System Type: STANDARD

Situs: 6980 S 148TH ST LC

Legal Description: T09N-R08E-S15-Lot 14

Owner: MARTINEZ, PETE
703 ANTHINY LN
LINCOLN NE
68520

Permit Fee:	$305.00
Variance Fee:	$0.00
Extension Fee:	$0.00
Total Fees:	$305.00
Issued:	06/19/2008
Expires:	06/19/2009

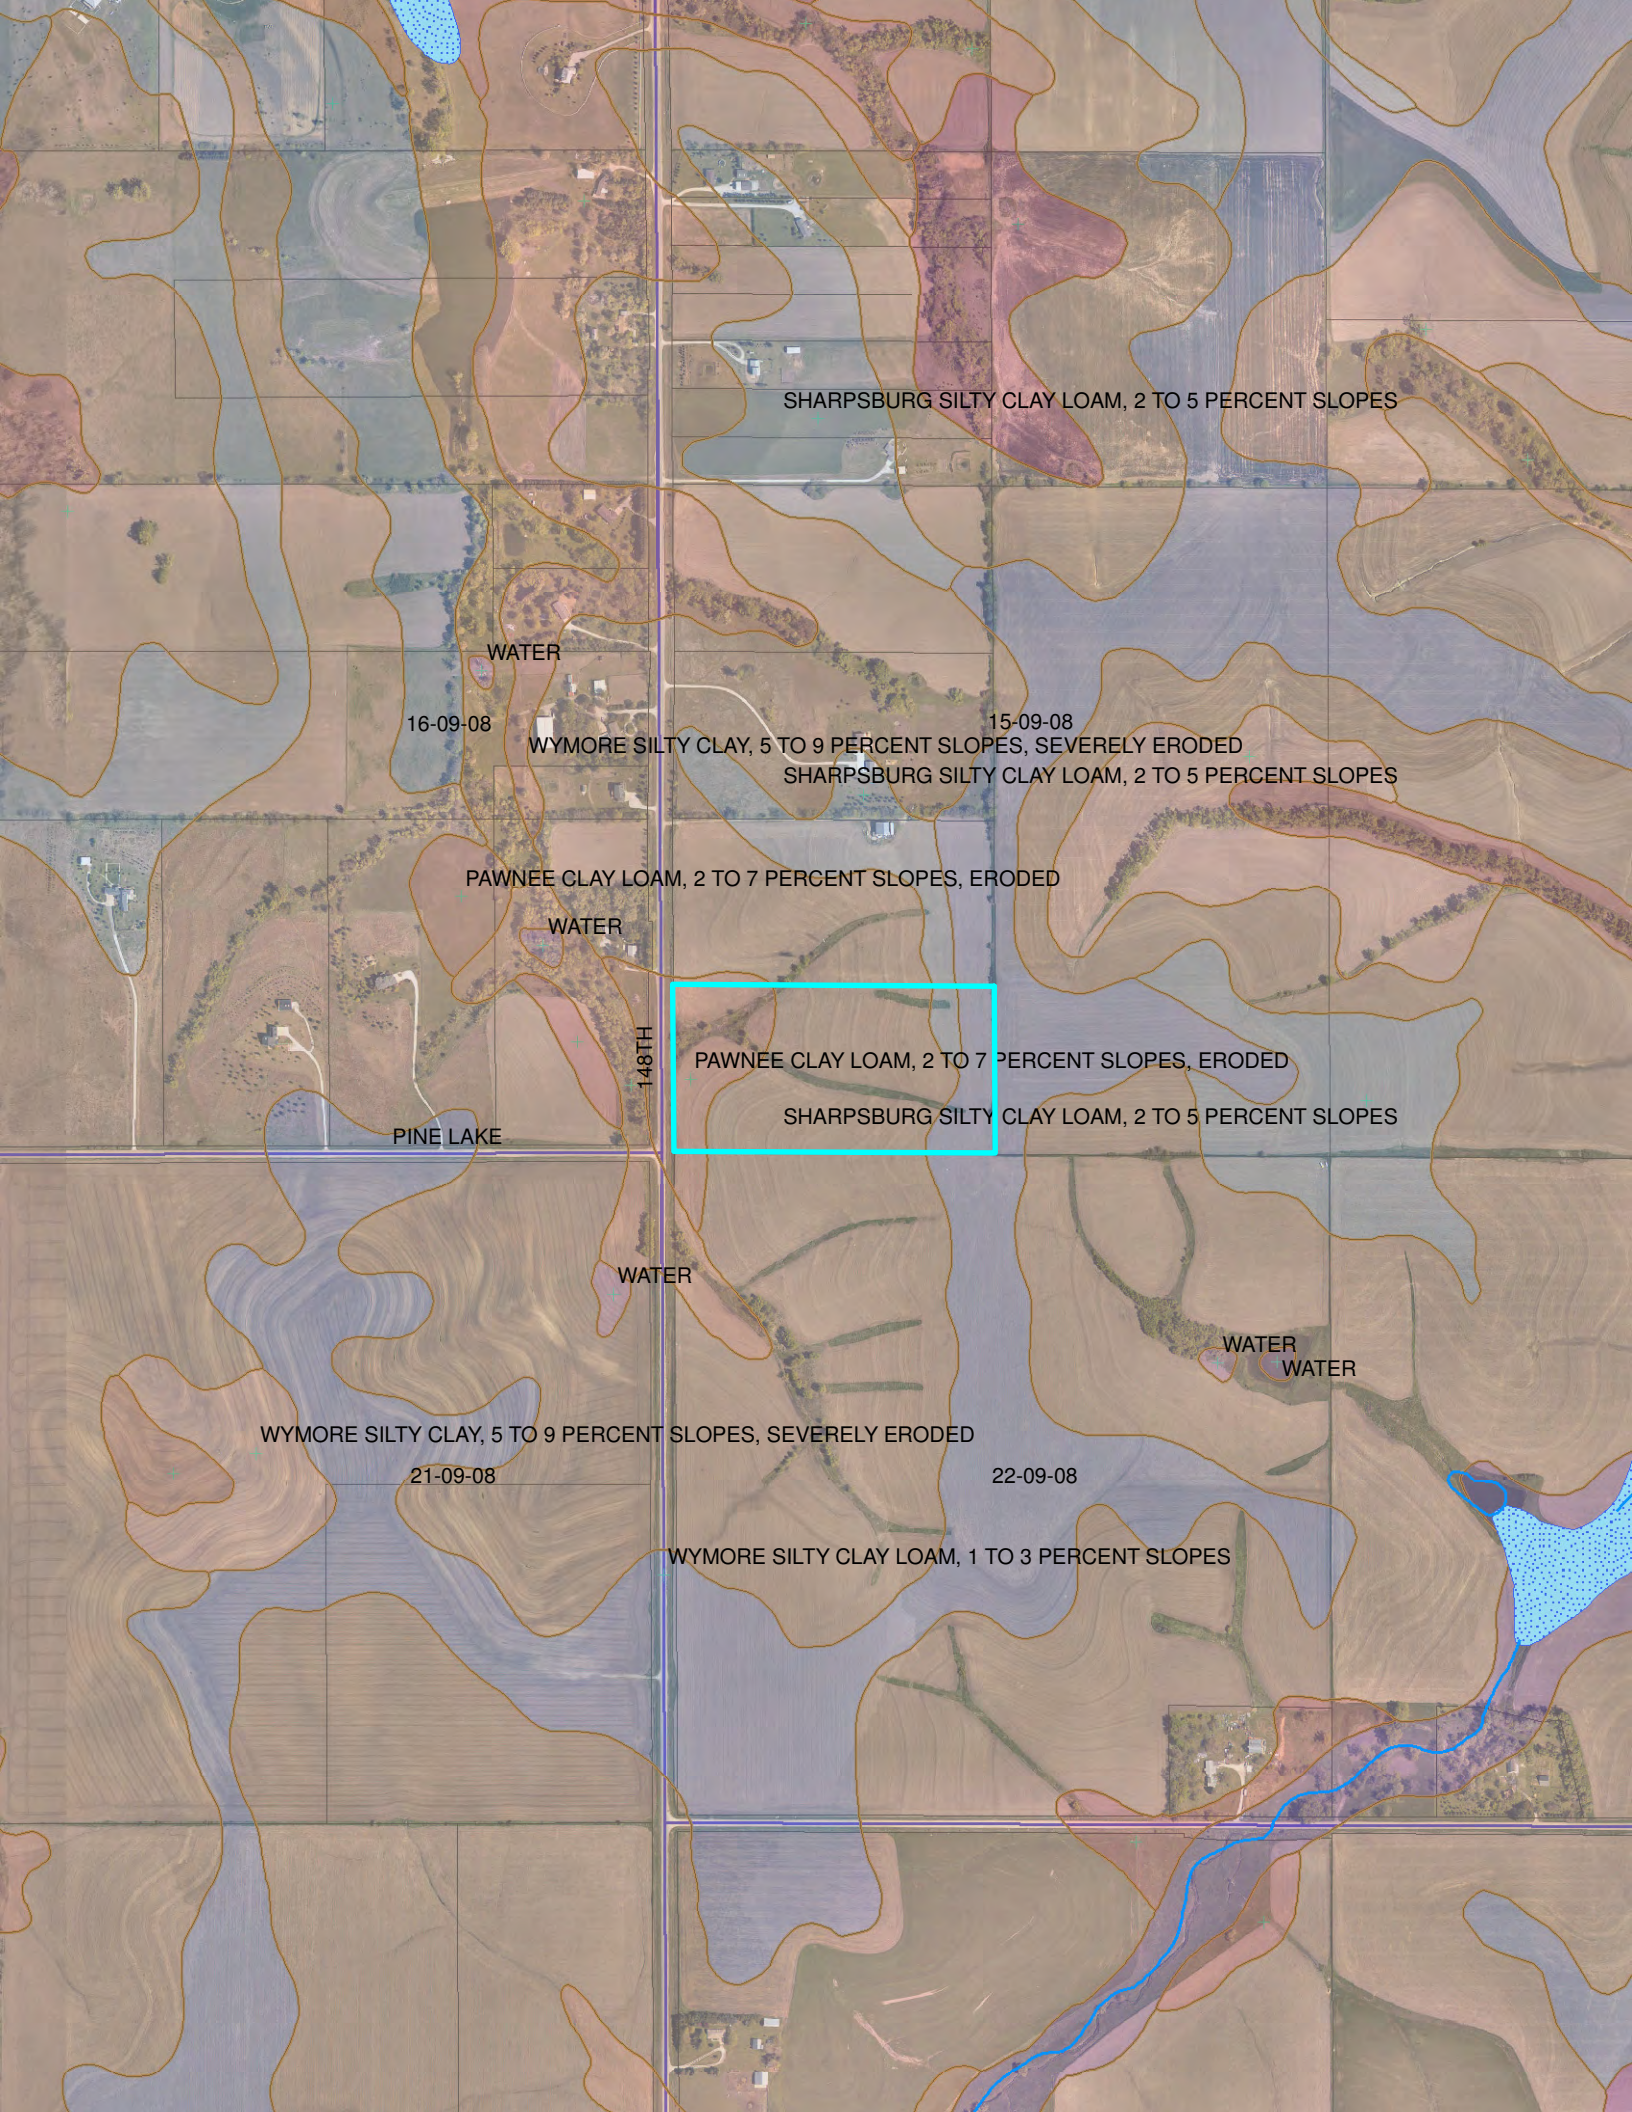
Bruce D. Dart, PhD, Health Director

On-site Waste System Permit Holder:

The above document is your permit to construct a new On-site Waste Water System at the location listed. Please contact this office once the sytem is complete in order to schedule a final inspection before use.

Bruce D. Dart, PhD
Health Director

SOUTHWICK SERVICES
PO BOX 191
HICKMAN NE 68372


SHARPSBURG SILTY CLAY LOAM, 2 TO 5 PERCENT SLOPES
WATER
16-09-08
15-09-08
WYMORE SILTY CLAY, 5 TO 9 PERCENT SLOPES, SEVERELY ERODED
SHARPSBURG SILTY CLAY LOAM, 2 TO 5 PERCENT SLOPES
PAWNEE CLAY LOAM, 2 TO 7 PERCENT SLOPES, ERODED
WATER
148TH
PAWNEE CLAY LOAM, 2 TO 7 PERCENT SLOPES, ERODED
SHARPSBURG SILTY CLAY LOAM, 2 TO 5 PERCENT SLOPES
PINE LAKE
WATER
WATER
WATER
WYMORE SILTY CLAY, 5 TO 9 PERCENT SLOPES, SEVERELY ERODED
21-09-08
22-09-08
WYMORE SILTY CLAY LOAM, 1 TO 3 PERCENT SLOPES