SCANNED

Application to Alter, Extend or Repair an Individual Sewage Disposal System

☐ Municipal Code 24.38 ☐ County Resolution Number 2832

HS000181

The undersigned hereby applies for a permit to: ☐ **ALTER** ☑ **EXTEND** ☐ **REPAIR** an existing Individual Sewage Disposal System, *in conformance* with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. **Legal description of property:**
   Township 12 Range 5 Section 23 1/4 Section SE
   Block ____ Lot ____ Addition ____
   Parcel ID 06 - 23 - 400 - 002 - 000 (i.e. 99-99-999-999-999)
   Street Address 18205 NW 70th St Raymond, NE 68428

2. **Property use:** ☒ residential ☐ commercial ☐ other use
   Number of bedrooms 3 Describe ____

3. **Type of Present Individual Disposal System** ☒ septic tank ☐ lagoon ☐ other

4. **Description of proposed alteration, extension or repair** Add. 130' of Lateral
   New D-Box

5. **Work to be done by:** ☐ owner ☒ contractor's name Lloyd J. Jakoubek
   Raymond Contracting

6. **Estimated project:**
   a. Repair, replace or minor extension with a cost less than $400 (no fee required).
   b. Total cost is greater than $400 (Return fee with this application)
   c. A "construction permit" is required if the use, operation, location, or type of the system is being change.

Print Name Robert Barry Address 18205 NW 70 Raymond Phone 783-2823
Applicant Signature (owner or lessee) Robert Barry

Please include the permit fee ($100) with this application
Fee must be included before the application will be processed. Incomplete information will delay processing

HEALTH DEPARTMENT USE ONLY

Date received 10/27/08 REVIEW: ☑ Approved ☐ Disapproved By: ____

Site visits
Date 10/27/08 By ____
Date ____/____/____ By ____
Date ____/____/____ By ____

Installation final written approval
Date 10/27/08 By ____

Return application to: Lincoln-Lancaster County Health Department - Environmental Health Division
3140 "N" Street, Lincoln, NE 68510
Phone: 441-8022

Business Office Use Only
Received: Date: 10/29/08 Amount 175.00 Check No. 6887 Initials ____

White - Division Copy Pink - Business Office Revised 9/00

LLCHD HS000181

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

D

Permit Number: HS000181

Onsite Wastewater Treatment System

As Built Plans & Specifications

Date 10/27/08 Legal Description 523 (1/4), T12 (1/4), R5 (Section Township Range) 6TH Principal Meridian E 1/2 SE.

Onsite System Location

Address (no rural route) 18205 NW 70TH. City Raymond NE, Zip 68428

Owner Robert Barry. Address 18205 NW 70TH.

A. Sewer Pipe old

1. Material: unknown
   Diameter: _____ in.
2. Distance above basement floor: _____ in.
   or distance below basement floor: _____ in.
3. Distance between dwelling and septic tank: _____ ft.
4. Number of clean-outs: _____
5. Distances to: well or suction line _____ ft.
   stream _____ ft.
   pressure line _____ ft.
   property line _____ ft.

B. Septic Tank old

☐ Label with Manufacturer, address and gallon capacity

1. Material: concrete
   Number of compartments: one
2. Capacity: 1000 gal.
3. Factory built: ☑ Yes ☐ No
4. Manholes: Over inlet, diameter middle at grade in.
   Over outlet, diameter _____ in.
   Riser: ☐ above ☐ below grade _____ in.
5. Inlet: ☑ baffle ☐ tee ☐ 6" dia. inspection pipe
6. Outlet: ☐ baffle ☐ tee ☐ 6" dia. inspection pipe
7. Depth to top of tank, below unfinished grade: 36" in.
8. Distances to: Well or suction line 100+ ft.
   Stream 100+ ft.
   Pressure line 90' ft.
   Property line 100+ ft.

C. ☐ Distribution Box ☒ Drop Boxes

(≥ 12" inspection opening) (removable lid to inspect)

1. Material: 3 Plastic
   Number available outlets: 3
2. Factory built: ☑ Yes ☐ No
3. Distance from septic tank: 34' ft.

D. Drainfield Absorption

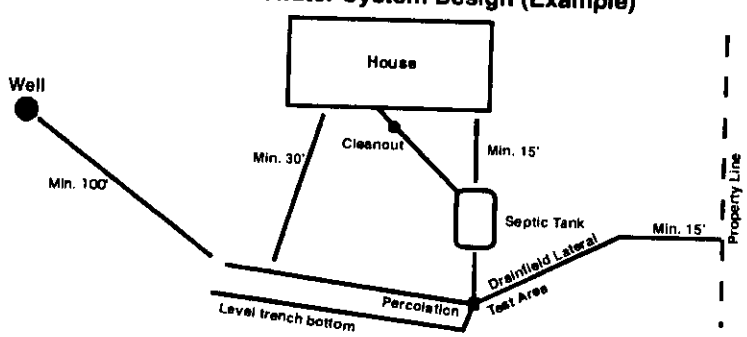
☑ Trench ☐ Bed ☐ Level Bottom

1. Type: ☐ Half rounds ☐ Perforated pipe ☐ Chambers
   Diameter or width: New 12" X 34" X 130'
   Number of distribution lines in bed 3
   Material: ☐ fiberglass ☑ plastic ☐ concrete
   ☐ other _____
2. Drainfield Laterals: Number 3
   Length of each line: old 100' ft. old 100' ft.
   New 130 ft. _____ ft., _____ ft.
3. Drainfield dimensions: Width 40" ft.
   Distribution Pipe Slope Flat in/100 ft.
   Average depth 30"-36" in
4. Filter material: Dirt
   Depth of material 30"-36" in.
5. Distances to: Well or suction line 100+ ft.
   Pressure line 100+ ft.
   Property line 15+ ft.
   House or building 15' ft.
   Lake or Stream 100+ ft.

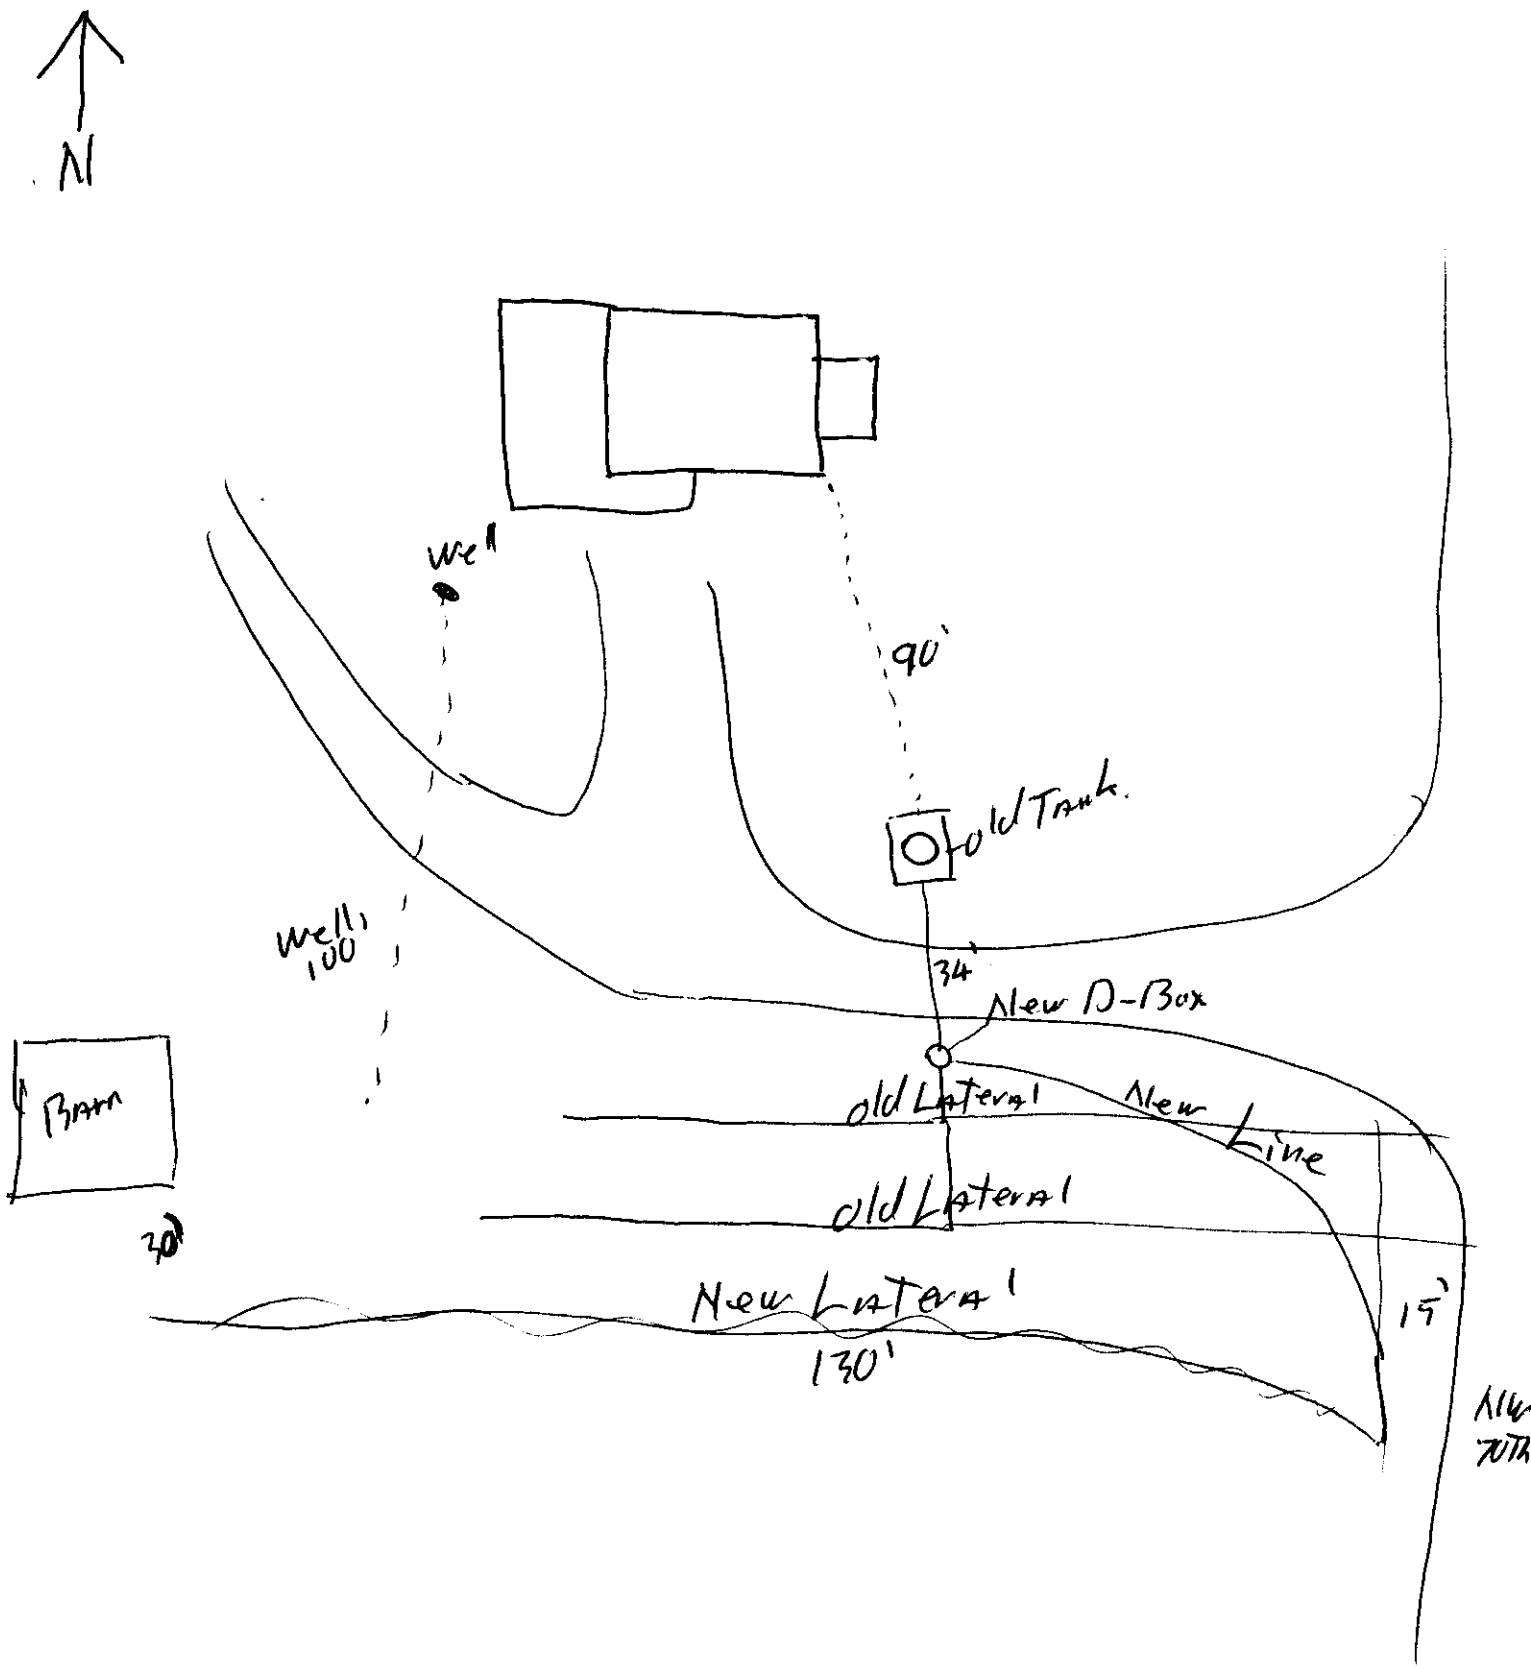
Complete As-Built drawing on the back fo this form.

Indicate North with Arrow

Onsite Wastewater System Design (Example)



10-29-2008 10: 8:55


N
well
90'
old Tank
well
100'
34'
New D-Box
Barn
old Lateral
New Line
old Lateral
20'
New Lateral
130'
15'

Application to Alter, Extend or Repair an Individual Sewage Disposal System

☐ Municipal Code 24.38 ☐ County Resolution Number 2832

HS000181

The undersigned hereby applies for a permit to: ☐ **ALTER** ☑ **EXTEND** ☐ **REPAIR** an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. **Legal description of property:**
   Township 12 Range 5 Section 23 1/4 Section SE
   Block ____ Lot ____ Addition ____
   Parcel ID 04-23-400-002-000 (i.e. 99-99-999-999-999)
   Street Address 18205 NW 70th St Raymond, NE 68428

2. **Property use:** ☒ residential ☐ commercial ☐ other use
   Number of bedrooms 3 Describe ____

3. **Type of Present Individual Disposal System** ☒ septic tank ☐ lagoon ☐ other

4. **Description of proposed alteration, extension or repair** Add. 130' of Lateral
   New D-Box

5. **Work to be done by:** ☐ owner ☒ contractor's name Lloyd J. Jakoubek
   Raymond Contractors

6. **Estimated project:**
   a. Repair, replace or minor extension with a cost less than $400 (no fee required).
   b. Total cost is greater than $400 (Return fee with this application)
   c. A "construction permit" is required if the use, operation, location, or type of the system is being change.

Print Name Robert Barry Address 18205 NW 70 Raymond Phone 783-2823
Applicant Signature (owner or lessee) Robert Barry

Please include the permit fee ($100) with this application
Fee must be included before the application will be processed. Incomplete information will delay processing

---

HEALTH DEPARTMENT USE ONLY

Date received 10/27/08 REVIEW: ☑ Approved ☐ Disapproved By: ____

Site visits
Date 10/27/08 By ____
Date ____/____/____ By ____
Date ____/____/____ By ____

Installation final written approval
Date 10/27/08 By ____

Return application to: Lincoln-Lancaster County Health Department - Environmental Health Division
3140 "N" Street, Lincoln, NE 68510
Phone: 441-8022

Business Office Use Only
Received: Date:____/____/____ Amount____ Check No. ____ Initials____

White - Division Copy Pink - Business Office Revised 9/00

Lincoln-Lancaster County Health Department
Environmental Public Health Division (402) 441-8027
3140 N Street Lincoln, NE 68510-1514

ON-SITE WASTE WATER SYSTEM
REPAIR PERMIT

System Type: STANDARD

No. HS000181

Situs: 18205 NW 70th

Permit Fee: $175.00

Legal Description: T12N-R05E-S23

Owner:

Total Fees: $175.00

Issued: 10/29/2008
Expires 10/29/2009

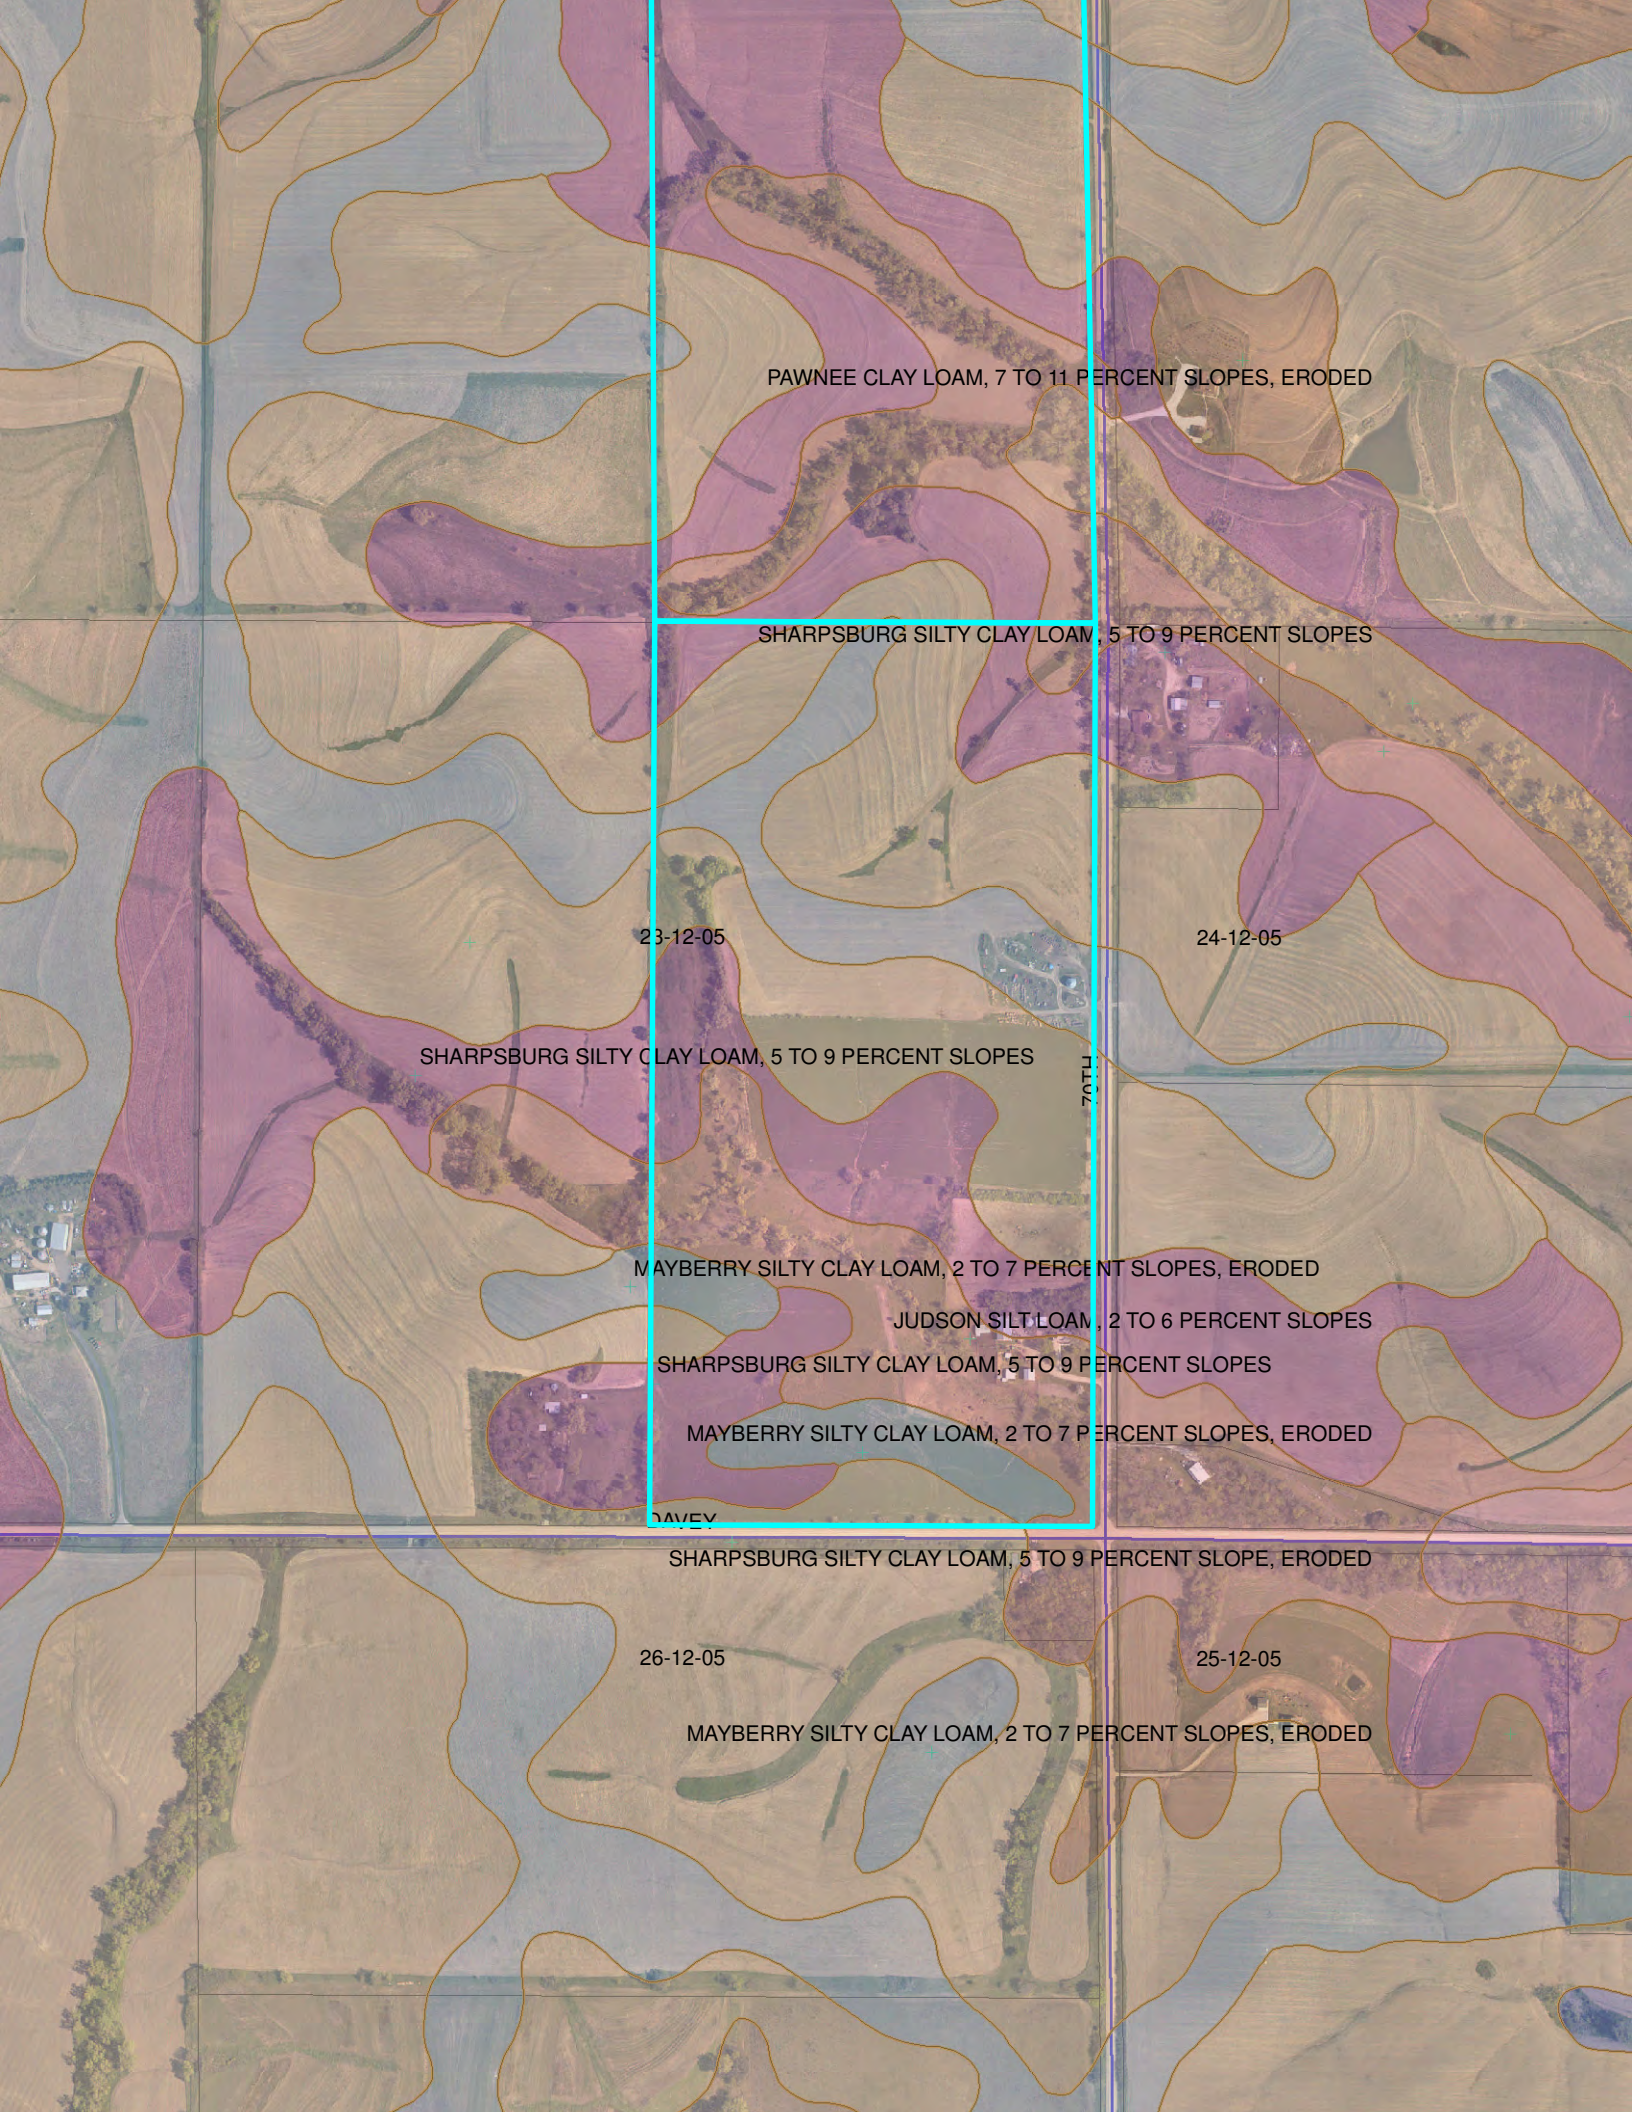
Bruce D. Dart, PhD, Health Director

Dear Applicant:

The above document is your permit to repair an existing On-site Waste Water System at the location listed. Please contact this office once repairs are complete to obtain final approval before use.

Bruce D. Dart, PhD
Health Director

RAYMOND CONTRACTING
13800 NW 70TH
RAYMOND NE 68428


PAWNEE CLAY LOAM, 7 TO 11 PERCENT SLOPES, ERODED
SHARPSBURG SILTY CLAY LOAM, 5 TO 9 PERCENT SLOPES
23-12-05
24-12-05
SHARPSBURG SILTY CLAY LOAM, 5 TO 9 PERCENT SLOPES
MAYBERRY SILTY CLAY LOAM, 2 TO 7 PERCENT SLOPES, ERODED
JUDSON SILT LOAM, 2 TO 6 PERCENT SLOPES
SHARPSBURG SILTY CLAY LOAM, 5 TO 9 PERCENT SLOPES
MAYBERRY SILTY CLAY LOAM, 2 TO 7 PERCENT SLOPES, ERODED
SHARPSBURG SILTY CLAY LOAM, 5 TO 9 PERCENT SLOPE, ERODED
26-12-05
25-12-05
MAYBERRY SILTY CLAY LOAM, 2 TO 7 PERCENT SLOPES, ERODED