LLCHD HS000250

JUL 13 2009

Application to Alter, Extend or Repair an Onsite Wastewater Treatment System

SCANNED

☐ Municipal Code 24.38 ☐ County Resolution Number 02-30

HS000250

The undersigned hereby applies for a permit to: ☐ **ALTER** ☑ **EXTEND** ☐ **REPAIR** an existing wastewater treatment system, complying with appropriate Ordinance or Resolution, as marked above with drawings attached.

1. **Legal description of property:**
   Township 10 Range 6e 1/4 ____ 1/4 NW Section 31
   Block 2 Lot 3 Addition High Ridge West Acres 2nd Add
   Parcel ID 10-31-102-607-000 (i.e. 99-99-999-999-999)
   Street Address (no rural route) 5111 W Sumner Cir Lincoln, NE 68522

2. **Property use:** ☑ residential ☐ commercial ☐ other use
   Number of bedrooms 3 Describe ____

3. **Type of Present Individual Disposal System** ☑ septic system ☐ lagoon ☐ other

4. **Description of proposed alteration, extension or repair** replace laterals (300' of new - Infiltrator chambers) and new drop box

5. **Work to be done by:** ☐ owner ☑ contractor's name Lloyd Jakubek, Raymond Contracting, Inc

6. **Estimated project:** a. Repair, replace, or minor extension with a cost less than $400 (no fee required).
   b. Total cost is greater than $400 (Return fee with this application)
   c. A permit is required if the use, operation, location, or type of system is changed.

Print Name Rebecca Burt Address 5111 W Sumner Cir Lincoln, NE 68522 Phone: 402-477-2299
mike Wilson [redacted] Rebecca Burt

Please include the permit fee (~~$160~~ 175) with this application
Fee must be included before the application will be processed. Incomplete information will delay processing.

HEALTH DEPARTMENT USE ONLY

Date received 7/6/09 REVIEW: ☑ Approved ☐ Disapproved By: [signature]

Site visits
Date 7/9/09 By DS
Date ____/____/____ By ____
Date ____/____/____ By ____

Installation final written approval
Date 7/14/09 By Dave Shaw

Return application to:
Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 "N" Street, Lincoln, NE 68510
Phone: 441-8022

Business Office Use Only

Received: Date: 7/17/09 Amount 175.00 Check No. 7121 Initials AKV

White - Division Copy Pink - Business Office Revised 9-06

7-20-2009 10: 0:55

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

D

Permit Number: HS000250

Onsite Wastewater Treatment System

As Built Plans & Specifications

Date 7-10-09 Legal Description NW 1/4 NW 1/4 31 10 6 Section Township Range High Ridge West 2nd Add Acres Block 2, Lot 3

Onsite System Location

Address (no rural route) 5111 W Sumner Cir City Lincoln NE, Zip 68522

Owner & Rebecca Burt Address Same

A. Sewer Pipe

1. Material: Old Line
   Diameter: _____ in.
2. Distance above basement floor: _____ in.
   or distance below basement floor: _____ in.
3. Distance between dwelling and septic tank: _____ ft.
4. Number of clean-outs: _____
5. Distances to: well or suction line _____ ft.
   stream _____ ft.
   pressure line _____ ft.
   property line _____ ft.

B. Septic Tank

Old Tank

☐ Label with Manufacturer, address and gallon capacity

1. Material: _____
   Number of compartments: _____
2. Capacity: _____ gal.
3. Factory built: ☐ Yes ☐ No
4. Manholes: Over inlet, diameter _____ in.
   Over outlet, diameter _____ in.
   Riser: ☐ above ☐ below grade _____ in.
5. Inlet: ☐ baffle ☐ tee ☐ 6" dia. inspection pipe
6. Outlet: ☐ baffle ☐ tee ☐ 6" dia. inspection pipe
7. Depth to top of tank, below unfinished grade: _____ in.
8. Distances to: Well or suction line _____ ft.
   Stream _____ ft.
   Pressure line _____ ft.
   Property line _____ ft.

C. ☐ Distribution Box ☐ Drop Boxes

(≥ 12" inspection opening) (removable lid to inspect)

1. Material: Plastic
   Number available outlets: 4
2. Factory built: ☑ Yes ☐ No
3. Distance from septic tank: 3' ft.

D. Drainfield Absorption

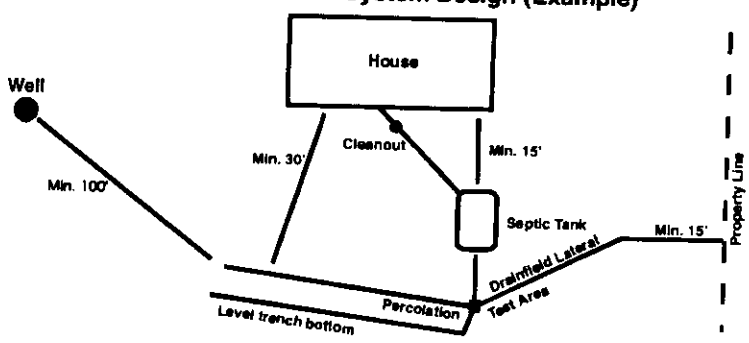
☑ Trench ☐ Bed ☐ Level Bottom

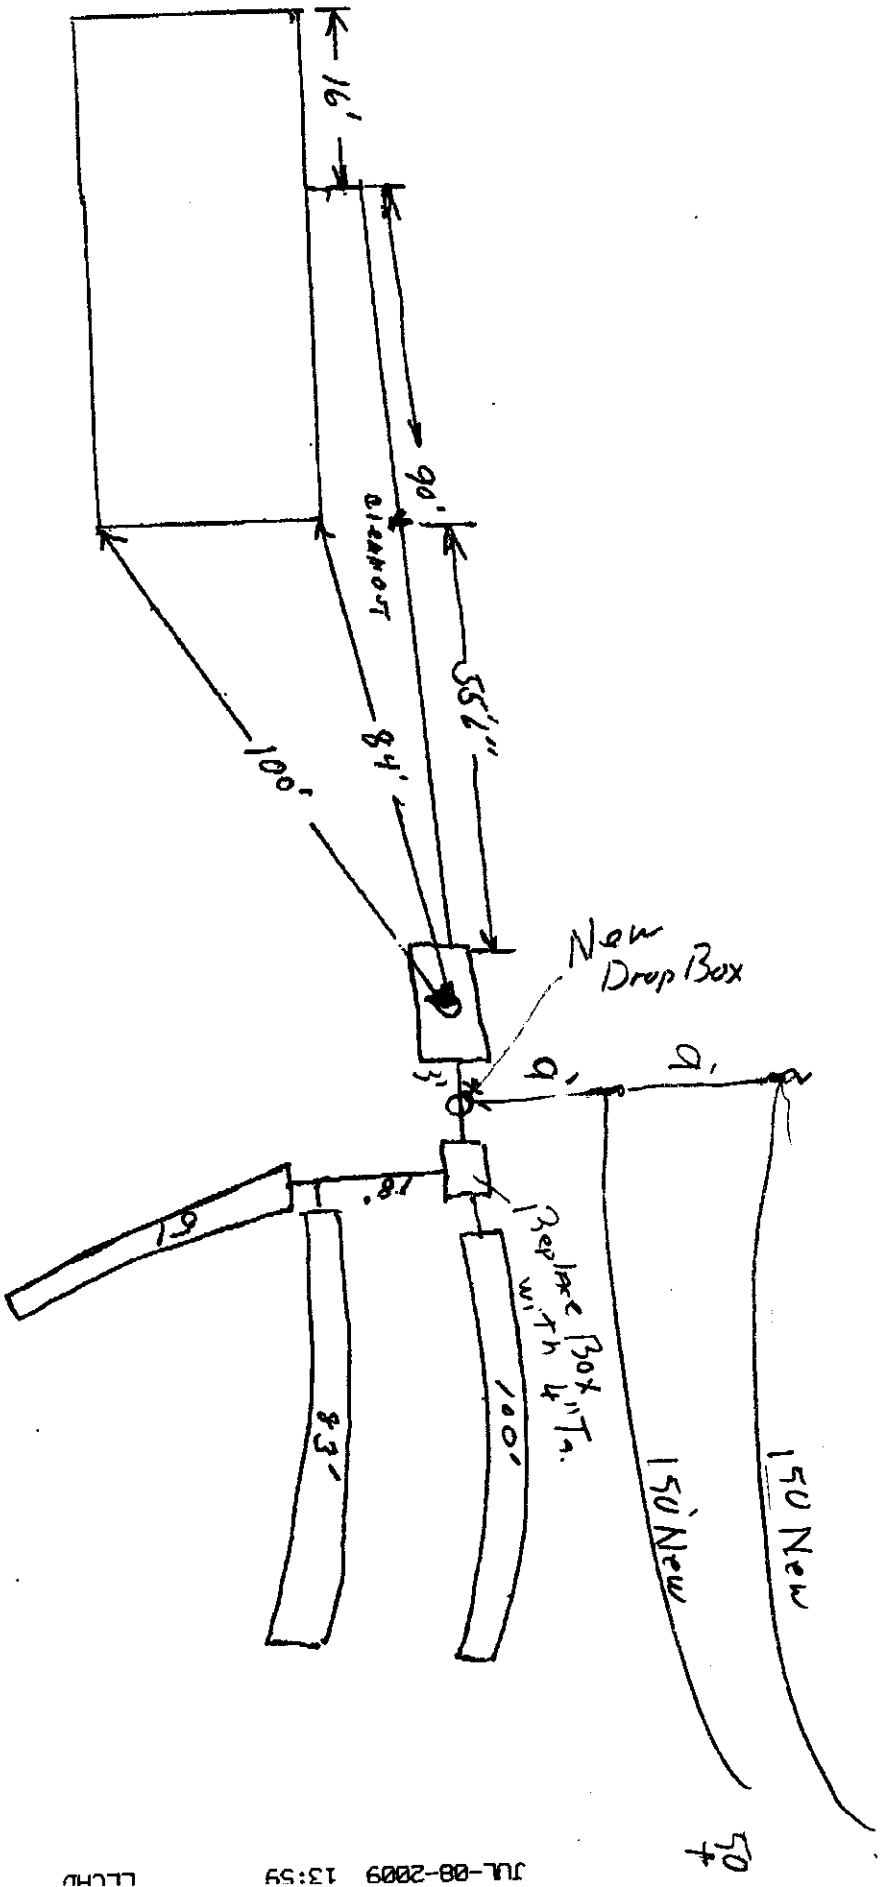
1. Type: ☐ Half rounds ☐ Perforated pipe ☐ Chambers
   Diameter or width: _____
   Number of distribution lines in bed _____
   Material: ☑ fiberglass ☑ plastic ☐ concrete
   ☐ other _____
2. Drainfield Laterals: Number _____
   Length of each line: 150' New ft. 150' New ft.
   100 ft. 83 ft., 61 ft.
3. Drainfield dimensions: Width 40' ft.
   Distribution Pipe Slope Flat in/100 ft.
   Average depth _____ in
4. Filter material: Dirt
   Depth of material _____ in.
5. Distances to: Well or suction line 100+ ft.
   Pressure line 100+ ft.
   Property line 50+ ft.
   House or building 100+ ft.
   Lake or Stream 100+ ft.

Complete As-Built drawing on the back fo this form.

Indicate North with Arrow

Onsite Wastewater System Design (Example)




16'
90'
55'2"
84'
100'
New Drop Box
3'
9'
9'
.8'
19
Replace Box with 4" Ta.
83'
100'
150' New
150' New
50+
100+
7/10/09
N

LLCHD HS000250

JUL 13 2009

Application to Alter, Extend or Repair an Onsite Wastewater Treatment System

❒ Municipal Code 24.38 ❒ County Resolution Number 02-30

HS000250

The undersigned hereby applies for a permit to: ❒ **ALTER** ☑ **EXTEND** ❒ **REPAIR** an existing wastewater treatment system, complying with appropriate Ordinance or Resolution, as marked above with drawings attached.

1. **Legal description of property:**
   Township 10 Range 6e 1/4 ____ 1/4 NW Section 31
   Block 2 Lot 3 Addition High Ridge West Acres 2nd Add
   Parcel ID 10-31-102-607-000 (i.e. 99-99-999-999-999)
   Street Address (no rural route) 5111 W Sumner Cir Lincoln, NE 68522

2. **Property use:** ☑ residential ❒ commercial ❒ other use
   Number of bedrooms 3 Describe ____

3. **Type of Present Individual Disposal System** ☑ septic system ❒ lagoon ❒ other

4. **Description of proposed alteration, extension or repair** replace laterals (300' of new - Gravelless chambers) and new drop box

5. **Work to be done by:** ❒ owner ☑ contractor's name Lloyd Jakubek, Raymond Contracting, Inc

6. **Estimated project:** a. Repair, replace, or minor extension with a cost less than $400 (no fee required).
   b. Total cost is greater than $400 (Return fee with this application)
   c. A permit is required if the use, operation, location, or type of system is changed.

Print Name Rebecca Burt Address 5111 W Sumner Cir Lincoln. NE 68522 Phone: 402-477-2299

[redacted] Mike Wilson Rebecca Burt

Please include the permit fee ~~($160)~~ 175 with this application

Fee must be included before the application will be processed. Incomplete information will delay processing.

HEALTH DEPARTMENT USE ONLY

Date received 7/6/09 REVIEW: ☑ Approved ❒ Disapproved By: [signature]

Site visits
Date 7/9/09 By DS.
Date ____/____/____ By ____
Date ____/____/____ By ____

Installation final written approval
Date 7/14/09 By [signature]

Return application to:
Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 "N" Street, Lincoln, NE 68510
Phone: 441-8022

Business Office Use Only

Received: Date: ____/____/____ Amount ____ Check No. ____ Initials ____

White - Division Copy Pink - Business Office Revised 9-06

7-17-2009 9:13:42

Lincoln-Lancaster County Health Department
Environmental Public Health Division (402) 441-8027
3140 N Street Lincoln, NE 68510-1514

ON-SITE WASTE WATER SYSTEM
REPAIR PERMIT

No. HS000250

System Type: STANDARD

Situs: 5111 W SUMNER CIR

Legal Description: T-R

Owner: BURT, REBECCA ET AL
5111 W SUMNER CIR
LINCOLN NE
68522

Permit Fee:	$175.00
Total Fees:	$175.00
Issued:	07/17/2009
Expires	07/17/2010

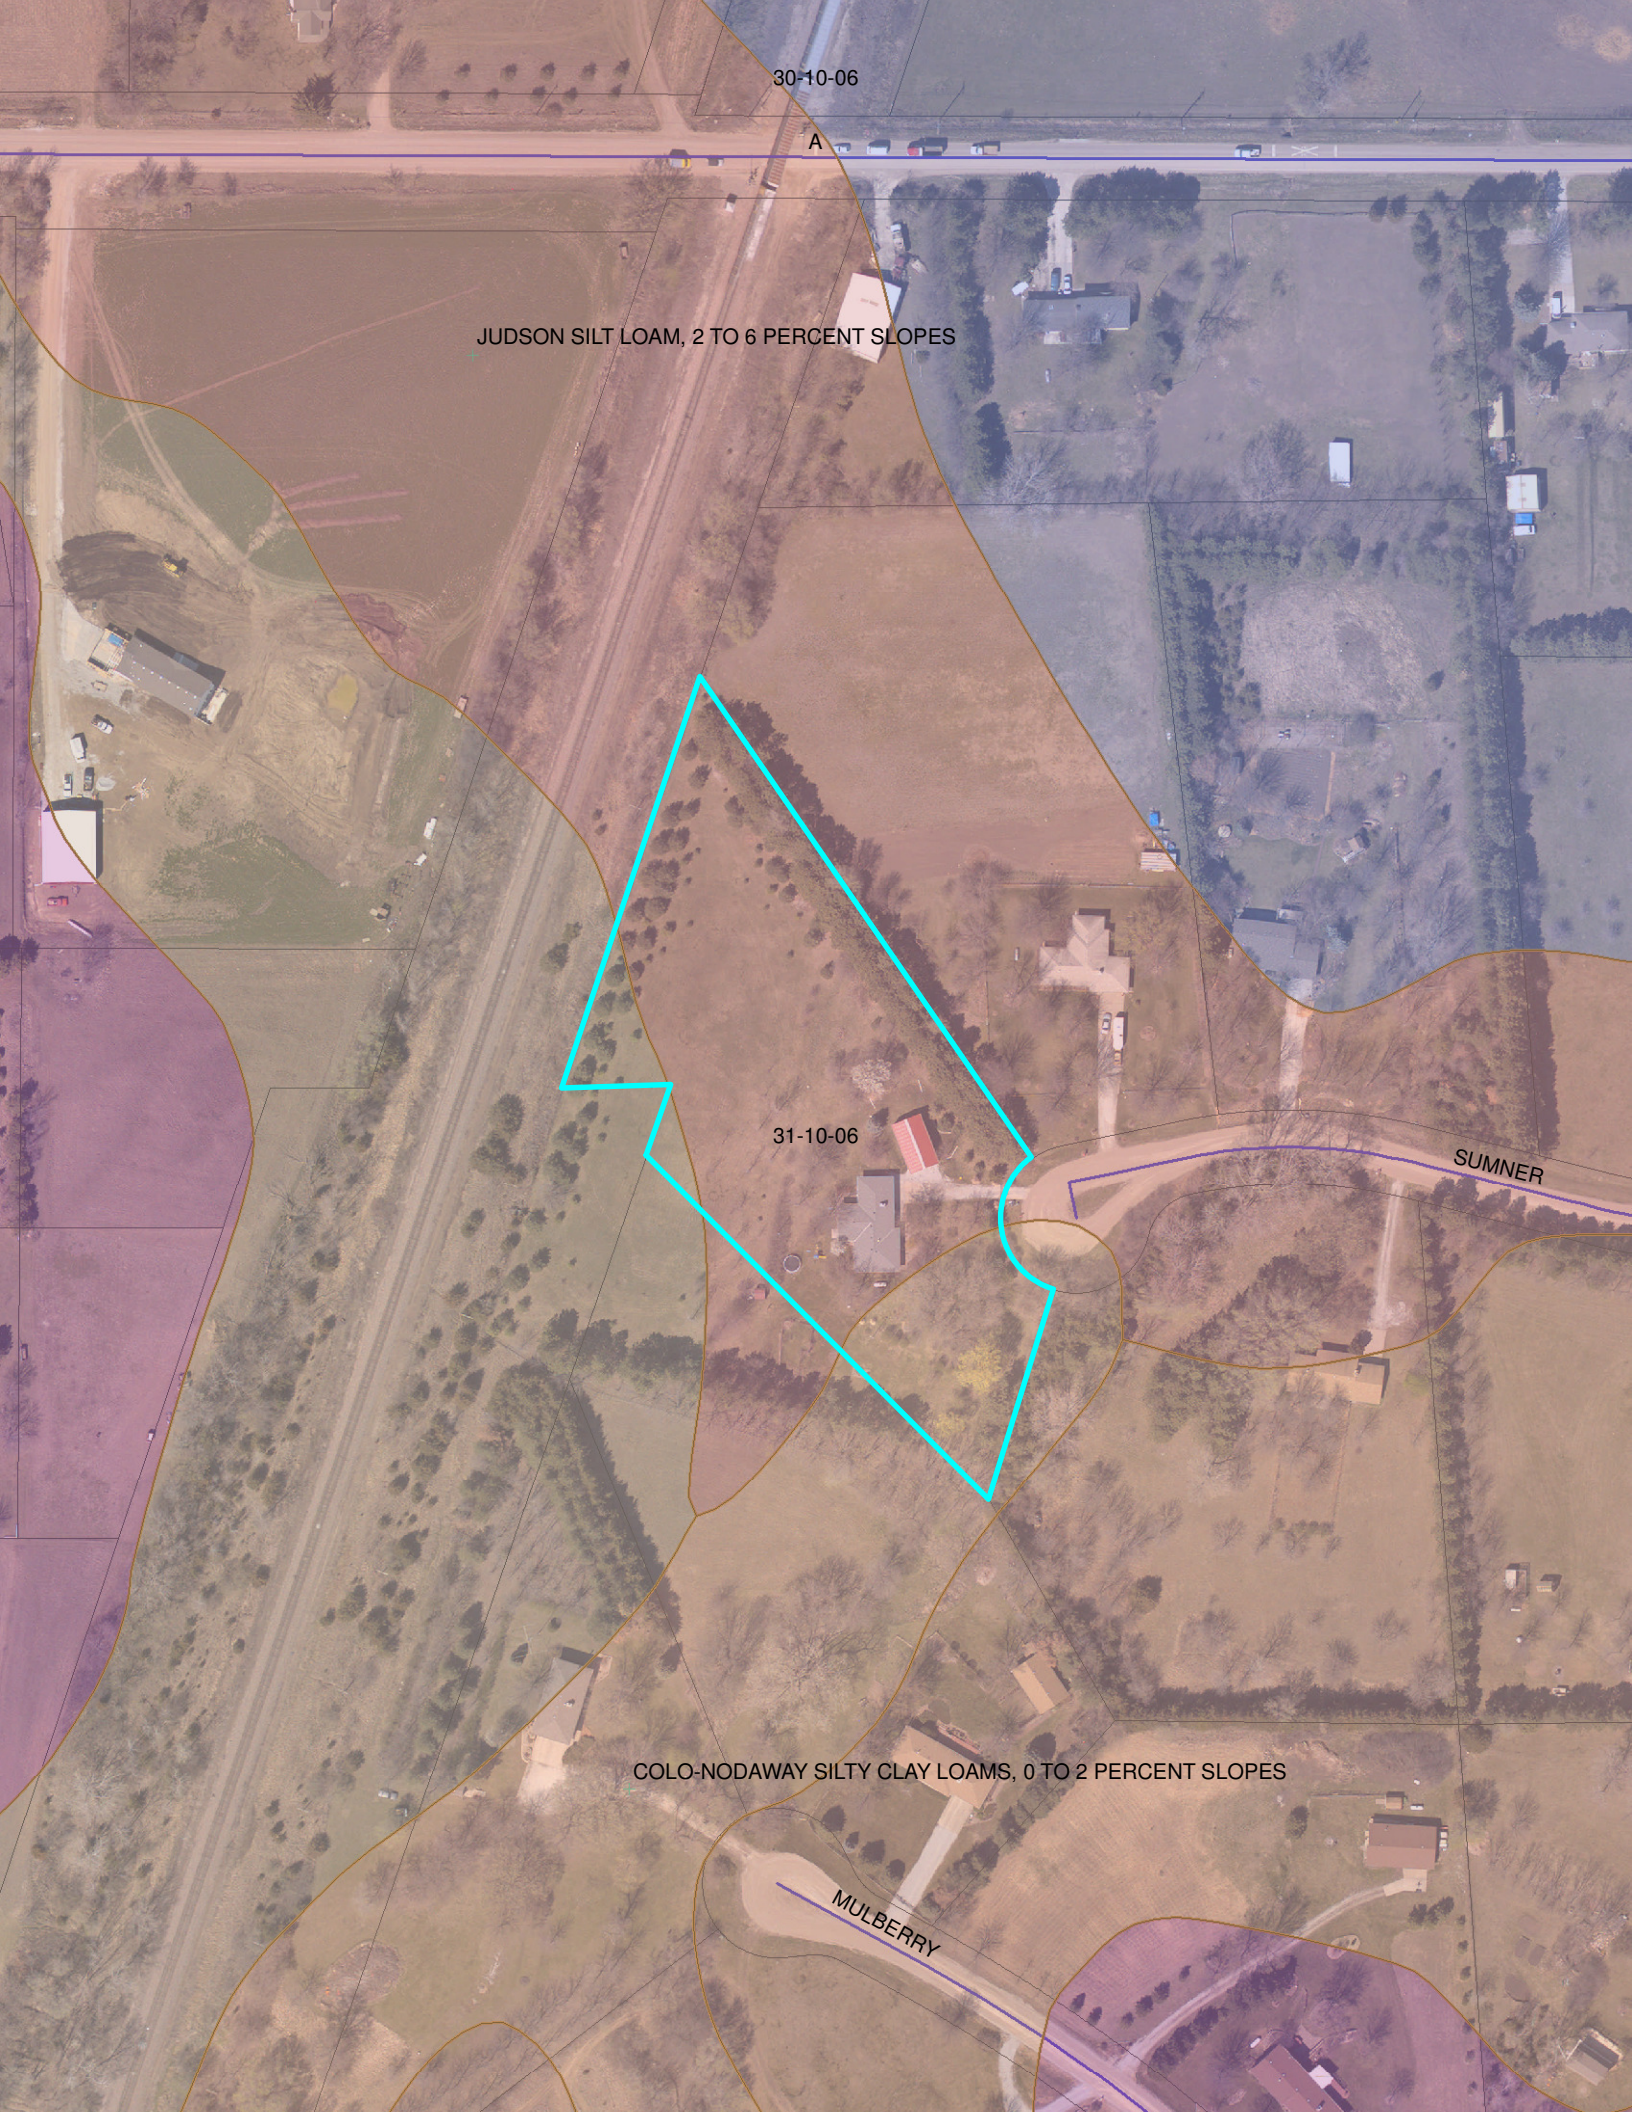
Bruce D. Dart, PhD, Health Director

Dear Applicant:

The above document is your permit to repair an existing On-site Waste Water System at the location listed. Please contact this office once repairs are complete to obtain final approval before use.

Bruce D. Dart, PhD
Health Director

RAYMOND CONTRACTING
13800 NW 70TH
RAYMOND NE 68428


30-10-06
A
JUDSON SILT LOAM, 2 TO 6 PERCENT SLOPES
31-10-06
SUMNER
COLO-NODAWAY SILTY CLAY LOAMS, 0 TO 2 PERCENT SLOPES
MULBERRY