Lincoln-Lancaster County Health Department
Environmental Public Health Division (402) 441-8027
3140 N Street Lincoln, NE 68510-1514

ON-SITE WASTE WATER SYSTEM
REPAIR PERMIT

No. HS000307

System Type: STANDARD

Situs: 12908 W PIONEERS BLVD

Legal Description: T09N-R05E-S06-Lot 12

Owner: PORK 21 INC
25500 S 82 ST
FIRTH NE
68358

Permit Fee:	$180.00
Total Fees:	$180.00
Issued:	11/13/2009
Expires	11/13/2010


Bruce D. Dart, PhD, Health Director

Dear Applicant:

The above document is your permit to repair an existing On-site Waste Water System at the location listed. Please contact this office once repairs are complete to obtain final approval before use.

Bruce D. Dart, PhD
Health Director

SOUTHWICK SEWER
PO BOX 191
HICKMAN NE 68372

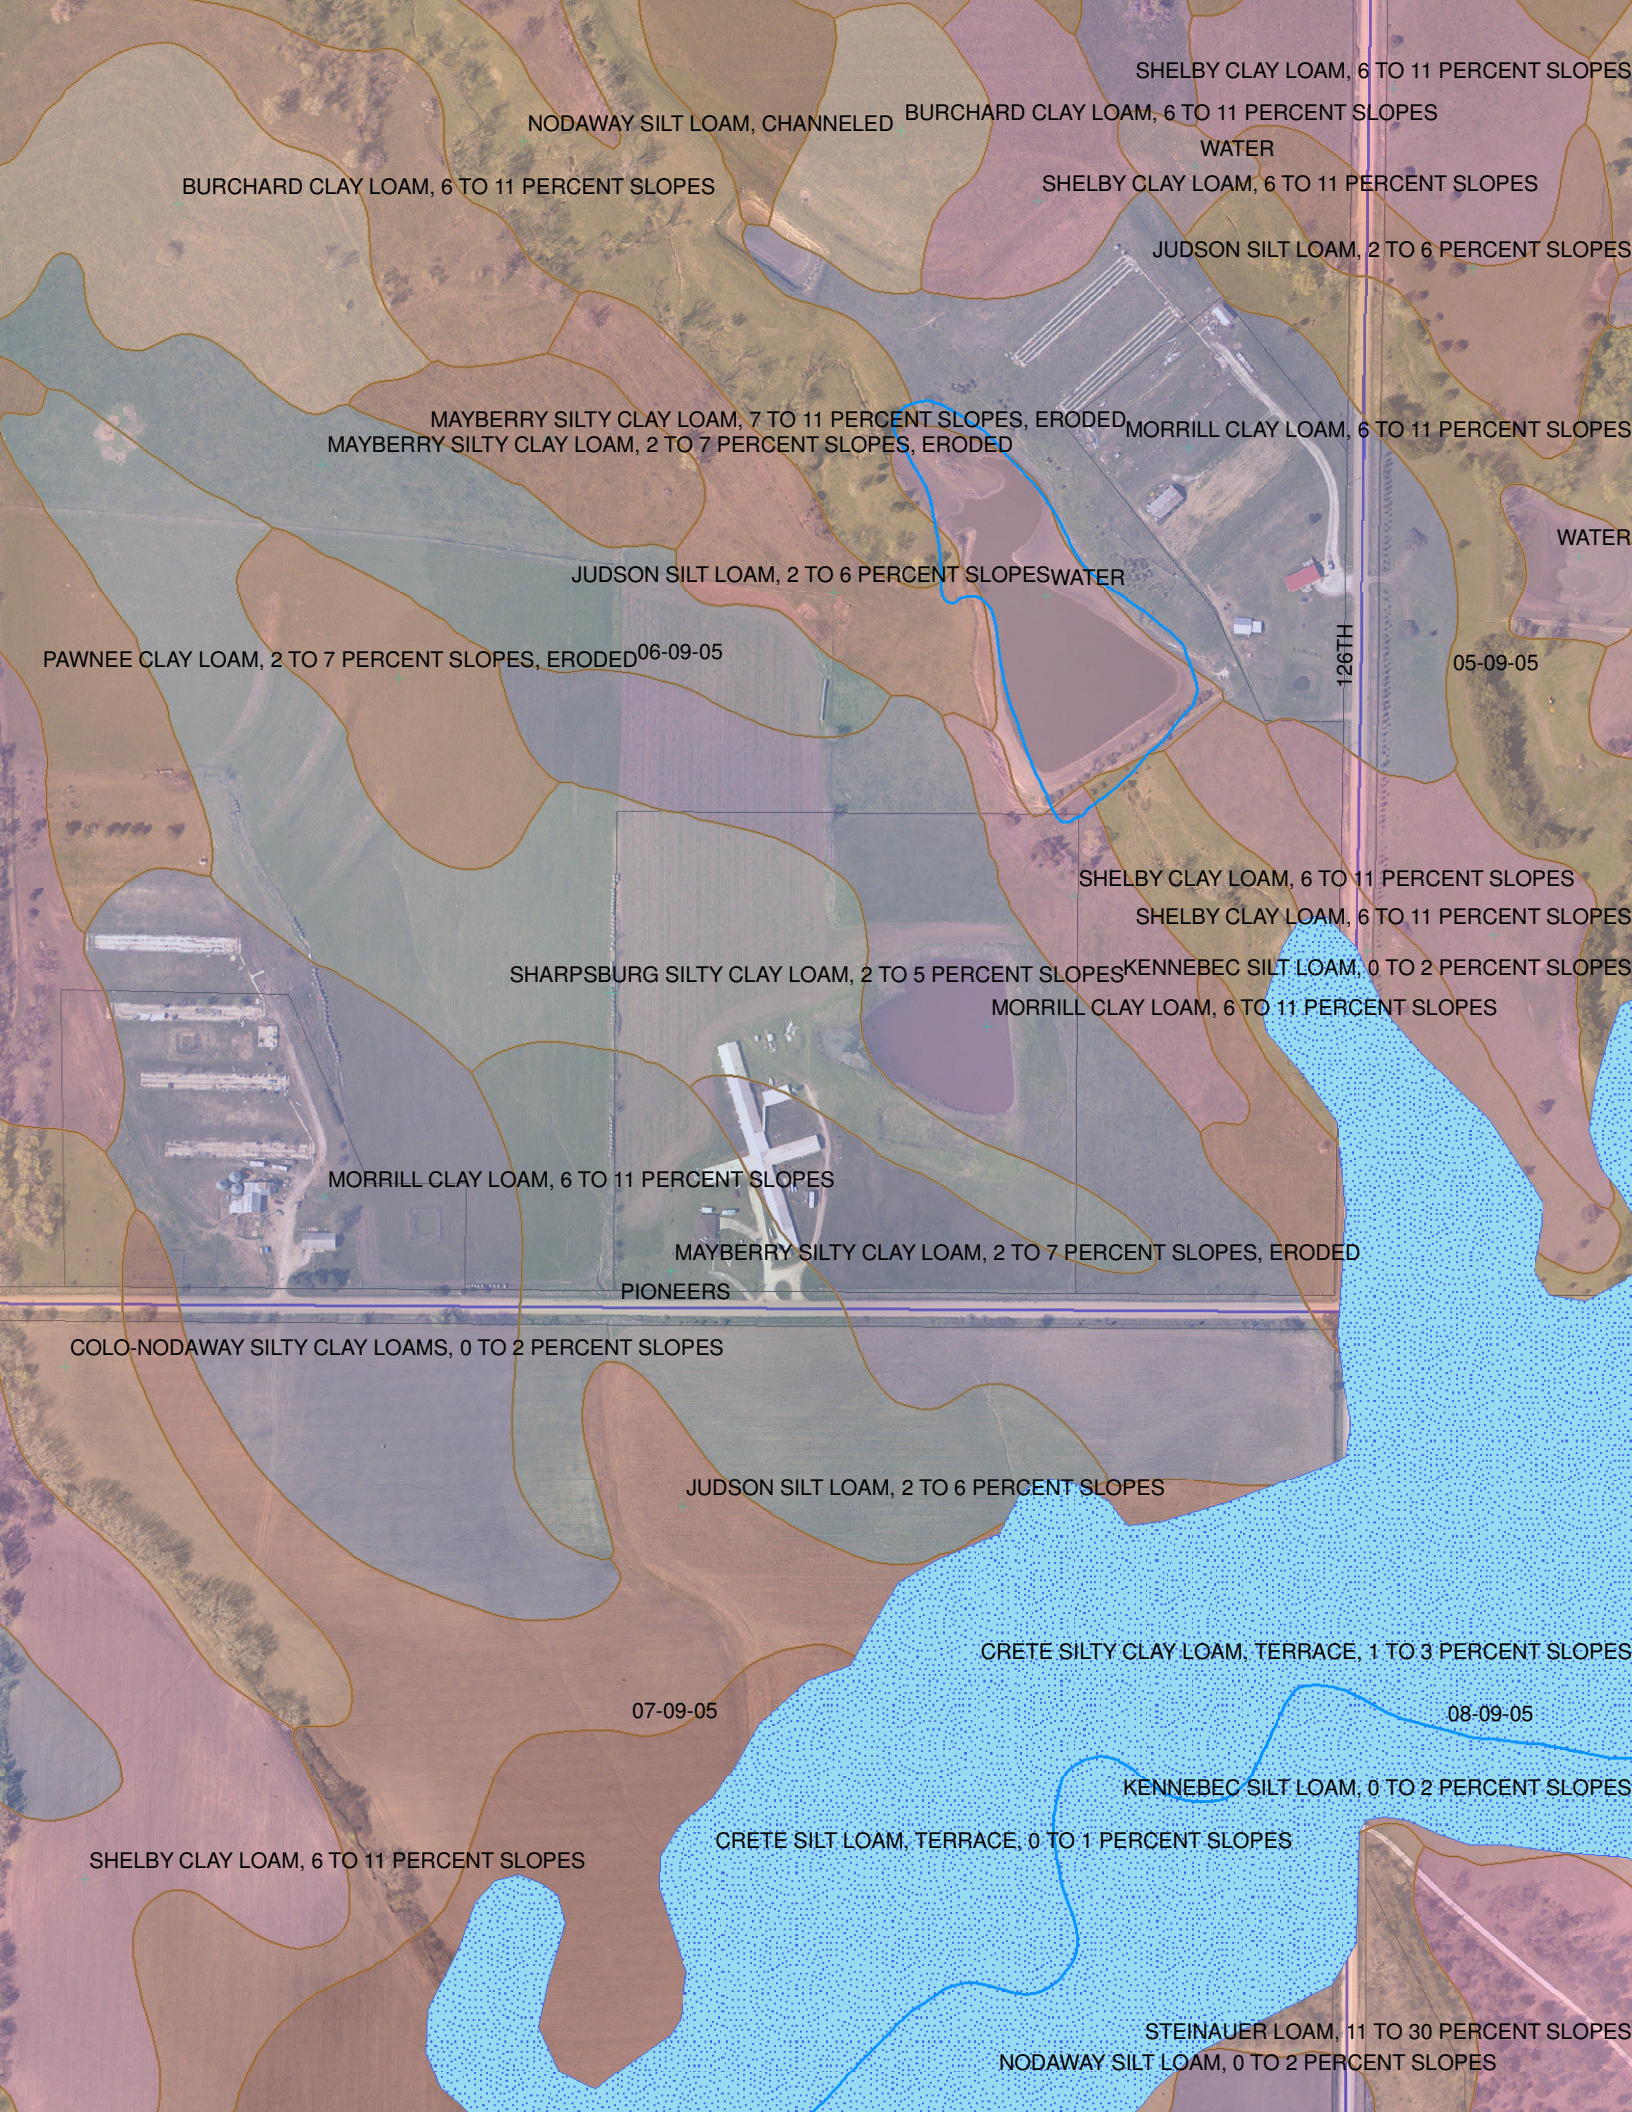
SHELBY CLAY LOAM, 6 TO 11 PERCENT SLOPES
NODAWAY SILT LOAM, CHANNELED
BURCHARD CLAY LOAM, 6 TO 11 PERCENT SLOPES
WATER
BURCHARD CLAY LOAM, 6 TO 11 PERCENT SLOPES
SHELBY CLAY LOAM, 6 TO 11 PERCENT SLOPES
JUDSON SILT LOAM, 2 TO 6 PERCENT SLOPES
MAYBERRY SILTY CLAY LOAM, 7 TO 11 PERCENT SLOPES, ERODED
MAYBERRY SILTY CLAY LOAM, 2 TO 7 PERCENT SLOPES, ERODED
MORRILL CLAY LOAM, 6 TO 11 PERCENT SLOPES
WATER
JUDSON SILT LOAM, 2 TO 6 PERCENT SLOPES
WATER
PAWNEE CLAY LOAM, 2 TO 7 PERCENT SLOPES, ERODED
06-09-05
126TH
05-09-05
SHELBY CLAY LOAM, 6 TO 11 PERCENT SLOPES
SHELBY CLAY LOAM, 6 TO 11 PERCENT SLOPES
SHARPSBURG SILTY CLAY LOAM, 2 TO 5 PERCENT SLOPES
KENNEBEC SILT LOAM, 0 TO 2 PERCENT SLOPES
MORRILL CLAY LOAM, 6 TO 11 PERCENT SLOPES
MORRILL CLAY LOAM, 6 TO 11 PERCENT SLOPES
MAYBERRY SILTY CLAY LOAM, 2 TO 7 PERCENT SLOPES, ERODED
PIONEERS
COLO-NODAWAY SILTY CLAY LOAMS, 0 TO 2 PERCENT SLOPES
JUDSON SILT LOAM, 2 TO 6 PERCENT SLOPES
CRETE SILTY CLAY LOAM, TERRACE, 1 TO 3 PERCENT SLOPES
07-09-05
08-09-05
KENNEBEC SILT LOAM, 0 TO 2 PERCENT SLOPES
CRETE SILT LOAM, TERRACE, 0 TO 1 PERCENT SLOPES
SHELBY CLAY LOAM, 6 TO 11 PERCENT SLOPES
STEINAUER LOAM, 11 TO 30 PERCENT SLOPES
NODAWAY SILT LOAM, 0 TO 2 PERCENT SLOPES

NOV 09 2009

Application to Alter, Extend or Repair an Onsite Wastewater Treatment System

SCANNED

❒ Municipal Code 24.38 ❒ County Resolution Number 02-30

H5000307

The undersigned hereby applies for a permit to: ❒ **ALTER** ☒ **EXTEND** ❒ **REPAIR** an existing wastewater treatment system, complying with appropriate Ordinance or Resolution, as marked above with drawings attached.

1. **Legal description of property:**
   Township 9 N Range 5 E 1/4 ____ 1/4 ____ Section 6
   Block ____ Lot ____ Addition ____
   Parcel ID ____-____-____-____-____ (i.e. 99-99-999-999-999)
   Street Address (no rural route) 12908 W. Pioneers Blvd. Pleasant Dale 68423

2. **Property use:** ☒ residential ❒ commercial ❒ other use
   Number of bedrooms 3 Describe ____

3. **Type of Present Individual Disposal System** ☒ septic system ❒ lagoon ❒ other

4. **Description of proposed alteration, extension or repair** Extend 100' Intelhaler Lateral into existing 158' of ½ round Fiberglass lateral
   Percolation rate avg. 39/min/in

5. **Work to be done by:** ❒ owner ☒ contractor's name Southwick Sewer & Drain Brad Southwick

6. **Estimated project:**
   a. Repair, replace, or minor extension with a cost less than $400 (no fee required).
   b. Total cost is greater than $400 (Return fee with this application)
   c. A permit is required if the use, operation, location, or type of system is changed.

Print Name Merlin Doctor Address 12908 W. Pioneers Blvd Phone: ____

Applicant Signature (owner or lessee) ____

Please include the permit fee ($170) with this application
Fee must be included before the application will be processed. Incomplete information will delay processing

---

HEALTH DEPARTMENT USE ONLY

Date received 11/9/09 REVIEW: ☒ Approved ❒ Disapproved By: ____

Site visits
Date 11/12/09 By DS.
Date ____/____/____ By ____
Date ____/____/____ By ____

Installation final written approval
Date 11/12/09 By D. S.

Return application to:
Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 "N" Street, Lincoln, NE 68510
Phone: 441-8022

SCANNED SCANNED

Business Office Use Only

Received: Date: 11/12/09 Amount $180.00 (170 J / 10 $) Check No. 3224 Initials BH all

White - Division Copy Pink - Business Office Revised 9-07

Lincoln-Lancaster County Health Department
Environmental Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

SCANNED

B

Permit Number: HS000307

Sewage Disposal System
Soil Absorption Test Data Report
Annex to Application

PLEASE PRINT OR TYPE

System Location (Indicate correct number and street)

Address 12908 W. Pioneers Blvd (no rural route) City Pleasant Dale NE, Zip 68423

Owner Merlin Doctor Addresss 12908 W Pioneers Blvd

Soil Type (SCS): _____ Percolation Rate: _____ min./inch

Date of Tests 10/15 to 10/16 Weather: Precipitation T Temperature 70s

Percolation Test Data Table

A.	B.	C. D. E. F. Pre-Saturation Period				G. H. I. J. K. Percolation Readings					L. M. N. Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Water Lev (in.)	Date (Mo/Da)	Time (Hr/Min)	Elapsed Time (Min)	Water Level Drop (in)	Percolation Rates (Min/in)
1	36										30	7/8	34
2	↓										↓	3/4	40
3												7/8	34

Person Conducting Percolation Tests

Name: Brad Southwick

Phone: 430-7606

Address 105 Locust P.O. 191
Hickman, Ne 68372

Sum of Percolation Rates: 108

Average of Rates: 36

Rate Used for Calculation: 40

DO NOT WRITE BELOW THIS LINE


Reviewing Action

Remarks _____

Signature of Reviewing Official _____ Date _____

M 23-101 10-96

12908 W. Pioneers Blvd T9 R5 S6 Lot 12

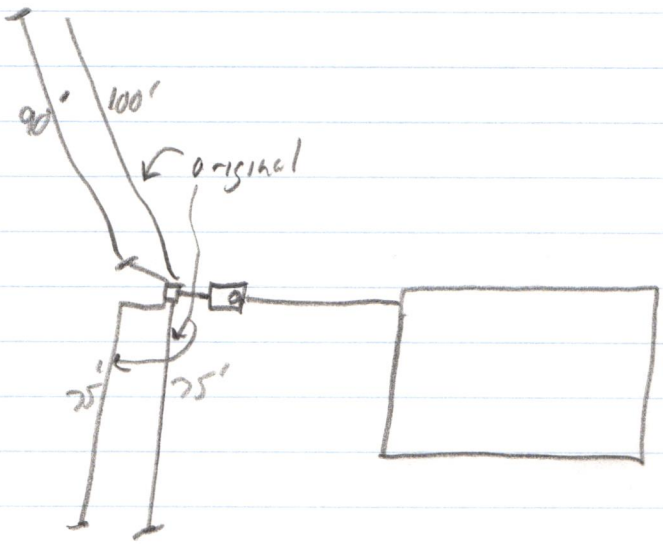

W. Pioneers Blvd.