LLCHD HS000531

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

AUG 10 2011

A

Permit Number HS000531

Onsite Wastewater Treatment System
Request for Site Clearance and Permit

Include Form B and C. Submit correct fee with this Application

3 acres or more required for: ☐ Septic System ☒ Lagoon ☐ Other (Refer to Form C)

The undersigned hereby requests site clearance and permit to construct a Wastewater Treatment System in conformance with appropriate regulations.

PLEASE PRINT OR TYPE

A. Onsite System Location 8205 W Raymond Rd.

Address Not yet available (no rural route) City Raymond, NE Zip 68428

Legal Description NW & SW 2 11 5 6 8

1/4 1/4 Section Township Range Subdivison Addition Block Lot

Geographical Location (if known): Lat/Long: PID 05-02-100-001-000

B. Owner

Name William Sterns Signature William D. Sterns

Address 8205 W Raymond Rd City/State/Zip Raymond, NE 68428

Home Phone 402- Work Phone

C. Certified Installer

Name: Lloyd Jakobsen / Raymond Contracting Signature Ronnie L. Johnson For Lloyd

Address 13800 NW 70th St City/State/Zip Raymond, NE 68428

Work Phone

D. Engineer ☐ **Check and complete if engineer designed system** P.E. License Number:

Designer Name Firm Work Phone

E. This system will serve a

☒ Residential Dwelling Number of Bedrooms 2 Is there a Whirlpool Bathtub? ☐ Yes ☒ No Total Acres 138.5

☐ Commercial Establishment/Other Facility Specify Design flow in gallons per day

Type of Wastewater ☐ Domestic ☐ Non-Domestic Well Permit Applied for ☐ Yes ☐ No ☐ Not Applicable

DO NOT WRITE BELOW THIS LINE

Approval Process ☐ Municipal Code 24.38 ☒ County Resolution No. 02-30

1. Health Department
Site visits
Date rec'd 8/11/11
Date frwd 8/11/11
ACTION ☒ Approved ☐ Disapproved
Signature

2. Supt. Bldg. Insp. or Village Clerk
Comments
Date rec'd 8-11-11
Date frwd 8-11-11
ACTION ☒ Approved ☐ Disapproved
Signature

3. City or County Engineer
Comments
Date rec'd 8-11-11
Date frwd 8-11-11
ACTION ☒ Approved ☐ Disapproved
Signature

Installation Final Written Approval
By
Date

Business Office Use Only
Date Received 8-12-11 Amount Paid 335 —
Received By AL Cash/Check No. 1702

White - Health Department Yellow - Engineer Pink - Building & Safety

Form A Updated: 5/10

8-15-2011 10:33:27

Lincoln-Lancaster County Health Department
Environmental Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022


C

Permit Number:

Sewage Disposal System

Preliminary Plan Specifications

Draw a plot plan showing system location, lines, distribution box, tank and laterals, percolation test hole locations, well, residence, compass direction and property lines. Indicate on drawing if residence and well are existing or proposed.

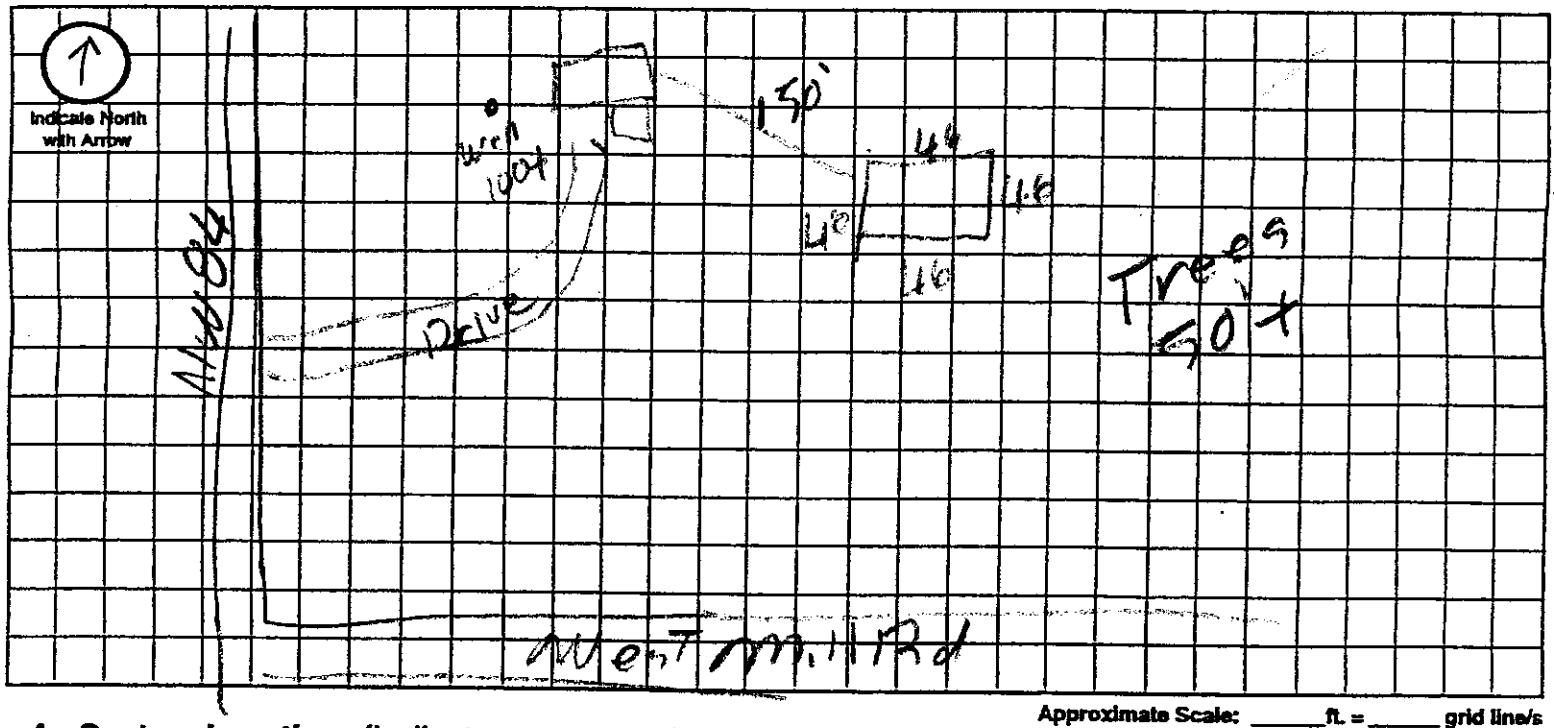

Approximate Scale: _____ ft. = _____ grid line/s

A. System Location (Indicate correct number and street)

Address (no rural route) 440 + SW 1/4 2-11-5 City Raymond NE, Zip 68428

B. Proposed Septic Tank/s

Tank Material: ☐ Concrete ☐ Plastic ☐ Other _____

C. Proposed Absorption System (See Form B for Percolation Information)

Percolation Rate _____ (min. per inch) Soil Type: _____ Land Slope: _____ %

Type of Absorption System: ☐ Trench ☐ Bed ☐ Other _____

Total Square Feet of Field Required: _____ sq. ft.

Type of Lateral: ☐ Half-Moon ☐ Perforated Pipe ☐ Other Lateral Material: _____

Capacity of Septic Tank _____ gals Number of Absorption Beds: _____ Number of Distribution Laterals per Bed _____

Total Length of Laterals _____ ft. Number of Trenches _____ Trench Width _____


D. Setbacks Check the Boxes Below if the Required Setback has been Satisfied

Distance From	Private Well	Public Well	Surface Water	Gound Water	Pressure Water Lines	Property Lines	Foundations Yours	Foundations Neighbors	All Other Setbacks
Tank (ft)	50 ☐	500 ☐	50 ☐	NA ☐	25 ☐	20 ☐	15 ☐	25 ☐	☐
Field (ft)	100 ☐	500 ☐	50 ☐	4 ☐	30 ☐	20 ☐	30 ☐	40 ☐	☐
Lagoon (ft)	100 ☑	500 ☑	50 ☑	N/A ☐	30 ☑	50 ☑	100 ☑	200 ☑	☑

E. Required Signatures

Home Building Contractor _____ Date _____

Installer Mark S. Jakubek Date 8/8/11

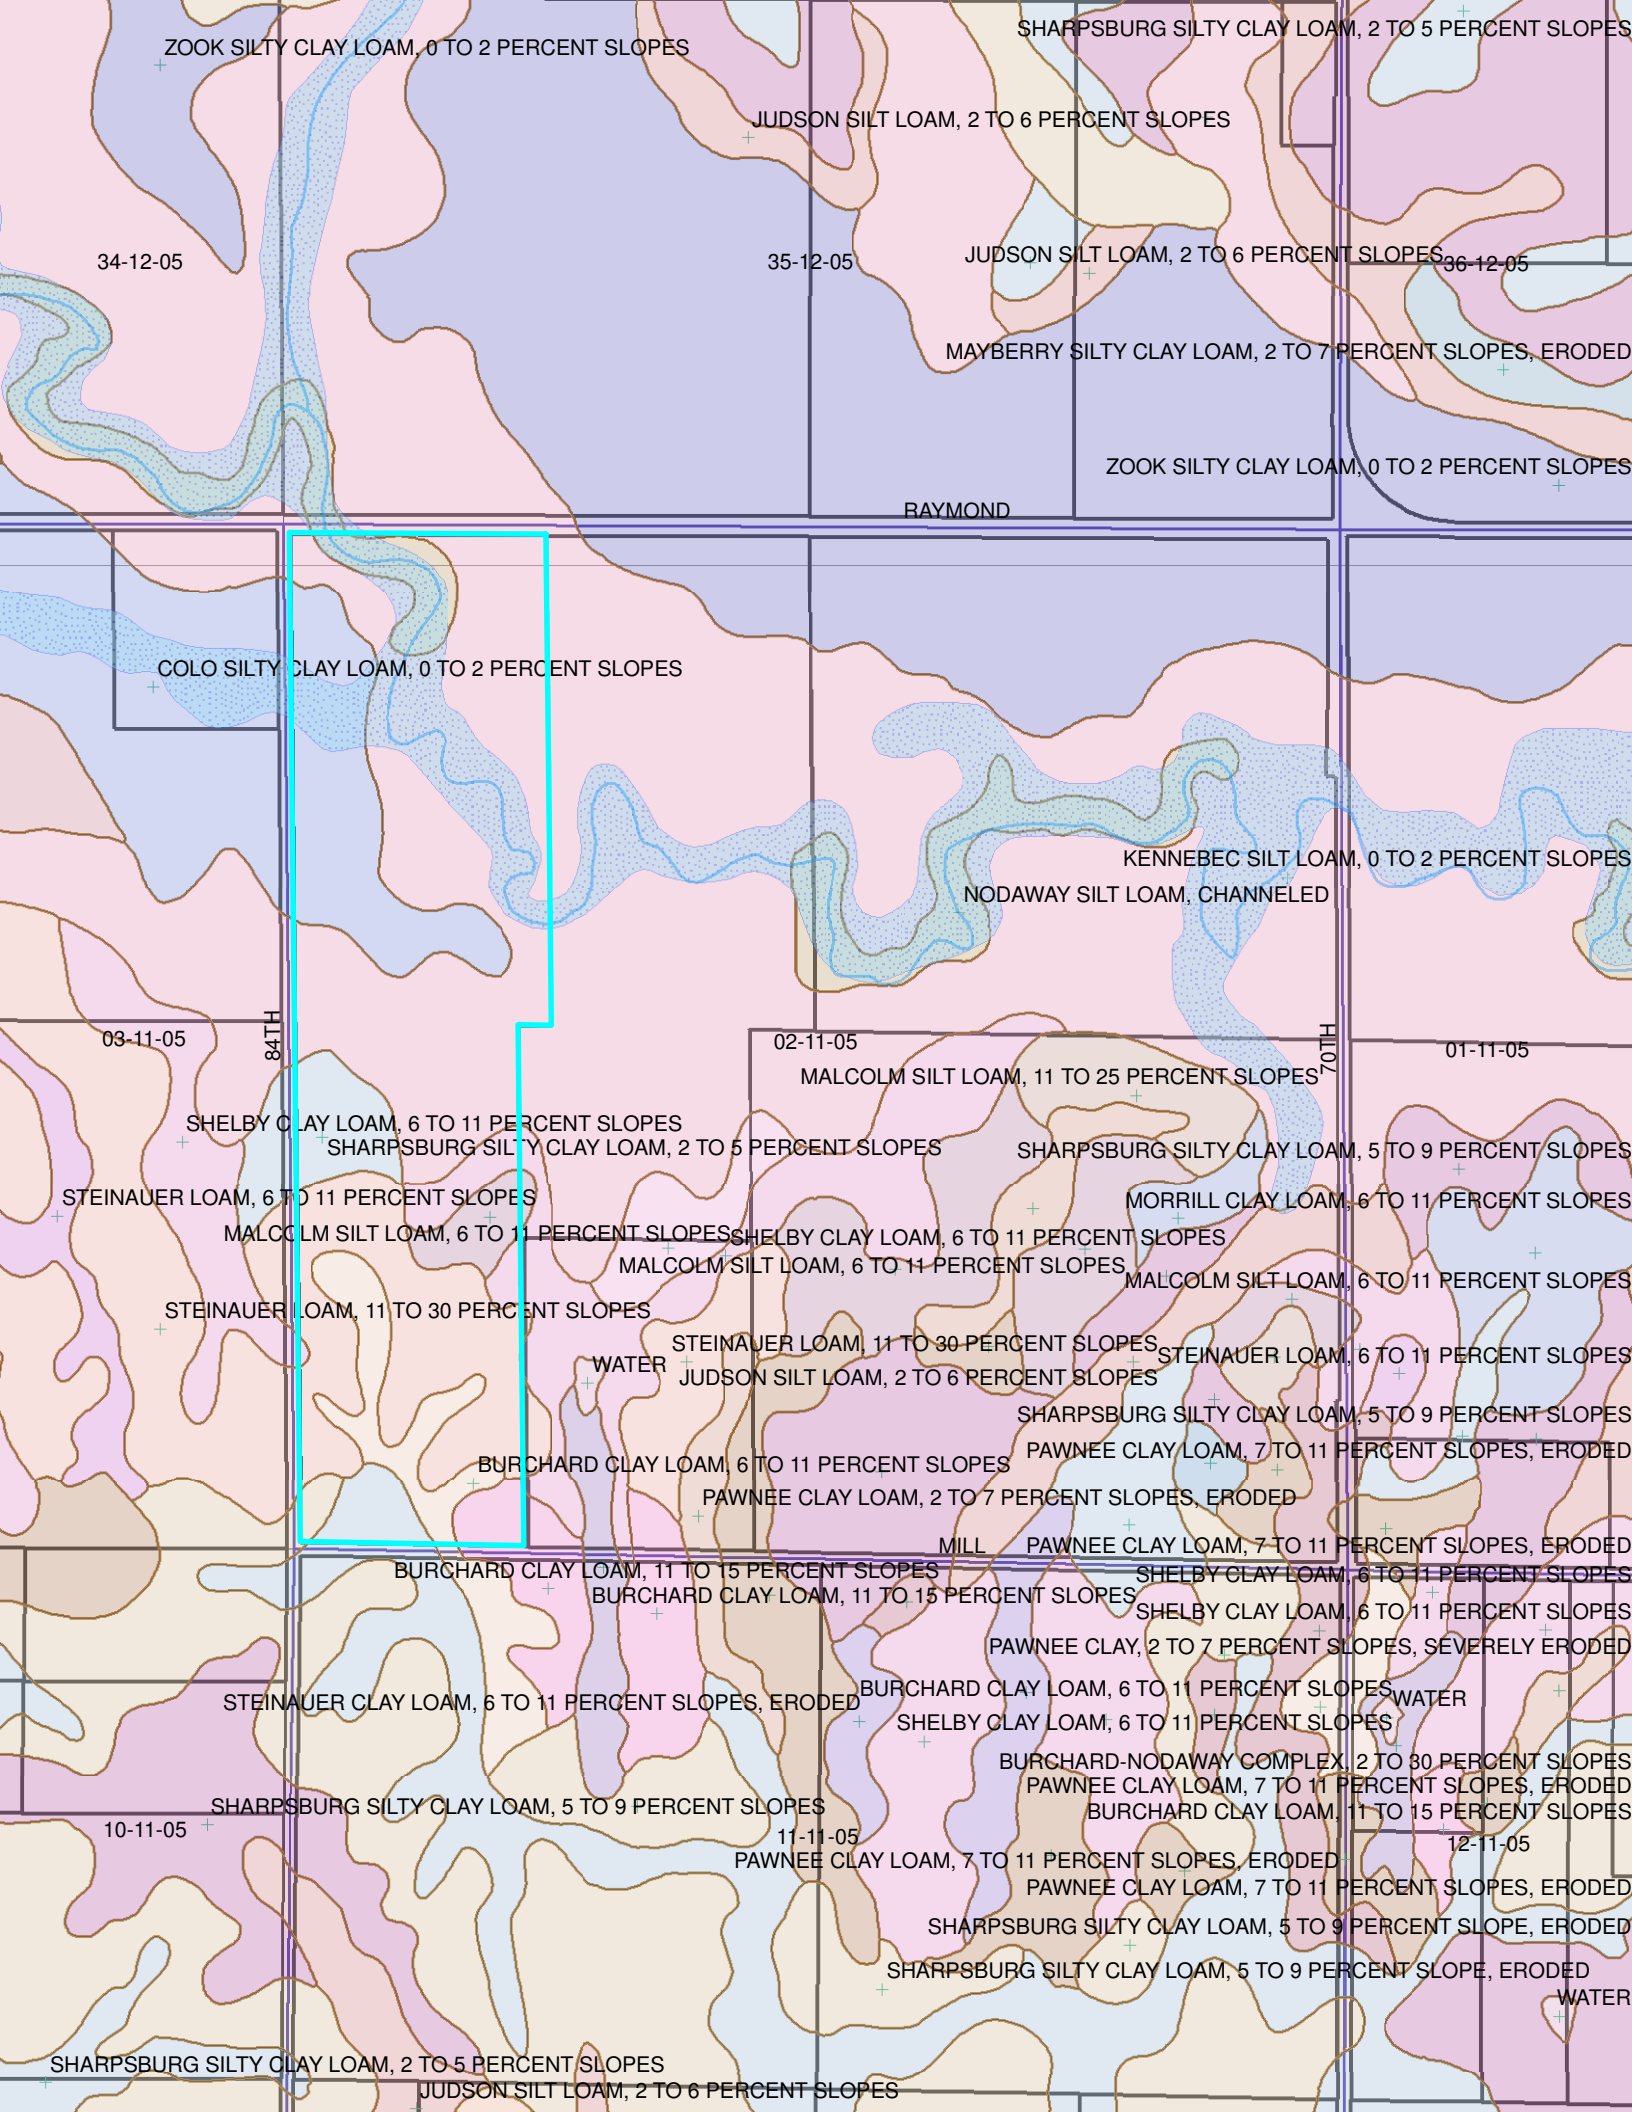
ZOOK SILTY CLAY LOAM, 0 TO 2 PERCENT SLOPES
SHARPSBURG SILTY CLAY LOAM, 2 TO 5 PERCENT SLOPES
JUDSON SILT LOAM, 2 TO 6 PERCENT SLOPES
34-12-05
35-12-05
JUDSON SILT LOAM, 2 TO 6 PERCENT SLOPES
36-12-05
MAYBERRY SILTY CLAY LOAM, 2 TO 7 PERCENT SLOPES, ERODED
ZOOK SILTY CLAY LOAM, 0 TO 2 PERCENT SLOPES
RAYMOND
COLO SILTY CLAY LOAM, 0 TO 2 PERCENT SLOPES
KENNEBEC SILT LOAM, 0 TO 2 PERCENT SLOPES
NODAWAY SILT LOAM, CHANNELED
03-11-05
84TH
02-11-05
70TH
01-11-05
MALCOLM SILT LOAM, 11 TO 25 PERCENT SLOPES
SHELBY CLAY LOAM, 6 TO 11 PERCENT SLOPES
SHARPSBURG SILTY CLAY LOAM, 2 TO 5 PERCENT SLOPES
SHARPSBURG SILTY CLAY LOAM, 5 TO 9 PERCENT SLOPES
STEINAUER LOAM, 6 TO 11 PERCENT SLOPES
MORRILL CLAY LOAM, 6 TO 11 PERCENT SLOPES
MALCOLM SILT LOAM, 6 TO 11 PERCENT SLOPES
SHELBY CLAY LOAM, 6 TO 11 PERCENT SLOPES
MALCOLM SILT LOAM, 6 TO 11 PERCENT SLOPES
MALCOLM SILT LOAM, 6 TO 11 PERCENT SLOPES
STEINAUER LOAM, 11 TO 30 PERCENT SLOPES
STEINAUER LOAM, 11 TO 30 PERCENT SLOPES
STEINAUER LOAM, 6 TO 11 PERCENT SLOPES
WATER
JUDSON SILT LOAM, 2 TO 6 PERCENT SLOPES
SHARPSBURG SILTY CLAY LOAM, 5 TO 9 PERCENT SLOPES
PAWNEE CLAY LOAM, 7 TO 11 PERCENT SLOPES, ERODED
BURCHARD CLAY LOAM, 6 TO 11 PERCENT SLOPES
PAWNEE CLAY LOAM, 2 TO 7 PERCENT SLOPES, ERODED
MILL
PAWNEE CLAY LOAM, 7 TO 11 PERCENT SLOPES, ERODED
BURCHARD CLAY LOAM, 11 TO 15 PERCENT SLOPES
SHELBY CLAY LOAM, 6 TO 11 PERCENT SLOPES
BURCHARD CLAY LOAM, 11 TO 15 PERCENT SLOPES
SHELBY CLAY LOAM, 6 TO 11 PERCENT SLOPES
PAWNEE CLAY, 2 TO 7 PERCENT SLOPES, SEVERELY ERODED
STEINAUER CLAY LOAM, 6 TO 11 PERCENT SLOPES, ERODED
BURCHARD CLAY LOAM, 6 TO 11 PERCENT SLOPES
WATER
SHELBY CLAY LOAM, 6 TO 11 PERCENT SLOPES
BURCHARD-NODAWAY COMPLEX, 2 TO 30 PERCENT SLOPES
PAWNEE CLAY LOAM, 7 TO 11 PERCENT SLOPES, ERODED
SHARPSBURG SILTY CLAY LOAM, 5 TO 9 PERCENT SLOPES
BURCHARD CLAY LOAM, 11 TO 15 PERCENT SLOPES
10-11-05
11-11-05
12-11-05
PAWNEE CLAY LOAM, 7 TO 11 PERCENT SLOPES, ERODED
PAWNEE CLAY LOAM, 7 TO 11 PERCENT SLOPES, ERODED
SHARPSBURG SILTY CLAY LOAM, 5 TO 9 PERCENT SLOPE, ERODED
SHARPSBURG SILTY CLAY LOAM, 5 TO 9 PERCENT SLOPE, ERODED
WATER
SHARPSBURG SILTY CLAY LOAM, 2 TO 5 PERCENT SLOPES
JUDSON SILT LOAM, 2 TO 6 PERCENT SLOPES

Lincoln-Lancaster County Health Department
Environmental Public Health Division (402) 441-8027
3140 N Street Lincoln, NE 68510-1514

ON-SITE WASTE WATER SYSTEM
CONSTRUCTION - INSTALLATION PERMIT

No. HS000531

System Type: LAGOON

Situs:

Legal Description: T11N-R05E-S02-Lot 6&8

Owner: STERNS, WM D & KAREN D
8205 W RAYMOND RD
RAYMOND NE
68428

Permit Fee:	$335.00
Variance Fee:	$0.00
Extension Fee:	$0.00
Total Fees:	$335.00
Issued:	08/12/2011
Expires:	08/11/2012

Judith A Halstead

Judith A. Halstead, MS, Health Director

On-site Waste System Permit Holder:

The above document is your permit to construct a new On-site Waste Water System at the location listed. Please contact this office once the sytem is complete in order to schedule a final inspection before use.

Judith A Halstead

Judith A. Halstead, MS
Health Director

RAYMOND CONTRACTING
13800 NW 70TH
RAYMOND NE 68428