Lincoln-Lancaster County Health Department
Environmental Public Health Division (402) 441-8027
3140 N Street Lincoln, NE 68510-1514

ON-SITE WASTE WATER SYSTEM
REPAIR PERMIT

No. HS000590

System Type: STANDARD

Situs: 4000 WAVERLY RD

Legal Description: T11N-R07E-S08-SW-Lot 18

Owner: PESTER, ROBERT L
4000 WAVERLY RD
DAVEY NE
68336

Permit Fee:	$190.00
Total Fees:	$190.00
Issued:	02/28/2012
Expires	03/14/2013

Judith A Halstead

Judith A. Halstead, MS, Health Director

Dear Applicant:

The above document is your permit to repair an existing On-site Waste Water System at the location listed. Please contact this office once repairs are complete to obtain final approval before use.

Judith A Halstead

Judith A. Halstead, MS
Health Director

RAYMOND CONTRACTING
13800 NW 70TH
RAYMOND NE 68428

LLCHD HS000590

FEB 23 2012

Application to Alter, Extend or Repair an Onsite Wastewater Treatment System

☐ Municipal Code 24.38 ☐ County Resolution Number 02-30

HS000590

The undersigned hereby applies for a permit to: ☐ **ALTER** ☒ **EXTEND** ☐ **REPAIR** an existing wastewater treatment system, complying with appropriate Ordinance or Resolution, as marked above with drawings attached.

1. **Legal description of property:**
   Township 11 Range 7 1/4 ____ 1/4 SW Section 8
   Block ____ Lot 18 Addition ____
   Parcel ID 18 - 08 - 300 - 005 - 000 (i.e. 99-99-999-999-999)
   Street Address (no rural route) 4000 Waverly Rd

2. **Property use:** ☒ residential ☐ commercial ☐ other use
   Number of bedrooms 3 Describe ____

3. **Type of Present Individual Disposal System** ☒ septic system ☐ lagoon ☐ other

4. **Description of proposed alteration, extension or repair** Replace drainfield, 188' of ADS Graveless Chambers

5. **Work to be done by:** ☐ owner ☒ contractor's name Lloyd Jirkovsky, Raymond Contracting

6. **Estimated project:** a. Repair, replace, or minor extension with a cost less than $400 (no fee required).
   b. Total cost is greater than $400 (Return fee with this application)
   c. A permit is required if the use, operation, location, or type of system is changed.

Print Name Robert Pester Address 4000 Waverly Rd Phone: 402-314-0975

Applicant Signature (owner or lessee) Robert L. Pester

Please contact LLCHD for the permit fee for this application
Fee must be included before the application will be processed. Incomplete information will delay processing

HEALTH DEPARTMENT USE ONLY

Date received 2/24/12 REVIEW: ☑ Approved ☐ Disapproved By: ____

Site visits
Date ____/____/____ By ____
Date ____/____/____ By ____
Date ____/____/____ By ____

Installation final written approval
Date ____/____/____ By ____

Return application to:
Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 "N" Street, Lincoln, NE 68510
Phone: 441-8643

Business Office Use Only

Received: Date: 2/25/12 Amount $140.00 Check No. 7339 Initials B. Hall

Revised 3-09

2-29-2012 15:11:39

Lincoln-Lancaster County Health Department
Environmental Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

B

Permit Number:

Sewage Disposal System
Soil Absorption Test Data Report
Annex to Application

PLEASE PRINT OR TYPE

System Location (Indicate correct number and street)

Address 4000 University Rd (no rural route) City Dwelf NE, Zip 68336

Owner Robert Pester Address same

Soil Type (SCS): Judson silt loam Percolation Rate: 30 min./inch

Date of Tests 2/1/12 to 2/2/12 Weather: Precipitation -0- Temperature 40

Percolation Test Data Table

A.	B.	C. D. E. F. Pre-Saturation Period				G. H. I. J. K. Percolation Readings					L. M. N. Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Water Lev (in.)	Date (Mo/Da)	Time (Hr/Min)	Elapsed Time (Min)	Water Level Drop (in)	Percolation Rates (Min/in)
1	30	2/1	8:00a	2/1	12:00p	2/2	12:00p	6	2/2	12:30p	30	3 3/4	8
2	26	"	"	"	"	"	"	"	"	"	"	3 3/8	9
3	24	"	"	"	"	"	"	"	"	"	"	2 5/8	11
4	24	"	"	"	"	"	"	"	"	"	"	3	10
5	23	"	"	"	"	"	"	"	"	"	"	1	30
6	25	"	"	"	"	"	"	"	"	"	"	3 1/4	9

Sum of Percolation Rates: 77
Average of Rates: 12.83
Rate Used for Calculation: 30 (20 min variance)

Person Conducting Percolation Tests


Name: Terri L. Jakoubek, Raymond Contracting, Inc.
Phone: 402-783-2603 or 402-890-3870
Address 13800 NW 70th St
Raymond, NE 68428 # C1198

DO NOT WRITE BELOW THIS LINE

Reviewing Action

Remarks _____

Signature of Reviewing Official _____ Date _____

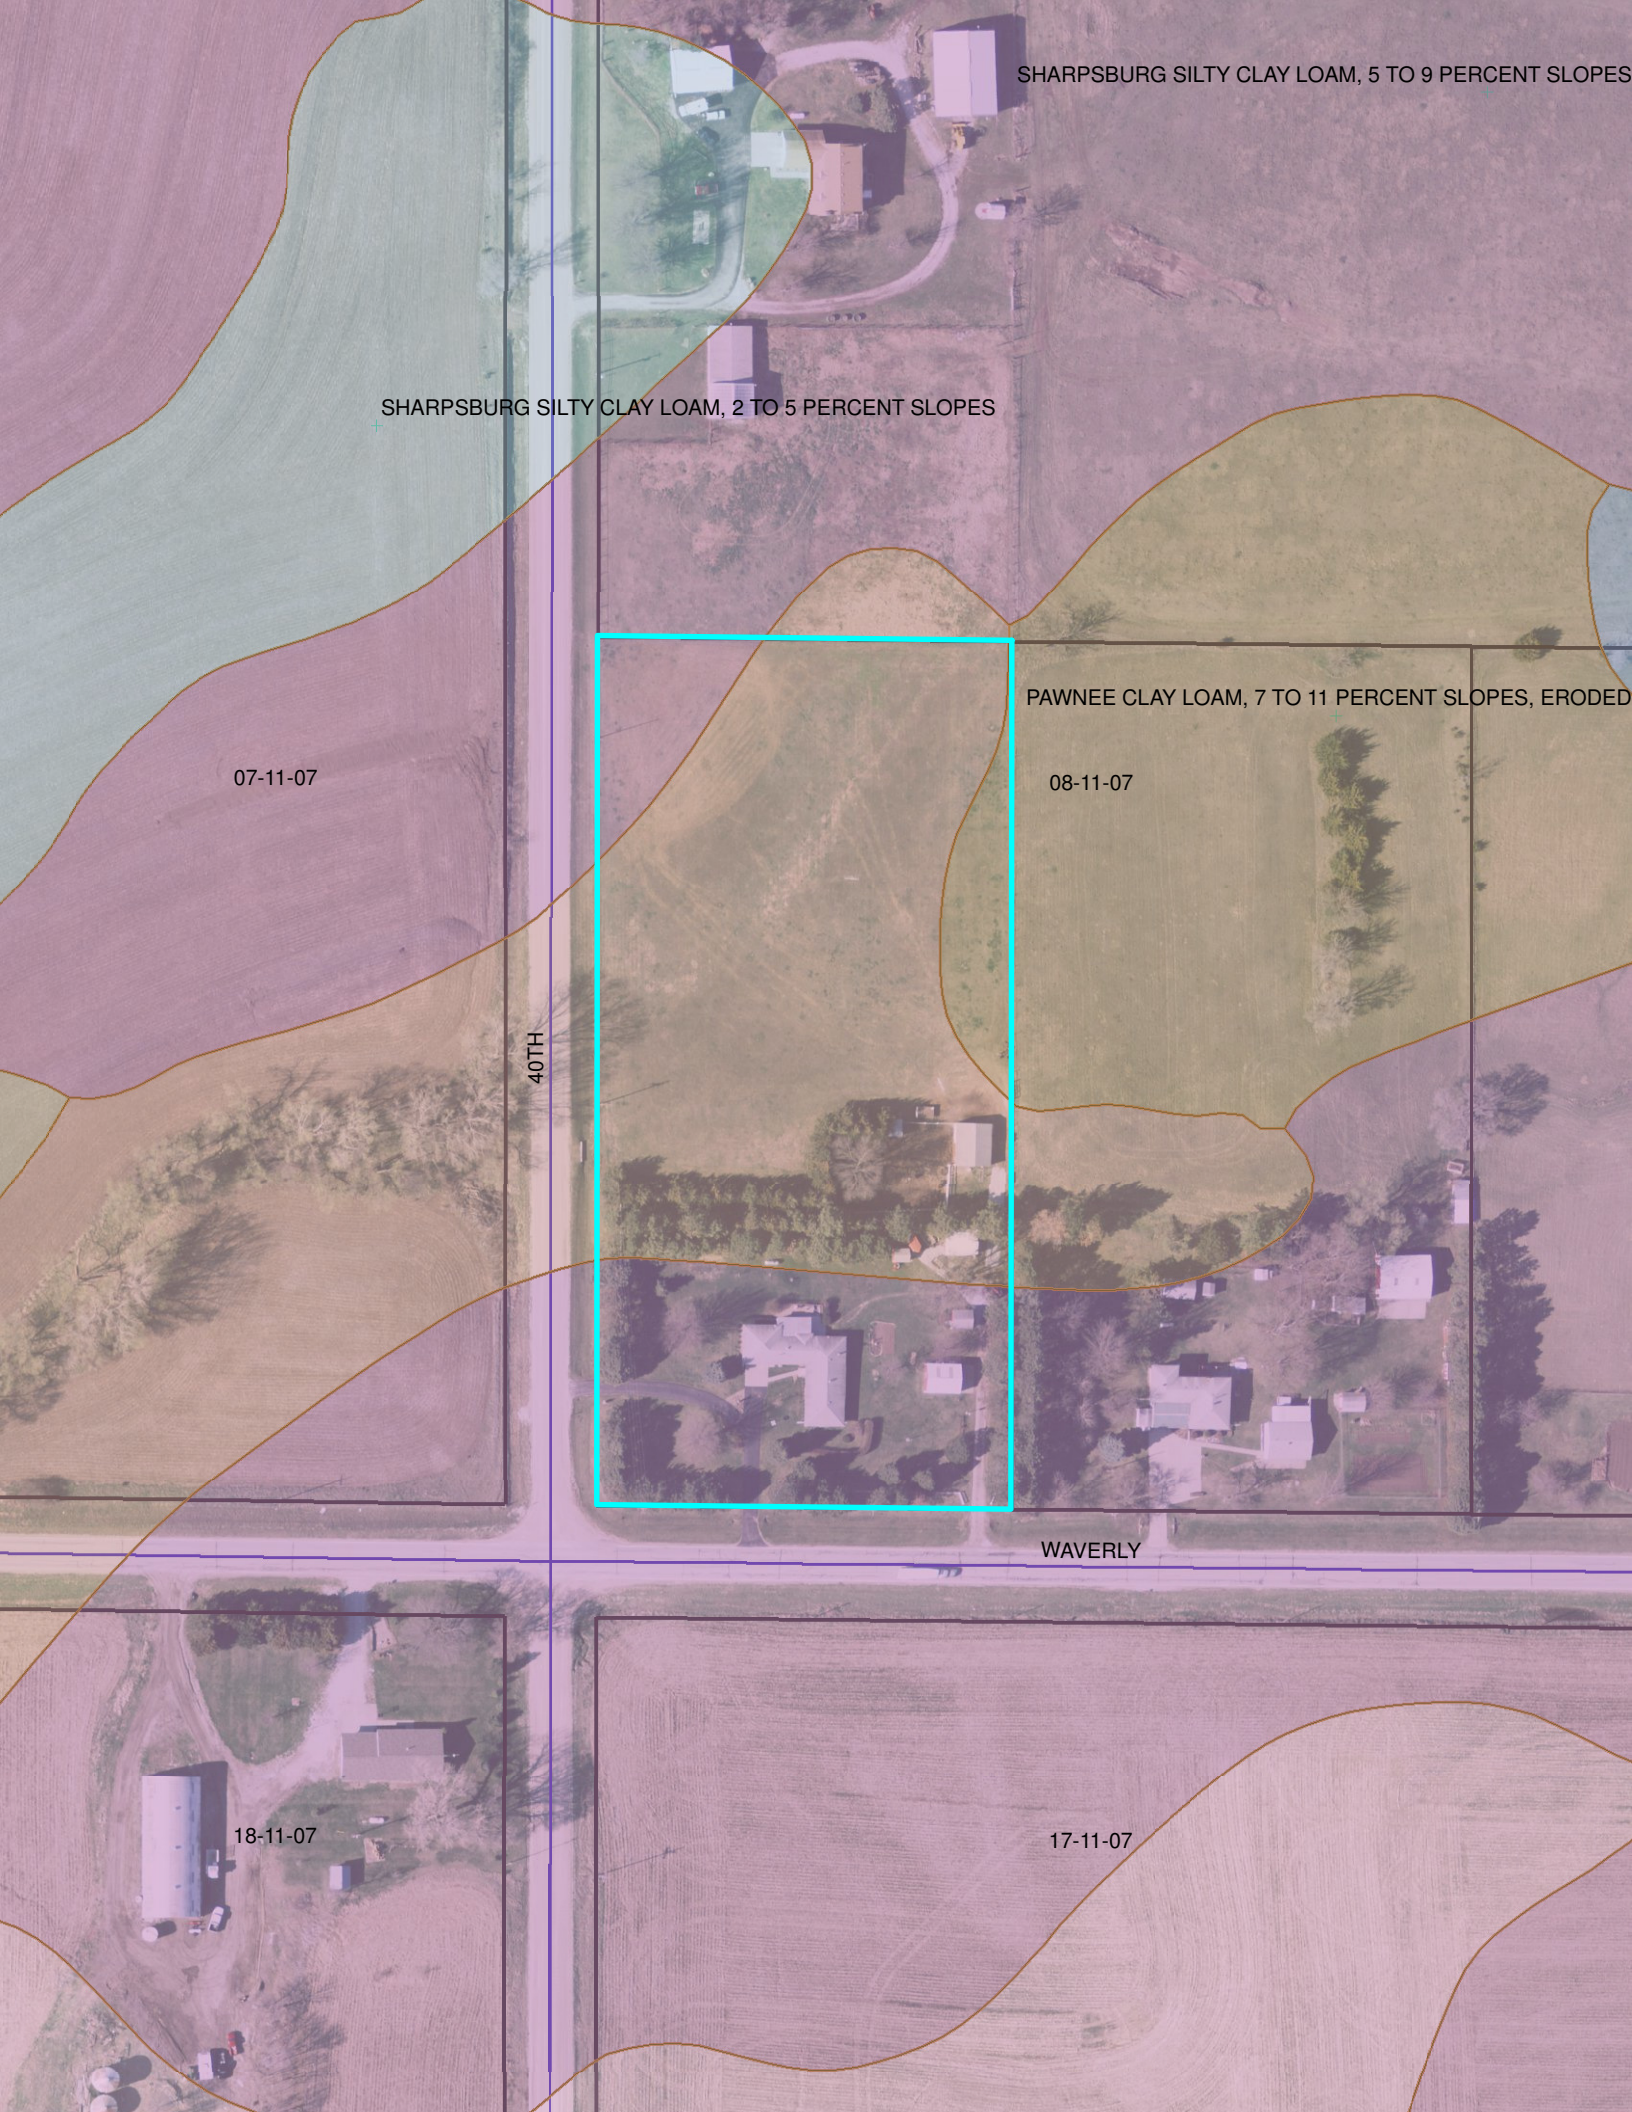
SHARPSBURG SILTY CLAY LOAM, 5 TO 9 PERCENT SLOPES
SHARPSBURG SILTY CLAY LOAM, 2 TO 5 PERCENT SLOPES
PAWNEE CLAY LOAM, 7 TO 11 PERCENT SLOPES, ERODED
07-11-07
08-11-07
40TH
WAVERLY
18-11-07
17-11-07

FEB 23 2012

SCANNED

Application to Alter, Extend or Repair an Onsite Wastewater Treatment System

☐ Municipal Code 24.38 ☐ County Resolution Number 02-30

H5000590

The undersigned hereby applies for a permit to: ☐ **ALTER** ☒ **EXTEND** ☐ **REPAIR** an existing wastewater treatment system, complying with appropriate Ordinance or Resolution, as marked above with drawings attached.

1. **Legal description of property:**
   Township 11 Range 7 1/4 ____ 1/4 SW Section 8
   Block ____ Lot 18 Addition ____
   Parcel ID 18 - 08 - 300 - 005 - 000 (i.e. 99-99-999-999-999)
   Street Address (no rural route) 4000 Waverly Rd

2. **Property use:** ☒ residential ☐ commercial ☐ other use
   Number of bedrooms 3 Describe ____

3. **Type of Present Individual Disposal System** ☒ septic system ☐ lagoon ☐ other

4. **Description of proposed alteration, extension or repair** Replace drainfield, 188' of BAS Gravelless Chambers

5. **Work to be done by:** ☐ owner ☒ contractor's name Lloyd Jablonski, Raymond Contracting

6. **Estimated project:**
   a. Repair, replace, or minor extension with a cost less than $400 (no fee required).
   b. Total cost is greater than $400 (Return fee with this application)
   c. A permit is required if the use, operation, location, or type of system is changed.

Print Name Robert Pester Address 4000 Waverly Rd Phone: 402-314-0975

Applicant Signature (owner or lessee) Robert L. Pester

Please contact LLCHD for the permit fee for this application
Fee must be included before the application will be processed. Incomplete information will delay processing

---

HEALTH DEPARTMENT USE ONLY

Date received 2/24/12 REVIEW: ☑ Approved ☐ Disapproved By: [signature]

Site visits
Date ___/___/___ By ____
Date ___/___/___ By ____
Date ___/___/___ By ____

Installation final written approval
Date 3/14/12 By [signature]

Return application to:
Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 "N" Street, Lincoln, NE 68510
Phone: 441-8643


Business Office Use Only

Received: Date: 2/28/12 Amount $190.00 Check No. 7839 Initials B. Hall

Revised 3-09

4000 Waverly

3/13/2012

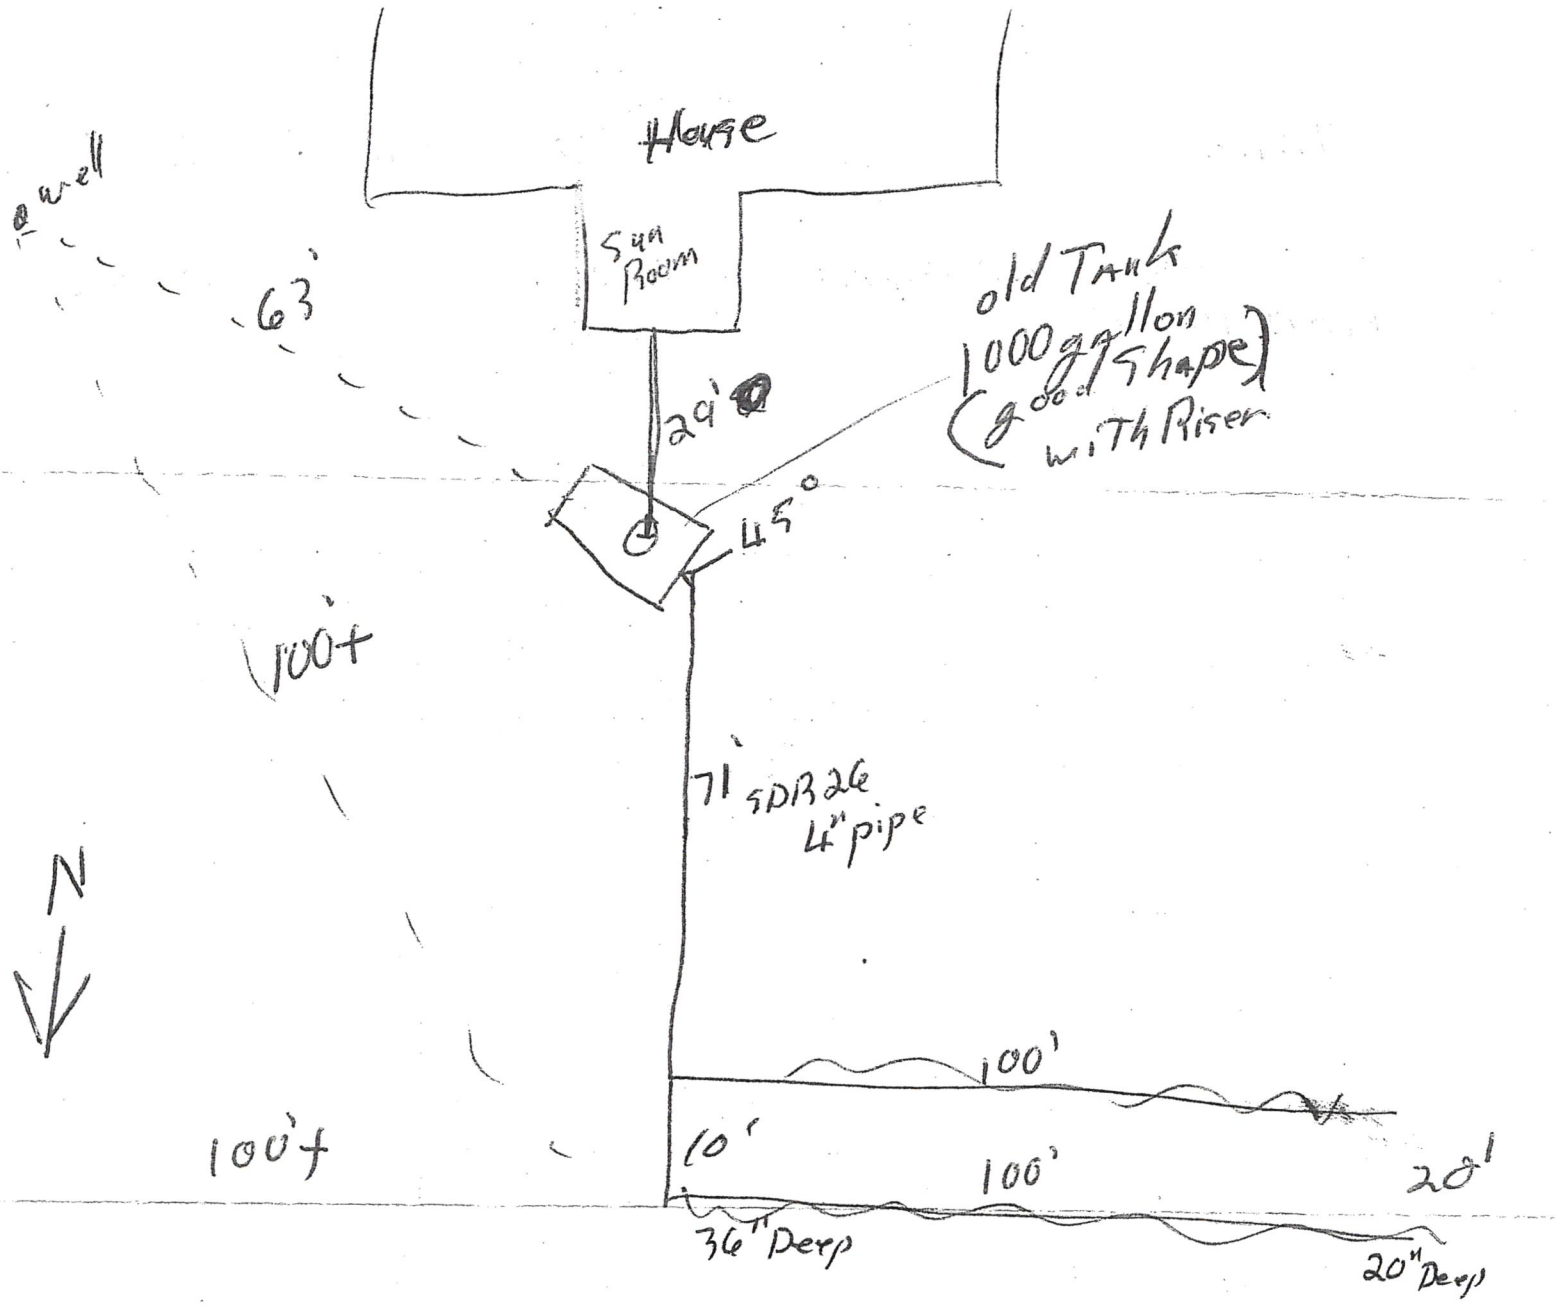

Raymond Contracting, Inc.
Lloyd J Jakoubek
13800 NW 70th St
Raymond, NE 68428
402-783-2663

3/13/2012

100'