Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

A

Permit Number
HS 000910

Onsite Wastewater Treatment System
Request for Site Clearance and Permit

Include Form B and C.
Submit correct fee
with this Application

3 acres or more required for: ☐ Septic System ☐ Lagoon ☒ Other (Refer to Form C) Holding Tanks

The undersigned hereby requests site clearance and permit to construct a Wastewater Treatment System in conformance with appropriate regulations.

PLEASE PRINT OR TYPE

(A) Onsite System Location

Address 11437 S 40TH (no rural route) City LINCOLN, NE Zip 68430

Legal Description 31 9N R7E 6TH PRINCIPAL MERIDIAN 39SE
(1/4 1/4 Section Township Range Subdivison Addition Block Lot)

PID 16-31-400-003-000

(B) Owner

Name Lancaster County Engineering Signature

Address 444 CHERRYCREEK RD City/State/Zip LINCOLN, NE 68528

Home Phone 402-672-5620 Work Phone 402-441-8332

C. Certified Installer

Name: Lloyd Jahnbek, Raymond Contracting, Inc Signature

Address 13800 NW 70th St City/State/Zip RAYMOND, NE 68428

Work Phone 402-890-6009

D. Engineer

☐ Check and complete if engineer designed system P.E. License Number:

Designer Name Firm Work Phone

E. This system will serve a

☐ Residential Dwelling Number of Bedrooms Whirlpool Bathtub? ☐ Yes ☐ No Total Acres 1.5
Garbage Grinder? ☐ Yes ☐ No

☒ Commercial Establishment/Other Facility Specify Lancaster County Design flow in gallons per day < 100

Type of Wastewater ☐ Domestic ☒ Non-Domestic maintenance shop - floor drains for vehicle & equipment run off and occassional washing

DO NOT WRITE BELOW THIS LINE

Approval Process ☐ Municipal Code 24.38 ☐ County Resolution No. 02-30

1. Health Department
Site visits Date rec'd ACTION ☐ Approved ☐ Disapproved
Date frwd Signature
Comments

2. Supt. Bldg. Insp. or Village Clerk
Comments Date rec'd ACTION ☐ Approved ☐ Disapproved
Date frwd Signature

3. City or County Engineer
Comments Date rec'd ACTION ☐ Approved ☐ Disapproved
Date frwd Signature

Installation Final Written Approval
By
Date

Business Office Use Only
Date Received 6/9/14 Amount Paid 365.00
Received By SB Cash/Check No. 8347

White - Health Department Yellow - Engineer Pink - Building & Safety



Lancaster County/City of Lincoln GIS Map

[redacted]

N
W E
S
NE

Printed: Jun 03, 2014

DISCLAIMER: The information is presented on a best-efforts basis, and should not be relied upon for making financial, survey, legal or other commitments. If you have questions or comments regarding the data displayed on this map, please email gis@lincoln.ne.gov and you will be directed to the appropriate department.

Lincoln-Lancaster County Health Department
Environmental Public Health Division (402) 441-8027
3140 N Street Lincoln, Nebraska 68510-1514

ON-SITE WASTE WATER SYSTEM
CONSTRUCTION - INSTALLATION PERMIT
No. HS000910

System Type: Standard

Situs: 11437 S 40TH, RURAL, NE

Issued: 6/10/2014

Expires: 6/10/2015

Description: S31, T9, R7, 6th Principal Meridian, LOT 39 SE

Owner: LANCASTER COUNTY
555 S 10 ST
LINCOLN, NE 68508

Judith A Halstead
Judith A. Halstead, MS, Health Director

Dear Applicant:

The above document is your permit to construct a new On-site Waste Water System at the location listed. Please contact this office once the sytem is complete in order to schedule a final inspection before use.

Judith A Halstead
Judith A. Halstead, MS
Health Director

RAYMOND CONTRACTING
13800 NW 70TH ST
RAYMOND, NE 68428

AUG 12 2014

D

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

Permit Number: HS0000910

Onsite Wastewater Treatment System

40th + Saltillo

As Built Plans & Specifications

Date July 30, 2014 Legal Description SE 1/4 1/4 31 Section 9N Township 7E Range

Onsite System Location

Address (no rural route) 11437 S. 40th St City Lincoln NE, Zip 68430

Owner _____ Address _____

A. Sewer Pipe

1. Material: SDR26
   Diameter: 4 in.
2. Distance above basement floor: _____ in.
   or distance below basement floor: 24 in.
3. Distance between dwelling and septic tank: 74 ft.
4. Number of clean-outs: one
5. Distances to: well or suction line 50+ ft.
   stream 100 ft.
   pressure line 100 ft.
   property line 50+ ft.

B. Septic Tank

☐ Label with Manufacturer, address and gallon capacity

1. Material: _____
   Number of compartments: _____
2. Capacity: _____ gal.
3. Factory built: ☐ Yes ☐ No
4. Manholes: Over inlet, diameter _____ in.
   Over outlet, diameter _____ in.
   Riser: ☐ above ☐ below grade _____ in.
5. Inlet: ☐ baffle ☐ tee ☐ 6" dia. inspection pipe
6. Outlet: ☐ baffle ☐ tee ☐ 6" dia. inspection pipe
7. Depth to top of tank, below unfinished grade: 66 – 42" in.
8. Distances to: Well or suction line 50 ft.
   Stream 100 ft.
   Pressure line 100 ft.
   Property line 50+ ft.

C. ☐ Distribution Box ☐ Drop Boxes

(≥ 12" inspection opening) (removable lid to inspect)

1. Material: _____
   Number available outlets: _____
2. Factory built: ☐ Yes ☐ No
3. Distance from septic tank: _____ ft.

D. Drainfield Absorption


☐ Trench ☐ Bed ☐ Level Bottom


1. Type: ☐ Half rounds ☐ Perforated pipe ☐ Chambers
   Diameter or width: _____
   Number of distribution lines in bed _____
   Material: ☐ fiberglass ☐ plastic ☐ concrete
   ☐ other _____
2. Drainfield Laterals: Number _____
   Length of each line: _____ ft. _____ ft.
   _____ ft. _____ ft., _____ ft.
3. Drainfield dimensions: Width _____ ft.
   Distribution Pipe Slope _____ in/100 ft.
   Average depth _____ in
4. Filter material: _____
   Depth of material _____ in.
5. Distances to: Well or suction line _____ ft.
   Pressure line _____ ft.
   Property line _____ ft.
   House or building _____ ft.
   Lake or Stream _____ ft.

Complete As-Built drawing on the back fo this form.

Onsite Wastewater System Design (Example)

Indicate North with Arrow

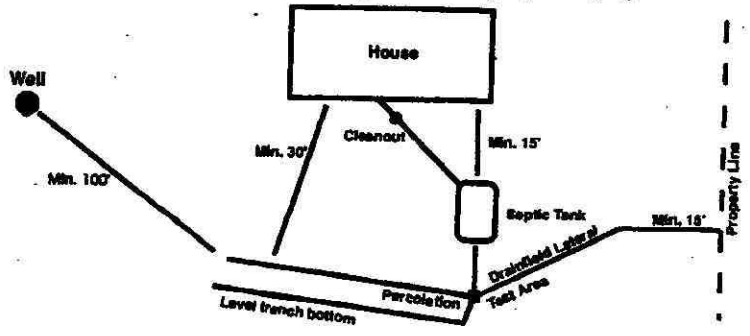

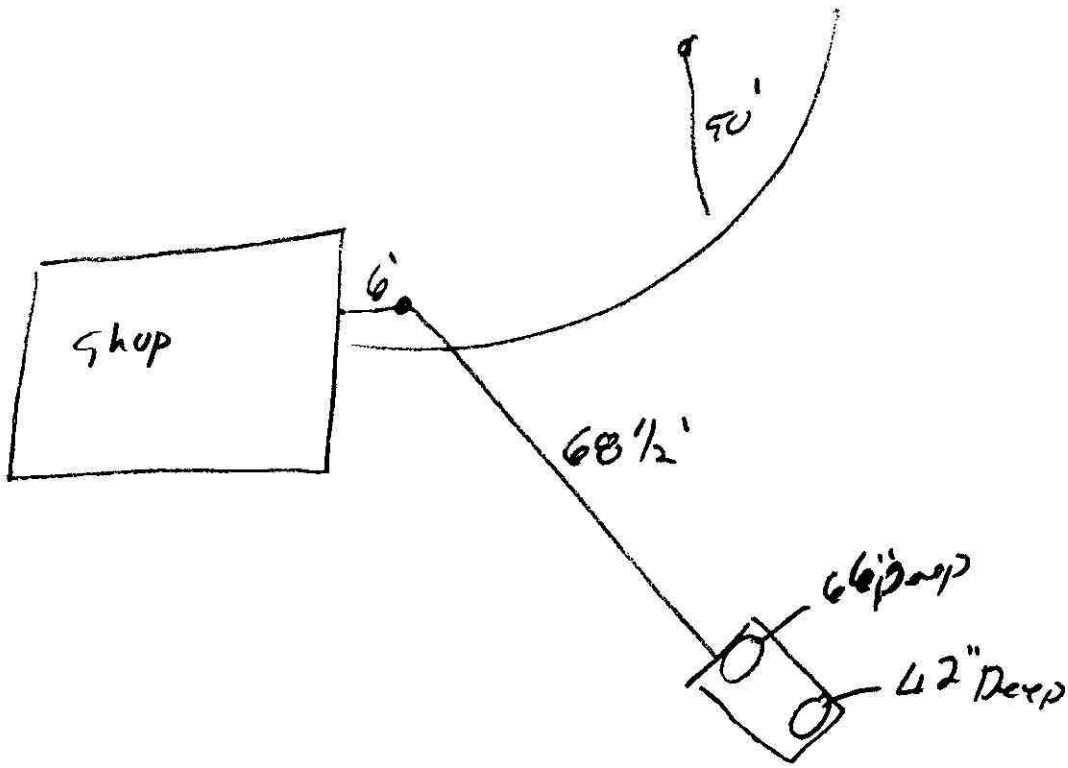
50'
Shop
6'
68½'
66' Deep
42" Deep

SCANNED

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

A

Permit Number
HS 000910

Onsite Wastewater Treatment System
Request for Site Clearance and Permit

Include Form B and C. Submit correct fee with this Application

3 acres or more required for: ☐ Septic System ☐ Lagoon ☒ Other (Refer to Form C) Holding Tanks

The undersigned hereby requests site clearance and permit to construct a Wastewater Treatment System in conformance with appropriate regulations.

PLEASE PRINT OR TYPE

(A) Onsite System Location

Address 11437 S 40TH (no rural route) City LINCOLN, NE Zip 68430

Legal Description 31 9N R7E 6TH PRINCIPAL MERIDIAN 39SE
(1/4 1/4 Section Township Range Subdivison Addition Block Lot)

PID 16-31-400-003-000

(B) Owner

Name Lancaster County Engineering Signature [signature]
Address 444 CHERRYCREEK RD City/State/Zip LINCOLN, NE 68528
Home Phone 402-672-5636 Work Phone 402-441-8332

C. Certified Installer

Name: Lloyd Jabolbek, Raymond Contracting, Inc Signature
Address 13800 NW 70th St City/State/Zip RAYMOND, NE 68428
Work Phone 402-890-6009

D. Engineer

☐ Check and complete if engineer designed system P.E. License Number:
Designer Name Firm Work Phone

E. This system will serve a

☐ Residential Dwelling Number of Bedrooms Whirlpool Bathtub? ☐ Yes ☐ No Total Acres 1.5
Garbage Grinder? ☐ Yes ☐ No

☒ Commercial Establishment/Other Facility Specify Lancaster County Design flow in gallons per day < 100

Type of Wastewater ☐ Domestic ☒ Non-Domestic maintenance shop - floor drains for vehicle & equipment drip off and accessory washing

DO NOT WRITE BELOW THIS LINE

Approval Process ☐ Municipal Code 24.38 ☑ County Resolution No. 02-30

1. Health Department
Site visits Date rec'd ACTION ☐ Approved ☐ Disapproved
Date frwd Signature
Comments

2. Supt. Bldg. Insp. or Village Clerk
Comments Date rec'd ACTION ☐ Approved ☐ Disapproved
Date frwd Signature

3. City or County Engineer
Comments Date rec'd ACTION ☐ Approved ☐ Disapproved
Date frwd Signature

Installation ~~Final Written Approval~~
By
Date 4/14/15

Business Office Use Only
Date Received 4/9/14 Amount Paid 365.00
Received By SB Cash/Check No. 8347

White - Health Department Yellow - Engineer Pink - Building & Safety

Tank just over 50 ft from well