Lincoln-Lancaster County Health Department
Environmental Public Health Division (402) 441-8027
3140 N Street Lincoln, Nebraska 68510-1514

ON-SITE WASTE WATER SYSTEM
CONSTRUCTION - INSTALLATION PERMIT
No. HS000936

System Type: Standard

Situs: 11625 A ST, RURAL, NE

Issued: 7/22/2014

Expires: 7/22/2015

Description: STEINER ADDITION, Lot 2

Owner: REMBOLT DEVELOPMENT LTD
5831 S 58 ST STE A
LINCOLN, NE 68516

Judith A Halstead
Judith A. Halstead, MS, Health Director

Dear Applicant:

The above document is your permit to construct a new On-site Waste Water System at the location listed. Please contact this office once the sytem is complete in order to schedule a final inspection before use.

Judith A Halstead
Judith A. Halstead, MS
Health Director

RAYMOND CONTRACTING
13800 NW 70TH ST.
RAYMOND, NE 68428

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

A

Permit Number
HS000936

Onsite Wastewater Treatment System
Request for Site Clearance and Permit

Include Form B and C.
Submit correct fee
with this Application

3 acres or more required for: ☒ Septic System ☐ Lagoon ☐ Other (Refer to Form C)

The undersigned hereby requests site clearance and permit to construct a Wastewater Treatment System in conformance with appropriate regulations.

PLEASE PRINT OR TYPE

A. Onsite System Location

Address 11625 A St (no rural route) City Lincoln NE Zip 68510

Legal Description NE 31 16N 8E Sterner Add 2
1/4 1/4 Section Township Range Subdivison Addition Block Lot

PID 23-31-207-002-000

B. Owner

Name Rembolt Development LTD Signature [signature] 7/8/14

Address 5821 S 58th St Ste A City/State/Zip Lincoln, NE 68516

Home Phone _____ Work Phone 402-430-6510

C. Certified Installer

Name: Lloyd Jakubek, Raymond Contracting Inc Signature Ryan L. Jakubek for Lloyd

Address 13800 NW 76th St City/State/Zip Raymond NE 68428

Work Phone 402-890-6609

D. Engineer

☐ Check and complete if engineer designed system P.E. License Number: _____

Designer Name _____ Firm _____ Work Phone _____

E. This system will serve a

☒ Residential Dwelling Number of Bedrooms 2 Whirlpool Bathtub? ☐ Yes ☒ No Total Acres < 1

Garbage Grinder? ☒ Yes ☐ No Lot 7 357.59 ft W/39' X 80' Sewer Easement

☐ Commercial Establishment/Other Facility Specify _____ Design flow in gallons per day _____

Type of Wastewater ☐ Domestic ☐ Non-Domestic

DO NOT WRITE BELOW THIS LINE

Approval Process ☐ Municipal Code 24.38 ☐ County Resolution No. 02-80

1. Health Department
Site visits 6/22/15
Comments _____
Date rec'd 7/22/14
Date frwd 7/22/14
ACTION ☐ Approved ☐ Disapproved
Signature [signature]

2. Supt. Bldg. Insp. or Village Clerk
Comments _____
Date rec'd _____
Date frwd _____
ACTION ☐ Approved ☐ Disapproved
Signature _____

3. City or County Engineer
Comments _____
Date rec'd _____
Date frwd _____
ACTION ☐ Approved ☐ Disapproved
Signature _____

Installation Final Written Approval
By Doug Ambler
Date 6/25/15

Business Office Use Only
Date Received 7-21-14 Amount Paid 315.00
Received By SB Cash/Check No. 8427

White - Health Department Yellow - Engineer Pink - Building & Safety

JUN 26 2015

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

D

Permit Number: HS000936

Onsite Wastewater Treatment System

As Built Plans & Specifications

Steiner Add Lot 2

Date June 22, 2015 Legal Description NE 1/4 1/4 31-10N-8E Section Township Range

Onsite System Location

Address (no rural route) 11625 A St City Walton NE, Zip 68461

Owner Laurie Doan Address Same

A. Sewer Pipe

1. Material: SDR 26
   Diameter: 4 in.
2. Distance above basement floor: 6 in.
   or distance below basement floor: ~~0~~ in.
3. Distance between dwelling and septic tank: 24 ft.
4. Number of clean-outs: one
5. Distances to: well or suction line 70+ ft.
   stream 10 ft.
   pressure line 10 ft.
   property line 30 ft.

B. Septic Tank

☑ Label with Manufacturer, address and gallon capacity

1. Material: Concrete 1000
   Number of compartments: one
2. Capacity: 1000 gal.
3. Factory built: ☑ Yes ☐ No
4. Manholes: Over inlet, diameter 24 in.
   Over outlet, diameter 24 in.
   Riser: ☐ above ☐ below grade AT in.
5. Inlet: ☑ baffle ☐ tee ☐ 6" dia. inspection pipe
6. Outlet: ☑ baffle ☐ tee ☐ 6" dia. inspection pipe
7. Depth to top of tank, below unfinished grade: 18 in.
8. Distances to: Well or suction line 70 ft.
   Stream 100 ft.
   Pressure line 100 ft.
   Property line 30 ft.

C. ☑ Distribution Box ☐ Drop Boxes

(≥ 12" inspection opening) (removable lid to inspect)

1. Material: Plastic
   Number available outlets: 5
2. Factory built: ☑ Yes ☐ No
3. Distance from septic tank: 40' ft.

D. Drainfield Absorption


☑ Trench ☐ Bed ☐ Level Bottom


1. Type: ☐ Half rounds ☐ Perforated pipe ☐ Chambers
   Diameter or width:
   Number of distribution lines in bed
   Material: ☐ fiberglass ☑ plastic ☐ concrete
   ☐ other
2. Drainfield Laterals: Number 4
   Length of each line: 35 ft. 40 ft.
   45 ft. 55 ft., ft.
3. Drainfield dimensions: Width 40" ft.
   Distribution Pipe Slope Flat in/100 ft.
   Average depth 28-34 in
4. Filter material: Soil
   Depth of material 28-34 in.
5. Distances to: Well or suction line 100 ft.
   Pressure line 30 ft.
   Property line 5 ft.
   House or building 40'+ ft.
   Lake or Stream 100' ft.

Complete As-Built drawing on the back fo this form.

Onsite Wastewater System Design (Example)

Indicate North with Arrow

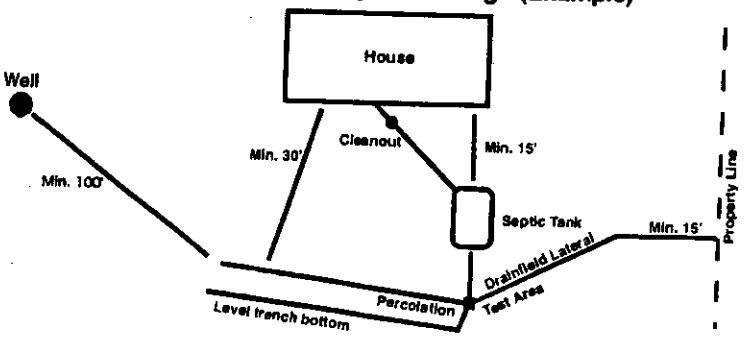

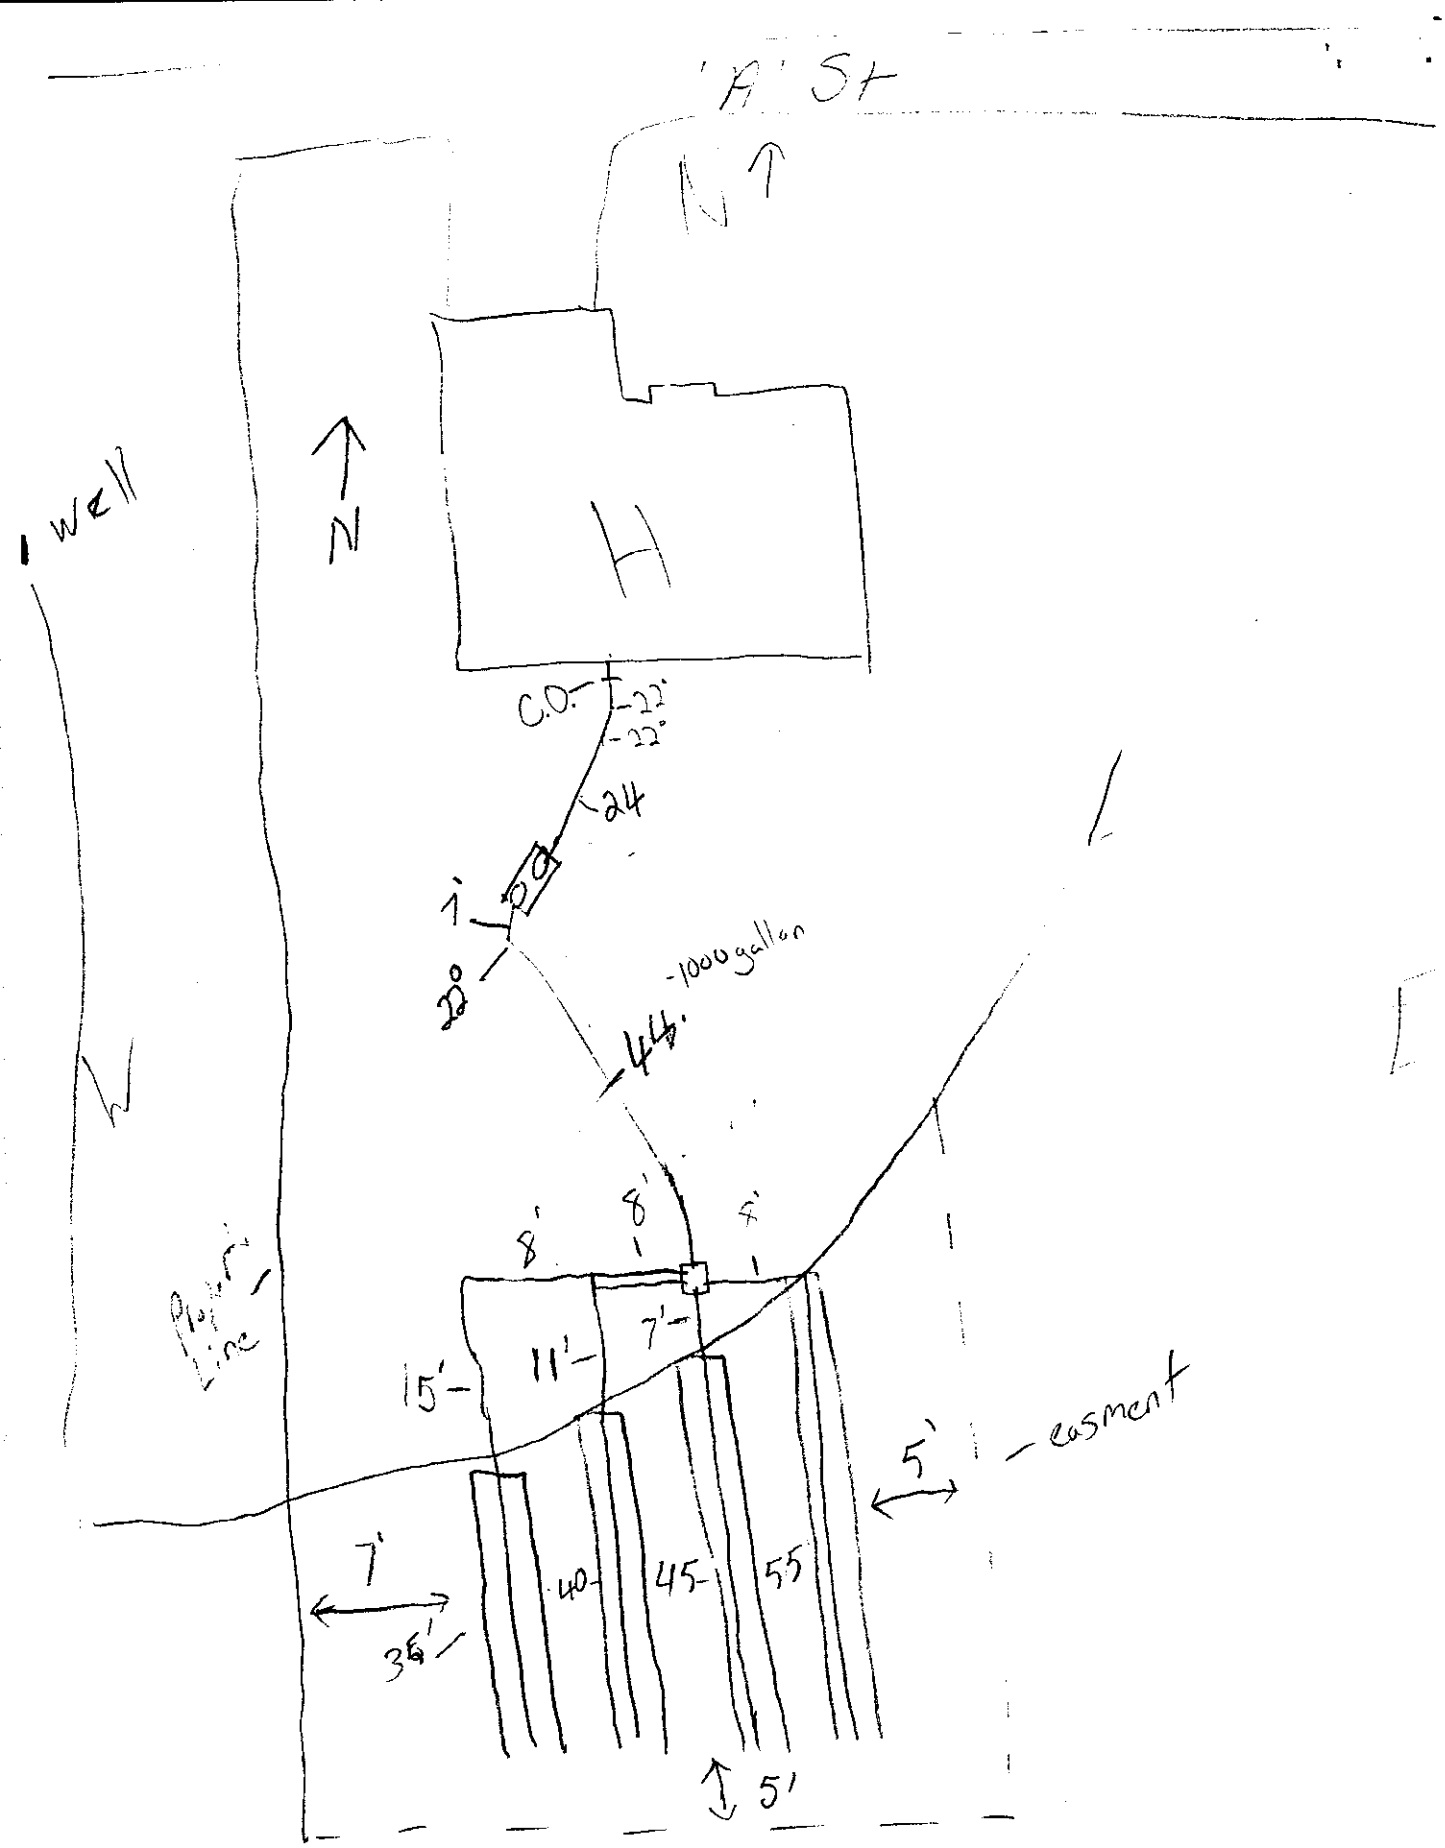
'A' St
N
N
H
well
C.O.
22'
22'
24
1'
20°
1000 gallon
44'
8'
8'
4'
15'
11'
7'
5'
easement
7'
35'
40
45
55
5'