Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

A

Permit Number
HS 001093

Onsite Wastewater Treatment System
Request for Site Clearance and Permit

Include Form B and C. Submit correct fee with this Application

3 acres or more required for: ☒ Septic System ☐ Lagoon ☐ Other (Refer to Form C)

The undersigned hereby requests site clearance and permit to construct a Wastewater Treatment System in conformance with appropriate regulations.

PLEASE PRINT OR TYPE

A. Onsite System Location

Address Wyndam Place 4th Addition (no rural route) City _____, NE Zip _____

Legal Description _____

1/4 1/4 Section Township Range Subdivison Addition Block Lot

PID 23-24-108-001-000

B. Owner

Name Korby Gilbertson Signature _____

Address 3515 Woods Ave City/State/Zip _____

Home Phone _____ Work Phone _____

C. Certified Installer

Name: Nathan Peterson Signature _____

Address 7701 Cornhusker Hwy #5 City/State/Zip Lincoln NE 68507

Work Phone 402-202-8130

D. Engineer

☐ **Check and complete if engineer designed system** P.E. License Number: _____

Designer Name _____ Firm _____ Work Phone _____

E. This system will serve a

☒ Residential Dwelling Number of Bedrooms 5 Whirlpool Bathtub? ☒ Yes ☐ No Total Acres 1.65

Garbage Grinder? ☒ Yes ☐ No

☐ Commercial Establishment/Other Facility Specify _____ Design flow in gallons per day _____

Type of Wastewater ☐ Domestic ☐ Non-Domestic

DO NOT WRITE BELOW THIS LINE

Approval Process ☐ Municipal Code 24.38 ☐ County Resolution No. 02-30

1. Health Department
Site visits _____ Date rec'd _____ Date frwd _____
Comments _____
ACTION ☐ Approved ☐ Disapproved
Signature _____

2. Supt. Bldg. Insp. or Village Clerk
Comments _____ Date rec'd _____ Date frwd _____
ACTION ☐ Approved ☐ Disapproved
Signature _____

3. City or County Engineer
Comments _____ Date rec'd _____ Date frwd _____
ACTION ☐ Approved ☐ Disapproved
Signature _____

Installation Final Written Approval
By _____
Date _____

Business Office Use Only
Date Received 7-6-15 Amount Paid 375.00
Received By SB Cash/Check No. 4915

White - Health Department Yellow - Engineer Pink - Building & Safety

Lincoln-Lancaster County Health Department (LLCHD)
Environmental Public Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

B

Permit Number: HS001093

Onsite Wastewater Treatment System

Soil Evaluation Report

PLEASE PRINT OR TYPE

Onsite System Location

Address Wyndam Place 4th Addition (no rural route) City PFD 23-24-108-001-000 NE, Zip

Owner Kirby Gilbertsen Address

Date of Tests 6/27 to 6/28 Weather: Precipitation None Temperature 90±

Percolation Test Data Table

A.	B.	C.	D.	E.	F.	G.	H.	I.	J.	K.	L.	M.	N.
		Saturation/Swelling Time				Water Level Drop Last 30 mins of 4 hr or last 10 mins of 1 hr					Results		
		Start		End		Start		Initial	End				
Hole No.	Hole Depth (in)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Water Lev (in.)	Date (Mo/Da)	Time (Hr/Min)	Elapsed Time Interval	Water Level Drop (in)	Percolation Rates (Min/in = mpi)
1	37	6/27	8:00A	6/28	8:00	6/28	8:30	6	6/28	12:00	30	1¼	24
2	36	6/27	8:00A	6/28	8:00	6/28	8:30	6	6/28	12:00	30	1	30
3	38	6/27	8:00	6/28	8:00	6/28	8:30	6	6/28	12:00	30	1	30
4	40	6/27	8:00	6/28	8:00	6/28	8:30	6	6/28	12:00	30	3/4	40
5	37	6/27	8:00	6/28	8:00	6/28	8:30	6	6/28	12:00	30	3/4	40
6	36	6/27	8:00	6/28	8:00	6/28	8:30	6	6/28	12:00	30	3/4	40
								6					
								6					

Person Conducting Percolation Test

Name: Claude Oie PE-3539
Phone: 402-486-4444
Address 6645 S. 66 St.
Lincoln, Ne. 68516
Soil type (NRCS Maps/Other) Silty Clay
Groundwater Depth None at 7'

Sum of Percolation Rates: 204
Average of Rates: 34
Rate Used for Calculation: Recommend 40

DO NOT WRITE BELOW THIS LINE

Reviewing Action


Comments (Soil type, groundwater, floodplain, etc.)

Signature of Reviewing Official Date

te Form B 12_06

WYNDAM PLACE 4TH ADDITION

FINAL PLAT
BASED ON COUNTY SPECIAL PERMIT #198COA

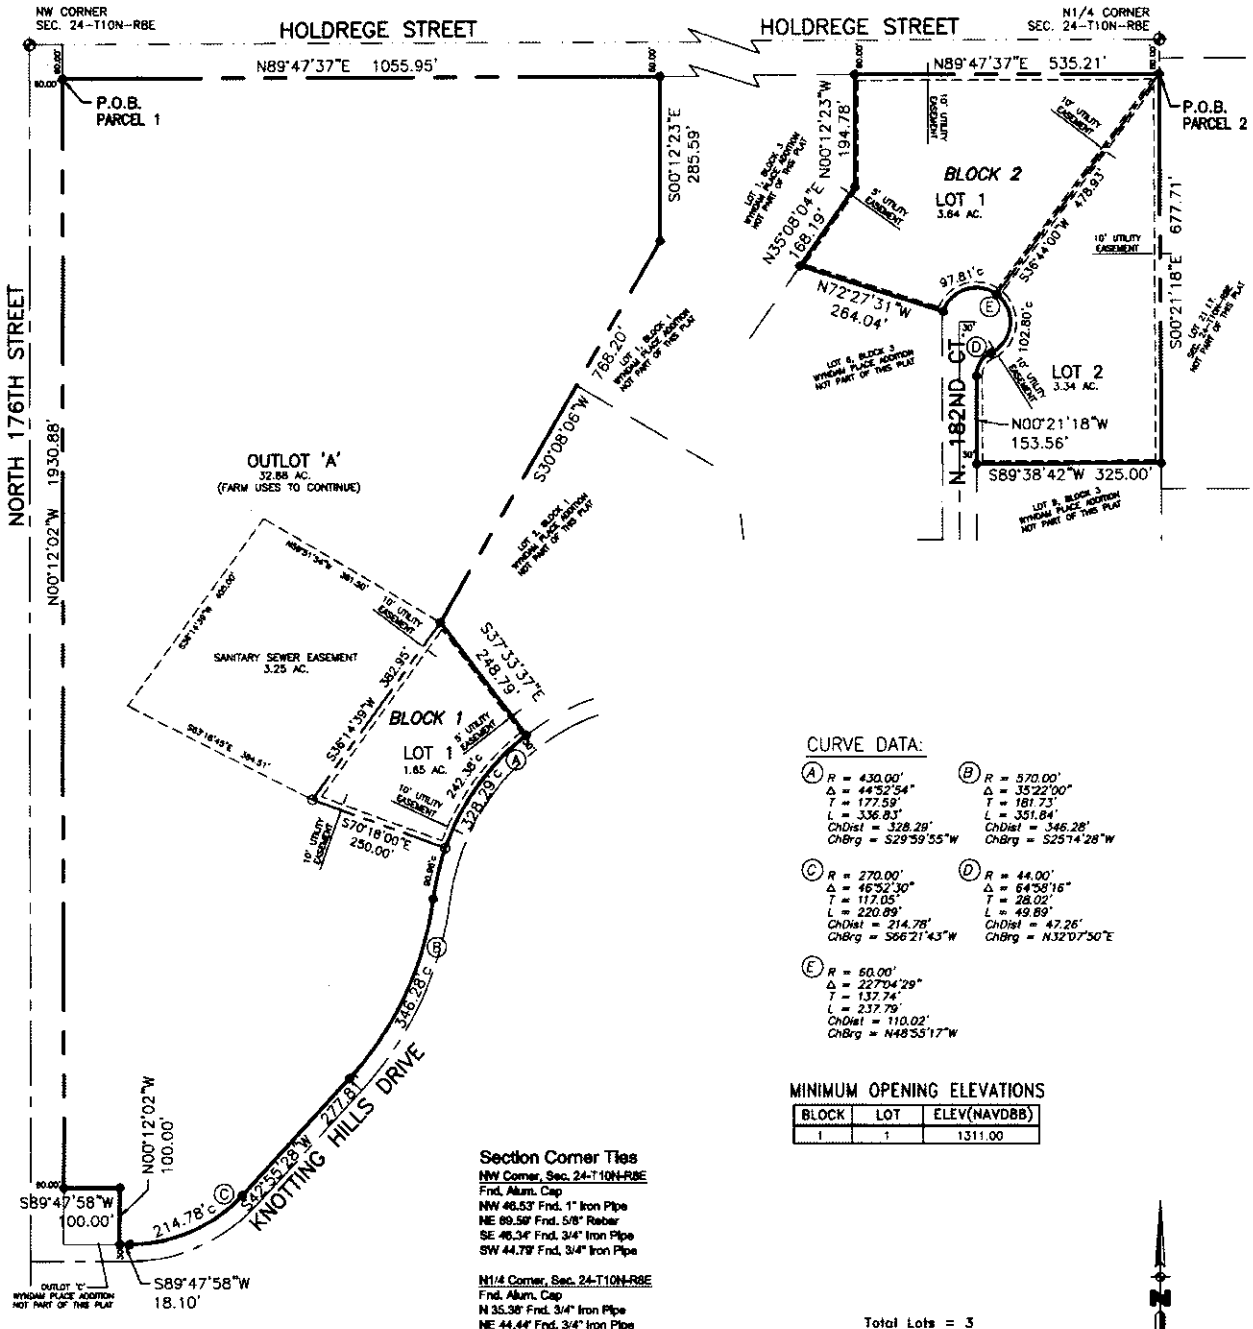

CURVE DATA:

(A) R = 430.00'
Δ = 44°52'54"
T = 177.59'
L = 336.83'
ChDist = 328.29'
ChBrg = S29°59'55"W

(B) R = 570.00'
Δ = 35°22'00"
T = 181.73'
L = 351.84'
ChDist = 346.28'
ChBrg = S25°14'28"W

(C) R = 270.00'
Δ = 46°52'30"
T = 117.05'
L = 220.89'
ChDist = 214.78'
ChBrg = S66°21'43"W

(D) R = 44.00'
Δ = 64°58'16"
T = 28.02'
L = 49.89'
ChDist = 47.26'
ChBrg = N32°07'50"E

(E) R = 60.00'
Δ = 227°04'29"
T = 137.74'
L = 237.79'
ChDist = 110.02'
ChBrg = N48°55'17"W

MINIMUM OPENING ELEVATIONS

BLOCK	LOT	ELEV(NAVD88)
1	1	1311.00

Section Corner Ties

NW Corner, Sec. 24-T10N-R8E
Fnd. Alum. Cap
NW 46.53' Fnd. 1" Iron Pipe
NE 89.58' Fnd. 5/8" Rebar
SE 46.34' Fnd. 3/4" Iron Pipe
SW 44.79' Fnd. 3/4" Iron Pipe

N1/4 Corner, Sec. 24-T10N-R8E
Fnd. Alum. Cap
N 35.38' Fnd. 3/4" Iron Pipe
NE 44.44' Fnd. 3/4" Iron Pipe
SE 78.30' Fnd. 2" Galv. Iron Pipe
S 33.00' Fnd. 1" Pipe

Total Lots = 3
Total Outlots = 1
Total Acres = 41.51

SCALE: 1" = 150'

LEGEND

● CORNER FOUND (5/8" Rebar)
○ CORNER SET (3/4" X 24" BAR W/ CAP)

Lincoln-Lancaster County Health Department
Environmental Public Health Division (402) 441-8027
3140 N Street Lincoln, Nebraska 68510-1514

ON-SITE WASTE WATER SYSTEM
CONSTRUCTION - INSTALLATION PERMIT
No. HS001093

System Type: Standard

Situs: No Site Address Specified

Issued: 7/8/2015

Expires: 7/8/2016

Description: WYNDAM PLACE 4TH ADDITION, BLOCK 1, Lot 1

Owner: GILBERTSON, KORBY M
3515 WOODS AVE
LINCOLN, NE 68510

Judith A Halstead
Judith A. Halstead, MS, Health Director

Dear Applicant:

The above document is your permit to construct a new On-site Waste Water System at the location listed. Please contact this office once the sytem is complete in order to schedule a final inspection before use.

Judith A Halstead
Judith A. Halstead, MS
Health Director

INFINITY EXCAVATING LLC
7701 CORNHUSKER HWY STE 5
LINCOLN, NE 68507