Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

A

Permit Number HS001246

Onsite Wastewater Treatment System
Request for Site Clearance and Permit

Include Form B and C. Submit correct fee with this Application

3 acres or more required for: ☐ Septic System ☒ Lagoon ☐ Other (Refer to Form C)

The undersigned hereby requests site clearance and permit to construct a Wastewater Treatment System in conformance with appropriate regulations.

PLEASE PRINT OR TYPE

A. Onsite System Location 6295 Basin Creek Rd. SB

Address South 64th Court (no rural route) City Hickman, NE Zip

Legal Description Poe Estates 2 7

1/4 1/4 Section Township Range Subdivison Addition Block Lot

Geographical Location (if known): Lat/Long: 14e 04e 202-007 PID 14-04-202-007-000 SB

B. Owner

Name Signature

Address City/State/Zip

Home Phone Work Phone

C. Certified Installer

Name: Earnest Well Drilling Inc. Signature

Address P.O. Box 14 City/State/Zip Milford, NE 68405

Work Phone 402-761-7281

D. Engineer ☐ Check and complete if engineer designed system P.E. License Number:

Designer Name Firm Work Phone

E. This system will serve a

☒ Residential Dwelling Number of Bedrooms 3 Is there a Whirlpool Bathtub? ☐ Yes ☐ No Garbage grinder ☐ Yes Total Acres 5.0

☐ Commercial Establishment/Other Facility Specify Design flow in gallons per day

Type of Wastewater ☒ Domestic ☐ Non-Domestic Well Permit Applied for ☐ Yes ☐ No ☒ Not Applicable

DO NOT WRITE BELOW THIS LINE

Approval Process ☐ Municipal Code 24.38 ☐ County Resolution No. 02-30

1. Health Department
Site visits
Date rec'd
Date frwd
ACTION ☐ Approved ☐ Disapproved
Signature

2. Supt. Bldg. Insp. or Village Clerk
Comments
Date rec'd
Date frwd
ACTION ☐ Approved ☐ Disapproved
Signature

3. City or County Engineer
Comments
Date rec'd
Date frwd
ACTION ☐ Approved ☐ Disapproved
Signature

Installation Final Written Approval
By
Date

Business Office Use Only
Date Received 5-23-16 Amount Paid $385
Received By SB Cash/Check No. 1843

White - Health Department Yellow - Engineer Pink - Building & Safety

Form A Updated: 5/10


Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

Permit Number: HS001246

Onsite Wastewater Treatment System

Preliminary Plan Specifications

Draw a plot plan showing onsite system sewer lines, drop of distribution boxes, tank, drainfields, percolation test holes, well, residence, direction of groundwater flow, property lines, and reserve area for replacement onsite system.

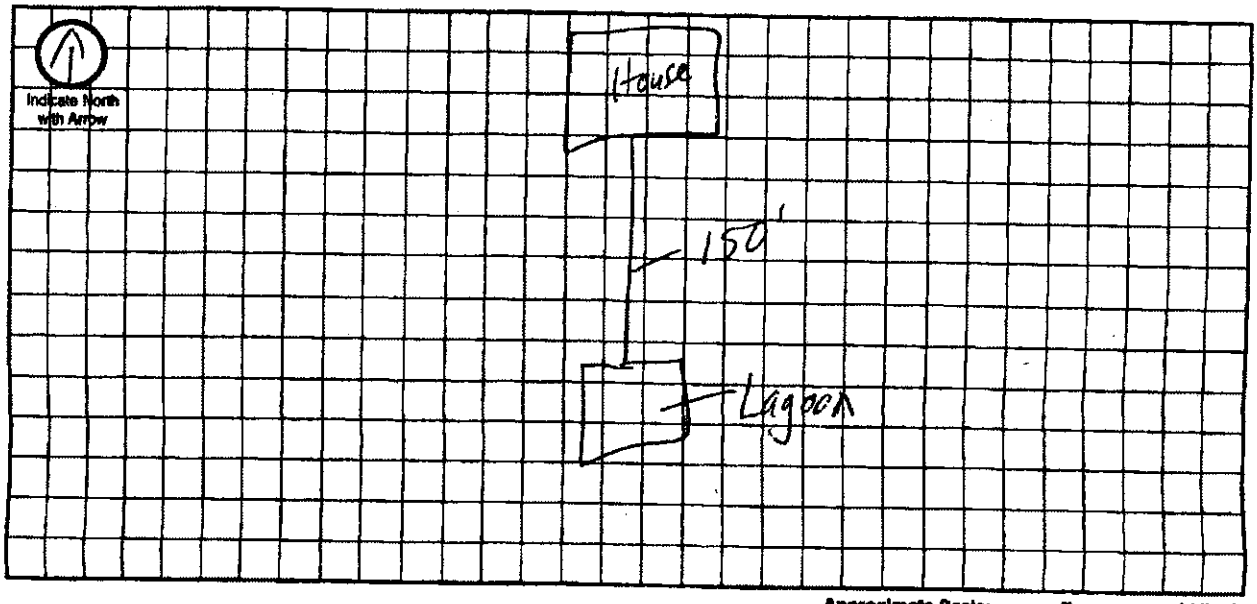

Approximate Scale: _____ ft. = _____ grid line/s

A. Onsite System Location

Address (no rural route) _____ City _____ NE, Zip _____

B. Proposed Septic Tank/s

Septic Tank Cap._____ gals Tank Material: ☐ Concrete ☐ Plastic ☐ Other_____ ☐ Lagoon(Max. seepage 1/8" per day)

C. Reserve Area for Replacement Onsite System

☐ Drainfield Absorption Area (percolation test required) ☒ Lagoon

D. Drainfield Absorption System

Percolation Rate_____ (min/inch = mpi) No. of Bedrooms_____ Soil Type_____ Land Slope_____%

☐ Trench ☐ Bed ☐ Non-Standard (engineer designed and NDEQ approved Total Square feet of drainfield_____sq.ft.

Total length of laterals_____ Type of distribution: ☐ Perforated pipe ☐ Half-Round ☐ Chamber ☐ Other

No. of absorption trenches_____ Width_____ No. of drop boxes_____ Distrubtion Box_____

No. of absorption beds_____ Width_____ No of Distribution lines per bed_____

E. Setbacks Check the Boxes Below if the Required Setback has been Satisfied

Distance From	Private Well	Public Well	Surface Water	Gound Water	Pressure Water Lines	Property Lines	Foundations Yours	Foundations Neighbors	All Other Setbacks
Tank (ft)	50 ☐	500 ☐	50 ☐	NA ☐	25 ☐	20 ☐	15 ☐	25 ☐	☐
Field (ft)	100 ☐	500 ☐	50 ☐	4 ☐	30 ☐	20 ☐	30 ☐	40 ☐	☐
Lagoon (ft)	100 ☐	500 ☐	50 ☐	N/A ☐	30 ☐	50 ☐	100 ☐	200 ☐	☐

F. Required Signatures

Home Building Contractor _____ Date _____

Installer _____ Date 4/22/16

Onsite Form C (2-08)

Lincoln-Lancaster County Health Department
Environmental Public Health Division (402) 441-8027
3140 N Street Lincoln, Nebraska 68510-1514

ON-SITE WASTE WATER SYSTEM
CONSTRUCTION - INSTALLATION PERMIT
No. HS001246

System Type: Lagoon

Situs: No Site Address Specified

Description: POE ESTATES, BLOCK 2, Lot 7

Issued: 5/6/2016

Expires: 5/6/2017

Owner: FIRST STATE BANK NEBRASKA
ATTN: MIRANDA HOBELMAN 5617
THOMPSON CREEK BLVD
LINCOLN, NE 68516

Judith A Halstead

Judith A. Halstead, MS, Health Director

Dear Applicant:

The above document is your permit to construct a new On-site Waste Water System at the location listed. Please contact this office once the sytem is complete in order to schedule a final inspection before use.

Judith A Halstead

Judith A. Halstead, MS
Health Director

DON JOHNSON HOMES II INC
5901 NORTH 27TH ST
LINCOLN, NE 68521

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

Exhibit 6

Permit Number: 17500 1246

Onsite Wastewater Treatment System-Lagoon

Inspection Sheet

Date 10/19/16 Legal Description ¼ Joe Estates Blk 2, Lot 7 ¼ Section/Township/Range

Onsite System Location

Address (no rural route) 6295 Bass Creek City _____

Owner _____ Address _____

Mark One: ☐ Dwelling ☐ Non-dwelling

☒ New System ☐ Repair

☐ Temporary modification (Describe problem causing discharge and reason for temporary modification): _____

Lagoon constructed so not to receive surface water	Yes X No___
Lagoon floor is level	Yes X No___
Lagoon is equipped with a depth gage/concrete slab	Yes___ No___ N/O
Influent line is at least 4 inches and slopes no less than 1/8 inch	
Clean outs located every 75 feet and one located 1 foot about highest water level	Yes___ No___ N/O
Inside slope not steeper than three horizontal to one vertical	Yes X No___
Minimum width of the top of the dike shall be 4 feet	Yes X No___
Fence installed	Yes___ No X Fence Complete 5/12/17

Top of the Dike 29 Bottom of Lagoon 23 Design Flow 300 gpd

Setbacks (Check the Boxes Below if the Required Setback has been Satisfied):

Surface Water distance from Water Mark	Private Drinking Water Wells	Public Drinking Water Supply Wells		All Other Water Wells	Property Lines	Trees and Brush	Neighbor's Foundation		All Other Setbacks
50 ft ☐	100 ft ☒	Non-Community	100ft ☐	100ft ☐	50ft ☐	50ft ☐	Class 1	200ft ☒	☐
		Community	* ☒				Class 2	200ft ☐	
							Class 3	100ft ☐	

*Evaluated by a professional engineer for potential impact on the well and submitted to Dept. for approval if less than 1000ft.

Geographical Coordinates to 6 Decimals: _____

Dike North side

Comments: Use a Lagoon - 10/20/16

Inspections prior to Final Approval
Initial NH Date 10/27/16
Follow-Up DS Date 5/12/17
Follow-Up _____ Date _____

Installation Final Written Approval
By Doug Mues
Date 5/12/17

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

dlc 5/15/17

D Exhibit 4

Permit Number: 1246

Onsite Wastewater Treatment System
As-Built Description and Drawing

Type of Onsite Wastewater System: ☒ Lagoon (Skip to Back Page) ☐ Subsurface Septic ☐ Mound

Onsite Wastewater System Location

Address or Legal Description or Parcel Identification Number (PID) 6295 Bass Creek Rd

Owner: Matt & Cami Hollins Address 3180 S. 72nd St. Apt. 269 Lincoln, NE 68506

A. Wastewater Piping

1. Material: PVC Diameter: 4 in.
2. Distance between dwelling and septic tank: _____ ft.

B. Septic Tank

1. Material _____
2. Capacity: _____
3. Depth to top of tank, below unfinished grade: ____ in.
4. Distance to:
   Well _____ ft.
   Pressure line _____ ft
   Property Line _____ ft.
   Foundation _____ ft.

C Distribution Box or Drop Box

Distance and Direction from septic tank: _____ ft. _____

D. Drainfield/Absorption Field

☐ Trench ☐ Bed

1. Type: ☐ Perforated Pipe ☐ Chamberless ☐ Other
   Material brand and inside width of Chamberless: _____
2. Number of Laterals: _____
3. Length of each lataral (linear): ft._____ ft._____ ft._____ ft._____
4. Drainfield size: _____ sq. ft.
5. Distance to:
   Well _____ ft.
   Pressure line _____ ft.
   Property line _____ ft.
   Depth of Groundwater _____

Was the Onsite Wastewater System covered prior to LLCHD inspection? ☒ Yes ☐ No

If Yes, the Certified Professional must sign below for final approval:

I swear and affirm that the system complies with Lincoln Municipal Code (LMC) 24.38 and/or County Resolution R-13-0062 requirements and that the information and documentation submitted are true and accurate.


Certified Professional Signature: _____ Date: 10/18/16

Complete As-Built drawing on the back of this form.

Owner
Matt & Kari Collins

EARNEST WELL DRILLING INC.
P.O. Box H
MILFORD, NE 68405
761-2281 475-3276

DATE 10/18/16

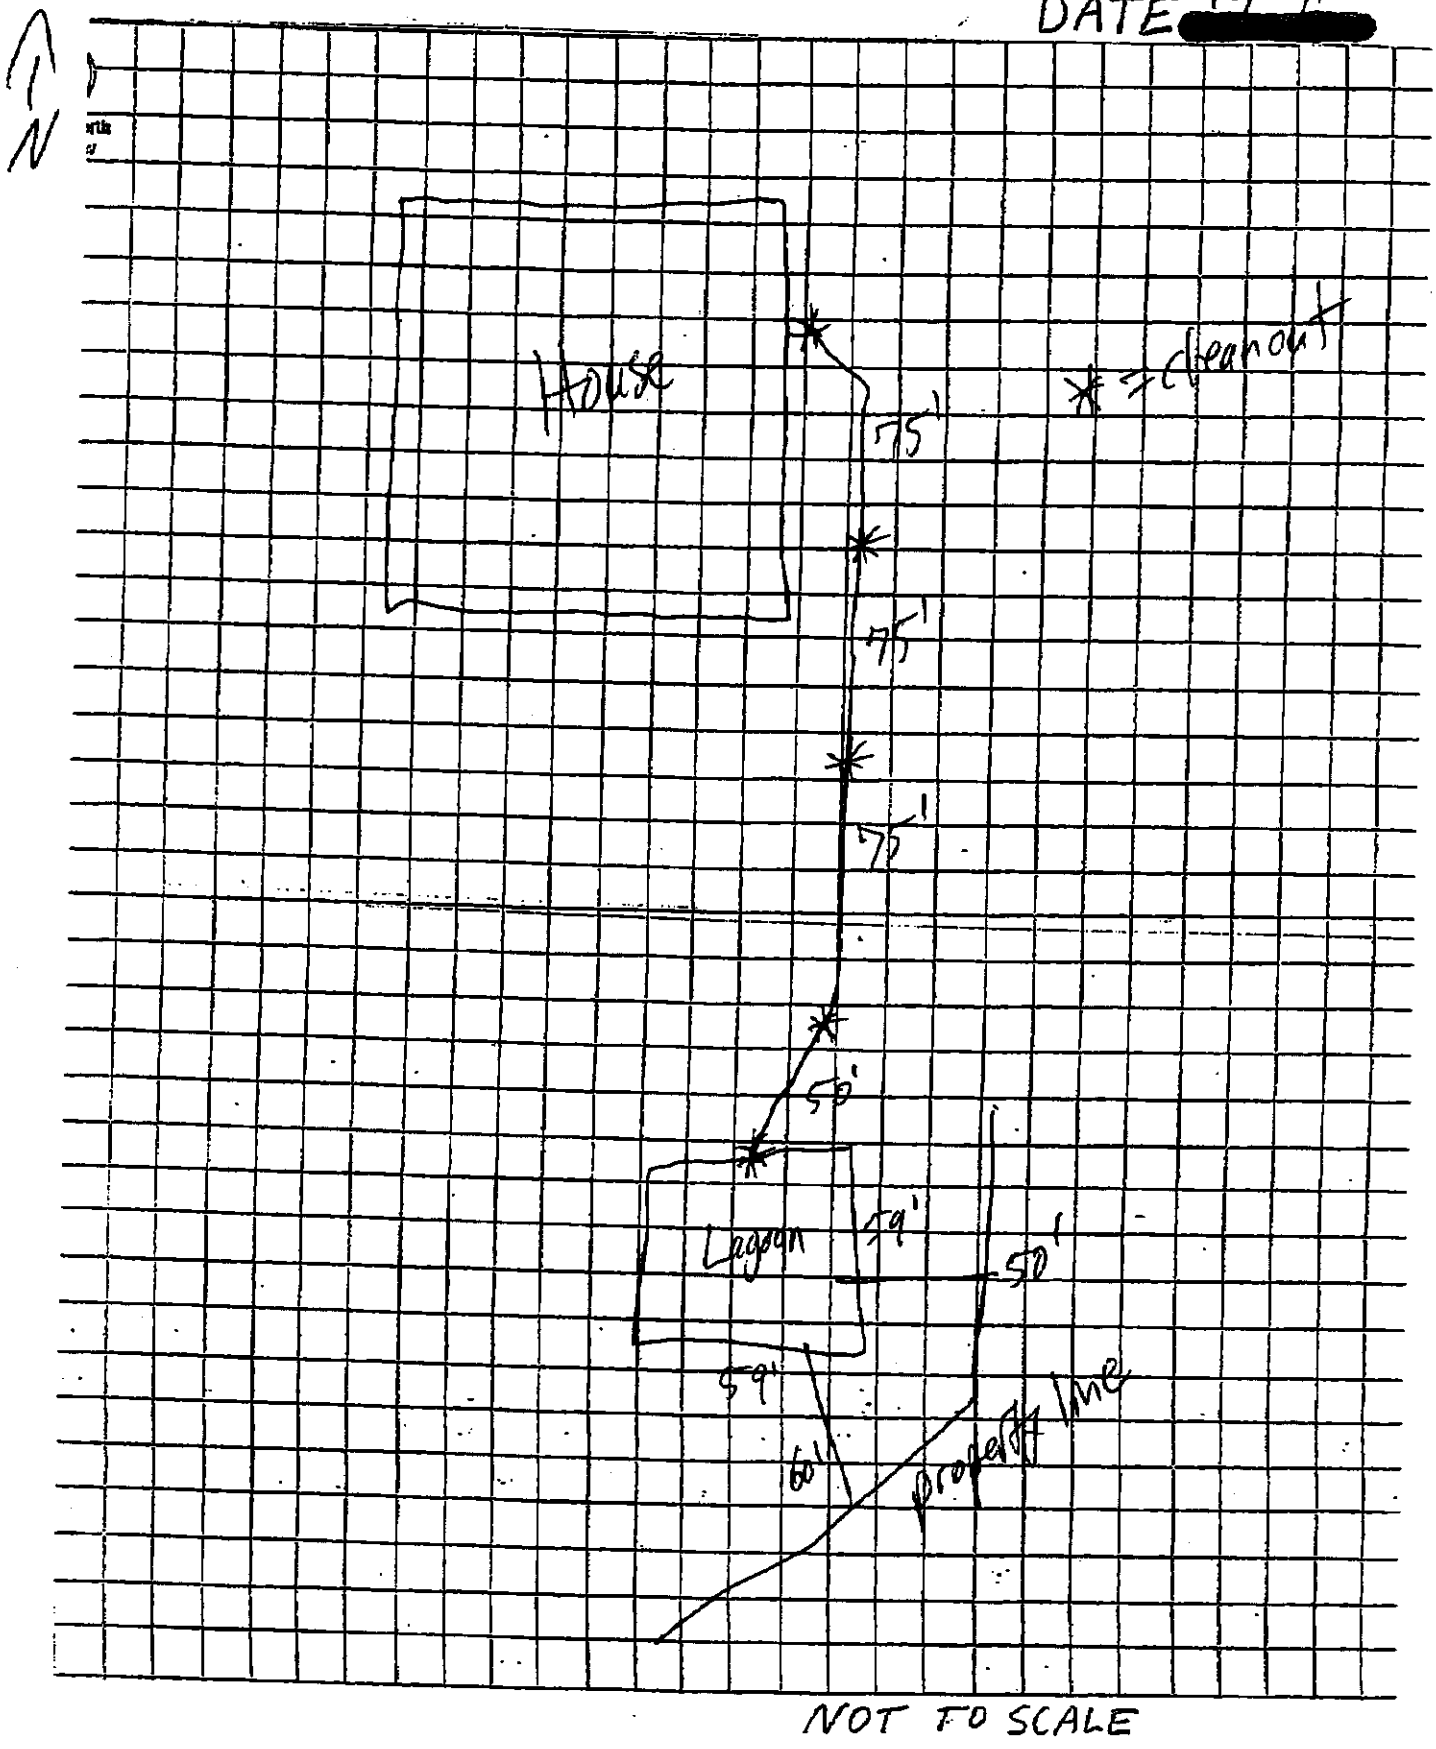

Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

SCANNED

A

Permit Number HS001246

Onsite Wastewater Treatment System
Request for Site Clearance and Permit

Include Form B and C.
Submit correct fee
with this Application

3 acres or more required for: ☐ Septic System ☒ Lagoon ☐ Other (Refer to Form C)

The undersigned hereby requests site clearance and permit to construct a Wastewater Treatment System in conformance with appropriate regulations.

PLEASE PRINT OR TYPE

A. Onsite System Location 6295 Bass Creek Rd. SB

Address South 64th Court (no rural route) City Hickman, NE Zip

Legal Description 4 7 9 Poe Estates 2 7

1/4 | 1/4 | Section | Township | Range | Subdivison | Addition | Block | Lot

Geographical Location (if known): Lat/Long: ~~14e 04e 202 007~~ PID 14-04-202-007-000 SB

B. Owner

Name Signature

Address City/State/Zip

Home Phone Work Phone

C. Certified Installer

Name: Earnest Well Drilling Inc. Signature

Address P.O. Box 14 City/State/Zip Milford, NE 68405

Work Phone 402-761-2281

D. Engineer ☐ Check and complete if engineer designed system P.E. License Number:

Designer Name Firm Work Phone

E. This system will serve a

☒ Residential Dwelling Number of Bedrooms 3 Garbage grinder ☐ Yes Is there a Whirlpool Bathtub? ☐ Yes ☐ No Total Acres 5.0

☐ Commercial Establishment/Other Facility Specify Design flow in gallons per day

Type of Wastewater ☒ Domestic ☐ Non-Domestic Well Permit Applied for ☐ Yes ☐ No ☒ Not Applicable

DO NOT WRITE BELOW THIS LINE

Approval Process ☐ Municipal Code 24.38 ☐ County Resolution No. 02-30

1. Health Department
Site visits Final Lagoon, 5/12/16 Ken
Date rec'd 5/6/16
Date frwd 5/6/16
ACTION ☒ Approved ☐ Disapproved
Signature

2. Supt. Bldg. Insp. or Village Clerk
Comments
Date rec'd
Date frwd
ACTION ☒ Approved ☐ Disapproved
Signature

3. City or County Engineer
Comments
Date rec'd
Date frwd
ACTION ☐ Approved ☐ Disapproved
Signature

Installation Final Written Approval
By
Date 5/12/16

Business Office Use Only
Date Received 5-3-16 Amount Paid $385
Received By SB Cash/Check No. 1843

White - Health Department Yellow - Engineer Pink - Building & Safety

Form A Updated: 5/10