JUN 2 0 2016

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

A

Permit Number HS001290

Existing Home

Onsite Wastewater Treatment System
Request for Site Clearance and Permit

Include Form B and C. Submit correct fee with this Application

3 acres or more required for: ☒ Septic System ☐ Lagoon ☐ Other (Refer to Form C)

The undersigned hereby requests site clearance and permit to construct a Wastewater Treatment System in conformance with appropriate regulations.

PLEASE PRINT OR TYPE

A. Onsite System Location

Address 5930 S 114th St (no rural route) City Lincoln, NE Zip 68526

Legal Description N 1/2 (1/4) 18 (1/4) 9N (Section) 8E (Township) Whispering Creek (Range) 2 (Subdivison) 4 (Addition) (Block) (Lot)

PID 22-18-200-004-000

B. Owner

Name John Klimpel Signature [signature]

Address 5930 S 114th St City/State/Zip Lincoln, NE 68526

Home Phone 402-730-0122 Work Phone

C. Certified Installer

Name: Lloyd Jakoubek, Raymond Contracting Inc Signature [signature]

Address 13800 NW 70th St City/State/Zip Raymond, NE 68428

Work Phone 402-890-6009 or 402-783-2663

D. Engineer ☐ Check and complete if engineer designed system P.E. License Number:

Designer Name Firm Work Phone

E. This system will serve a

☒ Residential Dwelling Number of Bedrooms 4 Whirlpool Bathtub? ☒ Yes ☐ No Total Acres 4.46

Garbage Grinder? ☒ Yes ☐ No

☐ Commercial Establishment/Other Facility Specify Design flow in gallons per day

Type of Wastewater ☐ Domestic ☐ Non-Domestic

DO NOT WRITE BELOW THIS LINE

Approval Process ☐ Municipal Code 24.38 ☐ County Resolution No. 02-30

1. Health Department

Site visits Date rec'd ACTION ☐ Approved ☐ Disapproved

Date frwd Signature

Comments

2. Supt. Bldg. Insp. or Village Clerk

Comments Date rec'd ACTION ☐ Approved ☐ Disapproved

Date frwd Signature

3. City or County Engineer

Comments Date rec'd ACTION ☐ Approved ☐ Disapproved

Date frwd Signature

Installation Final Written Approval

By

Date

Business Office Use Only

Date Received 6-20-16 Amount Paid 91385

Received By SB Cash/Check No. 8931

White - Health Department Yellow - Engineer Pink - Building & Safety

Form A Updated: 1/13

JUN 2 0 2016

B

Lincoln-Lancaster County Health Department
Environmental Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

Permit Number: HS001290

Sewage Disposal System
Soil Absorption Test Data Report
Annex to Application

PLEASE PRINT OR TYPE

System Location (Indicate correct number and street)

Address 5990 So. 114th St (no rural route) City Lincoln NE, Zip _____

Owner John Klimpel Address _____

Soil Type (SCS): _____ Percolation Rate: _____ min./inch

Date of Tests 8-22 to 8-23 Weather: Precipitation _____ Temperature 92 °F

Percolation Test Data Table

A.	B.	C. D. E. F. Pre-Saturation Period				G. H. I. J. K. Percolation Readings					L. M. N. Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Water Lev (in.)	Date (Mo/Da)	Time (Hr/Min)	Elapsed Time (Min)	Water Level Drop (in)	Percolation Rates (Min/in)
1	22	8-22	10:00	8-22	4:00	8-23	10:00	8	8-23	10:00	30	1/4"	
2	23	↓	↓	↓	↓	↓	↓	↓	↓	↓	30	3/4"	40 MIN/IN
3	22										30	1/4"	20 MIN/IN
4	24										30	1/2"	20 MIN/IN
5	21										30	3/4"	40 MIN/IN
6	22										30	1 1/8"	27 MIN/IN
7	21	↓	↓	↓	↓	↓	↓	↓	↓	↓	30	7/8"	34 MIN/IN

Sum of Percolation Rates: 181
Average of Rates: 30
Rate Used for Calculation: 60

Person Conducting Percolation Tests

Name: Ryan Vahl
Phone: _____
Address _____

DO NOT WRITE BELOW THIS LINE

Reviewing Action

Remarks _____

Signature of Reviewing Official _____ Date _____

FORM 23-101 10-96

JUN 2 0 2016

C


Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

Permit Number: HS001290

Onsite Wastewater Treatment System

Preliminary Plan Specifications

Draw a plot plan showing onsite system sewer lines, drop of distribution boxes, tank, drainfields, percolation test holes, well, residence, direction of groundwater flow, property lines, and reserve area for replacement onsite system.

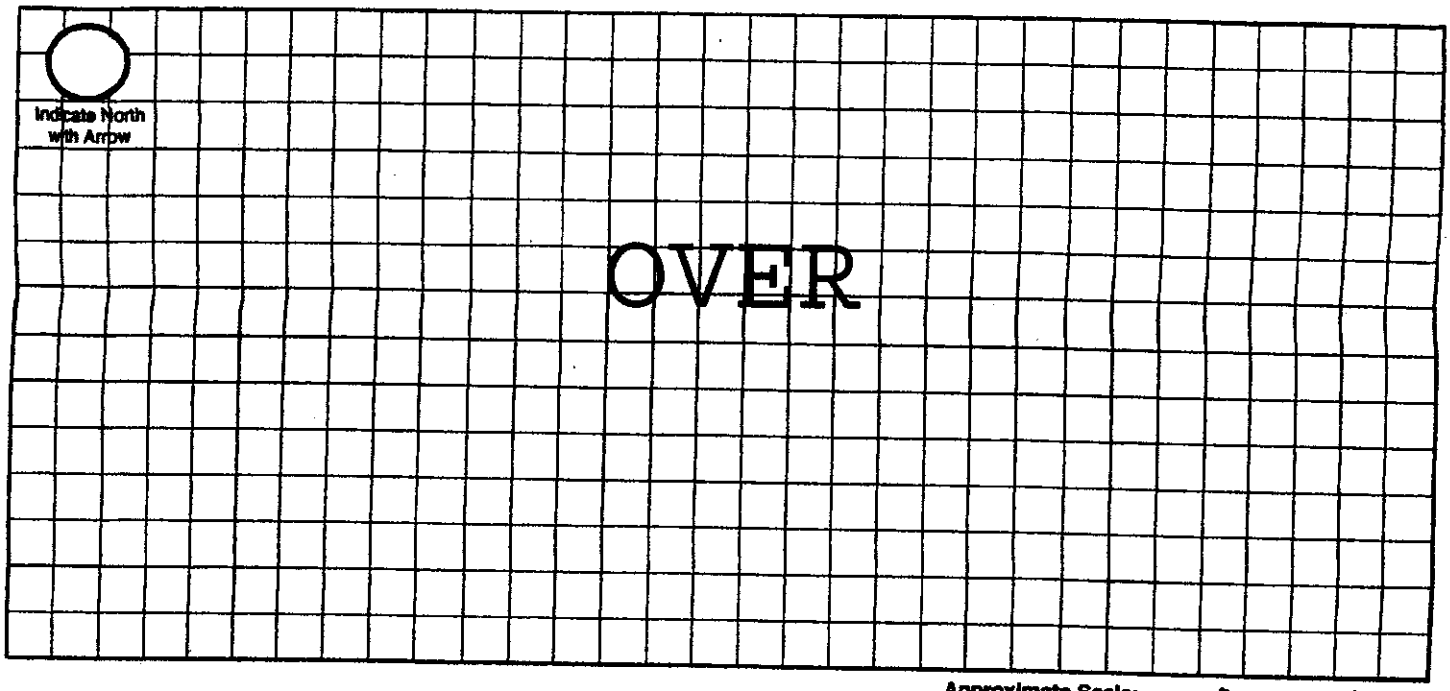

Approximate Scale: _____ ft. = _____ grid line/s

A. Onsite System Location

Address (no rural route) 5930 S 114th St City Lincoln NE, Zip 68526

B. Proposed Septic Tank/s

Septic Tank Cap. 2,000 gals Tank Material: ☒ Concrete ☐ Plastic ☐ Other_____ ☐ Lagoon(Max. seepage 1/8" per day)

C. Reserve Area for Replacement Onsite System

☐ Drainfield Absorption Area (percolation test required) ☒ Lagoon

D. Drainfield Absorption System

Percolation Rate 60 (min/inch = mpi) No. of Bedrooms 4 Soil Type Pawnee Clay Loam Land Slope_____%

☒ Trench ☐ Bed ☐ Non-Standard (engineer designed and NDEQ approved Total Square feet of drainfield 2,115 sq.ft.

Total length of laterals 470 Type of distribution: ☐ Perforated pipe ☐ Half-Round ☐ Chamber ☒ Other

No. of absorption trenches 4 Width 40" No. of drop boxes 1 Distrubtion Box Using EZFlow 1203H

No. of absorption beds_____ Width_____ No of Distribution lines per bed_____


E. Setbacks Check the Boxes Below if the Required Setback has been Satisfied

Distance From	Private Well	Public Well	Surface Water	Gound Water	Pressure Water Lines	Property Lines	Foundations Yours	Foundations Neighbors	All Other Setbacks
Tank (ft)	50 ☒	500 ☒	50 ☒	NA ☒	25 ☒	20 ☒	15 ☒	25 ☒	☒
Field (ft)	100 ☒	500 ☒	50 ☒	4 ☒	30 ☒	20 ☒	30 ☒	40 ☒	☒
Lagoon (ft)	100 ☐	500 ☐	50 ☐	N/A ☐	30 ☐	50 ☐	100 ☐	200 ☐	☐

F. Required Signatures

Home Building Contractor Existing Home Date _____

Installer [signature] Date 10/15/16

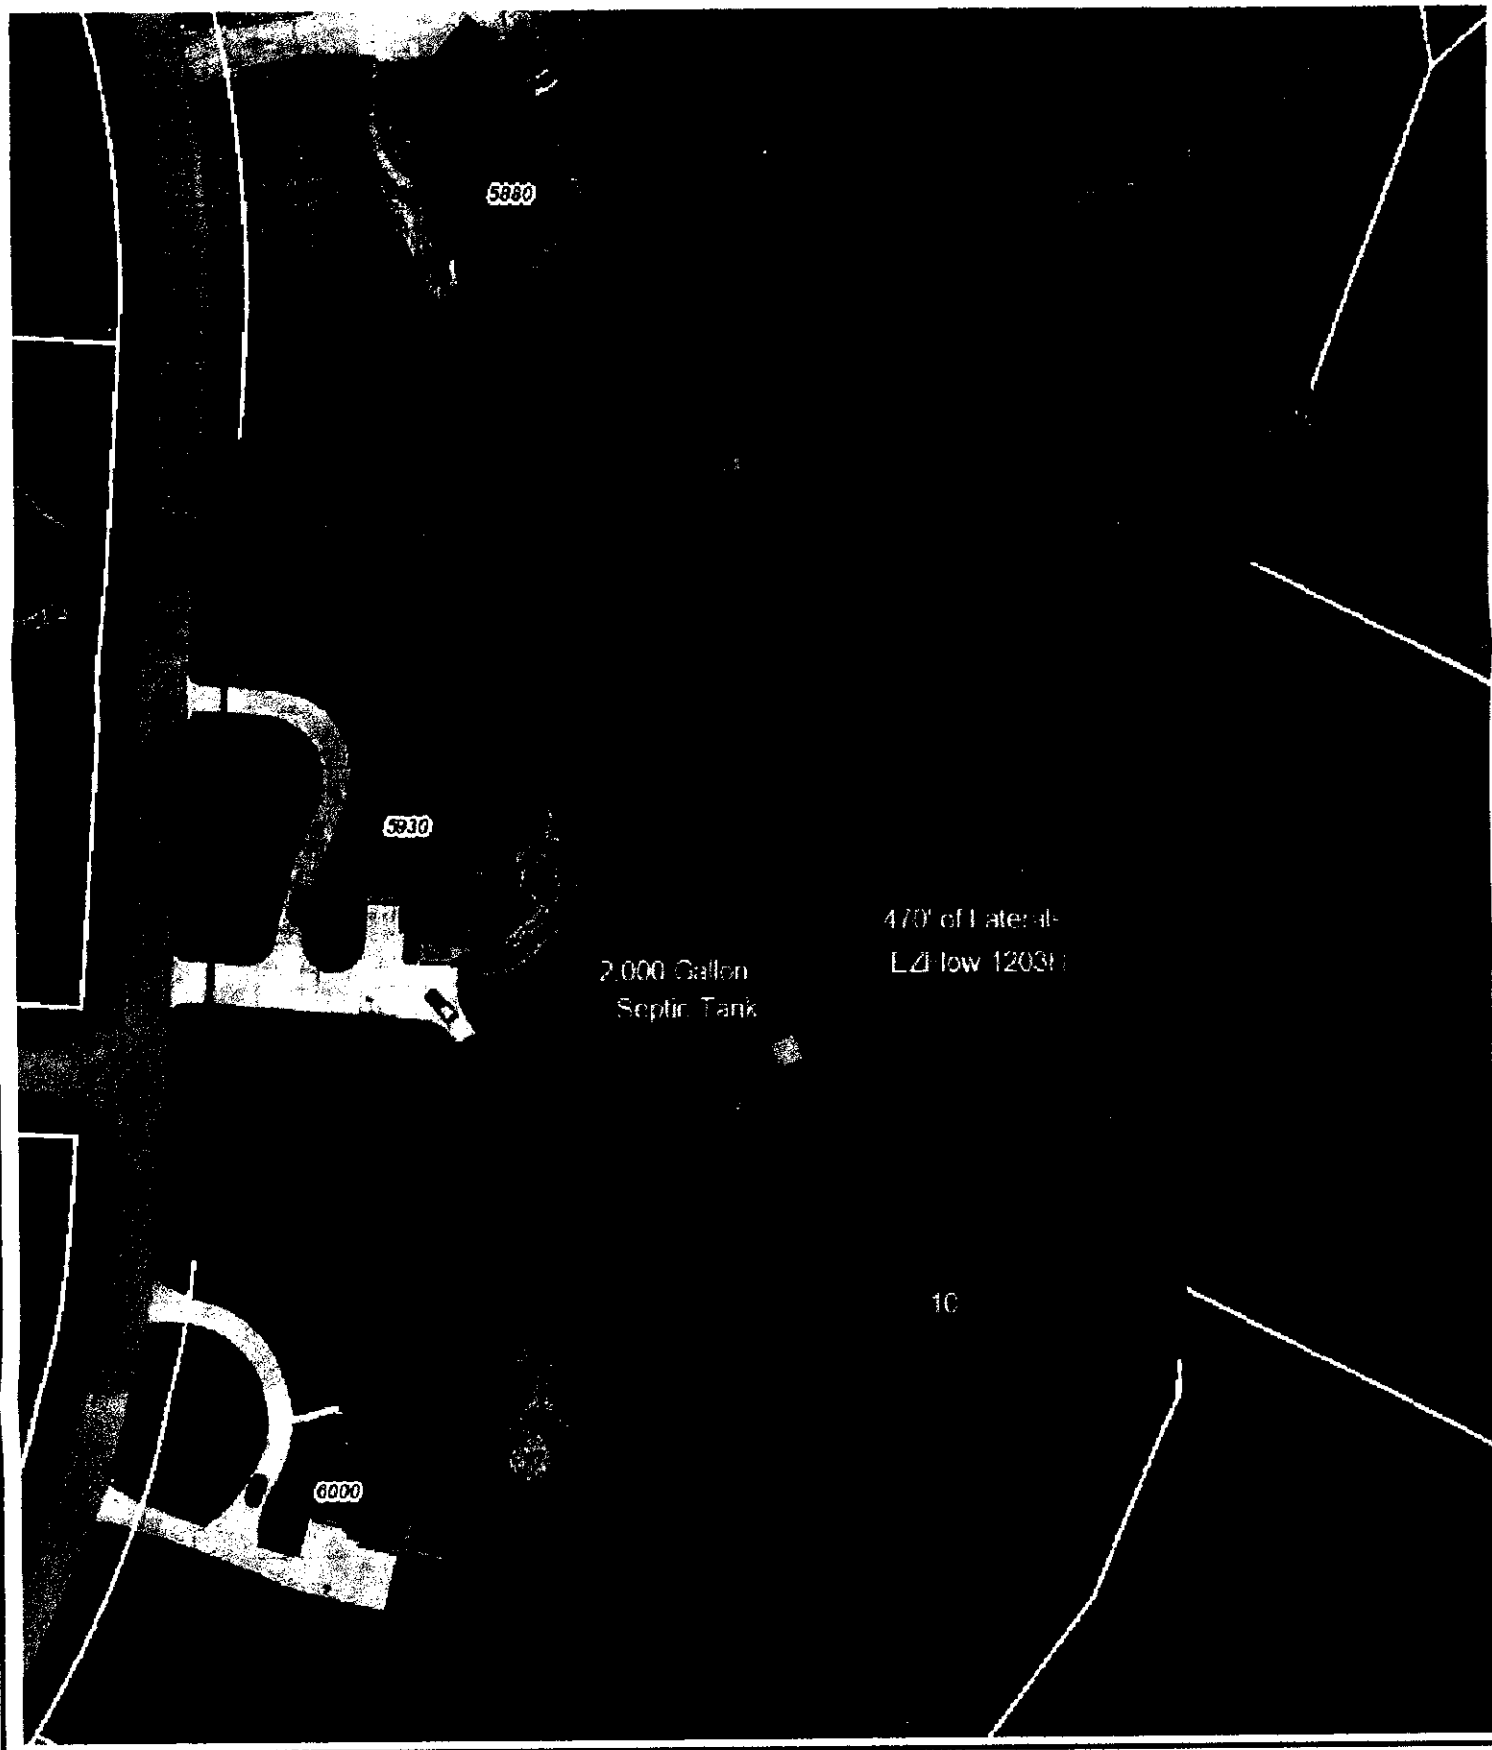

Lancaster County/City of Lincoln GIS Map

N
W E
S

John Klimpel 5930 S 114th St, Lincoln, NE 68526 402-730-1022

Printed: Jun 15, 2016

DISCLAIMER: The information is presented on a best-efforts basis, and should not be relied upon for making financial, survey, legal or other commitments. If you have questions or comments regarding the data displayed on this map, please email ags@lincoln.ne.gov and you will be directed to the appropriate department.

Lincoln-Lancaster County Health Department
Environmental Public Health Division (402) 441-8027
3140 N Street Lincoln, Nebraska 68510-1514

ON-SITE WASTE WATER SYSTEM
CONSTRUCTION - INSTALLATION PERMIT
No. HS001290

System Type: Standard

Situs: 5930 S 114 ST, RURAL, NE

Issued: 8/24/2016

Expires: 8/24/2017

Description: WHISPERING CREEK ADDITION, BLOCK 2, Lot 4

Owner: KLIMPEL, JOHN E & TAMARIE A
5930 S 114 ST
LINCOLN, NE 68526

Judith A Halstead
Judith A. Halstead, MS, Health Director

Dear Applicant:

The above document is your permit to construct a new On-site Waste Water System at the location listed. Please contact this office once the sytem is complete in order to schedule a final inspection before use.

Judith A Halstead
Judith A. Halstead, MS
Health Director

RAYMOND CONTRACTING
13800 NW 70TH ST
RAYMOND, NE 68428

Health / On-Site Waste Water Systems / NA / NA

Applied: 8/24/2016
Issued:
Expires:
Closed:
First Issue:
Last Issue:
Renewal:
Last Insp:

App Name: WHISPERING CREEK ADDITION, BLOCK 2, Lot 4
Subtype (ASI): Standard
Created By: SBUHR
Assigned To: NHARTMAN
Inspection Area: NHARTMAN
Permit Detail Section Last Updated on: 8/24/2016 11:04:45AM
Permit Detail Section Last Updated By: SBUHR
Short Notes:
Detailed Description:

Created/Opened Date: 08/24/2016
Balance Due: $385.00

Active/Inactive?: A
App Status: Application Accepted
License Status: Pending
License Exp Date: 08/24/2016
License Last Updated: 08/24/2016
License Last Update By: SBUHR

License Interval: 1 Years
License Method: FILED DATE

CONTACT INFORMATION QUICKVIEW:

Address (Property Address):
5930 S 114TH ST
LINCOLN, NE 68461

Owner (Property Owner):
KLIMPEL, JOHN E & TAMARIE A
5930 S 114 ST

LINCOLN, NE

Applicant:
JEFFREY SCHOENECK
2620 ELKHORN OAKS CIR

ARLINGTON, NE 68002
402-720-9209

Mail To:
JEFFREY SCHOENECK
2620 ELKHORN OAKS CIR

ARLINGTON, NE 68002
402-720-9209

CONDITIONS DETAIL:

CONTACTS:

Applicant

Full Name: JEFFREY SCHOENECK N
First Name: JEFFREY **Middle Name:** **Last Name:** SCHOENECK
Business / Organization Name:
Address 1: 2620 ELKHORN OAKS CIR
City State Zip: ARLINGTON NE 68002
Phone 1: 402-720-9209 **Phone 2:** **Phone 3:**
Email:
Comments:
Last Updated: 8/24/2016 11:04:45AM **Last Updated By:** SBUHR

Health / On-Site Waste Water Systems / NA / NA

Applied: 8/24/2016
Issued:
Expires:
Closed:
First Issue:
Last Issue:
Renewal:
Last Insp:

App Name: WHISPERING CREEK ADDITION, BLOCK 2, Lot 4
Subtype (ASI): Standard
Created By: SBUHR
Created/Opened Date: 08/24/2016
Assigned To: NHARTMAN
Balance Due: $385.00
Inspection Area: NHARTMAN
Permit Detail Section Last Updated on: 8/24/2016 11:04:45AM
Permit Detail Section Last Updated By: SBUHR
Short Notes:
Detailed Description:

Active/Inactive?: A
App Status: Application Accepted
License Status: Pending
License Exp Date: 08/24/2016
License Last Updated: 08/24/2016
License Last Update By: SBUHR

License Interval: 1 Years
License Method: FILED DATE

CONTACTS:

Mailing Address

Full Name: JEFFREY SCHOENECK N
First Name: JEFFREY **Middle Name:** **Last Name:** SCHOENECK
Business / Organization Name:
Address 1: 2620 ELKHORN OAKS CIR
City State Zip: ARLINGTON NE 68002
Phone 1: 402-720-9209 **Phone 2:** **Phone 3:**
Email:
Comments:
Last Updated: 8/24/2016 11:04:45AM **Last Updated By:** SBUHR

Health / On-Site Waste Water Systems / NA / NA

Applied: 8/24/2016
Issued:
Expires:
Closed:
First Issue:
Last Issue:
Renewal:
Last Insp:

App Name: WHISPERING CREEK ADDITION, BLOCK 2, Lot 4
Subtype (ASI): Standard
Created By: SBUHR
Created/Opened Date: 08/24/2016
Assigned To: NHARTMAN
Balance Due: $385.00
Inspection Area: NHARTMAN
Permit Detail Section Last Updated on: 8/24/2016 11:04:45AM
Permit Detail Section Last Updated By: SBUHR
Short Notes:
Detailed Description:

Active/Inactive?: A
App Status: Application Accepted
License Status: Pending
License Exp Date: 08/24/2016
License Last Updated: 08/24/2016
License Last Update By: SBUHR

License Interval: 1 Years
License Method: FILED DATE

PROPERTY ADDRESS INFO:

Hse Nbr Start	Dir	Prefix	Street Name	Suffix	City	State	Zip	Unit Type	Unit #	X Coord	Y Coord
B1 Address #: 1,192,833		**L1 Address #:** 135495					**Date Last Updated:** 8/24/2016 11:04:45AM		**By:** SBUHR	**Primary Address?:** Y	
External Address UID: AGIS_LINCOLN$*$27504074									**Address Status:** A	**Active?:** A	
5930	S	114TH	ST	LINCOLN	NE	68461				198343.17	182688.95

GIS / PARCEL INFO:

HS001328 **GIS ID: 2218202004000** **GIS Type:** Parcels **GIS Service:** AGIS_LINCOLN **GIS Object ID:** 104510 **Last Updated:** 8/24/2016 11:05:03AM **By:** SBUHR A
Parcel #: 2218202004000 **B1 Parcel:** 221820200 **Legal Desc:** WHISPERING CREEK ADDITION, BLOCK 2, Lot 4
L1 Parcel #: 34799 **External GIS Parcel UID:** AGIS_LINCOLN$*$2218202004000 **Township:** RURAL **Primary Parcel?:** Y **Parcel Status:** A
ASI: **Subtype:** Standard **Jurisdiction:** **X Coord:** **Y Coord:**

PROPERTY OWNER INFO:

HS001328 **B1 Owner #: 1,053,196** **L1 Owner #:** 34323 **Date Last Updated:** 8/24/2016 11:04:45AM **By:** SBUHR **Primary Owner:** Y
External Owner GIS UID: AGIS_LINCOLN$*$2218202004000 **Owner Status:** **Record Status:** A

Owner Full Name: KLIMPEL, JOHN E & TAMARIE A
5930 S 114 ST
LINCOLN NE 68526
Phone #: **Fax:** **Email:**

WORKFLOW HISTORY:

Task Name	Task Status	Status Date	Update Date	Action By	Comments	A?
Application Intake	Application Accepted	08/25/2016	8/25/2016 8:39:01AM	LoriCook		A

Health / On-Site Waste Water Systems / NA / NA

Applied: 8/24/2016
Issued:
Expires:
Closed:
First Issue:
Last Issue:
Renewal:
Last Insp:

App Name: WHISPERING CREEK ADDITION, BLOCK 2, Lot 4
Subtype (ASI): Standard
Created By: SBUHR
Created/Opened Date: 08/24/2016
Assigned To: NHARTMAN
Balance Due: $385.00
Inspection Area: NHARTMAN
Permit Detail Section Last Updated on: 8/24/2016 11:04:45AM
Permit Detail Section Last Updated By: SBUHR
Short Notes:
Detailed Description:

Active/Inactive?: A
App Status: Application Accepted
License Status: Pending
License Exp Date: 08/24/2016
License Last Updated: 08/24/2016
License Last Update By: SBUHR

License Interval: 1 Years
License Method: FILED DATE

WORKFLOW OVERRIDE AUDIT LOG

Action	Type	WFProcess	Task Desc	Status	Comments	Rec_Date	User
WorkflowHistory							
WorkflowTaskAssigment							
assign	assign	H_OS_WSTWTR	Application Intake			8/24/2016 11:04:47AM	SBUHR

9/1/2016 3:16:41PM Page 1 of 1

RECORD COMMENTS:

Date	ID #	User ID	Comment
8/24/2016 11:04:46AM	1298193	SBUHR	SYSTEM - Record created by SBUHR
8/24/2016 11:04:46AM	1298194	SBUHR	SYSTEM - Date_A updated to 8/24/2016 on initialization of a new case.
8/25/2016 8:39:01AM	1298478	LCOOK	SYSTEM - LCOOK has changed the workflow in task: Application Intake to a status of: Application Accepted. Workflow Comments: No comments made.
8/25/2016 8:39:03AM	1298479	LCOOK	SYSTEM - Fee(s) invoiced by LCOOK. Fees Invoiced Total is now $385 . Total Balance due = $385.
8/25/2016 8:39:03AM	1298480	LCOOK	SYSTEM - Added NWCONSTA_H Fee to record with a qty of 1 from Fee Schedule H_OS_WSTWTR upon Application Accepted. Invoice the fee? Y. Total balance for this fee: $385.00. This Fee amount = $385.00. Total Balance Due on record is now: $385. Fee Comment: SYSTEM - Added via Script - Invoiced
8/25/2016 8:40:15AM	1298481	LCOOK	SYSTEM - Payment made in the Amount of $385.00 using method: Credit Card - Visa. Balance Due is now $0. Cashier: LCOOK. Payment Comments made: CALLED IN. Payment Date: 2016-08-25.
8/25/2016 8:40:15AM	1298482	LCOOK	SYSTEM - DATE_N set to 8/25/2016 on payment received
9/1/2016 3:15:21PM	1300574	BPAVEL	SYSTEM - Payment Refund made.

FEES ITEMIZED DETAIL:

Health / On-Site Waste Water Systems / NA / NA

Applied: 8/24/2016
Issued:
Expires:
Closed:
First Issue:
Last Issue:
Renewal:
Last Insp:

App Name: WHISPERING CREEK ADDITION, BLOCK 2, Lot 4
Subtype (ASI): Standard
Created By: SBUHR
Assigned To: NHARTMAN
Inspection Area: NHARTMAN
Permit Detail Section Last Updated on: 8/24/2016 11:04:45AM
Permit Detail Section Last Updated By: SBUHR
Short Notes:
Detailed Description:

Created/Opened Date: 08/24/2016
Balance Due: $385.00

Active/Inactive?: A
App Status: Application Accepted
License Status: Pending
License Exp Date: 08/24/2016
License Last Updated: 08/24/2016
License Last Update By: SBUHR

License Interval: 1 Years
License Method: FILED DATE

INVOICE #	Fee Code	Fee Description	Fee Schedule	Schedule Version	Qty	Units	Fee Amt	Balance Due	Fee Apply Date	Applied By	Status
1176565	NWCONSTA_H	New Construction Standard	H_OS_WSTWTR	2015-2016	1	EACH	$385.00	$385.00	8/25/2016 8:39:02AM	LCOOK	INVOICED
		SYSTEM - Added via Script - Invoiced									
							$385.00	**$385.00**			

FEE DETAIL BY INVOICE WITH PAYMENT INFO:

Trans Amt	Trans Date	Action	Payment Method	Cashier	Check #	CC Auth Code	Paymt Seq #	Receipt #	Acc Audit Seq #	Amt Not Allocated	Last Update By
HS001328											
Invoice # 1176565		385.00	**Fee Schedule**			**INVOICED**		**Invoice Balance:**		**$385.00**	
New Construction Standard		**NWCONSTA_H**	**$385.00** 2015-2016 **12123.3157**								
$385.00	8/25/2016 8:39:03AM	Invoice FeeItem					0		10383004		LCOOK
-$385.00	8/25/2016 8:40:14AM	Payment Applied	Credit Card - Visa CALLED IN	LCOOK		8436	1295561	8459385	10383062	$0.00	LCOOK
-$385.00	9/1/2016 3:14:17PM	Refund Applied	Credit Card - Visa CALLED IN	BPAVEL		8436	1295561	8459385	10394084	$0.00	BPAVEL

-$385.00 **Remaining Balance for New Construction Standard on Invoice # 1176565**

Fee Status: INVOICED

CURRENT BALANCE DUE:

	Fee Amount	Payments Total	Refunds Total	Fee Balance
New Construction Standard	$385.00	$(385.00)	$385.00	$385.00
	Total Amount Due			**$385.00**

Applied: 8/24/2016
Issued:
Expires:
Closed:
First Issue:
Last Issue:
Renewal:
Last Insp:

App Name: WHISPERING CREEK ADDITION, BLOCK 2, Lot 4
Subtype (ASI): Standard
Created By: SBUHR
Created/Opened Date: 08/24/2016
Assigned To: NHARTMAN
Balance Due: $385.00
Inspection Area: NHARTMAN
Permit Detail Section Last Updated on: 8/24/2016 11:04:45AM
Permit Detail Section Last Updated By: SBUHR
Short Notes:
Detailed Description:

Active/Inactive?: A
App Status: Application Accepted
License Status: Pending
License Exp Date: 08/24/2016
License Last Updated: 08/24/2016
License Last Update By: SBUHR

License Interval: 1 Years
License Method: FILED DATE

ACCOUNTING AUDIT TRAIL ITEMIZED INFO:

Transaction Date	Action	Transaction Amount	Method	Invoice #	Receipt #	CC Auth Code	Check Number	Fee Description	Qty	Fee Amt	Cashier ID	Reason
8/25/2016 8:39:03AM	Invoice	$385.00		1176565	0				0	$0.00		
8/25/2016 8:39:03AM	Invoice FeeItem	$385.00		1176565	0			New Construction Standard	1	$385.00		
8/25/2016 8:40:14AM	Payment	$385.00	Credit Card - Visa	0	0	8436			0	$0.00	LCOOK	
	CALLED IN											
8/25/2016 8:40:14AM	Payment Applied	$385.00	Credit Card - Visa	1176565	0			New Construction Standard	1	$385.00	LCOOK	
8/25/2016 8:40:14AM	Update For Payment	$385.00	Credit Card - Visa	0	0				0	$0.00	LCOOK	
8/25/2016 8:40:15AM	Payment Receipt	$385.00	Credit Card - Visa	0	8459385				0	$0.00	LCOOK	
9/1/2016 3:14:17PM	Refund Applied	-$385.00	Credit Card - Visa	1176565	0			New Construction Standard	1	$385.00	BPAVEL	
9/1/2016 3:14:17PM	Update For Refund	-$385.00	Credit Card - Visa	1176565	0				0	$0.00	BPAVEL	
9/1/2016 3:15:20PM	Refund	-$385.00	Credit Card - Visa	0	0				0	$0.00	BPAVEL	
	His credit card was refunded by Shelli B.											
9/1/2016 3:15:20PM	Refund Receipt	-$385.00	Credit Card - Visa	0	8460732				0	$0.00	BPAVEL	

Health / On-Site Waste Water Systems / NA / NA

Applied: 8/24/2016
Issued:
Expires:
Closed:
First Issue:
Last Issue:
Renewal:
Last Insp:

App Name: WHISPERING CREEK ADDITION, BLOCK 2, Lot 4
Subtype (ASI): Standard
Created By: SBUHR
Created/Opened Date: 08/24/2016
Assigned To: NHARTMAN
Balance Due: $385.00
Inspection Area: NHARTMAN
Permit Detail Section Last Updated on: 8/24/2016 11:04:45AM
Permit Detail Section Last Updated By: SBUHR
Short Notes:
Detailed Description:

Active/Inactive?: A
App Status: Application Accepted
License Status: Pending
License Exp Date: 08/24/2016
License Last Updated: 08/24/2016
License Last Update By: SBUHR

License Interval: 1 Years
License Method: FILED DATE

ASI INFORMATION:

ASI Field Description	ASI Field Label	ASI Value	Last Updated Date / User
DATES			
dat_extend			
dat_repair_exp			
dat_repair_final			
DATE_A	Entered (A)	8/24/2016	8/24/2016 11:04:46AM SBUHR
DATE_B	Begins (B)		
DATE_C	Expires (C)		
DATE_D	Closed (D)		
DATE_E	Final Approval (E)		
DATE_F	DATE_F		
DATE_G	Renewal (G)		
DATE_H	Follow Up (H)		
DATE_I	Issued (I)		
DATE_J	DATE_J		
DATE_K	First Issue (K)		
DATE_L	Repair (L)		
DATE_M	Repair Issued (M)		
DATE_N	Pending (N)	8/25/2016	8/25/2016 8:40:15AM LCOOK
GENERAL INFORMATION			
Balance Due		385.00	9/1/2016 3:15:21PM BPAVEL
Establishment			
Fee Current		385.00	8/25/2016 8:39:03AM LCOOK
Initialization For		New Construction	8/24/2016 11:04:45AM SBUHR
Inspection Area		NHARTMAN	8/24/2016 11:04:45AM SBUHR
GIS			
DUMMY SPEAR FIELD			
Jurisdiction	Jurisdiction		
Jurisdiction Effective Date			
X_COORDINATE	X_COORDINATE		
Y_COORDINATE	Y_COORDINATE		

Health / On-Site Waste Water Systems / NA / NA

Applied: 8/24/2016
Issued:
Expires:
Closed:
First Issue:
Last Issue:
Renewal:
Last Insp:

App Name: WHISPERING CREEK ADDITION, BLOCK 2, Lot 4
Subtype (ASI): Standard
Created By: SBUHR
Assigned To: NHARTMAN
Inspection Area: NHARTMAN
Permit Detail Section Last Updated on: 8/24/2016 11:04:45AM
Permit Detail Section Last Updated By: SBUHR
Short Notes:
Detailed Description:

Created/Opened Date: 08/24/2016
Balance Due: $385.00

Active/Inactive?: A
App Status: Application Accepted
License Status: Pending
License Exp Date: 08/24/2016
License Last Updated: 08/24/2016
License Last Update By: SBUHR

License Interval: 1 Years
License Method: FILED DATE

ASI INFORMATION:

ASI Field Description	ASI Field Label	ASI Value	Last Updated Date / User
SYSTEM INFORMATION			
Acres			
Additional Perc Test			
Bedrooms		4	8/24/2016 11:04:45AM SBUHR
Check Number			
Comments			
Commercial			
Design Flow (Max Gallons per Day)			
Garbage Grinder		Yes	8/24/2016 11:04:45AM SBUHR
Garbage Grinder Not Applicable			
Installer			
Installer Expires			
Installer Phone			
Large Capacity Tub Not Applicable			
Other			
Other Specify			
Perc Test Rate Used For Calc			
Prof Engineer Cert Number			
Professional Engineer			
Residential		CHECKED	8/24/2016 11:04:45AM SBUHR
Subtype		Standard	8/24/2016 11:04:45AM SBUHR
Type of Waste Water		Domestic	8/24/2016 11:04:45AM SBUHR
Whirlpool Bathtub		Yes	8/24/2016 11:04:45AM SBUHR
TSR			
Block	Block		
CA Check			
Direction 1			
Direction 2			
Direction 3			
Fraction 1			
Fraction 2			

Health / On-Site Waste Water Systems / NA / NA

Applied: 8/24/2016
Issued:
Expires:
Closed:
First Issue:
Last Issue:
Renewal:
Last Insp:

App Name: WHISPERING CREEK ADDITION, BLOCK 2, Lot 4
Subtype (ASI): Standard
Created By: SBUHR
Created/Opened Date: 08/24/2016
Assigned To: NHARTMAN
Balance Due: $385.00
Inspection Area: NHARTMAN
Permit Detail Section Last Updated on: 8/24/2016 11:04:45AM
Permit Detail Section Last Updated By: SBUHR
Short Notes:
Detailed Description:

Active/Inactive?: A
App Status: Application Accepted
License Status: Pending
License Exp Date: 08/24/2016
License Last Updated: 08/24/2016
License Last Update By: SBUHR

License Interval: 1 Years
License Method: FILED DATE

ASI INFORMATION:

ASI Field Description	ASI Field Label	ASI Value	Last Updated Date / User
TSR			
Fraction 3			
Legal (Township)			
Legal Description		WHISPERING CREEK ADDITION, BLOCK 2, Lot 4	8/24/2016 2:01:59PM SBUHR
Location	Location		
Lot Outlot		4	8/24/2016 2:02:33PM SBUHR
Parcel	Parcel	22182020004000	8/24/2016 2:01:59PM SBUHR
Parcel Situs			
Permit Situs			
Property ID		false	8/24/2016 2:02:49PM SBUHR
Property Owner ID		false	8/24/2016 2:02:49PM SBUHR
Range	Range		
Section	Section	false	8/24/2016 2:02:08PM SBUHR
Site Address			
Subdivision	Subdivision		

ASIT INFORMATION:

ROW:

RELATED RECORDS

Health / On-Site Waste Water Systems / NA / NA

Applied: 8/24/2016
Issued:
Expires:
Closed:
First Issue:
Last Issue:
Renewal:
Last Insp:

App Name: WHISPERING CREEK ADDITION, BLOCK 2, Lot 4
Subtype (ASI): Standard
Created By: SBUHR
Assigned To: NHARTMAN
Inspection Area: NHARTMAN
Permit Detail Section Last Updated on: 8/24/2016 11:04:45AM
Permit Detail Section Last Updated By: SBUHR
Short Notes:
Detailed Description:

Created/Opened Date: 08/24/2016
Balance Due: $385.00

Active/Inactive?: A
App Status: Application Accepted
License Status: Pending
License Exp Date: 08/24/2016
License Last Updated: 08/24/2016
License Last Update By: SBUHR

License Interval: 1 Years
License Method: FILED DATE

DOCUMENT UPLOAD HISTORY:

Uploaded Date	Seq #	Document Name	Source	Size	Doc Type	Doc Category	Group	Department	UploadBy

Health / On-Site Waste Water Systems / NA / NA

Applied: 8/24/2016
Issued:
Expires:
Closed:
First Issue:
Last Issue:
Renewal:
Last Insp:

App Name: WHISPERING CREEK ADDITION, BLOCK 2, Lot 4
Subtype (ASI): Standard
Created By: SBUHR
Created/Opened Date: 08/24/2016
Assigned To: NHARTMAN
Balance Due: $385.00
Inspection Area: NHARTMAN
Permit Detail Section Last Updated on: 8/24/2016 11:04:45AM
Permit Detail Section Last Updated By: SBUHR
Short Notes:
Detailed Description:

Active/Inactive?: A
App Status: Application Accepted
License Status: Pending
License Exp Date: 08/24/2016
License Last Updated: 08/24/2016
License Last Update By: SBUHR

License Interval: 1 Years
License Method: FILED DATE

Record Detail Audit Log

H_ADM045

*Note: This shows all Record, ASI, ASIT, Document, and Condition History for a record.
For workflow history, comment history, Fee/Payment history, etc see separate logs/reports.

HS001328

Date	Act	Product	Entity_Type	Entity_SubType	Field	Value	User
8/24/2016 11:04:46AM	A	AV360	CAP	CAP Detail	Record ID	16CAP-00000-0068N	SBUHR
8/24/2016 11:04:46AM	A	AV360	CAP	CAP Detail	Record Type	Health/On-Site Waste Water Systems/NA/NA	SBUHR
8/24/2016 11:04:46AM	A	AV360	CAP	CAP Detail	Status	Additional Info Required	SBUHR
8/24/2016 11:04:46AM	A	AV360	CAP	CAP Detail	Initiated by Product	AV360	SBUHR
8/24/2016 11:04:46AM	A	AV360	CAP	CAP Detail	Opened Date	08/24/2016	SBUHR
8/24/2016 11:04:46AM	A	AV360	CAP	CAP Detail	Record #	$$16CAP-00000-0068N	SBUHR
8/24/2016 11:04:46AM	A	AV360	CAP	CAP Detail	Tracking #	258266916	SBUHR
8/24/2016 11:04:46AM	A	AV360	CAP	CAP Detail	Created By ACA	N	SBUHR
8/24/2016 11:04:46AM	A	AV360	CAP	CAP Detail	Expiration Status	Pending	SBUHR
8/24/2016 11:04:46AM	A	AV360	CAP	CAP Detail	Expiration Date	08/24/2016 11:04:45	SBUHR
8/24/2016 11:04:46AM	U	AV360	CAP	CAP Detail	Record ID	16CAP-00000-0068N	SBUHR
8/24/2016 11:04:46AM	U	AV360	CAP	CAP Detail	Record #	HS001328	SBUHR
8/24/2016 11:04:46AM	U	AV360	CAP	CAP Detail	Record ID	16CAP-00000-0068N	SBUHR
8/24/2016 11:04:46AM	U	AV360	CAP	CAP Detail	Status	Additional Info Required	SBUHR
8/24/2016 11:04:46AM	U	AV360	CAP	CAP Detail	Opened Date	08/24/2016	SBUHR
8/24/2016 11:04:46AM	U	AV360	CAP	CAP Detail	Reported Date	08/24/2016	SBUHR
8/24/2016 11:04:46AM	A	AV360	CAP	CAP Detail	Channel Reported	Call Center	SBUHR
8/24/2016 11:04:46AM	A	AV360	CAP	CAP Detail	Total Job Cost	0	SBUHR
8/24/2016 11:04:46AM	A	AV360	CAP	CAP Detail	Assigned to Department	LINCOLN/HEALTH/WATER/NA/NA/NA/NA	SBUHR
8/24/2016 11:04:46AM	A	AV360	CAP	CAP Detail	Assigned to Staff	NHARTMAN	SBUHR
8/24/2016 11:04:46AM	A	AV360	CAP	CAP Detail	Assigned Date	08/24/2016	SBUHR
8/24/2016 11:04:46AM	A	AV360	CAP	CAP Detail	Total Fee Invoiced	0	SBUHR
8/24/2016 11:04:46AM	A	AV360	CAP	CAP Detail	Total Pay	0	SBUHR
8/24/2016 11:04:46AM	A	AV360	CAP	CAP Detail	Balance	0	SBUHR
8/24/2016 11:04:46AM	A	AV360	CAP	CAP Detail	Est. Prod. Units	0	SBUHR
8/24/2016 11:04:46AM	A	AV360	CAP	CAP Detail	Actual Prod. Units	0	SBUHR
8/24/2016 11:04:46AM	A	AV360	ASI	ASI	Inspection Area	NHARTMAN	SBUHR

Health / On-Site Waste Water Systems / NA / NA

Applied: 8/24/2016
Issued:
Expires:
Closed:
First Issue:
Last Issue:
Renewal:
Last Insp:

App Name: WHISPERING CREEK ADDITION, BLOCK 2, Lot 4
Subtype (ASI): Standard
Created By: SBUHR
Created/Opened Date: 08/24/2016
Assigned To: NHARTMAN
Balance Due: $385.00
Inspection Area: NHARTMAN
Permit Detail Section Last Updated on: 8/24/2016 11:04:45AM
Permit Detail Section Last Updated By: SBUHR
Short Notes:
Detailed Description:

Active/Inactive?: A
App Status: Application Accepted
License Status: Pending
License Exp Date: 08/24/2016
License Last Updated: 08/24/2016
License Last Update By: SBUHR

License Interval: 1 Years
License Method: FILED DATE

HS001328

Date	Act	Product	Entity_Type	Entity_SubType	Field	Value	User
8/24/2016 11:04:46AM	A	AV360	ASI	ASI	Initialization For	New Construction	SBUHR
8/24/2016 11:04:46AM	A	AV360	ASI	ASI	Balance Due	0.00	SBUHR
8/24/2016 11:04:46AM	A	AV360	ASI	ASI	Fee Current	0.00	SBUHR
8/24/2016 11:04:46AM	A	AV360	ASI	ASI	Subtype	Standard	SBUHR
8/24/2016 11:04:46AM	A	AV360	ASI	ASI	Whirlpool Bathtub	Yes	SBUHR
8/24/2016 11:04:46AM	A	AV360	ASI	ASI	Residential	CHECKED	SBUHR
8/24/2016 11:04:46AM	A	AV360	ASI	ASI	Bedrooms	4	SBUHR
8/24/2016 11:04:46AM	A	AV360	ASI	ASI	Type of Waste Water	Domestic	SBUHR
8/24/2016 11:04:46AM	A	AV360	ASI	ASI	Garbage Grinder	Yes	SBUHR
8/24/2016 11:04:47AM	U	10.00	CAP	CAP Detail	Application Name	5930 S 114TH ST - LIN	SBUHR
8/24/2016 11:04:47AM	A	10.00	ASI	ASI	DATE_A	8/24/2016	SBUHR
8/24/2016 2:01:59PM	A	AV360	ASI	ASI	Parcel	22182020004000	SBUHR
8/24/2016 2:02:50PM	U	10.00	CAP	CAP Detail	Application Name	WHISPERING CREEK ADDITION, BLOCK 2, Lot 4	SBUHR
8/24/2016 2:02:50PM	A	10.00	ASI	ASI	Legal Description	WHISPERING CREEK ADDITION, BLOCK 2, Lot 4	SBUHR
8/24/2016 2:02:50PM	A	10.00	ASI	ASI	Section	false	SBUHR
8/24/2016 2:02:50PM	A	10.00	ASI	ASI	Lot Outlot	4	SBUHR
8/24/2016 2:02:50PM	A	10.00	ASI	ASI	Property ID	false	SBUHR
8/24/2016 2:02:50PM	A	10.00	ASI	ASI	Property Owner ID	false	SBUHR
8/25/2016 8:39:01AM	U	AV360	CAP	CAP Detail	Status	Application Accepted	LCOOK
8/25/2016 8:39:03AM	U	10.00	CAP	CAP Detail	Total Fee Invoiced	385	LCOOK
8/25/2016 8:39:03AM	U	10.00	CAP	CAP Detail	Balance	385	LCOOK
8/25/2016 8:39:03AM	U	10.00	ASI	ASI	Balance Due	385.00	LCOOK
8/25/2016 8:39:03AM	U	10.00	ASI	ASI	Fee Current	385.00	LCOOK
8/25/2016 8:40:15AM	U	AV360	CAP	CAP Detail	Total Pay	385	LCOOK
8/25/2016 8:40:15AM	U	10.00	ASI	ASI	Balance Due	0.00	LCOOK
8/25/2016 8:40:15AM	A	10.00	ASI	ASI	DATE_N	8/25/2016	LCOOK
9/1/2016 3:15:20PM	U	AV360	CAP	CAP Detail	Total Pay	0	BPAVEL
9/1/2016 3:15:20PM	U	AV360	CAP	CAP Detail	Balance	0	BPAVEL
9/1/2016 3:15:21PM	U	10.00	ASI	ASI	Balance Due	385.00	BPAVEL

Health / On-Site Waste Water Systems / NA / NA

Applied: 8/24/2016
Issued:
Expires:
Closed:
First Issue:
Last Issue:
Renewal:
Last Insp:

App Name: WHISPERING CREEK ADDITION, BLOCK 2, Lot 4
Subtype (ASI): Standard
Created By: SBUHR
Created/Opened Date: 08/24/2016
Assigned To: NHARTMAN
Balance Due: $385.00
Inspection Area: NHARTMAN
Permit Detail Section Last Updated on: 8/24/2016 11:04:45AM
Permit Detail Section Last Updated By: SBUHR
Short Notes:
Detailed Description:

Active/Inactive?: A
App Status: Application Accepted
License Status: Pending
License Exp Date: 08/24/2016
License Last Updated: 08/24/2016
License Last Update By: SBUHR

License Interval: 1 Years
License Method: FILED DATE

CITY OF LINCOLN NEBRASKA

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
3140 "N" Street Lincoln, NE 68510-1514
402-441-8000 TDD: 402-441-6284 fax: 402-441-6229

LANCASTER COUNTY NEBRASKA
lincoln.ne.gov

Receipt No.: **8459385**
Receipt Date: **08/25/2016**

RECEIPT

RECORD & PAYER INFORMATION

Record Number:	HS001328
Record Type:	On-Site Waste Water System
Property Address:	5930 S 114TH ST LINCOLN, NE 68461
Payer:	JEFF SCHOENECK
Applicant:	2620 ELKHORN OAKS CIR ARLINGTON, NE 68002
Record Name:	WHISPERING CREEK ADDITION, BLOCK 2, Lot 4

PAYMENT DETAIL

Date	Pmt Method	Ref Number	Cashier	Comments	Amount
08/25/2016	Credit Card - Visa	8436	LCOOK	CALLED IN	$385.00

FEE DETAIL

Fee Description	Invoice #	Quantity	Units	Fee Amount	Current Paid
New Construction Standard	1176565	1.00	EACH	$385.00	$385.00
				$385.00	$385.00

CITY OF LINCOLN NEBRASKA

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
3140 "R" Street Lincoln, NE 68510-1514
402-441-8000 TDD: 402-441-8284 fax: 402-441-8229

LANCASTER NEBRASKA
lincoln.ne.gov

Receipt No.: **8460732**
Receipt Date: **09/01/2016**

RECEIPT

RECORD & PAYER INFORMATION

Record ID:	HS001328
Record Type:	On-Site Waste Water Systems
Property Address:	5930 S 114TH ST LINCOLN, NE 68461
Description of Work:	
Payer:	JEFFREY SCHOENECK
Applicant:	JEFFREY SCHOENECK 2620 ELKHORN OAKS CIR ARLINGTON, NE 68002

PAYMENT DETAIL

Date	Payment Method	Reference	Cashier	Comments	Amount
09/01/2016	Credit Card - Visa		BPAVEL	His credit card was refunded by Shelli B.	$-385.00

FEE DETAIL

Fee Description	Invoice #	Quantity	Fee Amount	Current Paid
				$0.00
			$0.00	$0.00

CITY OF LINCOLN NEBRASKA

Lincoln-Lancaster County Health Department
Environmental Public Health Division
[illegible] Lincoln [illegible] 68[illegible]-1514
Phone: 402-[illegible]643

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
3140 "N" Street Lincoln, NE 68510-1514
402-441-8000 TDD: 402-441-6284 fax: 402-441-6229
lincoln.ne.gov

OK JF 9/21/16

D

Exhibit 4

Permit Number

LANCASTER COUNTY NEBRASKA

Onsite Wastewater Treatment System
As-Built Description and Drawing

Type of Onsite Wastewater System: ☐ Lagoon (Skip to Back Page) ☒ Subsurface Septic ☐ Mound

Onsite Wastewater System Location

Address or Legal Description or Parcel Identification Number (PID) 5930 N 114th St., Lincoln

Owner: John Klimpel Address

A. Wastewater Piping

1. Material: PVC S-40 & SDR-35 Diameter: 4 in.
2. Distance between dwelling and septic tank: _____ ft.

B. Septic Tank

1. Material Concrete
2. Capacity: 2000 gal
3. Depth to top of tank, below unfinished grade: ____ in.
4. Distance to:
   Well N/A ft.
   Pressure line 225 ft
   Property Line 200 ft.
   Foundation 80 ft.

C Distribution Box or Drop Box

Distance and Direction from septic tank: NE ft. 320

D. Drainfield/Absorption Field

☒ Trench ☐ Bed

1. Type: ☐ Perforated Pipe ☒ Chamberless ☐ Other
   Material brand and inside width of Chamberless: Infiltrator Arc 36
2. Number of Laterals: 6
3. Length of each lateral (linear): ft. 95 ft. 65 ft. 75 ft. 60, 55', 40'
4. Drainfield size: 1413.75 sq. ft.
5. Distance to:
   Well N/A ft.
   Pressure line 225 ft.
   Property line 8 ft.
   Depth of Groundwater 5.25 (4ft From Lat Bottom)

Was the Onsite Wastewater System covered prior to LLCHD inspection? ☒ Yes ☐ No Partial

If Yes, the Certified Professional must sign below for final approval:

I swear and affirm that the system complies with Lincoln Municipal Code (LMC) 24.38 and/or County Resolution R-13-0062 requirements and that the information and documentation submitted are true and accurate.

Certified Professional Signature: Jeffery N Schoeneck Date: 9/15/2016

Complete As-Built drawing on the back of this form.

Updated 4/15

LINCOLN LANCASTER COUNTY HEALTH DEPARTMENT

DEVELOPMENT SERVICES CENTER DSC