HS001653

Application to Alter or Repair an Onsite Wastewater Treatment System

The applicant is applying for a permit to: ☐**ALTER** ☒**REPAIR** an existing Onsite Wastewater Treatment System, and agrees to comply with LMC 24.38 or County Resolution 02-0030.

1. **Street Address (No Rural Route):** 22401 SW 114th St, Crete, NE 68333 Kenneth Tesar

   Legal Description of Property: Township: 7N Range: 5E Section: 8-NE

   Block ____ Lot 16 SubDivsion ____ Add: ____

   ***Parcel ID** 01 - 08 - 200 - 009 - 000 (i.e. 99-99-999-999-999)

2. **Property use:** ☒ Residential ☐ Commercial ☐ Other use (Describe: ____)
   Number of bedrooms 3 Does the system have a: ☒ Garbage Grinder ☒ Large Capacity Tub

3. **Type of Present Individual Disposal System** ☒ septic system ☐ lagoon ☐ other

4. **Description of proposed alteration or repair:** Existing ADS chambers filled with soil on top lateral believed to be from saturation due to hydraulic overload. Added additional 1,080 square feet of drainfield using EZFlow 1203H bundles (240') and a drainfield control valve allowing owner to use both new & old drainfields.

5. **Current Type of Lateral-** ADS ARC36 **Current Linear Ft. Of Lateral -** 300'

   Current Tank Gallonage- 1,500

6. Print Name Terri Jakoubek Address 13800 NW 70th St, Raymond, NE 68428 Phone: 402-783-2663

Applicant Signature: Terri L. Jakoubek

Please contact LLCHD for the current permit fee for this application
Fee must be included before the application will be processed. Incomplete information will delay processing.

HEALTH DEPARTMENT USE ONLY

☐Municipal Code 24.38 ☐County Resolution Number 02-30

Date received ____/____/____ REVIEW: ☐ Approved ☐ Disapproved By: ____

Comments (if any): ____

Site visits
Date ____/____/____ By ____
Date ____/____/____ By ____

Installation final written approval
Date ____/____/____ By ____

Return application to: Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 "N" Street, Lincoln, NE 68510
Phone: (402) 441-8643

Business Office Use Only
Received: Date: 05/01/18 Amount $220.00 Check No. 9373 Initials JMD

Revised 4/8/13

Lincoln-Lancaster County Health Department
Environmental Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

B

Permit Number:

Sewage Disposal System
Soil Absorption Test Data Report
Annex to Application

PLEASE PRINT OR TYPE

System Location (Indicate correct number and street)

Address 22401 SW 114th St (no rural route) City Cortland (Kramer) NE, Zip 68333

Owner Ken Tessar Addresss Same

Soil Type (SCS): Wymore Percolation Rate: 55 min./inch

Date of Tests 11/30/05 to 12/1/05 Weather: Precipitation 0 Temperature 59°

Percolation Test Data Table

A.	B.	C. D. E. F. Pre-Saturation Period				G. H. I. J. K. Percolation Readings					L. M. N. Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Water Lev (in.)	Date (Mo/Da)	Time (Hr/Min)	Elapsed Time (Min)	Water Level Drop (in)	Percolation Rates (Min/in)
1	36	11/30	1:00p	11/30	5:00p	12/1	4:30p	0	12/1	5:00p	30	5/8	48
2	38	"	"	"	"	"	"	"	"	"	"	1/2	60
3	26	"	"	"	"	"	"	"	"	"	"	9/16	54
4	38	"	"	"	"	"	"	"	"	"	"	9/16	54
5	32	"	"	"	"	"	"	"	"	"	"	9/16	54
6	40	"	"	"	"	"	"	"	"	"	"	1/2	60

Person Conducting Percolation Tests

Name: Terri L. Imhoubek, Raymond Contracting, Inc.
Phone: 402-783-2603 or 402-890-3870
Address 13800 NW 70th St
Raymond, NE 68428 # C1198

Sum of Percolation Rates: 330
Average of Rates: 55
Rate Used for Calculation: 55


DO NOT WRITE BELOW THIS LINE

Reviewing Action

Remarks _____

Signature of Reviewing Official _____ Date _____

FORM 23-101 10-96

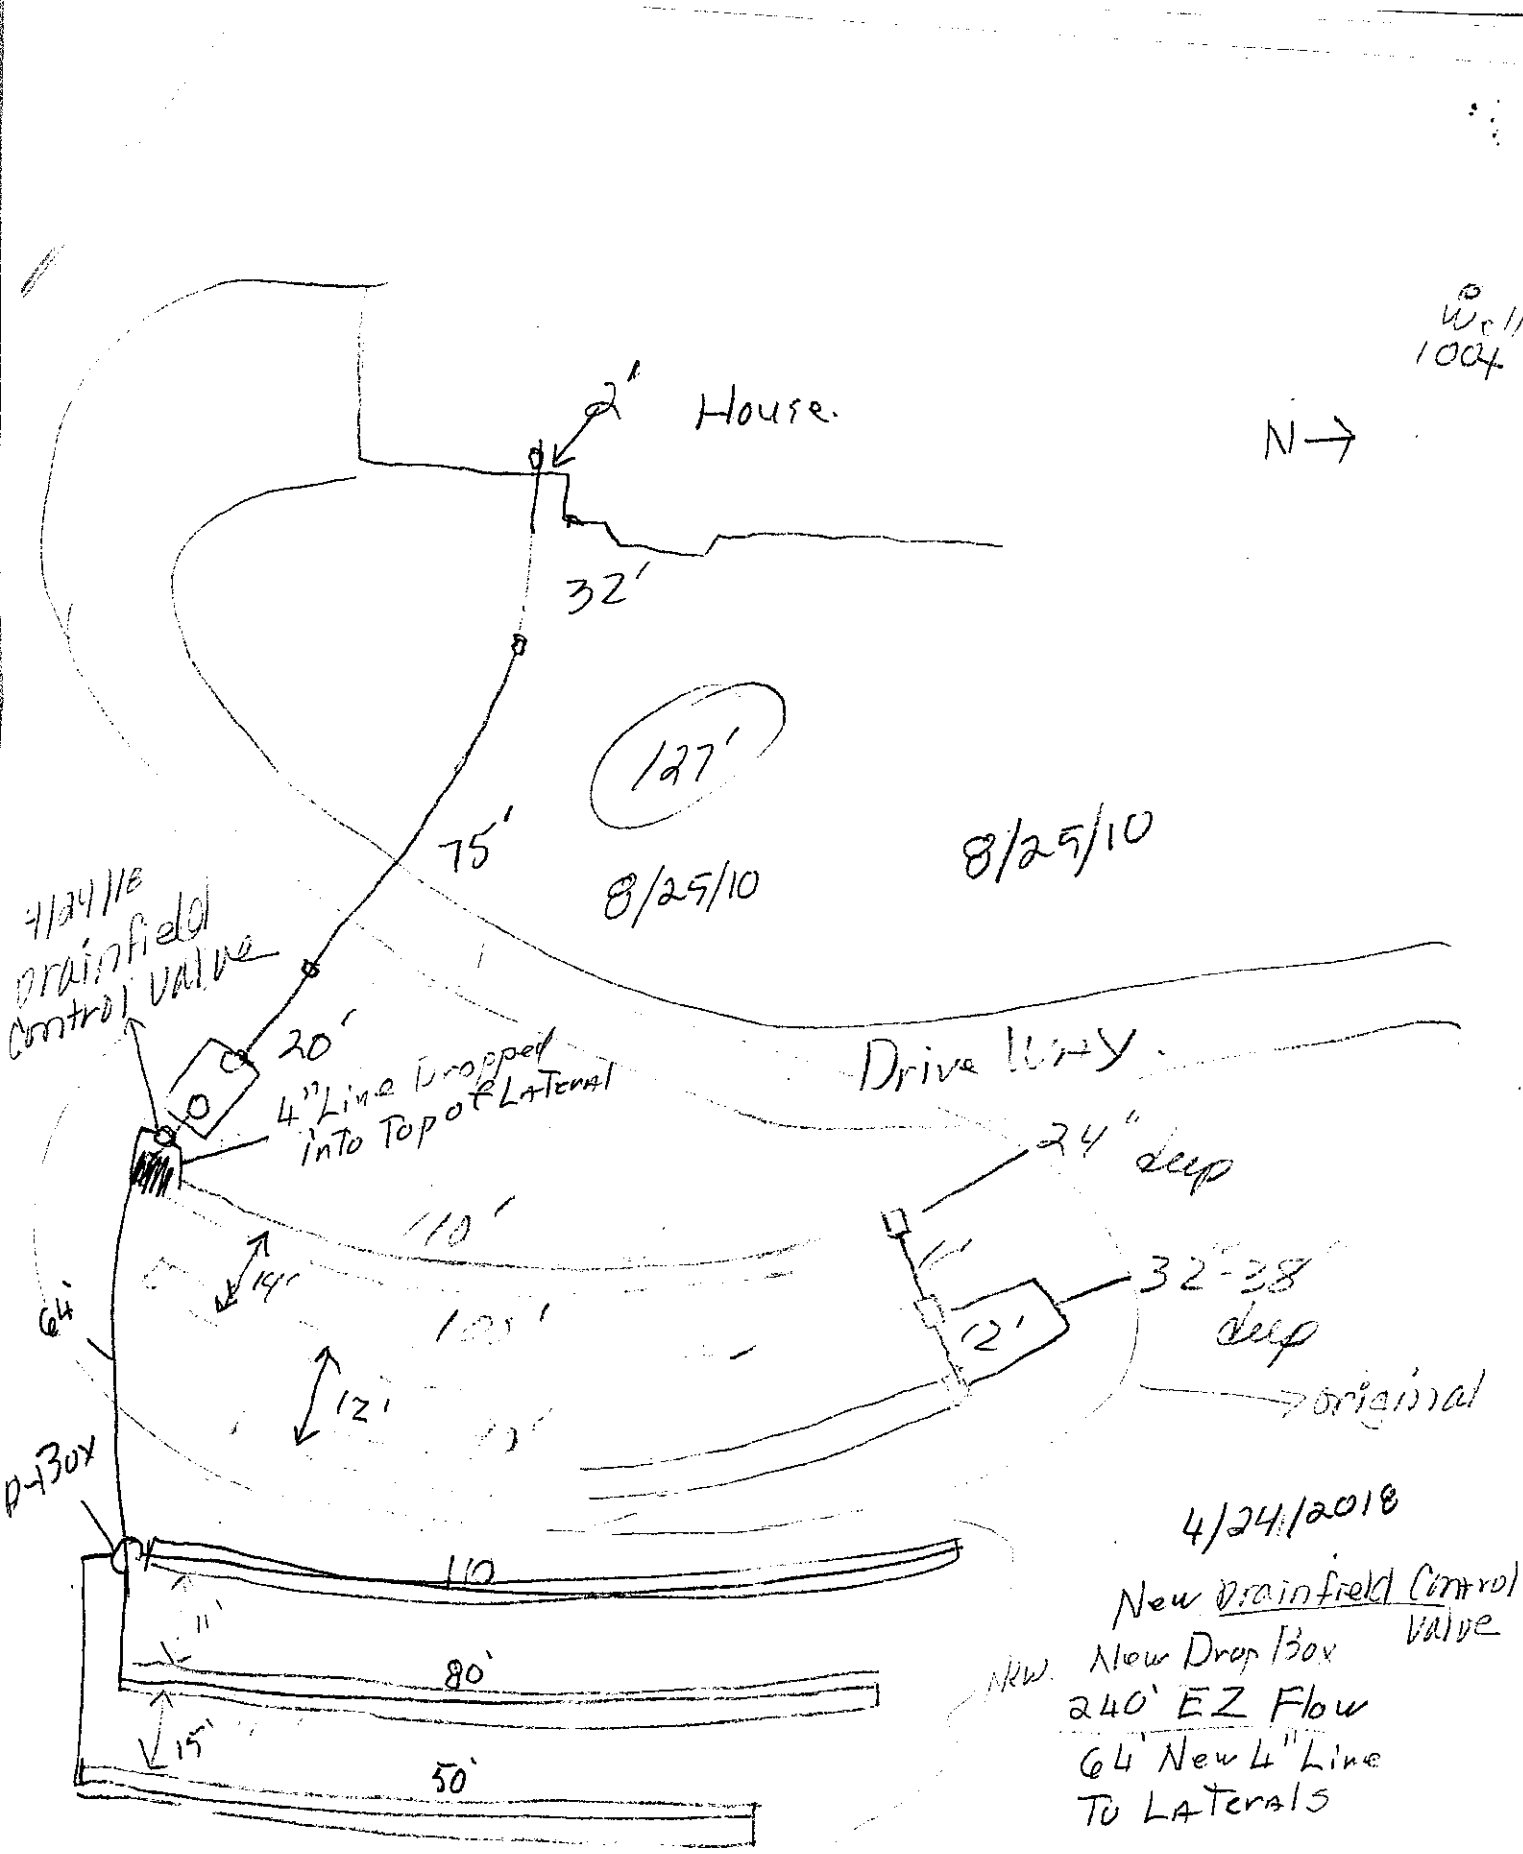

4/24/2018

New Drainfield Control Valve

New Drop Box

240' EZ Flow

64' New 4" Line To Laterals

36-48" Deep.

SCANNED

HS001653

Application to Alter or Repair an Onsite Wastewater Treatment System

The applicant is applying for a permit to: ☐ALTER ☒REPAIR an existing Onsite Wastewater Treatment System, and agrees to comply with LMC 24.38 or County Resolution 02-0030.

1. **Street Address (No Rural Route):** 22401 SW 114th St, Crete, NE 68333 Kenneth Tesar

   Legal Description of Property: Township: 7N Range: 5E Section: 8-NE

   Block _____ Lot 16 SubDivsion _____ Add: _____

   ***Parcel ID** 01 - 08 - 200 - 009 - 000 (i.e. 99-99-999-999-999)

2. **Property use:** ☒ Residential ☐ Commercial ☐ Other use (Describe: _____)
   Number of bedrooms 3 Does the system have a: ☒ Garbage Grinder ☒ Large Capacity Tub

3. **Type of Present Individual Disposal System** ☒ septic system ☐ lagoon ☐ other

4. **Description of proposed alteration or repair:** Existing ADS chambers filled with soil on top lateral believed to be from saturation due to hydraulic overload. Added additional 1,080 square feet of drainfield using EZFlow 1203H bundles (240') and a drainfield control valve allowing owner to use both new & old drainfields.

5. **Current Type of Lateral-** ADS ARC36 **Current Linear Ft. Of Lateral -** 300'

   Current Tank Gallonage- 1,500

6. Print Name Terri Jakoubek Address 13800 NW 70th St, Raymond, NE 68428 Phone: 402-783-2663

Applicant Signature: Terri L. Jakoubek

Please contact LLCHD for the current permit fee for this application
Fee must be included before the application will be processed. Incomplete information will delay processing.

HEALTH DEPARTMENT USE ONLY

☐Municipal Code 24.38 ☒County Resolution Number 02-30

Date received 5/4/18 REVIEW: ☒ Approved ☐ Disapproved By: _____

Comments (if any): _____

Site visits
Date 4/24/18 By _____
Date ___/___/___ By _____

Installation final written approval
Date 5/9/18 By _____

Return application to:
Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 "N" Street, Lincoln, NE 68510
Phone: (402) 441-8643

Business Office Use Only

Received: Date: 05/01/18 Amount $220.00 Check No. 9373 Initials _____

Revised 4/8/13

Lincoln-Lancaster County Health Department
Environmental Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

SCANNED

B

Permit Number:

Sewage Disposal System
Soil Absorption Test Data Report
Annex to Application

PLEASE PRINT OR TYPE

System Location (Indicate correct number and street)

Address 22401 SW 114th St (no rural route) City Hallam (Kramer) NE, Zip 68333

Owner Ken Tessar Addresss Same

Soil Type (SCS): Mayberry Percolation Rate: 55 min./inch

Date of Tests 11/30/09 to 12/1/09 Weather: Precipitation 0 Temperature 59°

Percolation Test Data Table

A.	B.	C. D. E. F. Pre-Saturation Period				G. H. I. J. K. Percolation Readings					L. M. N. Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Water Lev (in.)	Date (Mo/Da)	Time (Hr/Min)	Elapsed Time (Min)	Water Level Drop (in)	Percolation Rates (Min/in)
1	36	11/30	1:00p	11/30	5:00p	12/1	4:30p	6	12/1	5:00p	30	5/8	48
2	38	"	"	"	"	"	"	"	"	"	"	1/2	60
3	26	"	"	"	"	"	"	"	"	"	"	9/16	54
4	38	"	"	"	"	"	"	"	"	"	"	9/16	54
5	38	"	"	"	"	"	"	"	"	"	"	9/16	54
6	40	"	"	"	"	"	"	"	"	"	"	1/2	60

Sum of Percolation Rates: 330
Average of Rates: 55
Rate Used for Calculation: 55

Person Conducting Percolation Tests

Name: Terri L. Jakoubek, Raymond Contracting, Inc.
Phone: 402-783-2603 or 402-890-3870
Address 13800 NW 70th St
Raymond, NE 68428 # C1198

DO NOT WRITE BELOW THIS LINE


Reviewing Action

Remarks _____

Signature of Reviewing Official _____ Date _____

ORM 23-101 10-96

SCANNED

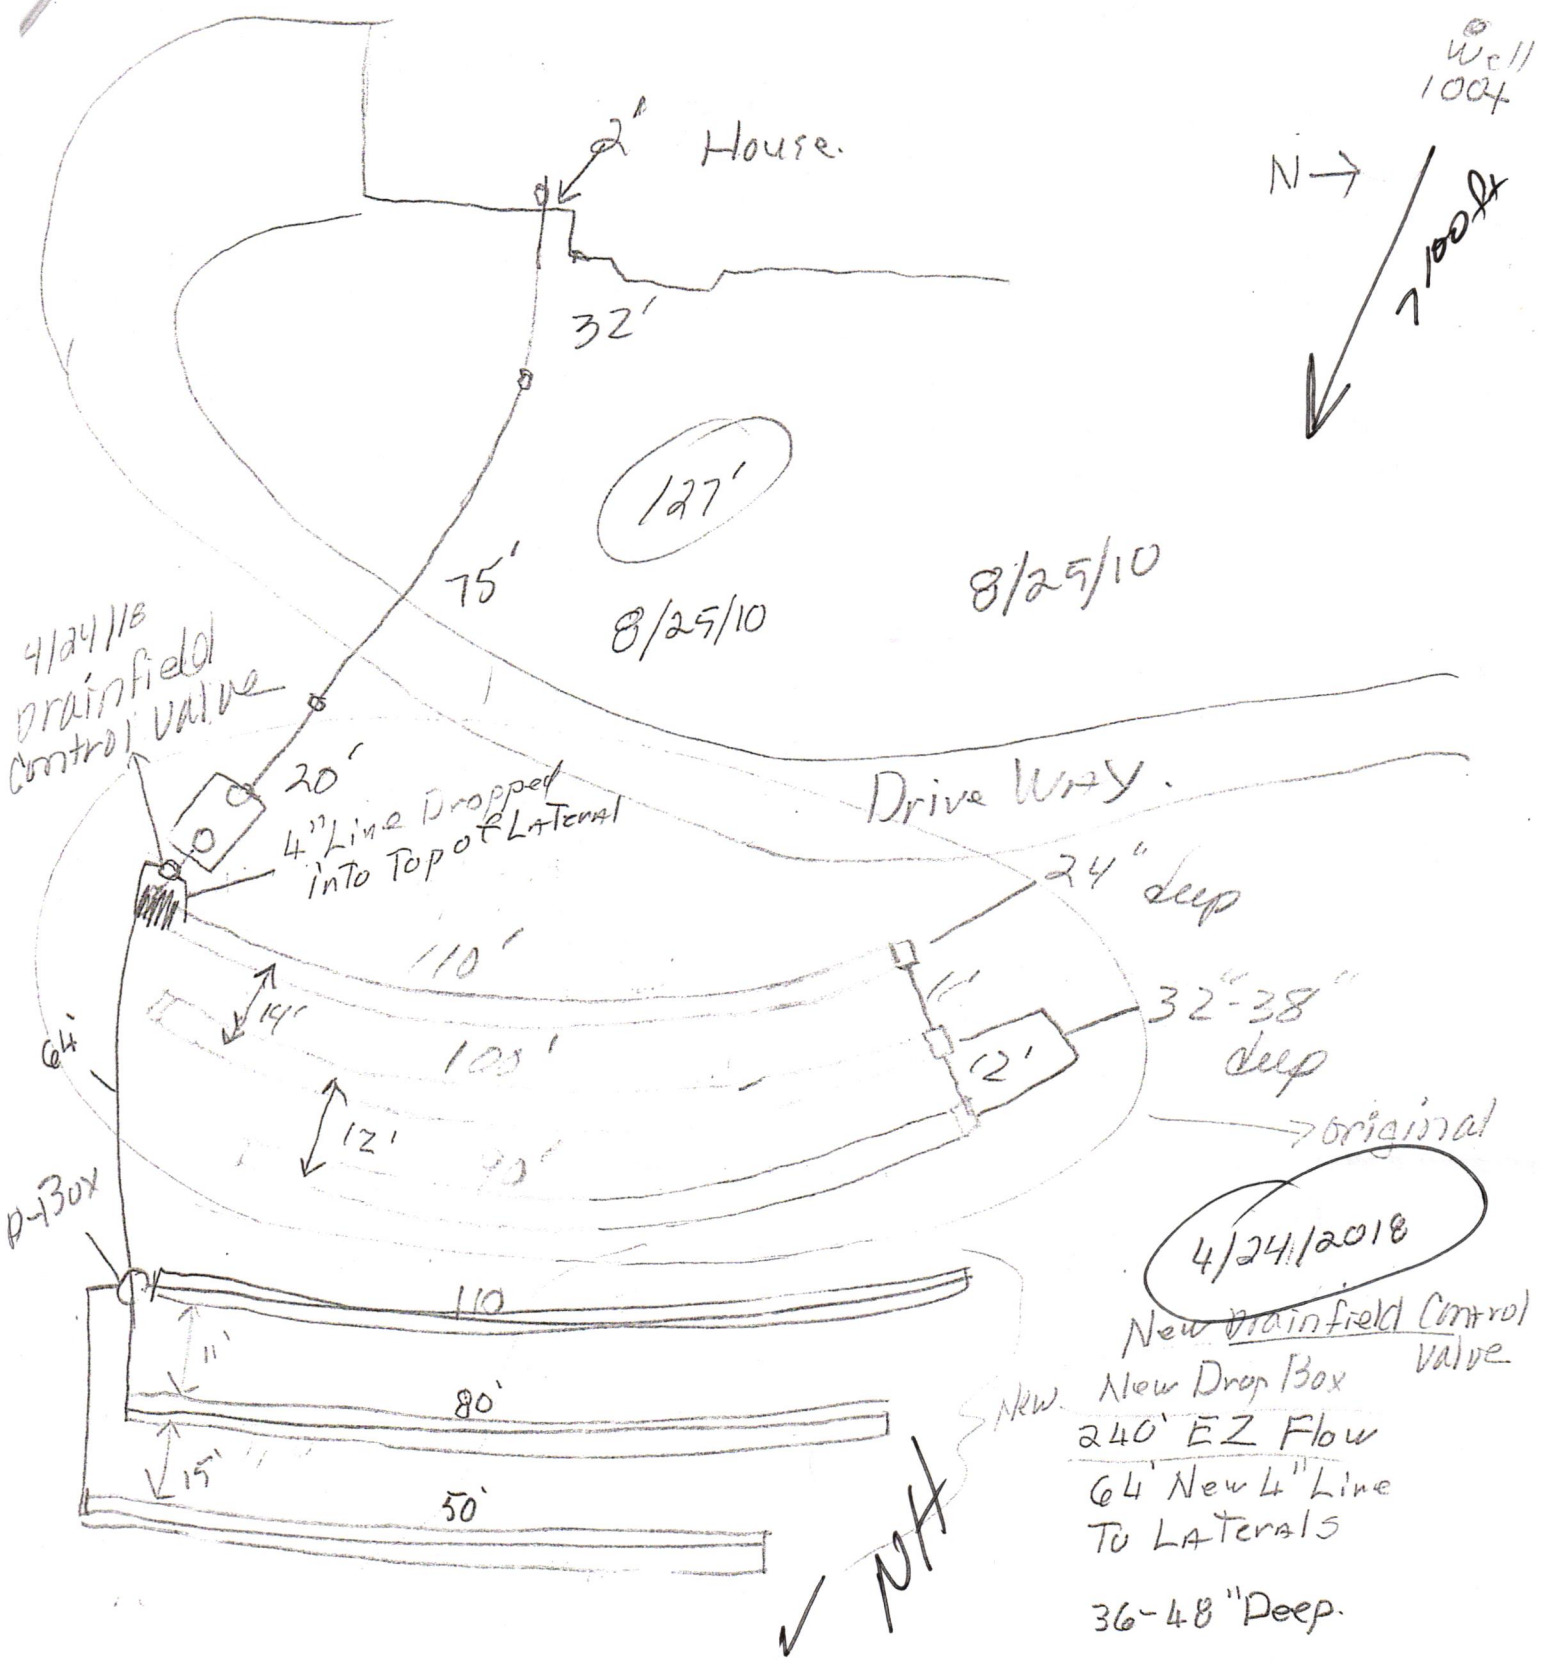
Well
100'
N
100'
2" House.
32'
127'
75'
8/25/10
8/25/10
4/24/18
Drainfield
Control Valve
20'
4" Line Dropped
into Top of Lateral
Drive Way.
24" deep
110'
14'
64'
105'
12'
32"-38"
deep
12'
original
P-Box
4/24/2018
New Drainfield Control
Valve
110
11'
80'
15'
50'
NRW
New Drop Box
240' EZ Flow
64' New 4" Line
To Laterals
36-48" Deep.