Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

A

Permit Number #500172

Onsite Wastewater Treatment System
Request for Site Clearance and Permit

Include Form B and C. Submit correct fee with this Application

3 acres or more required for: ☒ Septic System ☐ Lagoon ☐ Other (Refer to Form C)

The undersigned hereby requests site clearance and permit to construct a Wastewater Treatment System in conformance with appropriate regulations.

PLEASE PRINT OR TYPE

A. Onsite System Location

Address 1091 NW 112th St. (no rural route) City Lincoln, NE Zip 68528

Legal Description 20 10 5 Principal Meridian 21

1/4 | 1/4 | Section | Township | Range | Subdivison | Addition | Block | Lot

PID 04-20-200-004-000

B. Owner

Name Bob Tindle Signature

Address City/State/Zip Lincoln NE, 68528

Home Phone 402 432 7598 Work Phone

C. Certified Installer

Name: Steven C Lewis Signature

Address 4810 W. Claire Ave. City/State/Zip Lincoln NE, 68523

Work Phone 402 310 9160

D. Engineer ☐ Check and complete if engineer designed system P.E. License Number:

Designer Name Firm Work Phone

E. This system will serve a

☒ Residential Dwelling Number of Bedrooms 4 Whirlpool Bathtub? ☐ Yes ☒ No Total Acres 12

Garbage Grinder? ☐ Yes ☒ No

☐ Commercial Establishment/Other Facility Specify Design flow in gallons per day 500

Type of Wastewater ☒ Domestic ☐ Non-Domestic

DO NOT WRITE BELOW THIS LINE

Approval Process ☐ Municipal Code 24.38 ☐ County Resolution No. 02-30

1. Health Department ACTION ☐ Approved ☐ Disapproved

Site visits Date rec'd Signature

Date frwd

Comments

2. Supt. Bldg. Insp. or Village Clerk ACTION ☐ Approved ☐ Disapproved

Comments Date rec'd Signature

Date frwd

3. City or County Engineer ACTION ☐ Approved ☐ Disapproved

Comments Date rec'd Signature

Date frwd

Installation Final Written Approval

By

Date

Business Office Use Only

Date Received 08-21-18 Amount Paid $405

Received By JMO Cash/Check No. 8442

White - Health Department Yellow - Engineer Pink - Building & Safety

Form A Updated: 1/13

Lincoln-Lancaster County Health Department (LLCHD)
Environmental Public Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

B

Permit Number:

Onsite Wastewater Treatment System

Soil Evaluation Report

PLEASE PRINT OR TYPE

Onsite System Location

Address 1091 NW 112th St. (no rural route) City Lincoln NE, Zip 68528

Owner Bob Tindle Address

Date of Tests 19 Aug 2018 to 20 Aug 2018 Weather: Precipitation .83 in Temperature 74°

Percolation Test Data Table

A.	B.	C.	D.	E.	F.	G.	H.	I.	J.	K.	L.	M.	N.
		Saturation/Swelling Time				Water Level Drop Last 30 mins of 4 hr or last 10 mins of 1 hr					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Initial Water Lev (in.)	Date (Mo/Da)	Time (Hr/Min)	Elapsed Time Interval	Water Level Drop (in)	Percolation Rates (Min/in = mpi)
1	36	8/19	12:30	8-20	8:00	8-20	8:00	6	8-20	8:30	30	7/8	26.25
2	"	"	"	"	"	"	"	6	"	"	1	1 1/8	33.75
3	"	"	"	"	"	"	"	6	"	"	1	7/8	26.25
								6					
								6					
								6					
								6					
								6					

Person Conducting Percolation Test

Name: Steven C Lewis
Phone: 402 310 9160
Address 4810 W. Claire Ave
Lincoln NE, 68523

Sum of Percolation Rates: 86.25
Average of Rates: 28.75
Rate Used for Calculation: 20-30

Soil type (NRCS Maps/Other) 7206- 7050-
Groundwater Depth over 12'

DO NOT WRITE BELOW THIS LINE

Reviewing Action

Comments (Soil type, groundwater, floodplain, etc.)

Signature of Reviewing Official Date


GIS Viewer
CITY OF LINCOLN / LANCASTER COUNTY, NE
1091 NW 112TH ST, LINC
Sign in
I want to...
Tools
1091
House
Tank
Well
Aerials
2005
2018
0
20
40ft

Lincoln-Lancaster County Health Department
Environmental Public Health Division (402) 441-8027
3131 O Street Lincoln, Nebraska 68510-1514

ON-SITE WASTE WATER SYSTEM
CONSTRUCTION - INSTALLATION PERMIT
No. HS001722

System Type: Standard

Situs: 1091 NW 112TH ST, LINCOLN, NE 68528

Issued: 8/23/2018

Expires: 8/23/2019

Description: S20, T10, R5, 6th Principal Meridian, LOT 21 NE

Owner: TINDLE, EUGENE ROBERT &
JACQUELINE L OSBERG-TINDLE
1091 NW 112 ST
LINCOLN, NE 68528-9175

Shavonna M. Lausterer, MPH, CPH, Health Director

Dear Applicant:

The above document is your permit to construct a new On-site Waste Water System at the location listed. Please contact this office once the sytem is complete in order to schedule a final inspection before use.

Shavonna M. Lausterer, MPH, CPH
Health Director

STEVEN LEWIS
4810 W CLAIRE AVE
LINCOLN, NE 68523

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

SCANNED

A

Permit Number #5001722

Onsite Wastewater Treatment System
Request for Site Clearance and Permit

Include Form B and C. Submit correct fee with this Application

3 acres or more required for: ☒ Septic System ☐ Lagoon ☐ Other (Refer to Form C)

The undersigned hereby requests site clearance and permit to construct a Wastewater Treatment System in conformance with appropriate regulations.

PLEASE PRINT OR TYPE

A. Onsite System Location

Address 1091 NW 112th St. (no rural route) City Lincoln, NE Zip 68528

Legal Description 20 10 5 Principal Meridian 21

1/4 | 1/4 | Section | Township | Range | Subdivison | Addition | Block | Lot

PID 04-20-200-004-000

B. Owner

Name Bob Tindle Signature

Address City/State/Zip Lincoln NE, 68528

Home Phone 402 432 7598 Work Phone

C. Certified Installer

Name: Steven C Lewis Signature

Address 4810 W. Claire Ave. City/State/Zip Lincoln NE, 68523

Work Phone 402 310 9160

D. Engineer ☐ Check and complete if engineer designed system P.E. License Number:

Designer Name Firm Work Phone

E. This system will serve a

☒ Residential Dwelling Number of Bedrooms 4 Whirlpool Bathtub? ☐ Yes ☒ No Total Acres 12

Garbage Grinder? ☐ Yes ☒ No

☐ Commercial Establishment/Other Facility Specify Design flow in gallons per day 500

Type of Wastewater ☒ Domestic ☐ Non-Domestic

DO NOT WRITE BELOW THIS LINE

Approval Process ☒ Municipal Code 24.38 ☐ County Resolution No. 02-38

1. Health Department

Site visits

Comments

Date rec'd 8/23/18

Date frwd 8/23/18

ACTION ☒ Approved ☐ Disapproved

Signature

2. Supt. Bldg. Insp. or Village Clerk

Comments

Date rec'd

Date frwd

ACTION ☐ Approved ☐ Disapproved

Signature

3. City or County Engineer

Comments

Date rec'd

Date frwd

ACTION ☐ Approved ☐ Disapproved

Signature

Installation Final Written Approval

By

Date 10/16/18

Business Office Use Only

Date Received 09-21-18 Amount Paid $405

Received By JAO Cash/Check No. 6842

White - Health Department Yellow - Applicant/Installer Pink - Building & Safety

Form A Updated: 1/13

+ New System, Replacement Septic Tank

Nate C. Hartman

From: Antoinette Lewis <gagnerconstruction@yahoo.com>
Sent: Thursday, October 11, 2018 11:43 AM
To: Nate C. Hartman
Subject: 1091 NW 112th D sheet and Drawing
Attachments: 1091 NW 112th D and Drawing.pdf

Call me if you have any questions, (402)432-1082 – Steven Lewis

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

D Exhibit 4

Permit Number:

Onsite Wastewater Treatment System
As-Built Description and Drawing

Type of Onsite Wastewater System: ☐ Lagoon (Skip to Back Page) ☒ Subsurface Septic ☐ Mound

Onsite Wastewater System Location

Address or Legal Description or Parcel Identification Number (PID) 04-20-200-004-000

Owner Bob Tindle Address 1091 NW 112th St. Lincoln NE, 68528

A. Wastewater Piping

1. Material SDR26 Diameter: 4 in.
2. Distance between dwelling and septic tank: 63 ft.

B. Septic Tank

1. Material plastic & Existing concrete
2. Capacity: 1000g 1000g
3. Depth to top of tank, below unfinished grade: ____ in.
4. Distance to:
   Well over 100 ft.
   Pressure line NA ft
   Property Line 30 ft.
   Foundation 63 ft.

C Distribution Box or Drop Box

Distance and Direction from septic tank: 18 ft. SE

D. Drainfield/Absorption Field

☒ Trench ☐ Bed

1. Type: ☐ Perforated Pipe ☐ Chamberless ☒ Other
   Material brand and inside width of Chamberless: Infiltrator EZ Flow 4.5
2. Number of Laterals: 3
3. Length of each lateral (linear): ft. 100 ft. 110 ft. 20 ft. ____
4. Drainfield size: 1035 sq. ft. 1080 (1000 req'd)
5. Distance to:
   Well over 100 ft.
   Pressure line NA ft.
   Property line 10' ft.
   Depth of Groundwater 20'

Was the Onsite Wastewater System covered prior to LLCHD inspection? ☐ Yes ☐ No

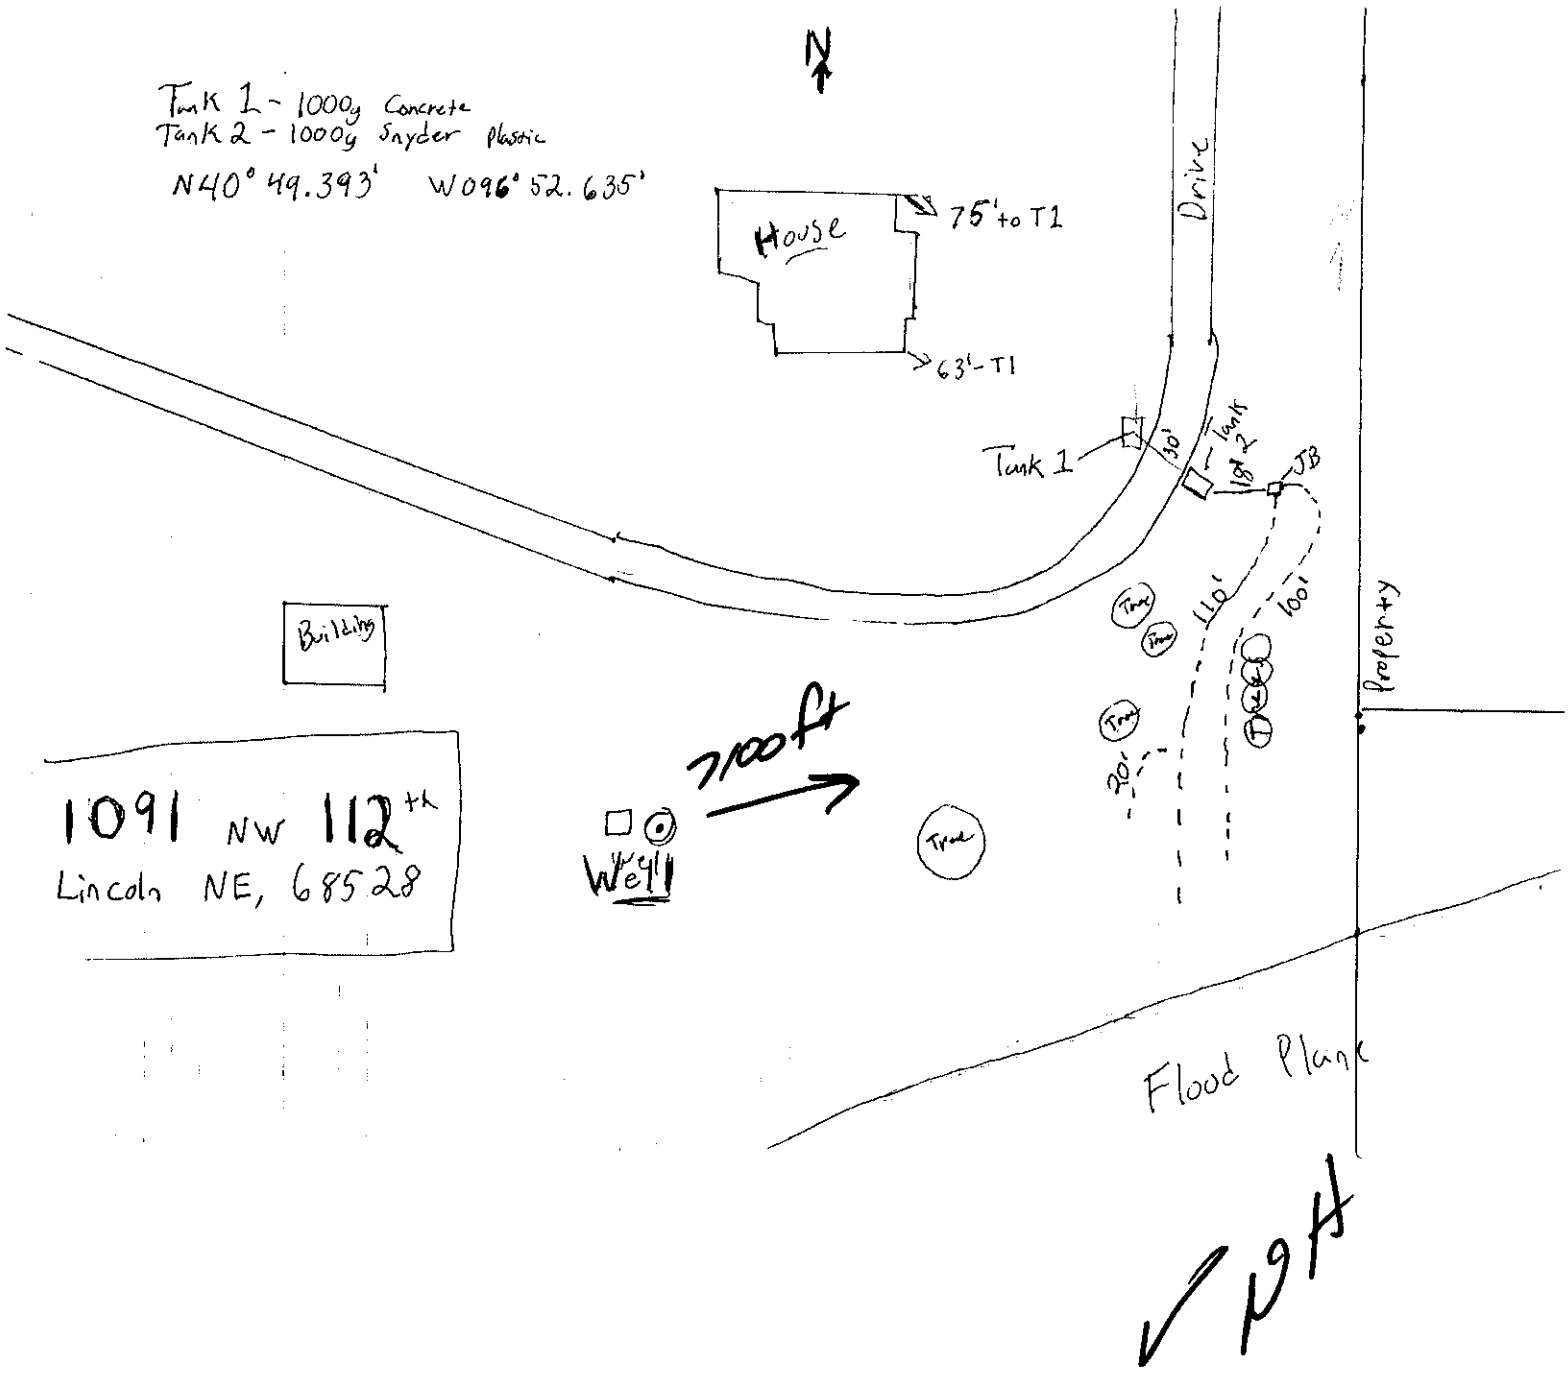
If Yes, the Certified Professional must sign below for final approval:

I swear and affirm that the system complies with Lincoln Municipal Code (LMC) 24.38 and/or County Resolution R-13-0062 requirements and that the information and documentation submitted are true and accurate.

Certified Professional Signature: _____ Date: 27 sept 2018

Complete As-Built drawing on the back of this form.

Updated 4/15


Tank 1 - 1000g Concrete
Tank 2 - 1000g Snyder Plastic
N40° 49.393' W096° 52.635'
N
House
75' to T1
63' - T1
Drive
Tank 1
30'
18' - Tank 2
JB
Building
110'
100'
Property
Tank
Tank
Tank
Tree
20'
700ft
Well
Tank
1091 NW 112th
Lincoln NE, 68528
Flood Plain
19ft


GIS Viewer
CITY OF LINCOLN - LANCASTER COUNTY, NE
1091 NW 112TH ST, LINC
Sign in
I want to...
Tools
1091
House
Tank
Well
Flood Plane
Aerials
2005
2018
0
20
40ft
SCANNED