Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

A

Permit Number 450017778

Onsite Wastewater Treatment System
Request for Site Clearance and Permit

Include Form B and C. Submit correct fee with this Application

3 acres or more required for: ☒ Septic System ☐ Lagoon ☐ Other (Refer to Form C)

The undersigned hereby requests site clearance and permit to construct a Wastewater Treatment System in conformance with appropriate regulations.

PLEASE PRINT OR TYPE

A. Onsite System Location

Address 500 Sprague rd. (no rural route) City Roca or Martell, NE Zip 68430

Legal Description 26 8 6 6th Principal Meridian 12733

1/4	1/4	Section	Township	Range	Subdivison	Addition	Block	Lot

PID 08 26 400 013 000

B. Owner

Name Eric & Jamie Carman Signature

Address City/State/Zip

Home Phone 402 540 4078 Work Phone

C. Certified Installer

Name: Steven C Lewis Signature

Address 4810 W. Claire Ave City/State/Zip Lincoln / NE / 68523

Work Phone 402 432-1082

D. Engineer ☐ Check and complete if engineer designed system P.E. License Number:

Designer Name Firm Work Phone

E. This system will serve a

☐ Residential Dwelling Number of Bedrooms Ø Whirlpool Bathtub? ☐ Yes ☐ No Total Acres 31.53

Garbage Grinder? ☐ Yes ☐ No

☒ Commercial Establishment/Other Facility Specify Horse Barn Design flow in gallons per day <50

Type of Wastewater ☒ Domestic ☐ Non-Domestic

DO NOT WRITE BELOW THIS LINE

Approval Process ☐ Municipal Code 24.38 ☐ County Resolution No. 02-30

1. Health Department

Site visits Date rec'd ACTION ☐ Approved ☐ Disapproved

Date fwd Signature

Comments

2. Supt. Bldg. Insp. or Village Clerk

Comments Date rec'd ACTION ☐ Approved ☐ Disapproved

Date fwd Signature

3. City or County Engineer

Comments Date rec'd ACTION ☐ Approved ☐ Disapproved

Date fwd Signature

Installation Final Written Approval

By

Date

Business Office Use Only

Date Received 12-11-18 Amount Paid $420.00

Received By JAO Cash/Check No. CC-0412

White - Health Department Yellow - Engineer Pink - Building & Safety

Form A Updated: 1/13

Lincoln-Lancaster County Health Department (LLCHD)
Environmental Public Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

B

Permit Number:

Onsite Wastewater Treatment System

Soil Evaluation Report

PLEASE PRINT OR TYPE 08 26 400 013 000

Onsite System Location

Address 500 Sprague Rd (No rural route) City Roca or Martell NE, Zip 68430

Owner Eric & Jamie Carman Address

Date of Tests 9 Dec 18 to 10 Dec 18 Weather: Precipitation Ø Temperature 40°

Percolation Test Data Table

A.	B.	C.	D.	E.	F.	G.	H.	I.	J.	K.	L.	M.	N.
		Saturation/Swelling Time				Water Level Drop Last 30 mins of 4 hr or last 10 mins of 1 hr					Results		
		Start		End		Start		Initial	End				
Hole No.	Hole Depth (in)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Water Lev (in.)	Date (Mo/Da)	Time (Hr/Min)	Elapsed Time Interval	Water Level Drop (in)	Percolation Rates (Min/in = mpi)
1	36	12/9	1:00	12/10	1:00	12/10	1:00	6	12/10	1:30	30	½	60
2	"	"	"	"	"	"	"	6	"	"	"	½	60
3	"	"	"	"	"	"	"	6	"	"	"	½	60
4	"	"	"	"	"	"	"	6	"	"	"	⅝	48
								6					
								6					
								6					
								6					

Person Conducting Percolation Test

Name: Steven C Lewis
Phone: 402 432-1082
Address 4810 w. Claire Ave
Lincoln NE, 68523
Soil type (NRCS Maps/Other) 7684
Groundwater Depth Over 12'

Sum of Percolation Rates: 228
Average of Rates: 57
Rate Used for Calculation: 50-60

DO NOT WRITE BELOW THIS LINE

Reviewing Action

Comments (Soil type, groundwater, floodplain, etc.)

Signature of Reviewing Official Date

Lincoln-Lancaster County Health Department
Environmental Public Health Division (402) 441-8027
3131 O Street Lincoln, Nebraska 68510-1514

ON-SITE WASTE WATER SYSTEM
CONSTRUCTION - INSTALLATION PERMIT
No. HS001778

System Type: Standard

Situs: No Site Address Specified

Issued: 12/12/2018

Expires: 12/12/2019

Description: S26, T8, R6, 6th Principal Meridian, LOTS 12 & 33 S1/2

Owner: CARMAN, ERIC H & JAMIE L
PO BOX 346
PANAMA, NE 68419

Shavonna M. Lausterer, MPH, CPH, Health Director

Dear Applicant:

The above document is your permit to construct a new On-site Waste Water System at the location listed. Please contact this office once the sytem is complete in order to schedule a final inspection before use.

Shavonna M. Lausterer, MPH, CPH
Health Director

STEVEN LEWIS
4810 W CLAIRE AVE
LINCOLN, NE 68523

SCANNED

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

A

Permit Number #5001778

Onsite Wastewater Treatment System
Request for Site Clearance and Permit

Include Form B and C. Submit correct fee with this Application

3 acres or more required for: ☒ Septic System ☐ Lagoon ☐ Other (Refer to Form C)

The undersigned hereby requests site clearance and permit to construct a Wastewater Treatment System in conformance with appropriate regulations.

PLEASE PRINT OR TYPE

A. Onsite System Location

Address 500 Sprague rd. (no rural route) City Roca or Martell NE Zip 68430

Legal Description 26 8 6 6th Principal Meridian 12833

1/4	1/4	Section	Township	Range	Subdivison	Addition	Block	Lot

PID 08 26 400 013 000

B. Owner

Name Eric & Jamie Carman Signature

Address City/State/Zip

Home Phone 402 540 4078 Work Phone

C. Certified Installer

Name: Steven C Lewis Signature

Address 4810 W. Claire Ave City/State/Zip Lincoln / NE / 68523

Work Phone 402 432-1082

D. Engineer ☐ Check and complete if engineer designed system P.E. License Number:

Designer Name Firm Work Phone

E. This system will serve a

☐ Residential Dwelling Number of Bedrooms Ø Whirlpool Bathtub? ☐ Yes ☐ No Total Acres 31.53

Garbage Grinder? ☐ Yes ☐ No

☒ Commercial Establishment/Other Facility Specify Horse Barn Design flow in gallons per day <50

Type of Wastewater ☒ Domestic ☐ Non-Domestic

DO NOT WRITE BELOW THIS LINE

Approval Process ☐ Municipal Code 24.38 ☒ County Resolution No. 02-38

1. Health Department
Site visits 9/6/19
Comments
Date rec'd 12/11/18
Date frwd 12/12/18
ACTION ☒ Approved ☐ Disapproved
Signature

2. Supt. Bldg. Insp. or Village Clerk
Comments
Date rec'd
Date frwd
ACTION ☐ Approved ☐ Disapproved
Signature

3. City or County Engineer
Comments
Date rec'd
Date frwd
ACTION ☐ Approved ☐ Disapproved
Signature

Installation Final Written Approval
By Doug Ahrens
Date 9/6/19

Business Office Use Only
Date Received 12-11-18 Amount Paid $420.00
Received By JMO Cash/Check # CC 0412

White - Health Department Yellow - Engineer Pink - Building & Safety

Form A Updated: 1/13

Nate C. Hartman

From: Brandon Sedlacek <southeast.sewer@yahoo.com>
Sent: Wednesday, July 17, 2019 11:24 AM
To: Nate C. Hartman
Subject: Jamie Carman Residents

Nate, this is Brandon with Southeast Sewer & Septic. Sorry I'm out of town this week but will go look at the septic system next week when I get back. Lenny said he got ahold of you.

Thanks

Sent from Yahoo Mail for iPhone

Nate C. Hartman

From: Nate C. Hartman
Sent: Friday, July 12, 2019 2:28 PM
To: 'middlecrossstables@hotmail.com'
Cc: Chris M. Schroeder
Subject: Illegal Septic System


Jamie:

This email serves a brief follow-up to our site visit earlier today. As discussed while onsite, within the next 7 days, you must provide a plan of action to the Lincoln-Lancaster County Health Department (LLCHD) within the next 7 days (-a detailed email will suffice). As a reminder, once a contractor has been chosen, make sure that they know to make contact with us regarding their timeline for work completion. In addition, there will also be a letter from our department describing the situation in more detail as well as any additional remediation that will need to happen in order to fully resolve the issue. In the meantime, please utilize the list of certified contractors that was emailed to this address earlier in the day.

If you have any questions as you continue to move forward, please let me know.


Thank you.

Nate Hartman REHS, QCIS, QPSWPPP
Senior Environmental Health Specialist
3131 'O' Street, Lincoln, NE 68510
O: 402-441-8643 F: 402-441-3890

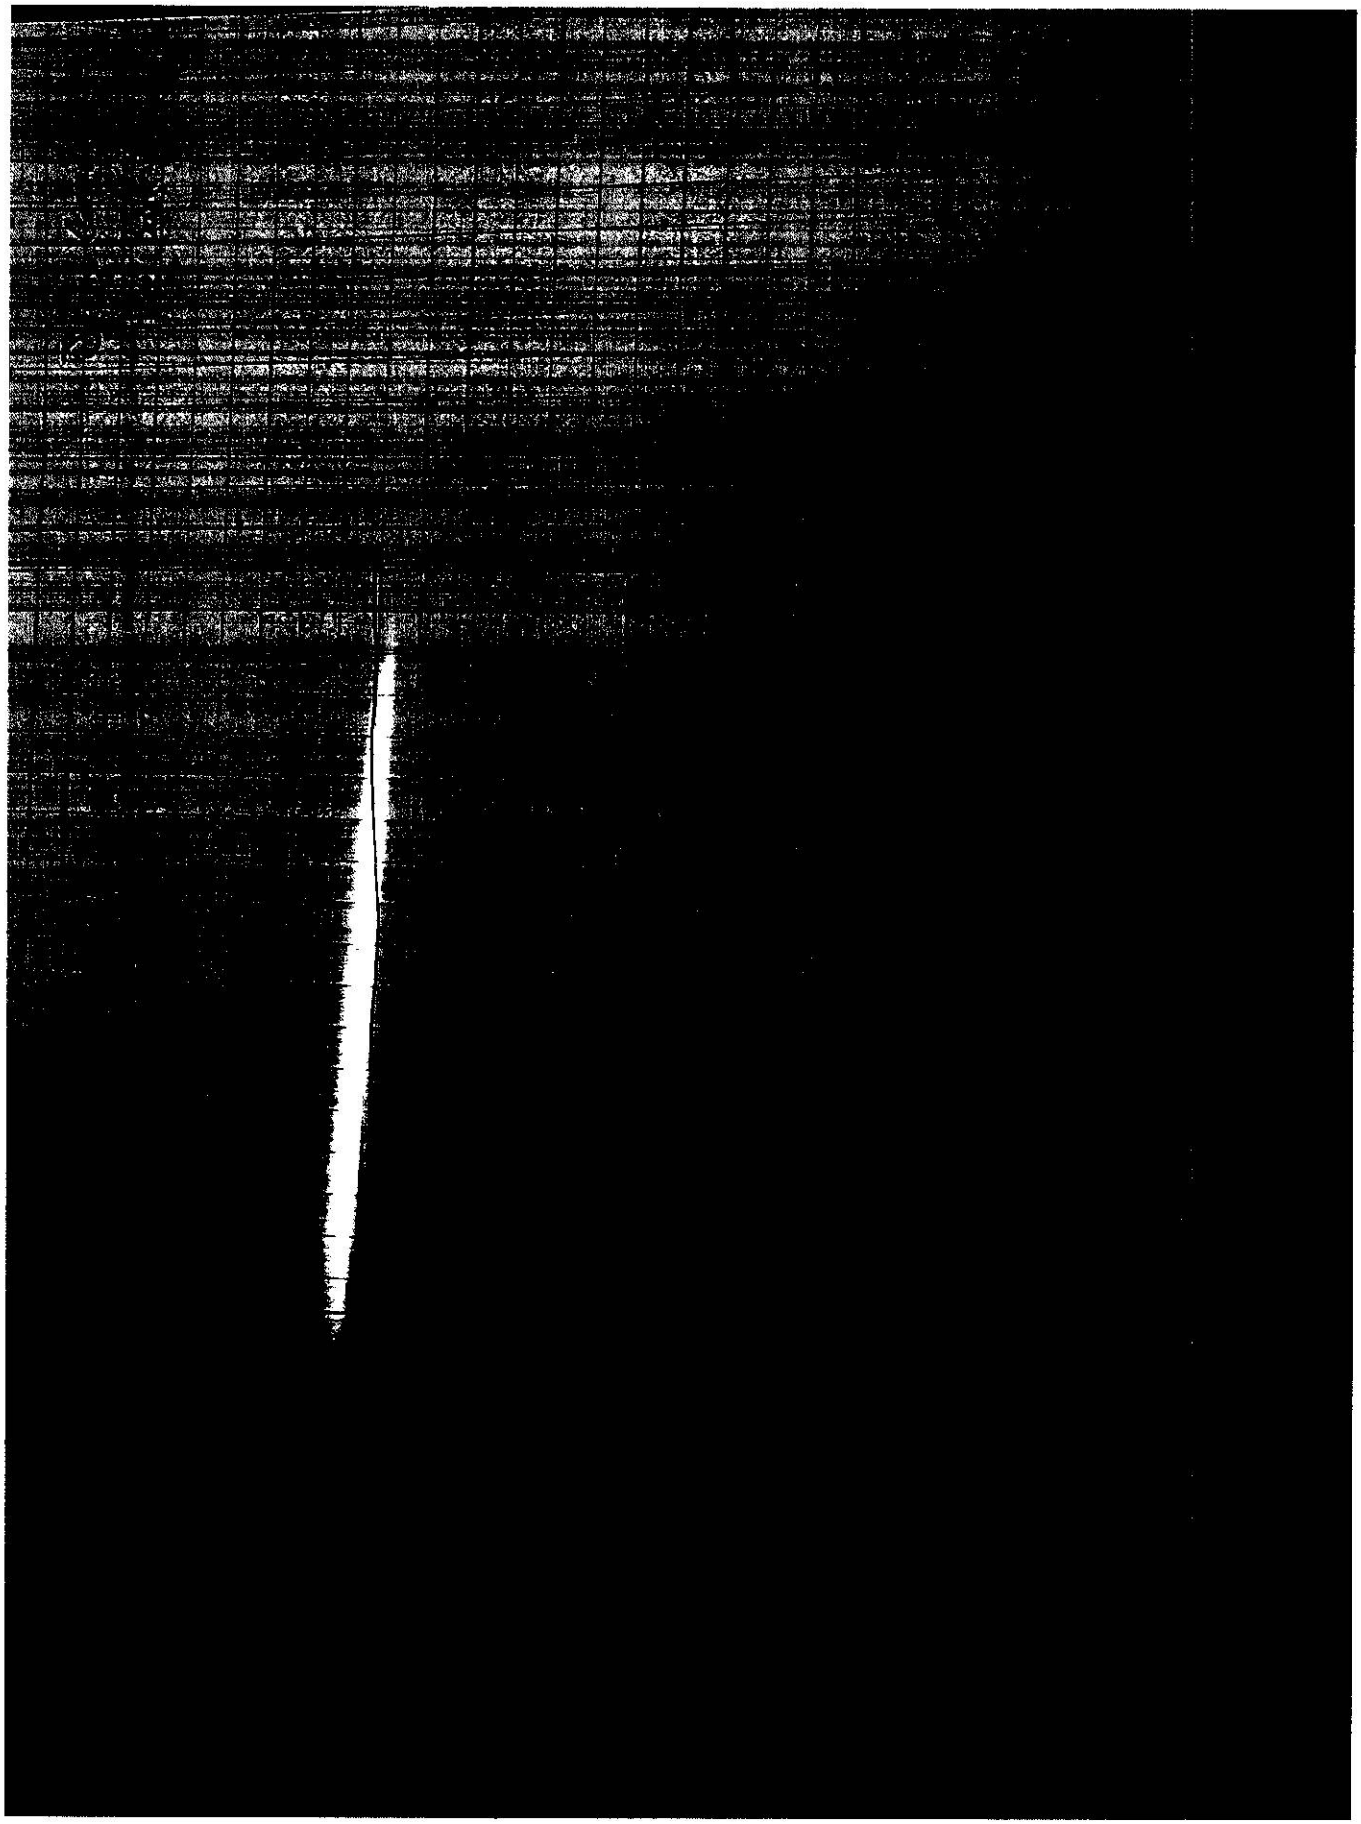

Nate C. Hartman

From: Brandon Sedlacek <southeast.sewer@yahoo.com>
Sent: Monday, September 09, 2019 6:59 AM
To: Nate C. Hartman
Subject: Jamie Carman Horse Barn

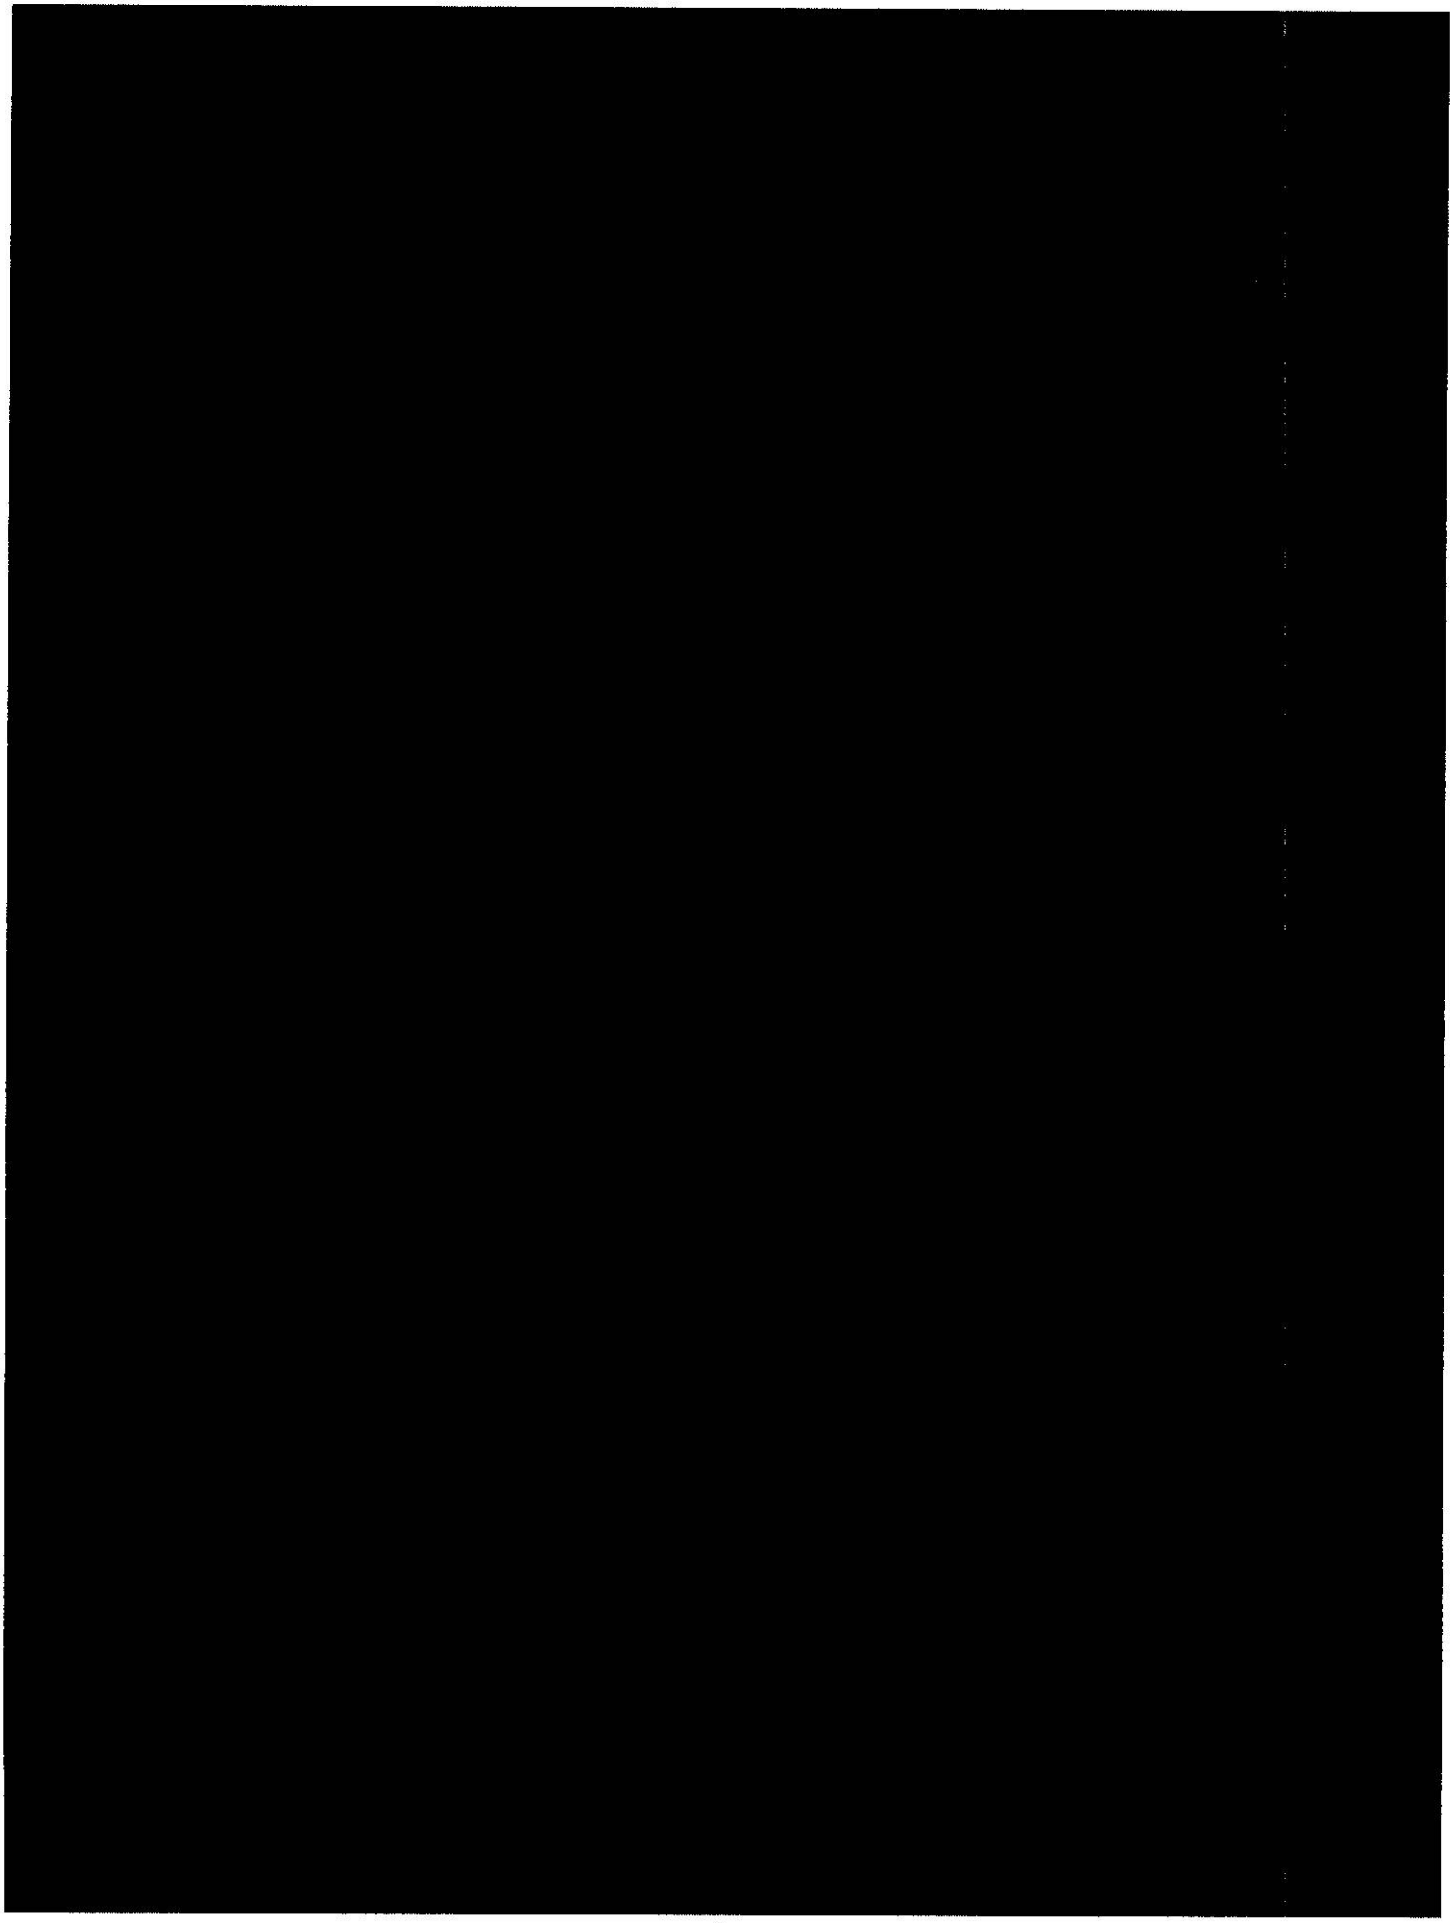


Nate C. Hartman

From: Doug R. Smith
Sent: Friday, September 06, 2019 11:21 AM
To: Nate C. Hartman; Chris M. Schroeder
Cc: Doug R. Smith
Subject: 500 Sprague

Nate, Chris,
Michael and I went to the Planning Mtg and on to 500 Sprague afterward. Southeast Sewer found a 1000 gallon tank and 100 feet of lateral (chambers) divided into 2 runs. Southeast was satisfied that it was done correctly. They did add risers to the tank. They will send in a drawing. So, good to go and all lived happily ever after. Vern J was working on a repair at I believe he said 600 Pennsylvania. He was adding only 30 feet of lateral, so, was going to be done before I could get there. So, told him to cover and send in the paperwork.

Doug Smith, REHS, CP-FS
Senior Environmental Health Specialist
3131 "O" Street, Lincoln, NE 68510
O: 402-441-8031 F: 402-441-3890

Jamie Carman
Horse Barn Bathroom

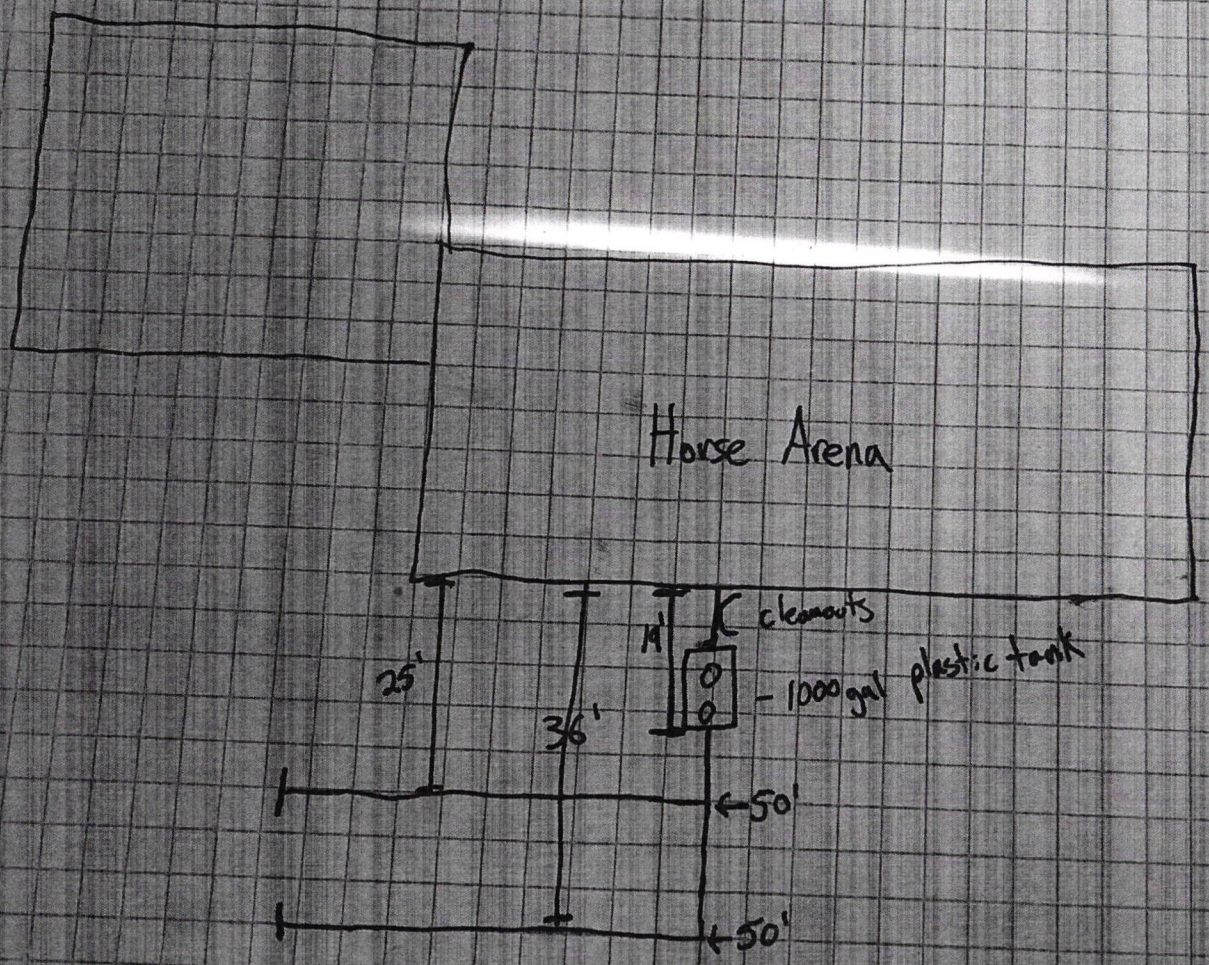

100 ft Arc 36 Laterals

SCANNED