Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

A

Permit Number #S001866

Existing Home

Onsite Wastewater Treatment System Request for Site Clearance and Permit

Include Form B and C. Submit correct fee with this Application

3 acres or more required for: ☒ Septic System ☐ Lagoon ☐ Other (Refer to Form C)

The undersigned hereby requests site clearance and permit to construct a Wastewater Treatment System in conformance with appropriate regulations.

PLEASE PRINT OR TYPE

A. Onsite System Location

Address 10440 S 56th St (no rural route) City Lincoln, NE Zip 68516

Legal Description NW 33 9N 7E 54
(1/4 1/4 Section Township Range Subdivison Addition Block Lot)

PID 16-33-100-053-000

B. Owner

Name Eugene Kohmetscher Signature E J. Kohmetscher

Address 10440 S 56th St City/State/Zip Lincoln, NE 68516

Home Phone 402-430-8722 Work Phone

C. Certified Installer

Name: Lloyd Jakoubek, Raymond Contracting Inc Signature Lloyd Jakoubek

Address 13800 NW 70th St City/State/Zip Raymond, NE 68428

Work Phone 402-890-6009 or 402-783-2663

D. Engineer

☐ **Check and complete if engineer designed system** P.E. License Number:

Designer Name Firm Work Phone

E. This system will serve a

☒ Residential Dwelling Number of Bedrooms 3 Whirlpool Bathtub? ☐ Yes ☒ No Total Acres 5
Garbage Grinder? ☒ Yes ☐ No

☐ Commercial Establishment/Other Facility Specify Design flow in gallons per day

Type of Wastewater ☐ Domestic ☐ Non-Domestic

DO NOT WRITE BELOW THIS LINE

Approval Process ☐ Municipal Code 24.38 ☐ County Resolution No. 02-30

1. Health Department
Site visits Date rec'd **ACTION** ☐ Approved ☐ Disapproved
Date frwd Signature
Comments

2. Supt. Bldg. Insp. or Village Clerk
Comments Date rec'd **ACTION** ☐ Approved ☐ Disapproved
Date frwd Signature

3. City or County Engineer
Comments Date rec'd **ACTION** ☐ Approved ☐ Disapproved
Date frwd Signature

Installation Final Written Approval
By
Date

Business Office Use Only
Date Received 7-24-19 Amount Paid $420.00
Received By JAD Cash/Check No. 9678

White - Health Department Yellow - Engineer Pink - Building & Safety

REC'D JUL 24 2019

Lincoln-Lancaster County Health Department (LLCHD)
Environmental Public Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

B

Permit Number:

Onsite Wastewater Treatment System

Soil Evaluation Report

PLEASE PRINT OR TYPE

Onsite System Location

Address 10440 S 56th St (no rural route) City Lincoln NE, Zip 68516

Owner Gene & Suzanne Kohmetscher Address 10440 S 56th St, Lincoln, NE 68516

Date of Tests 4/23/19 to 4/24/19 Weather: Precipitation 0 Temperature 70°

Percolation Test Data Table

A.	B.	C. D. E. F. Saturation/Swelling Time				G. H. I. J. K. Water Level Drop Last 30 mins of 4 hr or last 10 mins of 1 hr					L. M. N. Results		
		Start		End		Start		Initial	End				
Hole No.	Hole Depth (in)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Water Lev (in.)	Date (Mo/Da)	Time (Hr/Min)	Elapsed Time Interval	Water Level Drop (in)	Percolation Rates (Min/in = mpi)
1	48	4/23	9:00a	4/23	1:00p	4/24	1:00p	6	4/24	1:30p	30	1-1/2	20
2	44	"	"	"	"	"	"	6	"	"	"	9/16	53
3	52	"	"	"	"	"	"	6	"	"	"	1/2	60
4	70	"	"	"	"	"	"	6	"	"	"	1-1/8	27
								6					
								6					
								6					
								6					

Person Conducting Percolation Test

Name: Terri L Jakoubek, Raymond Contracting, Inc.
Phone: 402-783-2663 or 402-890-6009
Address 13800 NW 70th St
Raymond, NE 68428 Cert #1198

Sum of Percolation Rates: 160
Average of Rates: 40
Rate Used for Calculation: 60 (20 mpi variance)

Soil type (NRCS Maps/Other) Clay Loam
Groundwater Depth >10'

DO NOT WRITE BELOW THIS LINE

Reviewing Action

Comments (Soil type, groundwater, floodplain, etc.) _____

Signature of Reviewing Official _____ Date _____

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022


C

Permit Number:

Onsite Wastewater Treatment System

Preliminary Plan Specifications

Draw a plot plan showing onsite system sewer lines, drop of distribution boxes, tank, drainfields, percolation test holes, well, residence, direction of groundwater flow, property lines, and reserve area for replacement onsite system.

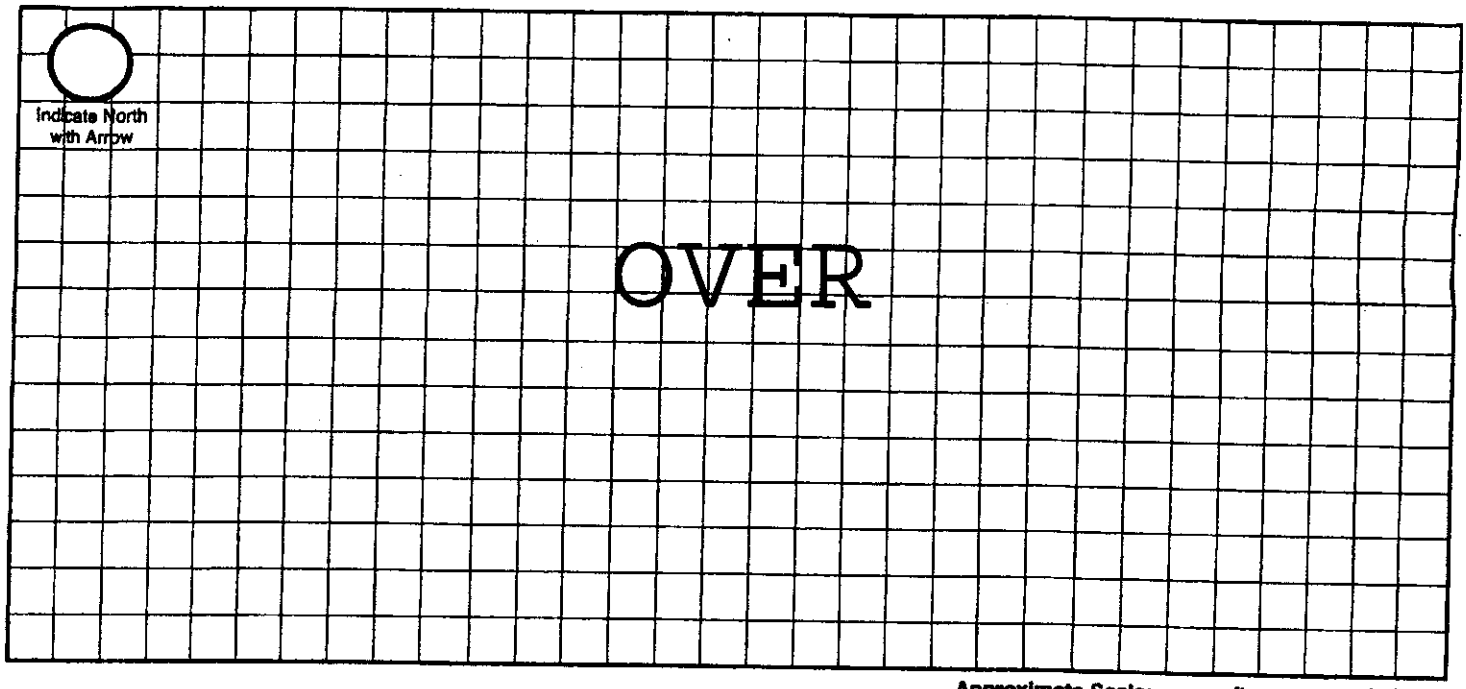

Approximate Scale: _____ ft. = _____ grid line/s

A. Onsite System Location

Address (no rural route) 10440 S 56th St City Lincoln NE, Zip 68516

B. Proposed Septic Tank/s

Septic Tank Cap. 1,500 gals Tank Material: ☒ Concrete ☐ Plastic ☐ Other _____ ☐ Lagoon(Max. seepage 1/8" per day)

C. Reserve Area for Replacement Onsite System

☐ Drainfield Absorption Area (percolation test required) ☒ Lagoon

D. Drainfield Absorption System

Percolation Rate 60 (min/inch = mpi) No. of Bedrooms 3 Soil Type SCL Land Slope _____%

☒ Trench ☐ Bed ☐ Non-Standard (engineer designed and NDEQ approved Total Square feet of drainfield 1,080 sq.ft.

Total length of laterals 240 Type of distribution: ☐ Perforated pipe ☐ Half-Round ☐ Chamber ☒ Other EZFlow 1203H

No. of absorption trenches 3 Width 40" No. of drop boxes 1 Distrubtion Box _____

No. of absorption beds _____ Width _____ No of Distribution lines per bed _____

E. Setbacks Check the Boxes Below if the Required Setback has been Satisfied

Distance From	Private Well	Public Well	Surface Water	Gound Water	Pressure Water Lines	Property Lines	Foundations Yours	Foundations Neighbors	All Other Setbacks
Tank (ft)	50 ☒	500 ☒	50 ☒	NA ☒	25 ☒	20 ☒	15 ☒	25 ☒	☒
Field (ft)	100 ☒	500 ☒	50 ☒	4 ☒	30 ☒	20 ☒	30 ☒	40 ☒	☒
Lagoon (ft)	100 ☐	500 ☐	50 ☐	N/A ☐	30 ☐	50 ☐	100 ☐	200 ☐	☐

F. Required Signatures


Home Building Contractor Existing Home Date _____

Installer [signature] Date 7/22/19

Gene Kohmetscher 402-450-2363 10440 S 56th St, Lincoln, NE 68516

GIS Viewer
CITY OF LINCOLN - LANCASTER COUNTY, NE

City of Lincoln\Lancaster County GIS Map

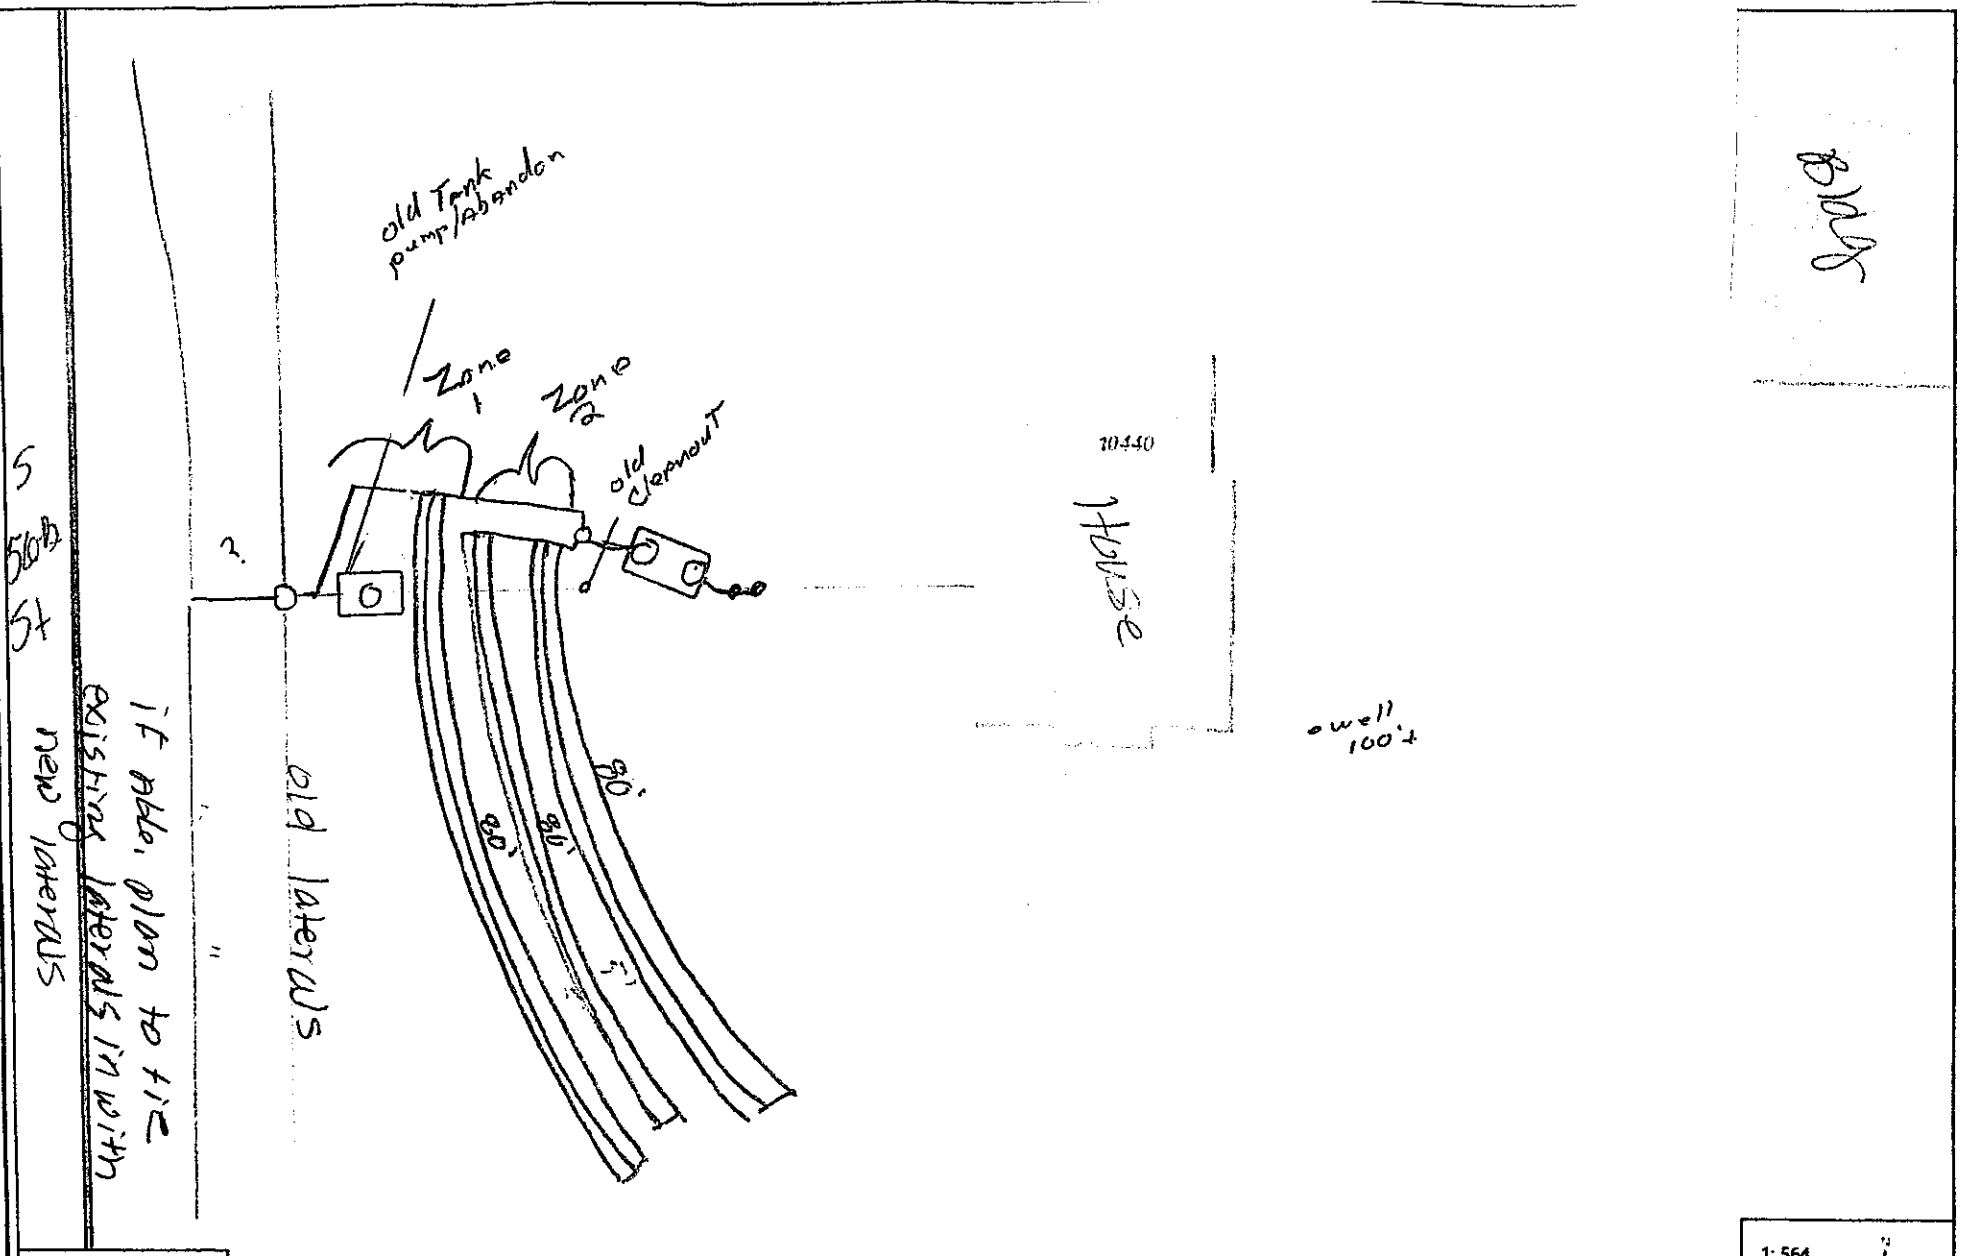

Printed: 5/2/2019

1: 564

Disclaimer: The information is presented on a best-efforts basis, and should not be relied upon for making financial, survey, legal or other commitments. If you have questions or comments regarding the data displayed on this map, please email assessor@lancaster.ne.gov and you will be directed to the appropriate department.

Lincoln-Lancaster County Health Department
Environmental Public Health Division (402) 441-8027
3131 O Street Lincoln, Nebraska 68510-1514

ON-SITE WASTE WATER SYSTEM
CONSTRUCTION - INSTALLATION PERMIT
No. HS001866

System Type: Standard

Situs: 10440 S 56TH ST, LINCOLN, NE 68516

Issued: 7/30/2019

Expires: 7/30/2020

Description: S33, T9, R7, 6th Principal Meridian, LOT 54 NW

Owner: KOHMETSCHER, EUGENE &
SUZANNE
10440 S 56 ST
LINCOLN, NE 68516

Patricia D. Lopez

Patricia D. Lopez, RN, MSN, Interim Health Director

Dear Applicant:

The above document is your permit to construct a new On-site Waste Water System at the location listed. Please contact this office once the sytem is complete in order to schedule a final inspection before use.

Patricia D. Lopez

Patricia D. Lopez, RN, MSN
Interim Health Director

RAYMOND CONTRACTING INC
13800 NW 70TH ST
RAYMOND, NE 68428