Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

A

Permit Number HSO1872

Onsite Wastewater Treatment System Permit Application

Include Form B and C. Submit correct fee with this Application

☐ Septic System ☒ Lagoon ☐ Other (Refer to Form C)

PLEASE PRINT OR TYPE

A. Onsite System Location

Address* 9720 NW 105th Street (no rural route) City Malcolm, NE Zip 68402

Legal Description ____ 12 11 5 6th Principal Meridian 93 NE

1/4 | 1/4 | Section | Township | Range | Subdivison | Addition | Block | Lot

PID 05-21-200-011-000 *Approx. Address (If to be determined) ____

B. Owner

Name Roger and Juli Plooster Signature ____

Address 9720 NW 105th Street City/State/Zip Malcolm 68402

Home Phone ____ Work Phone ____

C. Certified Installer

Name: Jaime Kubik Signature Jaime Kubik

Address 105 Locust Street P.O. Box 191 City/State/Zip Hickman, NE 68372

Work Phone 402-475-2462

D. Engineer

☐ **Check and complete if engineer designed system** P.E. License Number: ____

Designer Name ____ Firm ____ Work Phone ____

E. This system will serve a

☐ Residential Dwelling Number of Bedrooms 6 Whirlpool Bathtub? ☐ Yes ☐ No Total Acres 22.13

Garbage Grinder? ☐ Yes ☐ No

☐ Commercial Establishment/Other Facility Specify ____ Design flow in gallons per day Type of Wastewater ☐ Domestic ☐ Non-Domestic

DO NOT WRITE BELOW THIS LINE

Approval Process

1. Health Department

Site visits ____ Date rec'd ____ Date frwd ____

Comments ____

ACTION ☐ Approved ☐ Disapproved Signature ____

2. Supt. Bldg. Insp. or Village Clerk

Comments ____ Date rec'd ____ Date frwd ____

ACTION ☐ Approved ☐ Disapproved Signature ____

3. City or County Engineer

Comments ____ Date rec'd ____ Date frwd ____

ACTION ☐ Approved ☐ Disapproved Signature ____

Installation Final Written Approval

By ____

Date ____

Business Office Use Only
Date Received 8-09-19 Amount Paid $420.00
Received By JAO Cash/Check No. 3561

White - Health Department Yellow - Engineer Pink - Building & Safety

Form A Updated: 4/15

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

D

Permit Number:

Onsite Wastewater Treatment System
As-Built Description and Drawing

Type of Onsite Wastewater System: ☒ Lagoon **(Skip to Back Page)** ☐ Subsurface Septic ☐ Mound

Onsite Wastewater System Location

Address or Legal Description or Parcel Identification Number (PID) 05-21-200-011-000

Owner: Roger and Juli Plooster Address 9720 NW 105th Street, Malcolm NE 68402

A. Wastewater Piping

1. Material: SCH 40 Diameter: 4 in.
2. Distance between dwelling and septic tank: 30 ft.

B. Septic Tank

1. Material IM 1060 Infiltrator and 500 gallon pump tank
2. Capacity: 1500 and 500
3. Depth to top of tank, below unfinished grade: _____ in.
4. Distance to:
   Well _____ ft.
   Pressure line _____ ft
   Property Line _____ ft.
   Foundation _____ ft.

C Distribution Box or Drop Box

Distance and Direction from septic tank: _____ ft. _____

D. Drainfield/Absorption Field

☐ Trench ☐ Bed

1. Type: ☐ Perforated Pipe ☐ Chamberless ☐ Other
   Material brand and inside width of Chamberless: _____
2. Number of Laterals: _____
3. Length of each lataral (linear): ft._____ ft._____ ft._____ ft._____
4. Drainfield size: _____ sq. ft.
5. Distance to:
   Well _____ ft.
   Pressure line _____ ft.
   Property line _____ ft.
   Depth of Groundwater _____

Was the Onsite Wastewater System covered prior to LLCHD inspection? ☒ Yes ☐ No

If Yes, the Certified Professional must sign below for final approval:

I swear and affirm that the system complies with Lincoln Municipal Code (LMC) 24.38 and/or County Resolution R-13-0062 requirements and that the information and documentation submitted are true and accurate.


Certified Professional Signature: _____ Date: 8/12/19

Complete As-Built drawing on the back of this form.


Onsite Wastewater System Design (Example)

Indicate North
w/ Arrow Here:



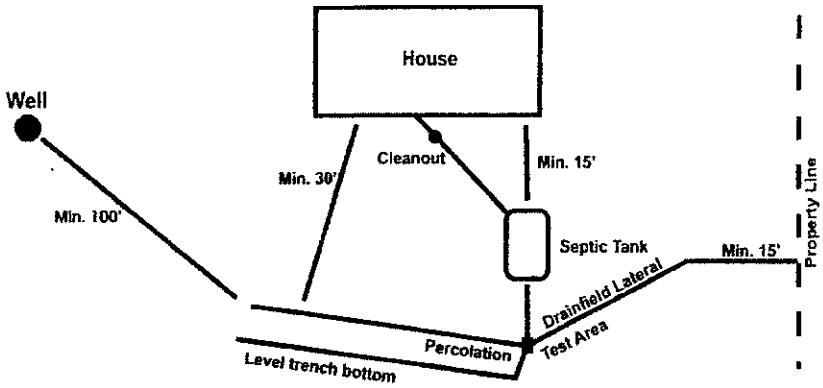

*Note-If Lagoon, show all applicable dimensions

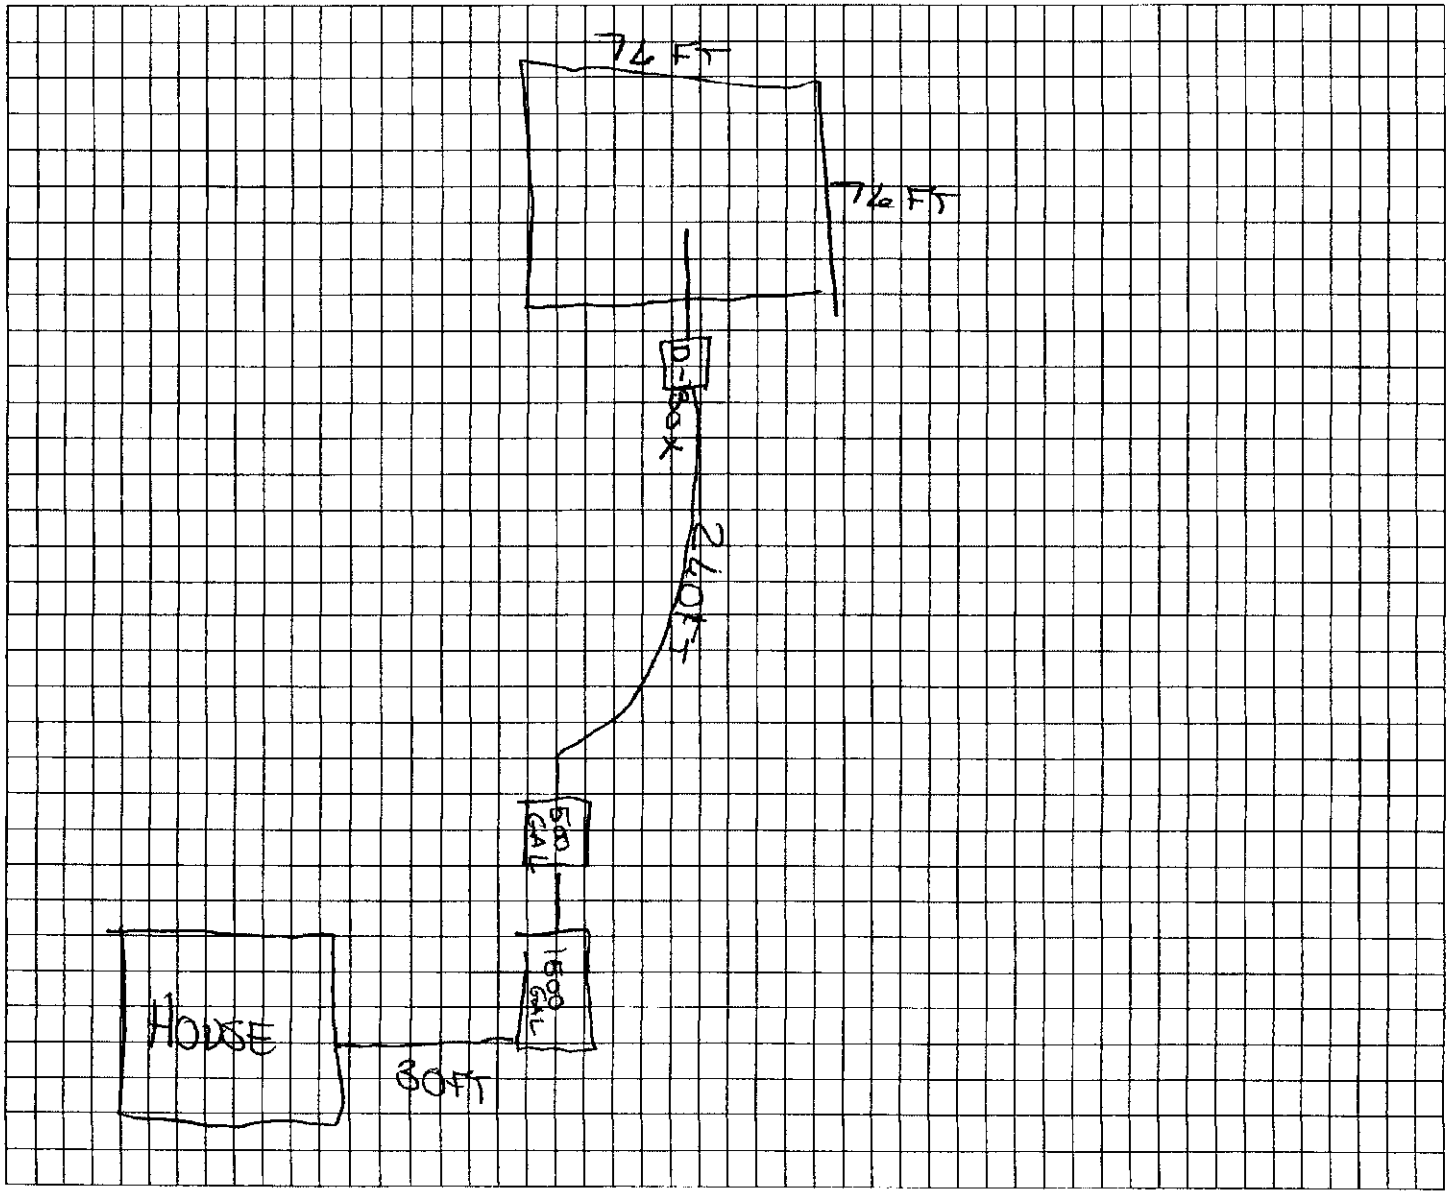

Lincoln-Lancaster County Health Department
Environmental Public Health Division (402) 441-8027
3131 O Street Lincoln, Nebraska 68510-1514

ON-SITE WASTE WATER SYSTEM
CONSTRUCTION - INSTALLATION PERMIT
No. HS001872

System Type: Lagoon

Situs: 9720 NW 105TH ST, RAYMOND, NE 68402

Issued: 8/12/2019

Expires: 8/12/2020

Description: S21, T11, R5, 6th Principal Meridian, LOT 93 NE

Owner: PLOOSTER, ROGER D & JULI A
9720 NW 105 ST
MALCOLM, NE 68402

Patricia D. Lopez

Patricia D. Lopez, RN, MSN, Interim Health Director

Dear Applicant:

The above document is your permit to construct a new On-site Waste Water System at the location listed. Please contact this office once the sytem is complete in order to schedule a final inspection before use.

Patricia D. Lopez

Patricia D. Lopez, RN, MSN
Interim Health Director

JAIME KUBIK
105 LOCUST ST, PO BOX 191
HICKMAN, NE 68372

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

SCANNED

A

Permit Number HSOC1872

Onsite Wastewater Treatment System Permit Application

Include Form B and C. Submit correct fee with this Application

☐ Septic System ☒ Lagoon ☐ Other (Refer to Form C)

PLEASE PRINT OR TYPE

A. Onsite System Location

Address* ~~9720~~ 9730 NW 105th Street (no rural route) City Malcolm, NE Zip 68402 — -95 per contractor on 8/12

Legal Description ____ 12 (1/4) 11 (1/4) 5 (Section) 6th Principal Meridian (Township) (Range) (Subdivison) (Addition) 97 (Block) ~~98~~ NE (Lot)

PID 05-21-200-011-000 *Approx. Address (If to be determined)

B. Owner

Name Roger and Juli Plooster Matt Plooster 318-2256 Signature

Address 9720 NW 105th Street City/State/Zip Malcolm 68402

Home Phone Work Phone

C. Certified Installer

Name: Jaime Kubik Signature

Address 105 Locust Street P.O. Box 191 City/State/Zip Hickman, NE 68372

Work Phone 402-475-2462

D. Engineer

☐ **Check and complete if engineer designed system** P.E. License Number:

Designer Name Firm Work Phone

E. This system will serve a

☐ Residential Dwelling Number of Bedrooms 6 Whirlpool Bathtub? ☐ Yes ☐ No Total Acres 22.13
Garbage Grinder? ☐ Yes ☐ No

☐ Commercial Establishment/Other Facility Specify Design flow in gallons per day Type of Wastewater ☐ Domestic ☐ Non-Domestic

DO NOT WRITE BELOW THIS LINE

Approval Process

1. Health Department
Site visits
Comments
Date rec'd 8/12/19
Date frwd 8/12/19
ACTION ☒ Approved ☐ Disapproved
Signature

2. Supt. Bldg. Insp. or Village Clerk
Comments
Date rec'd
Date frwd
ACTION ☐ Approved ☐ Disapproved
Signature

3. City or County Engineer
Comments
Date rec'd
Date frwd
ACTION ☐ Approved ☐ Disapproved
Signature

Installation/Final/Written Approval
By
Date 4/24/20 5/4/20 Dustin Fence Fence Fence Fence Fence 4/23/20 DH Det W Hoods.

Business Office Use Only
Date Received 8-09-19 Amount Paid $420.00
Received By JHO Cash/Check No. 3561

White - Health Department Yellow - Engineer Pink - Building & Safety

Form A Updated: 4/15

Nate C. Hartman

From: Nadine Link <malcolmne@msn.com>
Sent: Friday, April 19, 2019 9:59 AM
To: Nate C. Hartman
Subject: Re: Malcolm wells

Nate,

Have you received a permit for the new home on 112th, for Travis Tonkinson?

Nadine Link, Village Clerk Village of Malcolm 137 E 2nd Street P.O. Box 228 Malcolm, NE 68402 (402) 796-2250 - Office (402) 580-3959 - Cell (402) 796-2288 - Fax

---

From: Nate C. Hartman <nhartman@lincoln.ne.gov>
Sent: Friday, April 19, 2019 9:36 AM
To: Nadine Link
Subject: RE: Malcolm wells

Nadine:

Permit number HS001810 has been received, reviewed, approved and issued for 8345 NW 105th, the property owned by Mike Beach.

Let me know if you need anything else. Have a great weekend!

Nate Hartman REHS, QCIS, QPSWPPP
Senior Environmental Health Specialist
3131 'O' Street, Lincoln, NE 68510
O: 402-441-8643 F: 402-441-3890

From: Nadine Link [mailto:malcolmne@msn.com]
Sent: Wednesday, April 17, 2019 1:00 PM
To: Nate C. Hartman <nhartman@lincoln.ne.gov>
Subject: Malcolm wells

Nate,

The September 5, 2018 minutes approves Michael Beach to build at 8345 NW 105 - S28 - T11 - R5 - 6PM, Lot 38 W1/2

The February 6, 2019 minutes approves Travis Tonkinson to build at 9230 NW 112 - S21 - T11 - R5 - 6 PM, Lot 105W

The October 3, 2018 minutes approved Matt Plooster to build at S21 - T11 - R5 - 6PM, Lot 97 NE. Plooster might have already put the well in when they built the building around March 29, I can't get into my file drawer its stuck right now.

Let me know if I can be of further assistance.

Nadine Link, Village Clerk
Village of Malcolm
137 E 2nd Street
P.O. Box 228
Malcolm, NE 68402
(402) 796-2250 - Office
(402) 580-3959 - Cell
(402) 796-2288 - Fax
CONFIDENTIALITY NOTICE: This e-mail message, including any attachments, is for the sole use of the intended recipient(s) and may contain confidential and privileged information. Any unauthorized review, use, disclosure or distribution is prohibited. If you are not the intended recipient, please contact the sender by reply e-mail and destroy all copies of the original message.