Lincoln-Lancaster County Health Department
Environmental Public Health Division (402) 441-8027
3131 O Street Lincoln, Nebraska 68510-1514

ON-SITE WASTE WATER SYSTEM
CONSTRUCTION - INSTALLATION PERMIT
No. HS001937

System Type: Standard

Situs: 14000 NW 27 ST, RURAL, NE

Issued: 12/2/2019

Expires: 12/2/2020

Description: S4, T11, R6, 6th Principal Meridian, LOT 11 SW

Owner: WALLING, STEPHEN D
14000 NW 27 ST
RAYMOND, NE 68428

Patricia D. Lopez

Patricia D. Lopez, RN, MSN, Interim Health Director

Dear Applicant:

The above document is your permit to construct a new On-site Waste Water System at the location listed. Please contact this office once the sytem is complete in order to schedule a final inspection before use.

Patricia D. Lopez

Patricia D. Lopez, RN, MSN
Interim Health Director

RAYMOND CONTRACTING INC
13800 NW 70TH ST
RAYMOND, NE 68428

SCANNED

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

A

Permit Number HS001937

New Construction

Onsite Wastewater Treatment System
Request for Site Clearance and Permit

Include Form B and C. Submit correct fee with this Application

3 acres or more required for: ☑ Septic System ☐ Lagoon ☐ Other (Refer to Form C)

The undersigned hereby requests site clearance and permit to construct a Wastewater Treatment System in conformance with appropriate regulations.

PLEASE PRINT OR TYPE

A. Onsite System Location

Address 14000 NW 27th St (no rural route) City, Raymond, NE Zip 68428

Legal Description: SW (1/4) 4 (1/4) 11N (Section) 6E (Township) (Range) (Subdivison) (Addition) 11 (Block) (Lot)

PID 12-04-300-007-000

B. Owner

Name Wade Walling Signature [signature]

Address 14000 NW 27th St City/State/Zip Raymond, NE 68428

Home Phone 402-580-0998 Work Phone

C. Certified Installer

Name: Lloyd Jakoubek, Raymond Contracting Inc Signature [signature]

Address 13800 NW 70th St City/State/Zip Raymond, NE 68428

Work Phone 402-890-6009 or 402-783-2663

D. Engineer

☐ Check and complete if engineer designed system P.E. License Number:

Designer Name Firm Work Phone

E. This system will serve a

☑ Residential Dwelling Number of Bedrooms 2 Whirlpool Bathtub? ☐ Yes ☑ No Total Acres 20.69

Garbage Grinder? ☑ Yes ☐ No

☐ Commercial Establishment/Other Facility Specify Design flow in gallons per day

Type of Wastewater ☐ Domestic ☐ Non-Domestic

DO NOT WRITE BELOW THIS LINE

Approval Process ☐ Municipal Code 24.38 ☐ County Resolution No. 02-30

1. Health Department
Site visits
Comments
Date rec'd
Date frwd
ACTION ☐ Approved ☐ Disapproved
Signature

2. Supt. Bldg. Insp. or Village Clerk
Comments
Date rec'd
Date frwd
ACTION ☐ Approved ☐ Disapproved
Signature

3. City or County Engineer
Comments
Date rec'd
Date frwd
ACTION ☐ Approved ☐ Disapproved
Signature

Installation Final Written Approval
By [signature]
Date 11/9/22

Business Office Use Only
Date Received 11-26-19 Amount Paid $430
Received By MO Cash/Check No. 10267

White - Health Department Yellow - Engineer Pink - Building & Safety

Form A Updated: 1/13

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

D Exhibit 4

Permit Number: HS001937

Onsite Wastewater Treatment System
As-Built Description and Drawing

Type of Onsite Wastewater System: ☐ Lagoon (Skip to Back Page) ☒ Subsurface Septic ☐ Mound

Onsite Wastewater System Location PID = 12-04-300-007-000

Address or Legal Description or Parcel Identification Number (PID) 14000 NW 27th St, Raymond, NE 68428

Owner: Stephen D Walling Address Same

A. Wastewater Piping

1. Material: SDR26 Diameter: 4 in.
2. Distance between dwelling and septic tank: 100 ft.

B. Septic Tank

1. Material Concrete
2. Capacity: 2000
3. Depth to top of tank, below unfinished grade: 24 in.
4. Distance to:
   Well 100 ft.+
   Pressure line N/A ft
   Property Line 100 ft.+
   Foundation 80 ft.+

C Distribution Box or Drop Box

Distance and Direction from septic tank: 21 ft. W

D. Drainfield/Absorption Field

☒ Trench ☐ Bed

1. Type: ☐ Perforated Pipe ☐ Chamberless ☒ Other
   Material brand and inside width of Chamberless: EZFlow 1203H Bundles
2. Number of Laterals: 4
3. Length of each lateral (linear): ft. 30 ft. 30 ft. 30 ft. 40
4. Drainfield size: 585 sq. ft. (55 per)
5. Distance to:
   Well 100 ft.+
   Pressure line N/A ft.
   Property line 80 ft.+
   Depth of Groundwater >8'

NH

Was the Onsite Wastewater System covered prior to LLCHD inspection? ☒ Yes ☐ No (Partially)

If Yes, the Certified Professional must sign below for final approval:

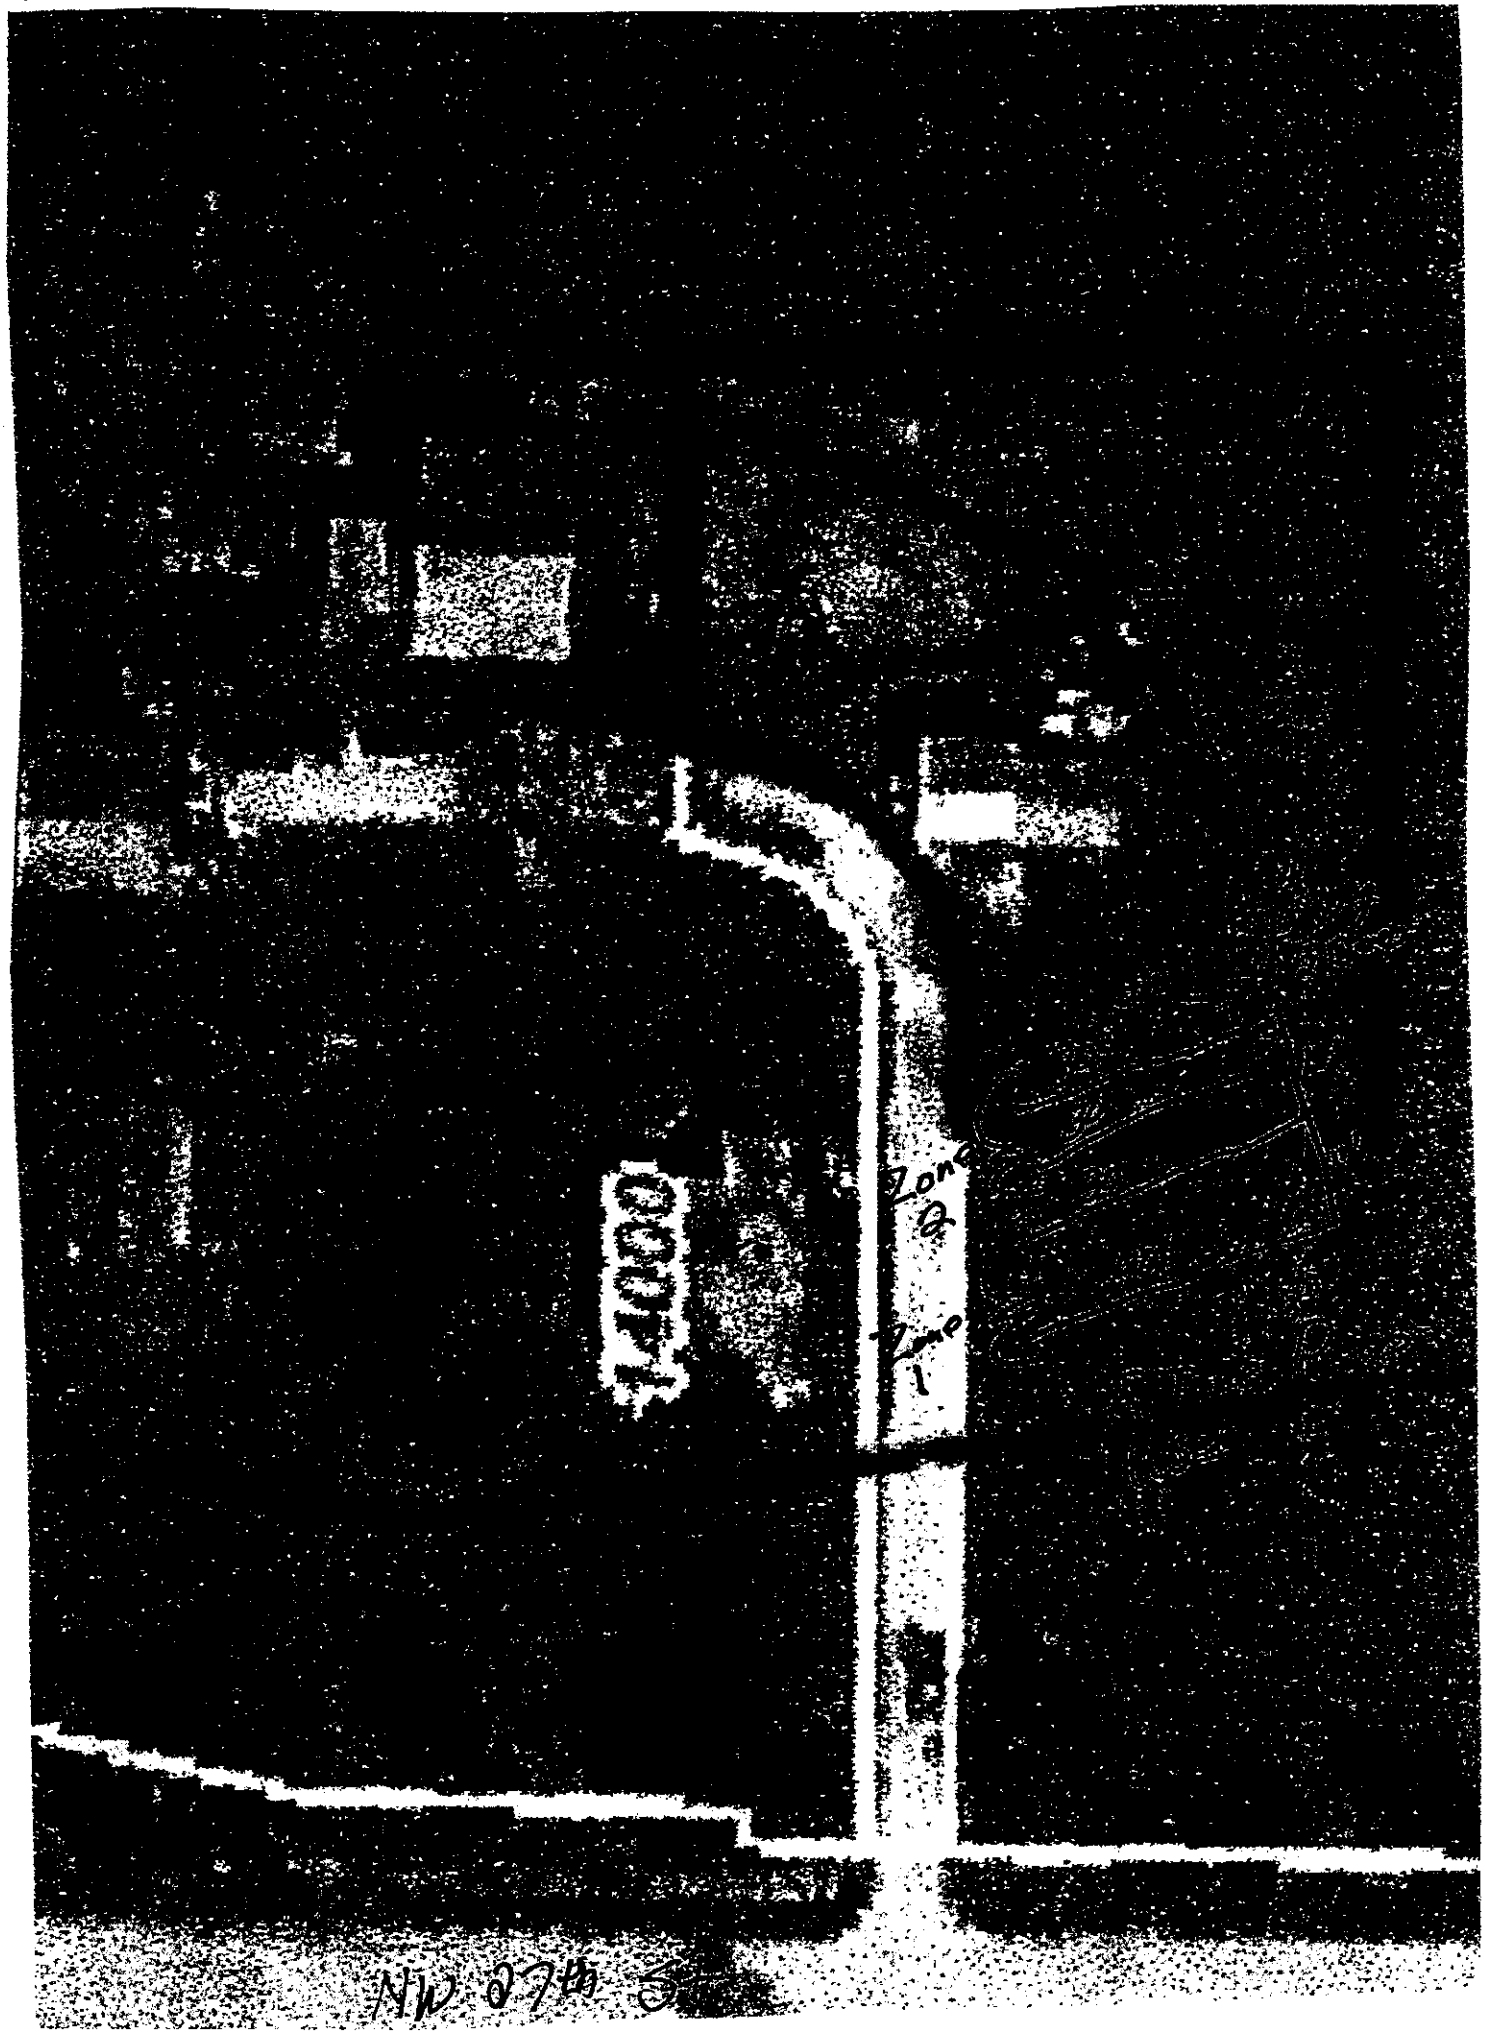
I swear and affirm that the system complies with Lincoln Municipal Code (LMC) 24.38 and/or County Resolution R-13-0062 requirements and that the information and documentation submitted are true and accurate.

Certified Professional Signature: Ronald L. Jakowski Date: May 29, 2020

Complete As-Built drawing on the back of this form.

Unable to make inspection NH

Updated 4/15


NW 97th St