Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

A

Permit Number #9002212

Onsite Wastewater Treatment System Permit Application

Include Form B and C. Submit correct fee with this Application

☒ Septic System ☐ Lagoon ☐ Other (Refer to Form C)

PLEASE PRINT OR TYPE

A. Onsite System Location

Address* _____ City _____, NE Zip _____
(no rural route)

Legal Description S31 T10 R8 WINDHOEK 12TH ADDITION 1
1/4 1/4 Section Township Range Subdivison Addition Block Lot

PID 23-31-416-001-000 *Approx. Address (If to be determined) _____

B. Owner

Name PRIDE HOMES Signature _____
Address 11401 VAN DORN STREET City/State/Zip WALTON, NE 68461
Home Phone _____ Work Phone _____

C. Certified Installer

Name JAIME KUBIK Signature Jaime Kubik
Address 105 LOCUST STREET P.O. BOX 191 City/State/Zip HICKMAN, NE 68372
Work Phone 402-475-2462

D. Engineer

☐ **Check and complete if engineer designed system** P.E. License Number: _____
Designer Name _____ Firm _____ Work Phone _____

E. This system will serve a

☐ Residential Dwelling Number of Bedrooms 6 Whirlpool Bathtub? ☐ Yes ☒ No Total Acres 3.03
Garbage Grinder? ☒ Yes ☐ No

☐ Commercial Establishment/Other Facility Specify _____ Design flow in gallons per day Type of Wastewater ☐ Domestic ☐ Non-Domestic

DO NOT WRITE BELOW THIS LINE

Approval Process

1. Health Department
Site visits _____ Date rec'd _____ ACTION ☐ Approved ☐ Disapproved
Date frwd _____ Signature _____
Comments _____

2. Supt. Bldg. Insp. or Village Clerk
Comments _____ Date rec'd _____ ACTION ☐ Approved ☐ Disapproved
Date frwd _____ Signature _____

3. City or County Engineer
Comments _____ Date rec'd _____ ACTION ☐ Approved ☐ Disapproved
Date frwd _____ Signature _____

Installation Final Written Approval
By _____
Date _____

Business Office Use Only
Date Received 5-10-21 Amount Paid #440.00
Received By JAE Cash/Check No. 02112

White - Health Department Yellow - Engineer Pink - Building & Safety

Form A Updated: 4/15

Lincoln-Lancaster County Health Department (LLCHD)
Environmental Public Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8643

B

Permit Number:

Onsite Wastewater Treatment System
Soil Evaluation Report

PLEASE PRINT OR TYPE

Onsite System Location

Address Windhoek 12th Addition Lot 1 (no rural route) City Walton NE, Zip 68461

Owner Pride Homes Address

Date of Tests 7/7/2020 to 7/8/2020 Weather: Precipitation None Temperature 90 degrees

Percolation Test Data Table

A.	B.	C. D. E. F. Saturation/Swelling Time				G. H. I. J. K. Last 30 mins of 4 hr or last 10 mins of 1 hr					L. M. N. Results		
		Start		End		Start		Initial	End				
Hole No.	Hole Depth(in)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Water Lev (in.)	Date (Mo/Da)	Time (Hr/Min)	Elapsed Time Interval	Water Level Drop(in)	Percolation Rates (Min/in = mpi)
1	30 inches	7/7	5:30 pm	7/8	7:05 am	7/8	10:35 am	6	7/8	11:05 am	30 min	1	30
2	30 inches	7/7	5:30 pm	7/8	7:05 am	7/8	10:35 am	6	7/8	11:05 am	30 min	1	30
3	30 inches	7/7	5:30 pm	7/8	7:05 am	7/8	10:35 am	6	7/8	11:05 am	30 min	5/8	48
								6					
								6					
								6					
								6					
								6					

Person Conducting Percolation Test

Name: Jason Kubik
Phone: 402-475-2462
Address 105 Locust Street P.O. Box 191
Hickman, NE 68372

Sum of Percolation Rates: 108
Average of Rates: 36
Rate Used for Calculation: 36

Soil type (NRCS Maps/Other) 7207 Askarben
Groundwater Depth +12 feet

DO NOT WRITE BELOW THIS LINE

Reviewing Action

Comments (Soil type, groundwater, floodplain, etc.)

Signature of Reviewing Official Date

Lincoln-Lancaster County Health Department
Environmental Public Health Division (402) 441-8027
3131 O Street Lincoln, Nebraska 68510-1514

ON-SITE WASTE WATER SYSTEM
CONSTRUCTION - INSTALLATION PERMIT
No. HS002212

System Type: Standard

Situs: No Site Address Specified

Issued: 5/10/2021

Expires: 5/10/2022

Description: WINDHOEK 12TH ADDITION, Lot 1

Owner: HARMON, TANNER J & KATHRYN R
3002 N SONORAN HILLS
MESA, AZ 85207

Patricia D. Lopez

Patricia D. Lopez, RN, MSN, Interim Health Director

Dear Applicant:

The above document is your permit to construct a new On-site Waste Water System at the location listed. Please contact this office once the sytem is complete in order to schedule a final inspection before use.

Patricia D. Lopez

Patricia D. Lopez, RN, MSN
Health Director

JAIME KUBIK
105 LOCUST ST, PO BOX 191
HICKMAN, NE 68372

Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

Exhibit 5

Permit Number: HS00.2212

Onsite Wastewater Treatment System

Inspection Sheet

Date 10/22/21 Legal Description ¼ ¼ Section/Township/Range

Onsite System Location

Address (no rural route) 11737 Seabiscuit City

Owner Address

Mark One: ☒ Dwelling ☐ Non-dwelling

~~☐~~ New System ☐ Alteration [☐ Tank Only ☐ Trench Only] ☐ Lateral Only

☐ Temporary modification (Describe problem causing discharge and reason for temporary modification):

Drainfield Absorption System:

~~☒~~ Lateral ☐ Bed ☐ Non-standard (engineer-designed and NDEQ approved) ☐ Holding Tank ☐ Trench

Perc, 3.6 MPI

Total square feet of drainfield 1,800 Sq. Ft. Tank Size 2,000 gals

Total length of laterals 400' Type of Distribution: ☐ Chamber ☐ Perforated Pipe ☒ Other (describe) E-Z Flow

No. of Absorption Laterals 4 Width 45 Factor No. of Drop Boxes Distribution Box 1

Leveling Method Used Laser

Setbacks (Check the Boxes Below if the Required Setback has been Satisfied):

Distance From	Private Well	Public Well	Surface Water	Ground water	Pressure Water Lines	Property Lines
Tank (ft)	50 ☐	500 ☐	50 ☐	NA ☐	10 ☐	5 ☐
Field (ft)	100 ☐	500 ☐	50 ☐	4 ☐	25 ☐	5 ☐

Geographical Coordinates to 6 Decimals:

Tank NA

Lateral #1 Lateral #3

Lateral #2 Lateral #4

Comments:

Inspections prior to Final Approval
Initial DS Date 10/22/21

Follow-Up Date

Follow-Up Date

Installation Final Written Approval
By Doug Shaw

Date 10/22/21

Field Note Drawing (See Reverse Side):

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

SCANNED

A

Permit Number
HS002212

Onsite Wastewater Treatment System Permit Application

Include Form B and C. Submit correct fee with this Application

☒ Septic System ☐ Lagoon ☐ Other (Refer to Form C)

PLEASE PRINT OR TYPE

A. Onsite System Location

Address* 11737 Seabiscuit LN (no rural route) City _____, NE Zip _____

Legal Description _____ S31 T10 R8 WINDHOEK 12TH ADDITION 1
1/4 | 1/4 | Section | Township | Range | Subdivison | Addition | Block | Lot

PID 23-31-416-001-000 *Approx. Address (If to be determined) _____

B. Owner

Name PRIDE HOMES Signature _____

Address 11401 VAN DORN STREET City/State/Zip WALTON, NE 68461

Home Phone _____ Work Phone _____

C. Certified Installer

Name JAIME KUBIK Signature _____

Address 105 LOCUST STREET P.O. Box 191 City/State/Zip HICKMAN, NE 68372

Work Phone 402-475-2462

D. Engineer

☐ **Check and complete if engineer designed system** P.E. License Number: _____

Designer Name _____ Firm _____ Work Phone _____

E. This system will serve a

☐ Residential Dwelling Number of Bedrooms 6 Whirlpool Bathtub? ☐ Yes ☒ No Garbage Grinder? ☒ Yes ☐ No Total Acres 3.03

☐ Commercial Establishment/Other Facility Specify _____ Design flow in gallons per day Type of Wastewater ☒ Domestic ☐ Non-Domestic

DO NOT WRITE BELOW THIS LINE

Approval Process

1. Health Department
Site visits 10/22/21 Date rec'd _____ Date frwd _____
Comments _____
ACTION ☐ Approved ☐ Disapproved Signature _____

2. Supt. Bldg. Insp. or Village Clerk
Comments _____ Date rec'd _____ Date frwd _____
ACTION ☐ Approved ☐ Disapproved Signature _____

3. City or County Engineer
Comments _____ Date rec'd _____ Date frwd _____
ACTION ☐ Approved ☐ Disapproved Signature _____

Installation Final Written Approval
By _____
Date 10/22/21

Business Office Use Only
Date Received 5-10-21 Amount Paid #440.00
Received By JAC Cash/Check No. 1102

White - Health Department Yellow - Engineer Pink - Building & Safety

Form A Updated: 4/15

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

D

Permit Number:

Onsite Wastewater Treatment System
As-Built Description and Drawing

Type of Onsite Wastewater System: ☐ Lagoon (Skip to Back Page) ☒ Subsurface Septic ☐ Mound

Onsite Wastewater System Location

Address or Legal Description or Parcel Identification Number (PID) 23-31-411e-001-000

Owner: TANNER HARMAN Address 11737 SEABISCUIT LANE WAHOO, NE 68466

A. Wastewater Piping

1. Material: SCH40 Diameter: 4 in.
2. Distance between dwelling and septic tank: 22 ft.

B. Septic Tank

1. Material CONCRETE
2. Capacity: 1500
3. Depth to top of tank, below unfinished grade: 12 in.
4. Distance to:
   Well +300 ft.
   Pressure line +50 ft
   Property Line +50 ft.
   Foundation 22 ft.

C Distribution Box or Drop Box

Distance and Direction from septic tank: 13 ft. NE

D. Drainfield/Absorption Field

☒ Trench ☐ Bed

1. Type: ☐ Perforated Pipe ☐ Chamberless ☒ Other
   Material brand and inside width of Chamberless: EZ Flow 12.03
2. Number of Laterals: 2
3. Length of each lateral (linear): ft. 150 ft. 150 ft. ____ ft. ____
4. Drainfield size: 1350 sq. ft.
5. Distance to:
   Well +300 ft.
   Pressure line +50 ft.
   Property line +50 ft.
   Depth of Groundwater +12

Was the Onsite Wastewater System covered prior to LLCHD inspection? ☒ Yes ☐ No

If Yes, the Certified Professional must sign below for final approval:

I swear and affirm that the system complies with Lincoln Municipal Code (LMC) 24.38 and/or County Resolution R-13-0062 requirements and that the information and documentation submitted are true and accurate.

Certified Professional Signature: [signature] Date: DEC 16, 2021

Complete As-Built drawing on the back of this form.

N
W + E
S

Scarborough LN

22
13
9
5
15
10
74 4" pipe

150' EZ flow
150' EZ flow

50' EZ
EZ
EZ
EZ
EZ
Dbl wall
Fuel tank
Tank conc.
22'
House

30' from tank
Approx
Well

Lincoln-Lancaster County Health Department (LLCHD)
Environmental Public Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8643

B

Permit Number:

Onsite Wastewater Treatment System
Soil Evaluation Report

PLEASE PRINT OR TYPE

Onsite System Location

Address Windhoek 12th Addition Lot 1 (no rural route) City Walton NE, Zip 68461

Owner Pride Homes Address

Date of Tests 7/7/2020 to 7/8/2020 Weather: Precipitation None Temperature 90 degrees

Percolation Test Data Table

A.	B.	C. D. E. F. Saturation/Swelling Time				G. H. I. J. K. Water Level Drop Last 30 mins of 4 hr or last 10 mins of 1 hr					L. M. N. Results		
		Start		End		Start		Initial	End				
Hole No.	Hole Depth(in)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Water Lev (in.)	Date (Mo/Da)	Time (Hr/Min)	Elapsed Time Interval	Water Level Drop(in)	Percolation Rates (Min/in = mpi)
1	30 inches	7/7	5:30 pm	7/8	7:05 am	7/8	10:35 am	6	7/8	11:05 am	30 min	1	30
2	30 inches	7/7	5:30 pm	7/8	7:05 am	7/8	10:35 am	6	7/8	11:05 am	30 min	1	30
3	30 inches	7/7	5:30 pm	7/8	7:05 am	7/8	10:35 am	6	7/8	11:05 am	30 min	5/8	48
								6					
								6					
								6					
								6					
								6					

Person Conducting Percolation Test

Name: Jason Kubik
Phone: 402-475-2462
Address 105 Locust Street P.O. Box 191
Hickman, NE 68372

Sum of Percolation Rates: 108
Average of Rates: 36
Rate Used for Calculation: 36

Soil type (NRCS Maps/Other) 7207 Askarben
Groundwater Depth +12 feet

DO NOT WRITE BELOW THIS LINE

Reviewing Action

Comments (Soil type, groundwater, floodplain, etc.)

Signature of Reviewing Official Date

Nate C. Hartman

From: Jason Kubik <southwicksewer@yahoo.com>
Sent: Thursday, January 6, 2022 8:09 PM
To: Nate C. Hartman
Subject: 11737 Seabiscuit Lane D SHEET CORRECTED
Attachments: 11737 Seabiscuit Lane D SHEET CORRECTED.pdf

My bad -- first one I missed two lines of lateral -- this one is corrected.

Jason and Jaime Kubik

Southwick Liquid Waste
Office: 402-475-2462
www.southwickliquidwaste.com

Windhoven 12th Lot 1

10-8-31

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

D

Permit Number:

Onsite Wastewater Treatment System
As-Built Description and Drawing

Type of Onsite Wastewater System: ☐ Lagoon (Skip to Back Page) ☒ Subsurface Septic ☐ Mound

Onsite Wastewater System Location

Address or Legal Description or Parcel Identification Number (PID) 23-31-411e-001-000

Owner: TANNER HARMAN Address 11737 SEABISCUIT LANE WALTON, NE 68461

A. Wastewater Piping

1. Material: SCH40 Diameter: 4 in.
2. Distance between dwelling and septic tank: 22 ft.

B. Septic Tank

1. Material CONCRETE
2. Capacity: 1500
3. Depth to top of tank, below unfinished grade: 12 in.
4. Distance to:
   Well +300 ft.
   Pressure line +50 ft
   Property Line +50 ft.
   Foundation 22 ft.

C Distribution Box or Drop Box

Distance and Direction from septic tank: 13 ft. NE

D. Drainfield/Absorption Field

☒ Trench ☐ Bed

1. Type: ☐ Perforated Pipe ☐ Chamberless ☒ Other
   Material brand and inside width of Chamberless: EZ Flow 12.03
2. Number of Laterals: 2
3. Length of each lateral (linear): ft. 150 ft. 150 ft. 50 ft. 50
4. Drainfield size: 1800 sq. ft.
5. Distance to:
   Well +300 ft.
   Pressure line +50 ft.
   Property line +50 ft.
   Depth of Groundwater +12

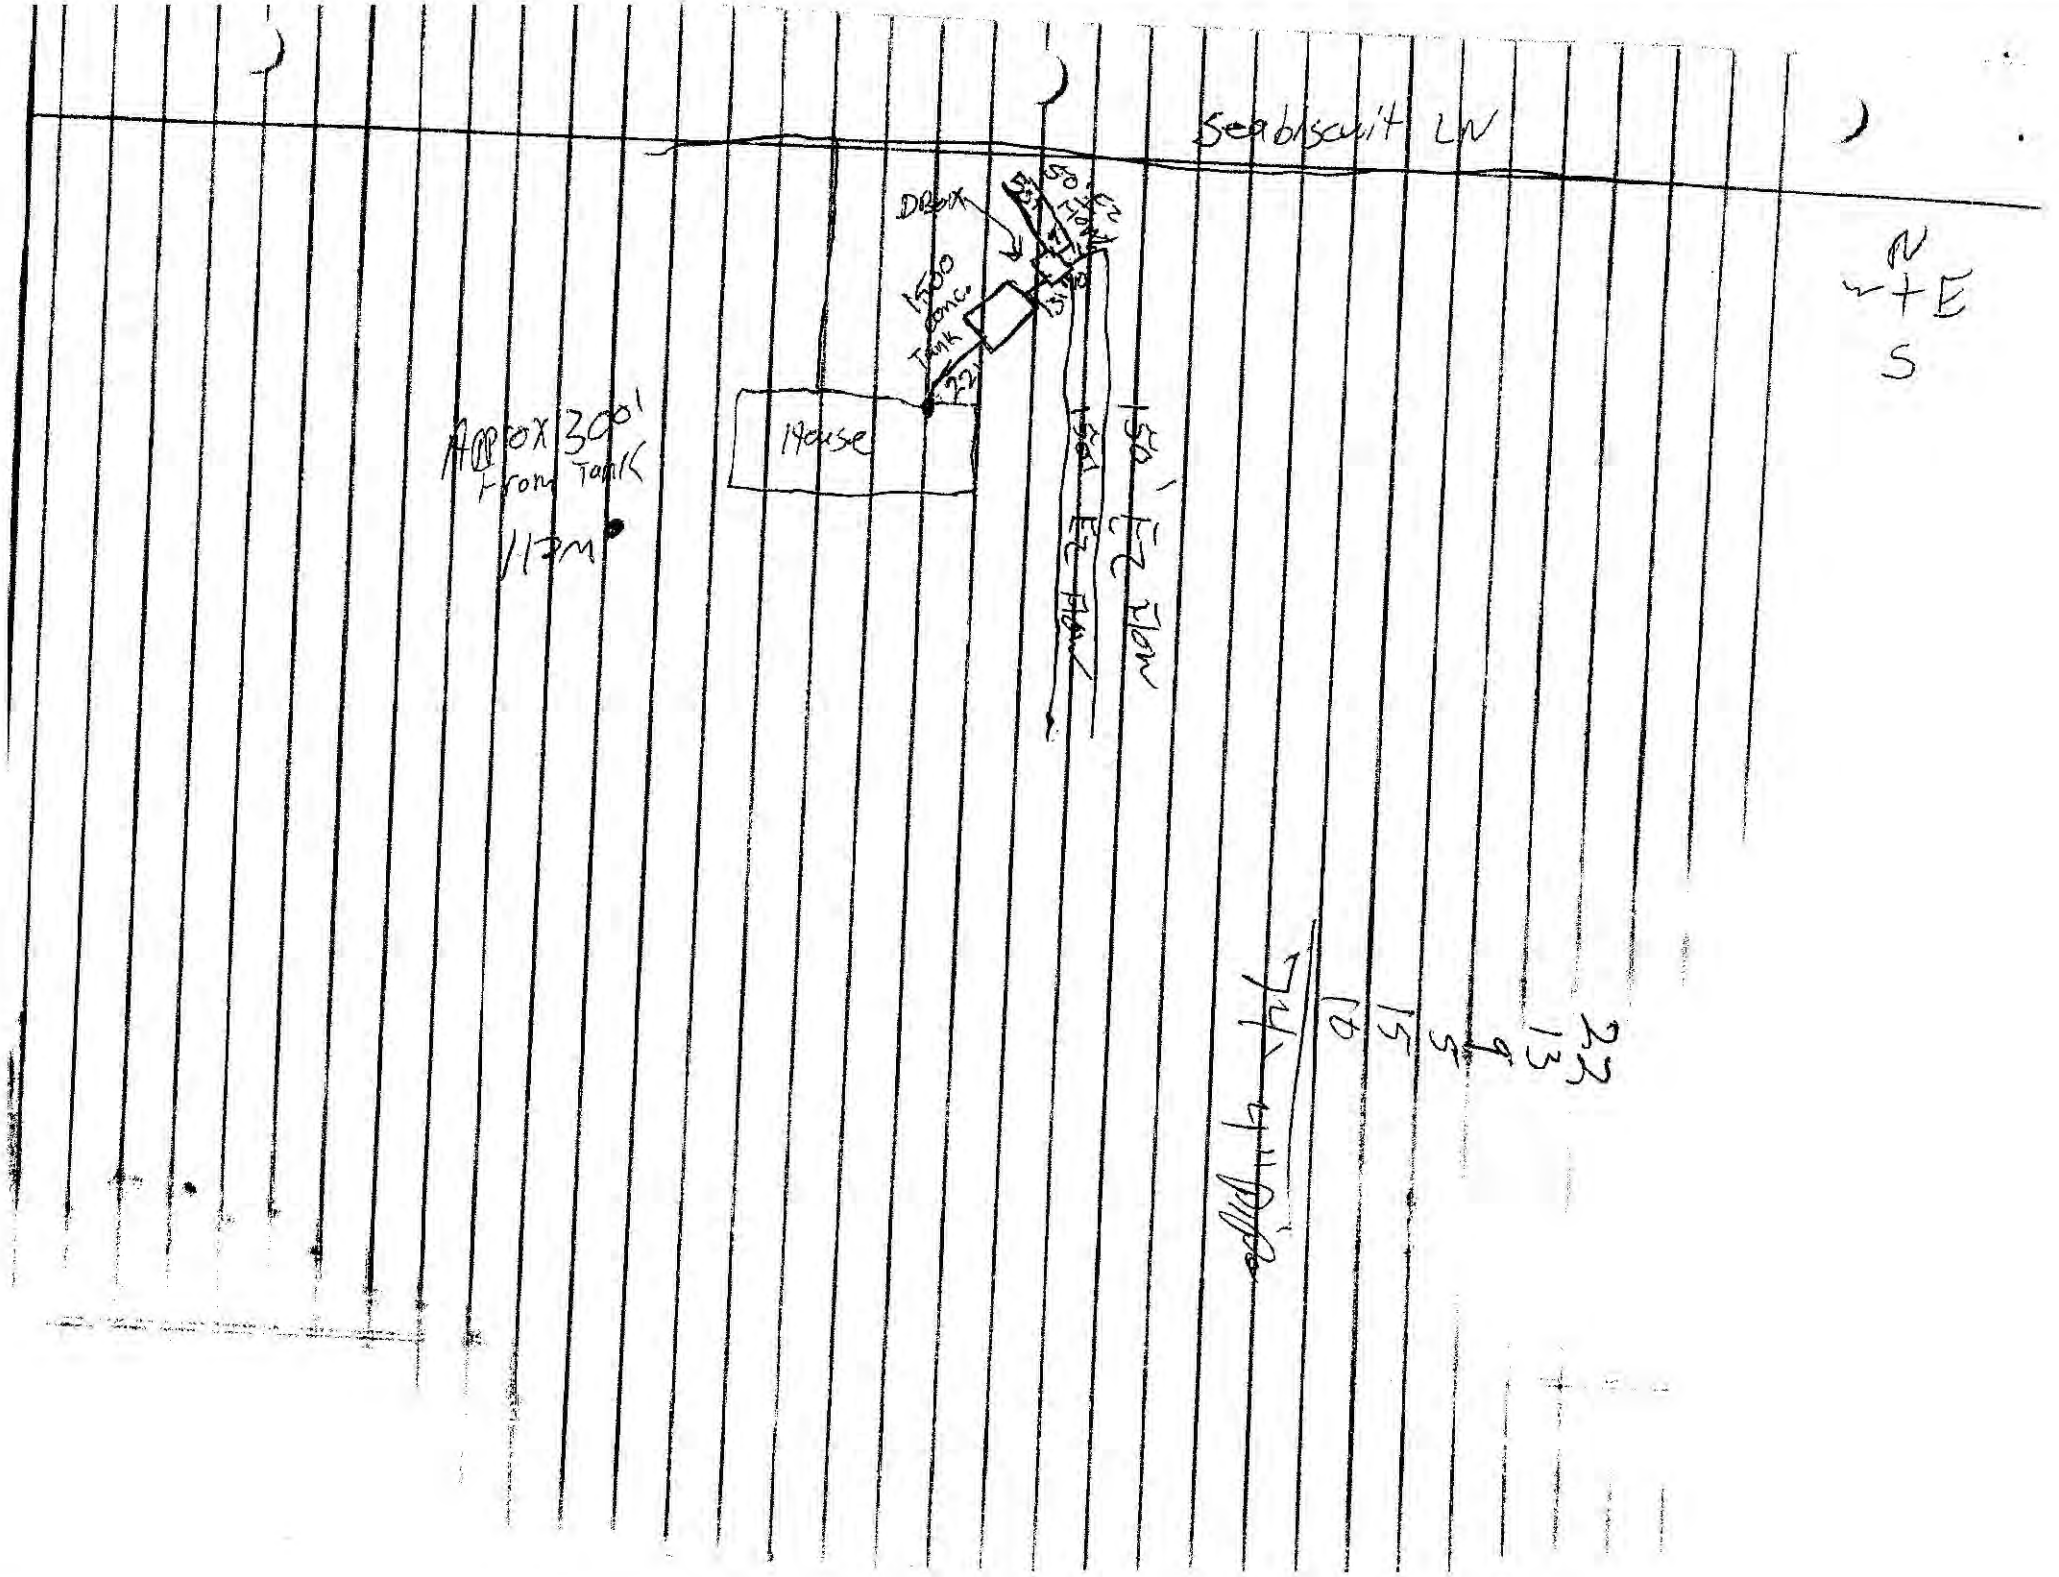
Was the Onsite Wastewater System covered prior to LLCHD inspection? ☒ Yes ☐ No

If Yes, the Certified Professional must sign below for final approval:

I swear and affirm that the system complies with Lincoln Municipal Code (LMC) 24.38 and/or County Resolution R-13-0062 requirements and that the information and documentation submitted are true and accurate.

Certified Professional Signature: [signature] Date: DEC 16, 2021

Complete As-Built drawing on the back of this form.


Seabiscuit LN
N
E
S
DBox
1500 Conc. Tank
House
Approx 300' from Tank
well
50' EE Dist
50' EE Dist
22
13
9
5
15
10
74

Nate C. Hartman

From: Jason Kubik <southwicksewer@yahoo.com>
Sent: Thursday, January 6, 2022 7:57 PM
To: Nate C. Hartman
Subject: 11737 Seabiscuit Lane (B and D SHEETS)
Attachments: 11737 Seabiscuit Lane B SHEET.pdf; 11737 Seabiscuit Lane D SHEET.pdf

Jason and Jaime Kubik

Southwick Liquid Waste
Office: 402-475-2462
www.southwickliquidwaste.com