Lincoln-Lancaster County Health Department
Environmental Public Health Division
3131 O Street • Lincoln NE 68510-1514
Phone: 402-441-8643

A

Permit Number HS0072243

Onsite Wastewater Treatment System Permit Application

Include Form B and C. Submit correct fee with this Application

☐ Septic System ☑ Lagoon ☐ Other (Refer to Form C)

PLEASE PRINT OR TYPE

A. Onsite System Location

Address* 9690 S 60th St (no rural route) City Lincoln, NE Zip 68516

Legal Description SE (1/4) SW (1/4) 28 (Section) 9N (Township) 7E (Range) Kess Estates (Subdivison) 1st (Addition) 1 (Block) (Lot)

PID 16-28-303-001-000 *Approx. Address (If to be determined)

B. Owner

Name Justin W & Jessica L Baker Signature Jessica Baker (Jun 18, 2021 11:56 CDT) Justin Baker (Jun 18, 2021 11:59 CDT)

Address 5211 S 78th St City/State/Zip Lincoln, NE 68516

Home Phone 970-234-3205 justin Work Phone 970-234-6491 jessica

C. Certified Installer

Name: Lloyd Jakoubek Signature Lloyd L. Jakoubek

Address 13800 NW 70th St City/State/Zip Raymond, NE 68428

Work Phone 402-783-2663

D. Engineer

☐ Check and complete if engineer designed system P.E. License Number:

Designer Name Firm Work Phone

E. This system will serve a

☑ Residential Dwelling Number of Bedrooms 6 Whirlpool Bathtub? ☑ Yes ☐ No Total Acres 3

Garbage Grinder? ☑ Yes ☐ No

☐ Commercial Establishment/Other Facility Specify Design flow in gallons per day

Type of Wastewater ☐ Domestic ☐ Non-Domestic

DO NOT WRITE BELOW THIS LINE

Approval Process

1. Health Department
Site visits Date rec'd ACTION ☐ Approved ☐ Disapproved
Date frwd Signature
Comments

2. Supt. Bldg. Insp. or Village Clerk
Comments Date rec'd ACTION ☐ Approved ☐ Disapproved
Date frwd Signature

3. City or County Engineer
Comments Date rec'd ACTION ☐ Approved ☐ Disapproved
Date frwd Signature

Installation Final Written Approval
By
Date

Business Office Use Only
Date Received 6-24-21 Amount Paid $440 cc
Received By JAO Cash/Check No. 115040

White - Health Department Yellow - Engineer Pink - Building & Safety

Form A Updated: 2/18


Lincoln-Lancaster County Health Department
Environmental Public Health Division
3131 O Street • Lincoln NE 68510-1514
Phone: 402-441-8643

C

Permit Number

Onsite Wastewater Treatment System
Preliminary Plan Specification

Draw a plot plan showing onsite system sewer lines, tank, drop or distribution boxes, drainfields, percolation test holes, well, residence, direction of groundwater flow, and reserve area for replacement onsite system.

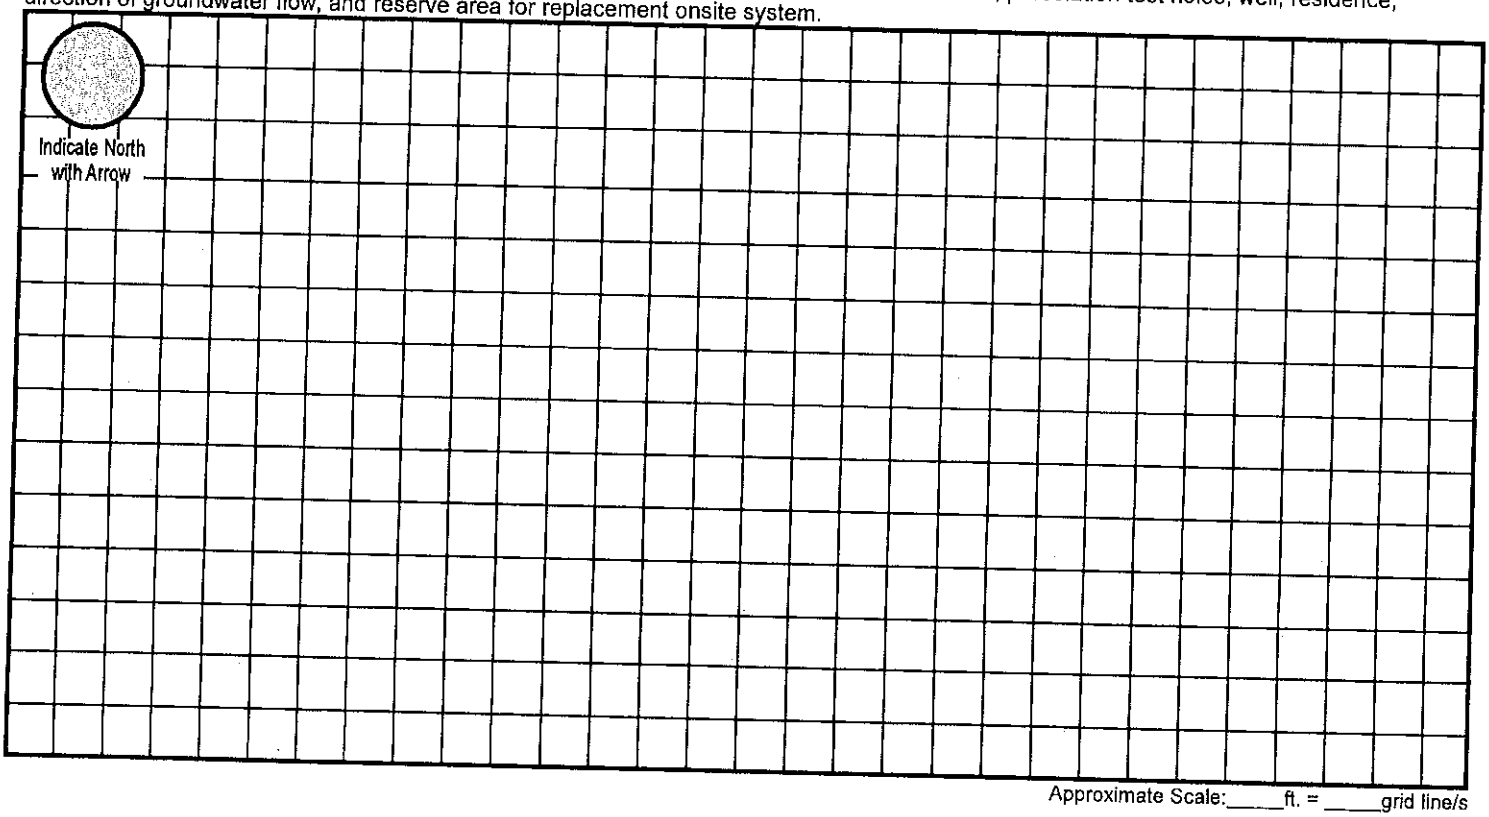

Approximate Scale:_____ft. = _____grid line/s

A. Onsite System Location

Address (no rural route) 9690 S 60th St City Lincoln NE, Zip 68516

B. Proposed Septic Tank/s

Septic Tank Cap._____gals Tank Material: ☐ Concrete ☐ Plastic ☐ Other _____ ☑ Lagoon (Max. Seepage 1/8"/day)

C. Reserve Area for Replacement Onsite System

☐ Drainfield Absorption Area (percolation test required) ☐ Lagoon

D. Drainfield Absorption System

Percolation Rate_____(min/inch = mpi) No. of Bedrooms_____ Soil Type _____ Land Slope _____ %

☐ Trench ☐ Bed ☐ Non-standard (engineer-designed and NDEQ approved) Total square feet of drainfield _____ Sq. Ft.

Total length of laterals _____ Type of Distribution: ☐ Perforated Pipe ☐ Half-Round ☐ Chambers ☐ Other _____

No. of Absorption Trenches _____ Width _____ No. of Drop Boxes _____ Distribution Box _____

No. of Absorption Beds _____ Width _____ No. of Distribution Lines per Bed _____

Installer Neil L. Jakonder Date: 6/21/21

Updated 2/18

9690 S 60th St, Lincoln, NE 68523

GIS Viewer
CITY OF LINCOLN - LANCASTER COUNTY, NE

City of Lincoln\Lancaster County GIS Map



DISCLAIMER: The information is presented on a best-efforts basis, and should not be relied upon for making financial, survey, legal or other commitments. If you have questions or comments regarding the data displayed on this map, please email assessor@lancaster.ne.gov and you will be directed to the appropriate department.

Lincoln-Lancaster County Health Department
Environmental Public Health Division (402) 441-8027
3131 O Street Lincoln, Nebraska 68510-1514

ON-SITE WASTE WATER SYSTEM
CONSTRUCTION - INSTALLATION PERMIT
No. HS002243

System Type: Lagoon

Situs: No Site Address Specified

Issued: 6/21/2021

Expires: 6/21/2022

Description: KESS ESTATES 1ST ADDITION, Lot 1

Owner: BAKER, JUSTIN W & JESSICA L
5211 S 78 ST
LINCOLN, NE 68516

Patricia D. Lopez

Patricia D. Lopez, RN, MSN, Interim Health Director

Dear Applicant:

The above document is your permit to construct a new On-site Waste Water System at the location listed. Please contact this office once the sytem is complete in order to schedule a final inspection before use.

Patricia D. Lopez

Patricia D. Lopez, RN, MSN
Health Director

RAYMOND CONTRACTING INC
13800 NW 70TH ST
RAYMOND, NE 68428

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3131 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

D

Permit Number: HS002243

Onsite Wastewater Treatment System
As-Built Description and Drawing

Type of Onsite Wastewater System: ☐ Lagoon (Skip to Back Page) ☑ Subsurface Septic ☐ Mound

Onsite Wastewater System Location PID = 16-28-303-001-000

Address or Legal Description or Parcel Identification Number (PID) 9690 S 60th St, Lincoln, NE 68516

Owner: Justin & Jessica Baker Address 5211 S 78th St, Lincoln, NE 685168

A. Wastewater Piping

1. Material: SDR26 Diameter: 4 in.
2. Distance between dwelling and septic tank: 135 ft.

B. Septic Tank(S)

1. Material Concrete
2. Capacity: 1,500 & 1,000
3. Depth to top of tank, below unfinished grade: 12-18 in.
4. Distance to:
   Well N/A ft. +
   Pressure line N/A ft +
   Property Line 100 ft. +
   Foundation 100 ft. +

C Distribution Box or Drop Box

Distance and Direction from septic tank: 135 ft. E

(Drainfield Control Valve)

D. Drainfield/Absorption Field

☑ Trench ☐ Bed

1. Type: ☐ Perforated Pipe ☐ Chamberless ☑ Other
   Material brand and inside width of Chamberless: EZFlow 1203H Bundles
2. Number of Laterals: 4 Depth: 2' to 4'
3. Length of each latara! (linear): ft. 80 ft. 80 ft. 80 ft. 80
4. Drainfield size: 1,440 sq. ft.
5. Distance to:
   Well N/A ft. +
   Pressure line N/A ft. +
   Property line 100 ft. +
   Depth of Groundwater >6'

Was the Onsite Wastewater System covered prior to LLCHD inspection? ☑ Yes (Partially) ☐ No


If Yes, the Certified Professional must sign below for final approval:

I swear and affirm that the system complies with Lincoln Municipal Code (LMC) 24.38 and/or County Resolution R-13-0062 requirements and that the information and documentation submitted are true and accurate.

Certified Professional Signature: Rene L. Jahnke Date: 9/15/21

Complete As-Built drawing on the back of this form.

Updated 2/18

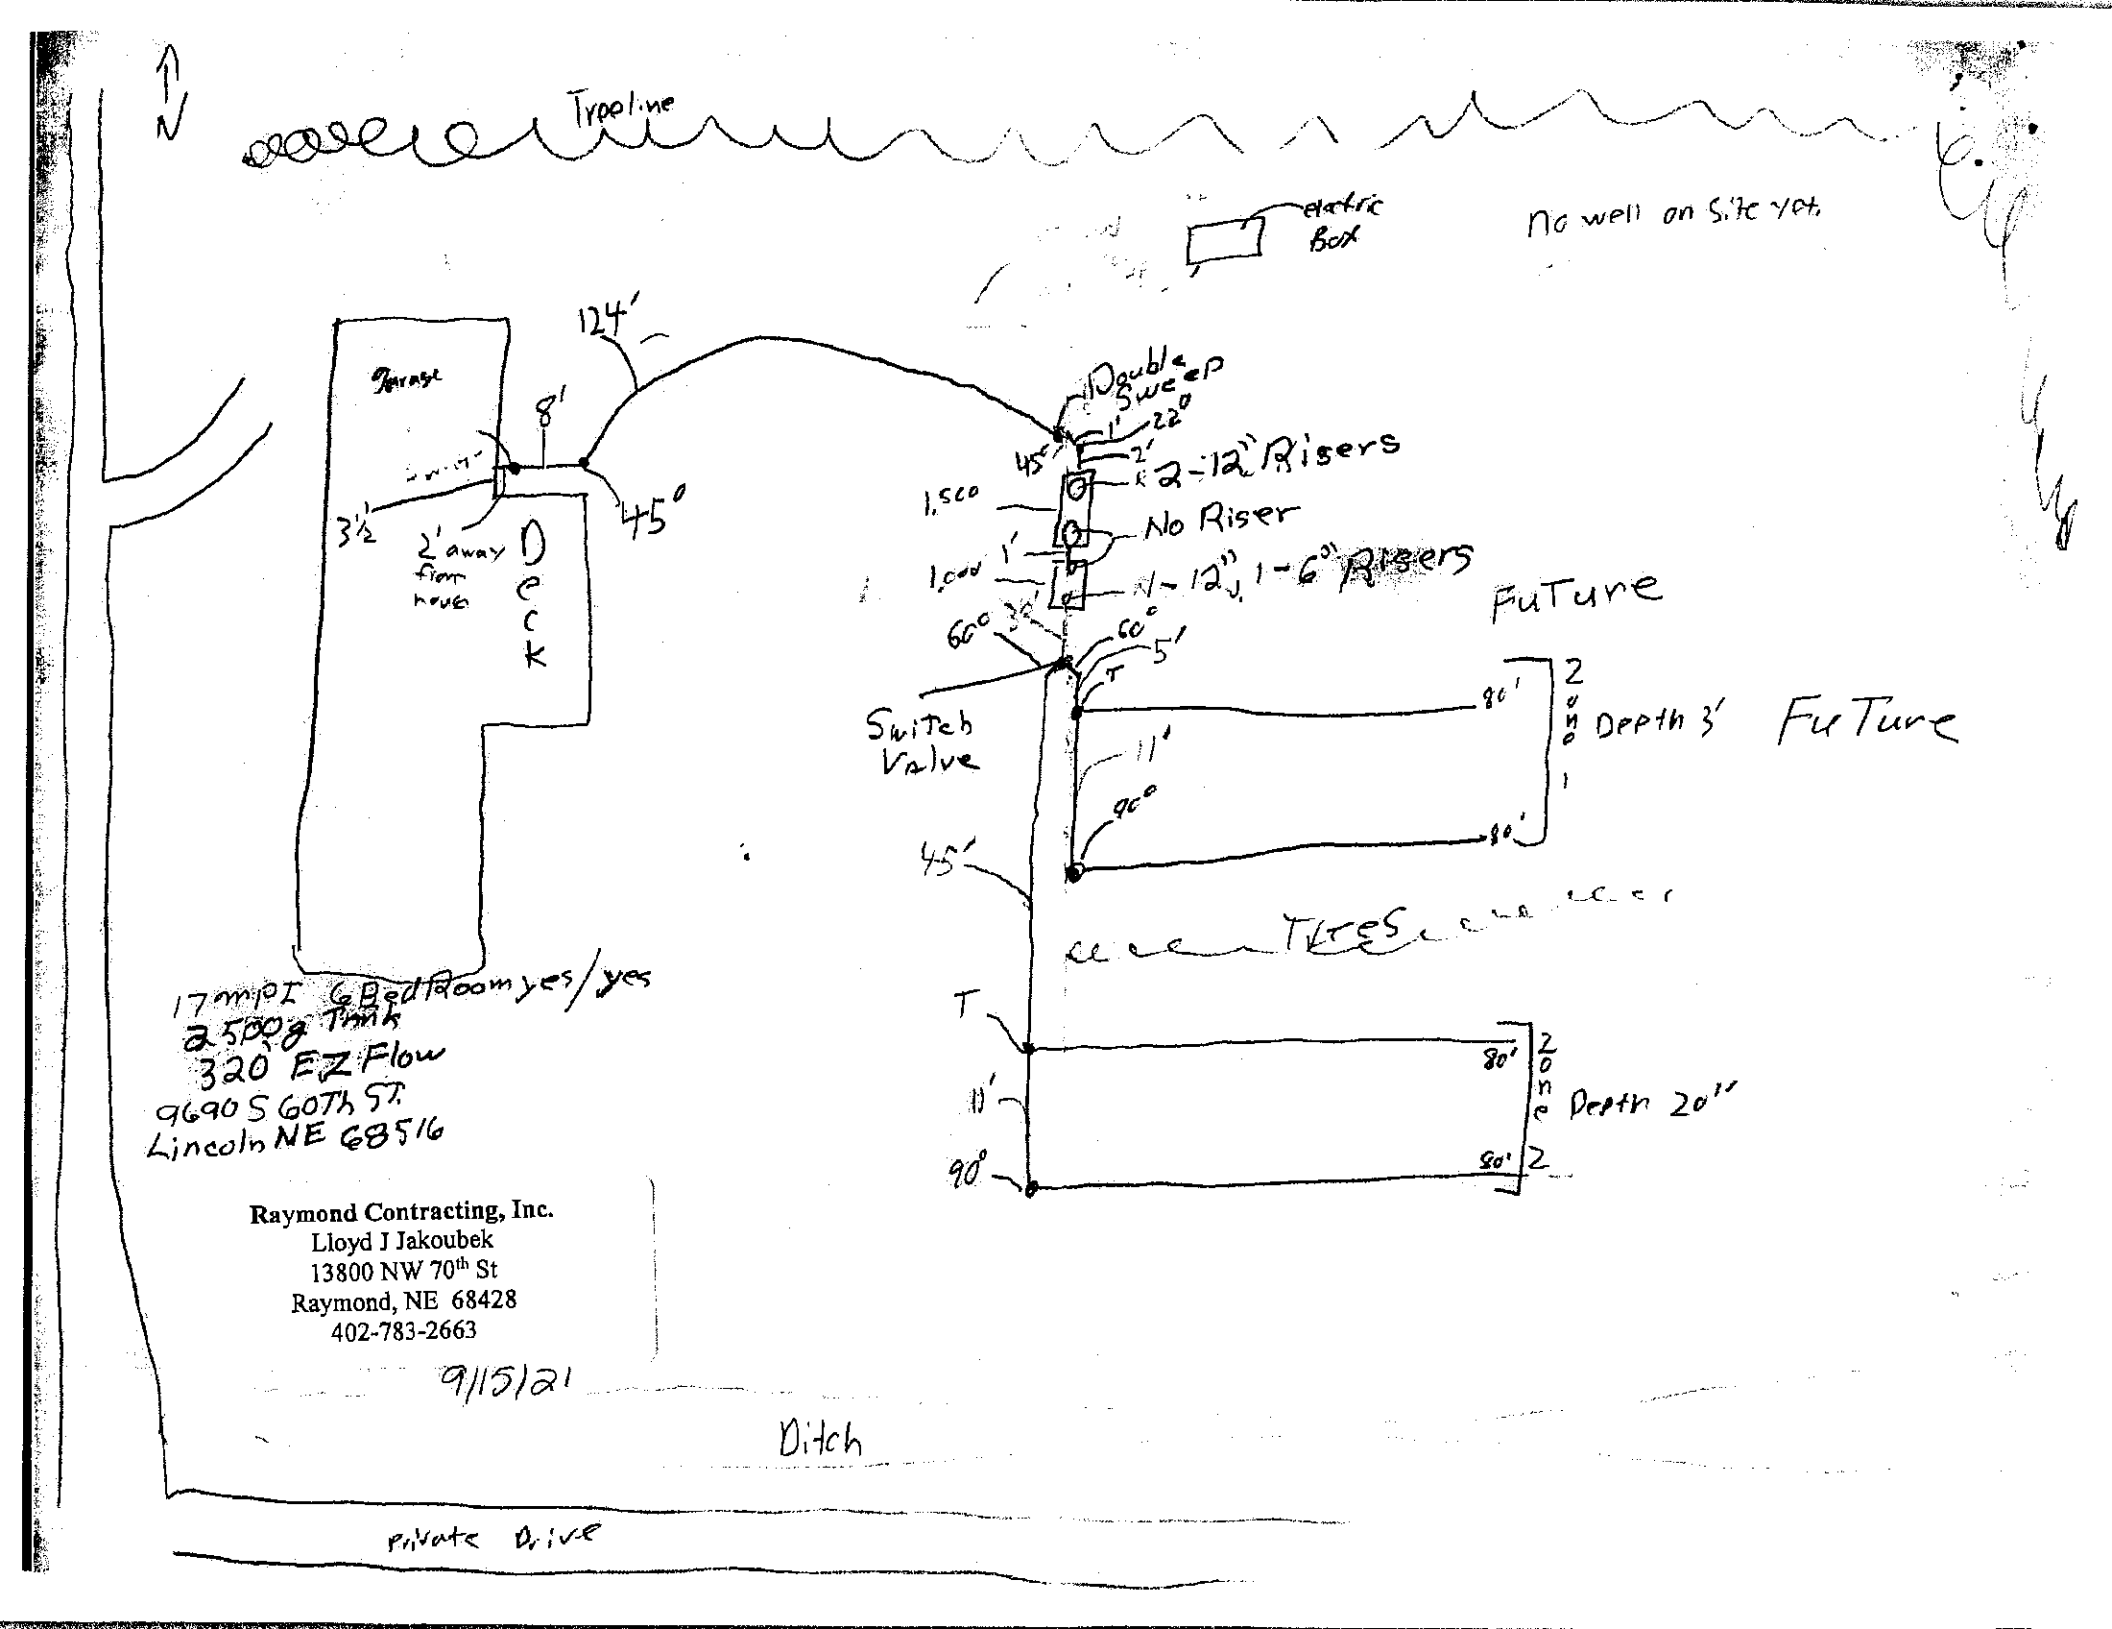
N
Treeline
electric Box
No well on site yet.
Garage
8'
124'
45°
3½'
2' away from house
Deck
Double Sweep
22°
1'
2'
45°
2-12" Risers
1.5co
No Riser
1.00
1'
1-12", 1-6" Risers
60°
30'
60°
5'
Switch Valve
Future
90'
2 Zone Depth 3'
Future
11'
90°
90'
45'
Trees
T
80'
2 Zone Depth 20"
11'
90°
80'
2
17 mpi 6 Bedroom yes/yes
2500g Tank
320 EZ Flow
9690 S 60th St.
Lincoln NE 68516
Raymond Contracting, Inc.
Lloyd J Jakoubek
13800 NW 70th St
Raymond, NE 68428
402-783-2663
9/15/21
Ditch
Private Drive

9690 S 60th St, Lincoln, NE 68516

GIS Viewer
CITY OF LINCOLN - LANCASTER COUNTY, NE

City of Lincoln\Lancaster County GIS Map * No well onsite



Disclaimer: The information is presented on a best-efforts basis, and should not be relied upon for making financial, survey, legal or other commitments. If you have questions or comments regarding the data displayed on this map, please email assessor@lancaster.ne.gov and you will be directed to the appropriate department.