HS0022SS

Application to Alter or Repair an Onsite Wastewater Treatment System

The applicant is applying for a permit to: ☐ALTER ☒REPAIR an existing Onsite Wastewater Treatment System, and agrees to comply with LMC 24.38 or County Resolution 02-0030.

1. **Street Address (No Rural Route):** 2210 W Roxbury Lane Lincoln, NE 68523

Legal Description of Property: Township: 9 Range: 6 Section: 21

Block 8 Lot 1 + outlot A SubDivsion Ridgewood Add:

***Parcel ID** 09-21-301-035-000 (i.e. 99-99-999-999-999)

2. **Property use:** ☒ Residential ☐ Commercial ☐ Other use (Describe:)

Number of bedrooms 4 Does the system have a: ☒ Garbage Grinder ☐Large Capacity Tub

3. **Type of Present Individual Disposal System** ☒ septic system ☐ lagoon ☐ other

4. **Description of proposed alteration or repair:** Lateral field will fill up and Leach out of [redacted] the ground.

5. **Current Type of Lateral-** Concrete Chambers **Current Linear Ft. Of Lateral -** 230'

Current Tank Gallonage- 1500

6. Print Name Brandon Sedlacek Address 11185 E State Hwy 41 Phone: 402-988-8425

Applicant Signature: Brandon Sedlacek

Please contact LLCHD for the current permit fee for this application

Fee must be included before the application will be processed. Incomplete information will delay processing.

HEALTH DEPARTMENT USE ONLY

☐Municipal Code 24.38 ☐County Resolution Number 02-30

Date received ____/____/____ REVIEW: ☐ Approved ☐ Disapproved By:

Comments (if any):

Site visits

Date ____/____/____ By

Date ____/____/____ By

Installation final written approval

Date ____/____/____ By

Return application to:

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 "N" Street, Lincoln, NE 68510
Phone: (402) 441-8643

Business Office Use Only

Received: Date: 7/12/21 Amount $235.00 Check No. 2279 Initials

Lincoln-Lancaster County Health Department (LLCHD)
Environmental Public Health Division
3131 "O" Street • Lincoln, NE 68510-1514
Phone: 402-441-8643

B

Permit Number:

Onsite Wastewater Treatment System
Soil Evaluation Report

PLEASE PRINT OR TYPE

Onsite System Location

Address 2210 Roxbury Lane (no rural route) City Lincoln NE, Zip 68523

Owner Chad Dlouhy Address 2210 Roxbury Lane

Date of Tests 6-28-21 to 6-29-21 Weather: Precipitation 0" Temperature 85°

Percolation Test Data Table

A.	B.	C.	D.	E.	F.	G.	H.	I.	J.	K.	L.	M.	N.
		Saturation/Swelling Time				Water Level Drop: Last 30 mins of 4 hr or last 10 mins of 1 hr					Results		
		Start		End		Start			End				
Hole No.	Hole Depth(in)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Initial Water Lev (in.)	Date (Mo/Da)	Time (Hr/Min)	Elapsed Time Interval	Water Level Drop(in)	Percolation Rates (Min/in = mpi)
1	36"	6-28	2pm	6-29	3pm	6-29	3pm	6	6-29	3:30	30	5/8"	48 mpi
2	"	"	"	"	"	"	3:01	6	6-29	3:31	"	5/8"	48 mpi
3	"	"	"	"	"	"	3:02	6	"	3:32	"	5/8"	48 mpi
4	"	"	"	"	"	"	3:03	6	"	3:33	"	1"	30 mpi
5	"	"	"	"	"	"	3:04	6	"	3:34	"	5/8"	48 mpi
6	"	"	"	"	"	"	3:05	6	"	3:35	"	1"	30 mpi
								6					
								6					

Person Conducting Percolation Test

Name: Brandon Sedlacek

Phone: 402-488-8425

Address 11185 E State Hwy 41 Adams, NE 68301

Sum of Percolation Rates: 252

Average of Rates: 42 mpi

Rate Used for Calculation: 41-50 mpi

Soil type (NRCS Maps/Other)

Groundwater Depth +10

DO NOT WRITE BELOW THIS LINE

Reviewing Action

Comments (Soil type, groundwater, floodplain, etc.)

Signature of Reviewing Official Date

Lincoln-Lancaster County Health Department
Environmental Public Health Division (402) 441-8027
3131 O Street Lincoln, Nebraska 68510-1514

ON-SITE WASTE WATER SYSTEM
ALTERATION PERMIT
No. HS002255

System Type: Standard

Situs: No Site Address Specified

Issued: 7/19/2021

Expires: 7/19/2022

Description: RIDGEWOOD, BLOCK 8, Lot 1, & OUTLOT A

Owner: DLOUHY, CHAD M & CHRISTINE L
2210 W ROXBURY LN
LINCOLN, NE 68523

Patricia D. Lopez

Patricia D. Lopez, RN, MSN, Health Director

Dear Applicant:

The above document is your permit to alter an existing On-site Waste Water System at the location listed. Please contact this office once the alteration is complete to obtain final approval before use.

Patricia D. Lopez

Patricia D. Lopez, RN, MSN
Health Director

BRANDON SEDLACEK
11185 E STATE HWY 41
ADAMS, NE 68301

SCANNED

HS0022SS

Application to Alter or Repair an Onsite Wastewater Treatment System

3pm.

The applicant is applying for a permit to: ☐ALTER ☒REPAIR an existing Onsite Wastewater Treatment System, and agrees to comply with LMC 24.38 or County Resolution 02-0030.

1. **Street Address (No Rural Route):** 2210 W Roxbury Lane Lincoln, NE 68523

Legal Description of Property: Township: 9 Range: 6 Section: 21

Block 8 Lot 1 + outlot A SubDivsion Ridgewood Add:

***Parcel ID** 09-21-361-035-000 (i.e. 99-99-999-999-999)

2. **Property use:** ☒ Residential ☐ Commercial ☐ Other use (Describe:)
Number of bedrooms 4 Does the system have a: ☒ Garbage Grinder ☐Large Capacity Tub

3. **Type of Present Individual Disposal System** ☒ septic system ☐ lagoon ☐ other

4. **Description of proposed alteration or repair:** Lateral field will fill up and leach out of [redacted] the ground.

5. **Current Type of Lateral-** Concrete Chambers **Current Linear Ft. Of Lateral -** 230'

Current Tank Gallonage- 1500

6.Print Name Brandon Sedlacek Address 11185 E State Hwy 41 Phone: 402-988-8425

Applicant Signature: Brandon Sedlacek

Please contact LLCHD for the current permit fee for this application
Fee must be included before the application will be processed. Incomplete information will delay processing.

HEALTH DEPARTMENT USE ONLY

☐Municipal Code 24.38 ☒County Resolution Number 02-30

Date received 7/19/21 REVIEW: ☒ Approved ☐ Disapproved By:

Comments (if any): adding Lateral

Site visits
Date 7/20/21 By DS
Date / / By

Installation final written approval
Date 8/09/21 By

Return application to:

Lincoln-Lancaster County Health Department
Environmental Public Health Division
3140 "N" Street, Lincoln, NE 68510
Phone: (402) 441-8643

Business Office Use Only

Received: Date: 7/21/21 Amount $235.00 Check No. 2279 Initials

HEALTH DEPARTMENT
Environmental Public Health Division
3140 N Street • Lincoln NE 68510-1514
Phone: 402-441-8643

Exhibit 5

Permit Number: H5002255

Onsite Wastewater Treatment System

Inspection Sheet

Date 8/9/21 Legal Description ____ ¼ ¼ Section/Township/Range

Onsite System Location

Address (no rural route) 2210 W. Roxbury City ____

Owner ____ Address ____

Mark One: ☒ Dwelling ☐ Non-dwelling

☐ New System ☒ Alteration [☐ Tank Only ☐ Trench Only] ☐ Lateral Only

☐ Temporary modification (Describe problem causing discharge and reason for temporary modification): ____

Drainfield Absorption System:

☐ Lateral ☐ Bed ☐ Non-standard (engineer-designed and NDEQ approved) ☐ Holding Tank ☐ Trench

Total square feet of drainfield 1,350 New Sq. Ft. Tank Size 1,500 existing tank gals

Total length of laterals 300' new Type of Distribution: ☐ Chamber ☐ Perforated Pipe ☒ Other (describe) E-Z Flow
230' existing - valved to allow dosing usage

No. of Absorption Laterals 3 new Width 4.5 factor No. of Drop Boxes ____ Distribution Box 1

Leveling Method Used Laser

Setbacks (Check the Boxes Below if the Required Setback has been Satisfied):

Distance From	Private Well	Public Well	Surface Water	Ground water	Pressure Water Lines	Property Lines
Tank (ft)	50 ☐	500 ☐	50 ☐	NA ☐	10 ☐	5 ☐
Field (ft)	100 ☐	500 ☐	50 ☐	4 ☐	2 ☐	5 ☐

Geographical Coordinates to 6 Decimals:

Tank ____ NA

Lateral #1 ____ Lateral #3 ____

Lateral #2 ____ Lateral #4 ____

Comments:

Add Note Drawing (See Reverse Side):

Inspections prior to Final Approval
Initial DS Date 7/20/21

Follow-Up ____ Date ____


Follow-Up ____ Date ____

Installation Final Written Approval
By Doug Ahlm

Date 8/9/21

Updated 4/15

Chad Dlouhy
2210 W Roxbury Ln
Lincoln, NE 68523

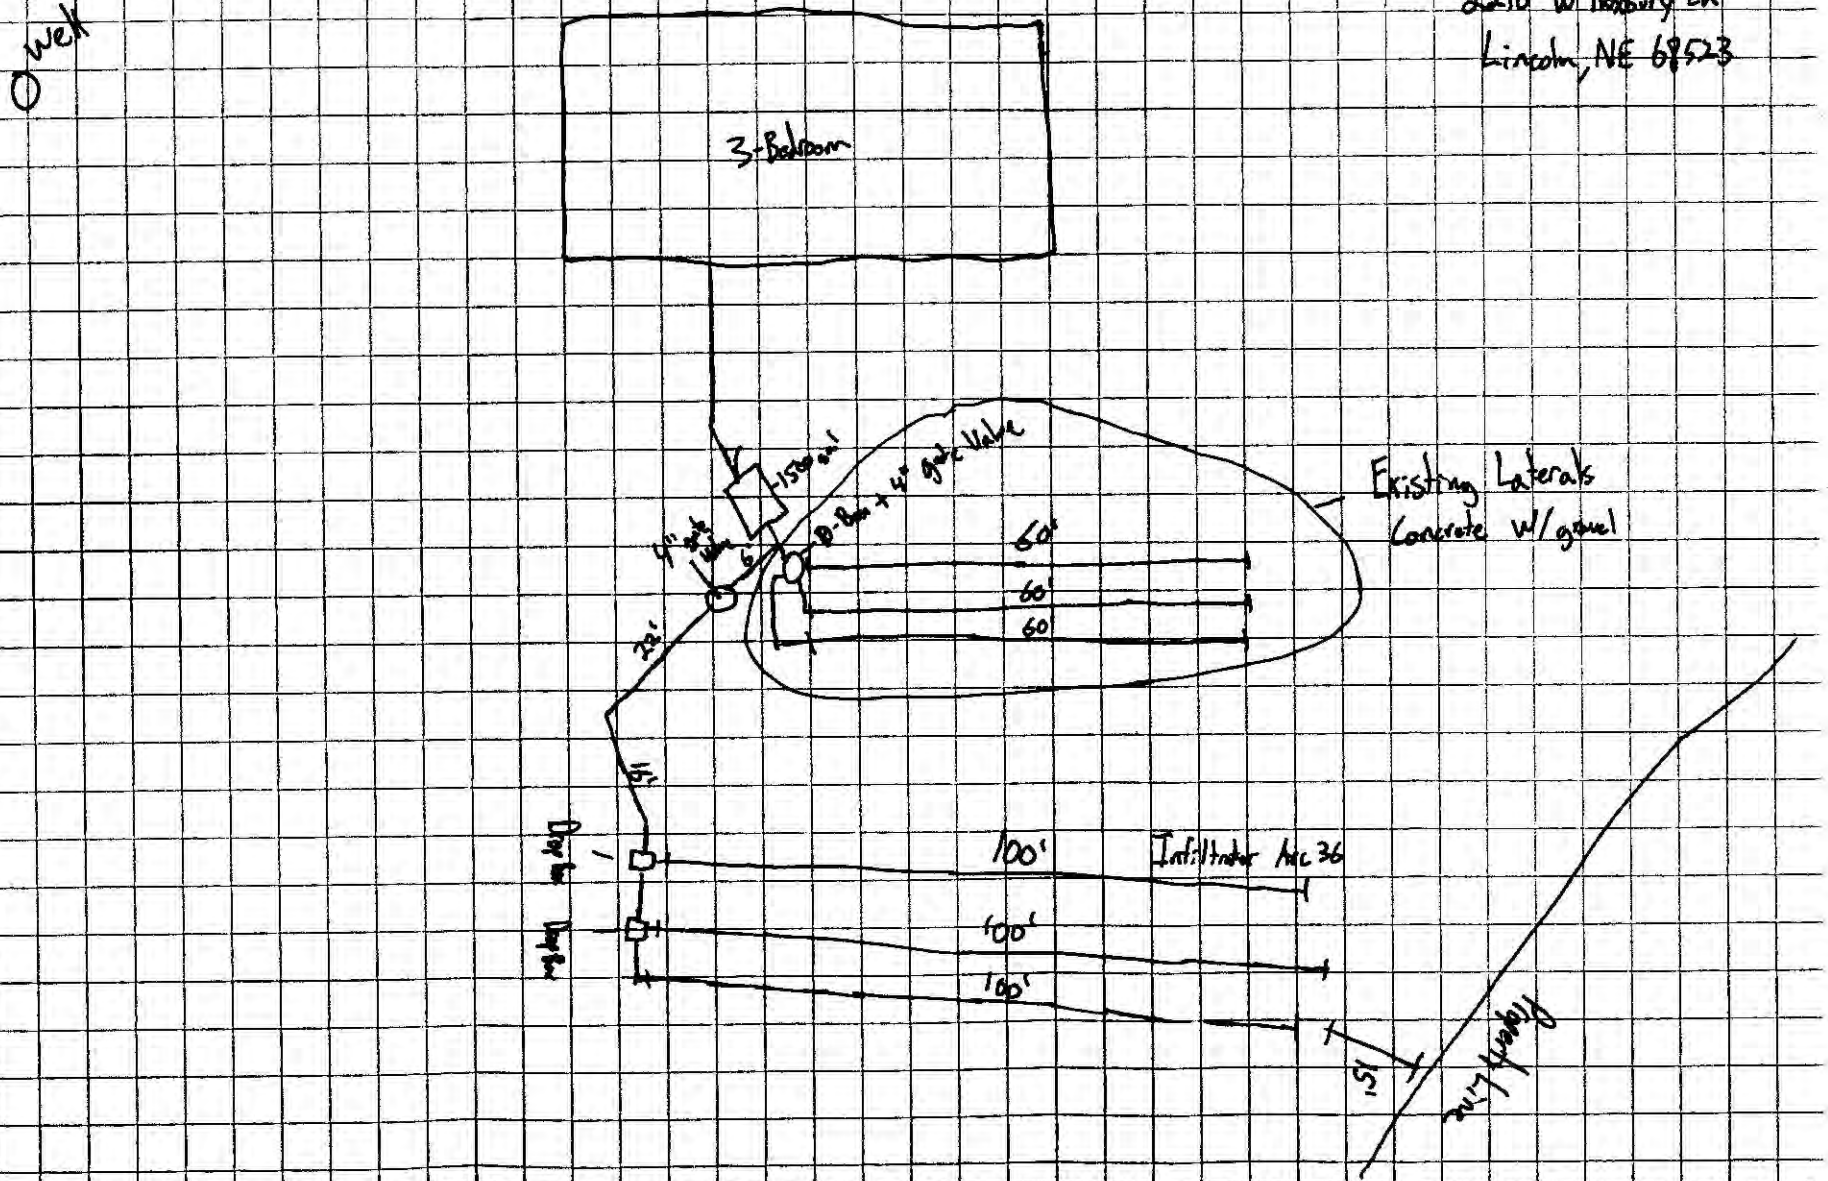

Jordyn Johnson
6877 West Beaver Creek Rd
Raymond, NE 68428

