FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Ave.
Lincoln, Nebraska 68502 (Phone: 471-7800)

FILE NO. 933900321

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: _____

The undersigned hereby applies for a permit to ALTER ☒, EXTEND ☐, or REPAIR ☐ an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 7N ; Range 5E ; Section 16 ;
Block _____; Lot _____; Addition _____
Street Address 114th SW Princeton Rd 11200 WEST PRINCETON ROAD

2. Property Use: Residential X ☐; Commercial _____ ☐
No. Bedrooms 3 or 4 Describe _____
Other Use ☐
Describe _____

3. Type of existing Individual Sewage Disposal System: Septic Tank ☐; Other ✓

4. Description of proposed alteration, extension or repair: dig Lagoon, ran 80' of 4" pvc added onto existing line

5. Work to be done by: Owner ✓; or Contractor ☐, Crete Lumber
Contractor's Name

6. Estimated cost of project:

a. Materials	$ 200	00
b. Labor	$ 650	00
c. Other	$	
TOTAL	$ 850	00

Greg Brown
Signature of Applicant (owner or lessee)

Box 152 Hallam NE. 68368 114th SW Princeton Rd.
Address

(Do not write below this line)

REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ _____


2. Site Visits:
Date: _____ by: J.C.H.
Date: 5/27/94 by: J.C.H.
Date: _____ by: _____

3. Date: Approved ☒; Disapproved ☐
by: Jerrold C. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 5/27/94 by: J.C. Hood

Greg Brewer South 20+ acres

Princeton Rd.

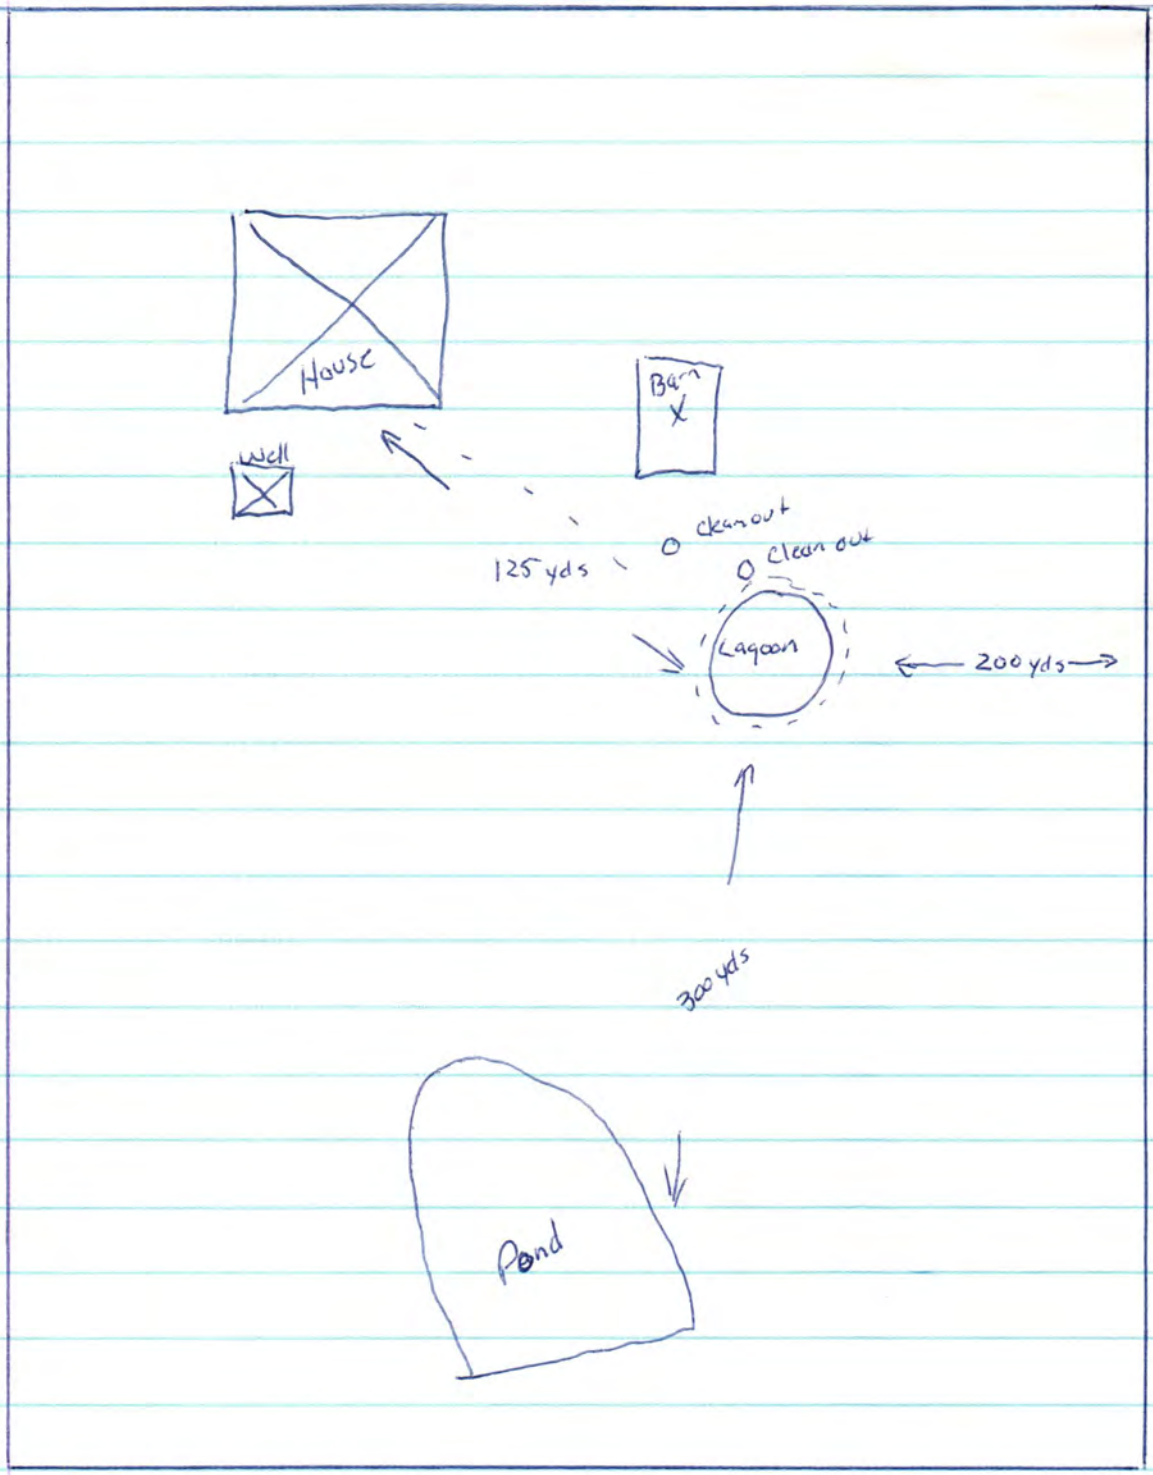

003

Lincoln-Lancaster County Health Department

2200 St. Mary's Avenue, Lincoln, Nebraska 68502 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

ORIGINAL LOAN APPROVAL FILE
PREVIOUS HISTORY UNKNOWN

This form must be completed and returned to r

MAKE CHECK PAYABLE TO: Lincoln-Lancaster County Health Department or LLCHD

☑ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

☐ Evaluation of the Individual Water System ☐ Evaluation of the Sewage Disposal System

Legal Description of Property: Street Address 11200 WEST PRINCETON ROAD 114th + W. Princeton Rd. Hallam

Twp 7N Range 5E Section 16 1/4 SW 1/4 Block Lot Addition

Directions to Property Acreage In Hallam, Ne

Location of Well North of Garage Tap Location: Inside ☐ Outside ☒

Location of Sewage System Lagoon - North of Barns Year Installed ?

	NAME	ADDRESS	PHONE
Present Owner:	Greg + Ruth Brewer	114th + W Princeton Rd. Hallam, Ne	826-3899
Tenant/Buyer:	Bruce R + Ellen M Miller	1035 S. 6th St. Lincoln, Ne 68508	477-1450
Return to:	Metropolitan Federal Bank	238 S. 13th St. Lincoln, Ne 68508	435-7241

Signature of Applicant Kim Byrd Address 238 S. 13th St. Lincoln, Ne 68508 Date 5/11/94

HEALTH DEPARTMENT USE ONLY

Date Received 05/12/94 Received $150.00 ✓ Check ☑ ✓ Cash ☐ #21201274

PRELIMINARY STATUS--By Jerrold C. Hood **DATE:** 5/13/94

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM	Additional Site Visits
Construction	☐	☒	Approved ☐	Date 5/23/94 by J.C.H.
Bacteria	☒ 0 /ml	☐ /ml	Provisional ☐	Date 5/27/94 by J.C.H.
Nitrate	☒ <0.1 ppm	☐ ppm	Disapproved ☒	Date / / by

Comments: OLD WELLS MUST BE PROPERLY ABANDONED. WELL PIT MUST BE ABANDONED. ALL TOO CLOSE TO WELL. SEWAGE SYSTEM NEEDS TO BE BUILT. SCREEN MISSING OUT OF See Attached Letter ☐

ATTENTION: Old wells abandoned, well pit abandoned, current replaced. Approval is provisional on the sewage system because the majority of the sewer line was built prior to regulations and before inspections.

FINAL STATUS

WATER SYSTEM: Approved: ☒ **SEWAGE DISPOSAL SYSTEM** Approved: ☐ Provisional Approval: ☒

Approved by Jerrold C. Hood R.E.H.S. Date 5/27/94

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

Sewage system complete 5/24/94 J.C.H.

'94 MAY 13 P4:43

REPORTED

'94 MAY 13 P12:00

RECEIVED

COMPLETE INFORMATION BELOW

WATER CHEMISTRY

STATE LAB NO. 154-9169

DATE COLLECTED 5 (MO) 13 (DAY) 94 (YEAR) 11:15 A.M. (HOUR)

SAMPLE COLLECTED BY JERROLD HOOD

SAMPLE LOCATION GREG BREWER

PROPERTY LEGAL DESCRIPTION: COUNTY LANCASTER

QRTR SW SECT 16 TWNSHP 7 N RANGE 5 E

NAME AND ADDRESS OF PERSON TO RECEIVE EXTRA REPORT:

PLEASE PRINT COMPLETE ADDRESS

THIS LAB REPORT IS TO BE MAILED TO:

LINCOLN-LANCASTER COUNTY
ENVIRONMENTAL HEALTH
2200 ST. MARY'S AVENUE
LINCOLN, NEBRASKA 68502

STATE OF NEBRASKA DEPARTMENT OF HEALTH LABORATORIES
3701 SOUTH 14th LINCOLN, NE 68502

FOR LABORATORY USE ONLY

TEST METHOD: USEPA METHOD 353.2

NITRATE ANALYSIS FOR DRINKING WATER

NITRATE — N less than 0.1 mg/l

NOT TESTED BECAUSE OF:
☐ DAMAGE
☐ INSUFFICIENT AMOUNT
☐ IMPROPER CONTAINER

TEST(S) BY JW

FOR ACCOUNTING USE ONLY

LWN 88

'94 MAY 24 P2:57

REPORTED

'94 MAY 23 P3:59

RECEIVED

WATER MICROBIOLOGY

STATE LAB NO. 14/0690

COMPLETE INFORMATION BELOW

DATE COLLECTED 5 (MO) 23 (DAY) 94 (YEAR) 3:15 p.m. (HOUR)

SAMPLE COLLECTED BY JERROLD HOOD

SAMPLE LOCATION GREG BREWER

PROPERTY LEGAL DESCRIPTION: COUNTY LANCASTER

QRTR SW SECT 16 TWNSHP 7 N RANGE 5 E

NAME AND ADDRESS OF PERSON TO RECEIVE EXTRA REPORT:

PLEASE PRINT COMPLETE ADDRESS

THIS LAB REPORT IS TO BE MAILED TO:

LINCOLN-LANCASTER COUNTY
ENVIRONMENTAL HEALTH
2200 ST. MARY'S AVENUE
LINCOLN, NEBRASKA 68502

STATE OF NEBRASKA DEPARTMENT OF HEALTH LABORATORIES
3701 SOUTH 14th LINCOLN, NE 68502

FOR LABORATORY USE ONLY

TEST METHOD: ☑ MEMBRANE FILTER ☐ MPN

COLIFORM PURITY TEST FOR DRINKING WATER

TOTAL COLIFORMS 0 PER 100 ML.

☑ THE WATER MEETS BACTERIOLOGICAL STANDARD

☐ WATER DOES NOT MEET BACTERIOLOGICAL STANDARD

☐ RESULTS MAY BE INVALID DUE TO EXCESSIVE AGE*

*SAMPLES RECEIVED BETWEEN 30-48 HRS. AFTER COLLECTION

SAMPLE NOT ANALYZED BECAUSE OF:

☐ EXCESSIVE AGE ☐ INSUFFICIENT AMOUNT

☐ DAMAGE ☐ IMPROPER CONTAINER

TEST METHOD NUMBER: NIPDWR 141.27

TEST(S) BY KJ

FOR ACCOUNTING USE ONLY

LWB 91