LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

Division of Environmental Health
2200 St. Marys Ave Lincoln, NE 68502 (402) 471-8000

NON TRANSFERABLE

PERMIT

SEWAGE SYSTEM REPAIR

No. 8939000130

Issued 09/19/89
Expires 03/19/90

ESTABLISHMENT

JIM RHODES
T7N R7E SEC 23 QTR NW
NW 1/4 QTR.

FEES: Permit 018754 $30.00

Total $30.00

PERMITTEE

JIM RHODES
8405 PRINCETON RD
FIRTH NE 68358

Issued By COUNTY HEALTH

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE	
DATE	AMOUNT

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐

County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Ave.
Lincoln, Nebraska 68502 (Phone: 471-7800)

FILE NO. _____

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 9-19-89

The undersigned hereby applies for a permit to ALTER ☒, EXTEND ☐, or REPAIR ☐ an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 7N ; Range 7E ; Section NW¼23 ;
Block _____; Lot _____; Addition _____
Street Address 8405 Princeton Road

2. Property Use: Residential _____ ☒; Commercial _____ ☐
No. Bedrooms 3 Describe _____
Other Use ☐
Describe _____

3. Type of existing Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Description of proposed alteration, extension or repair: Abandon Septic Tank & open end discharge. Build Sewage Lagoon

5. Work to be done by: Owner ☐ ; or Contractor ☒, Southern Sewer & Drain
Contractor's Name

6. Estimated cost of project:

a. Materials	$	
b. Labor	$	
c. Other	$	
TOTAL	$	1350 00

Jim Rhodes by Brad Southern
Signature of Applicant (owner or lessee)

8405 Princeton Rd
Firth Ne 68358 Hickman, Ne 68372
Address

(Do not write below this line)

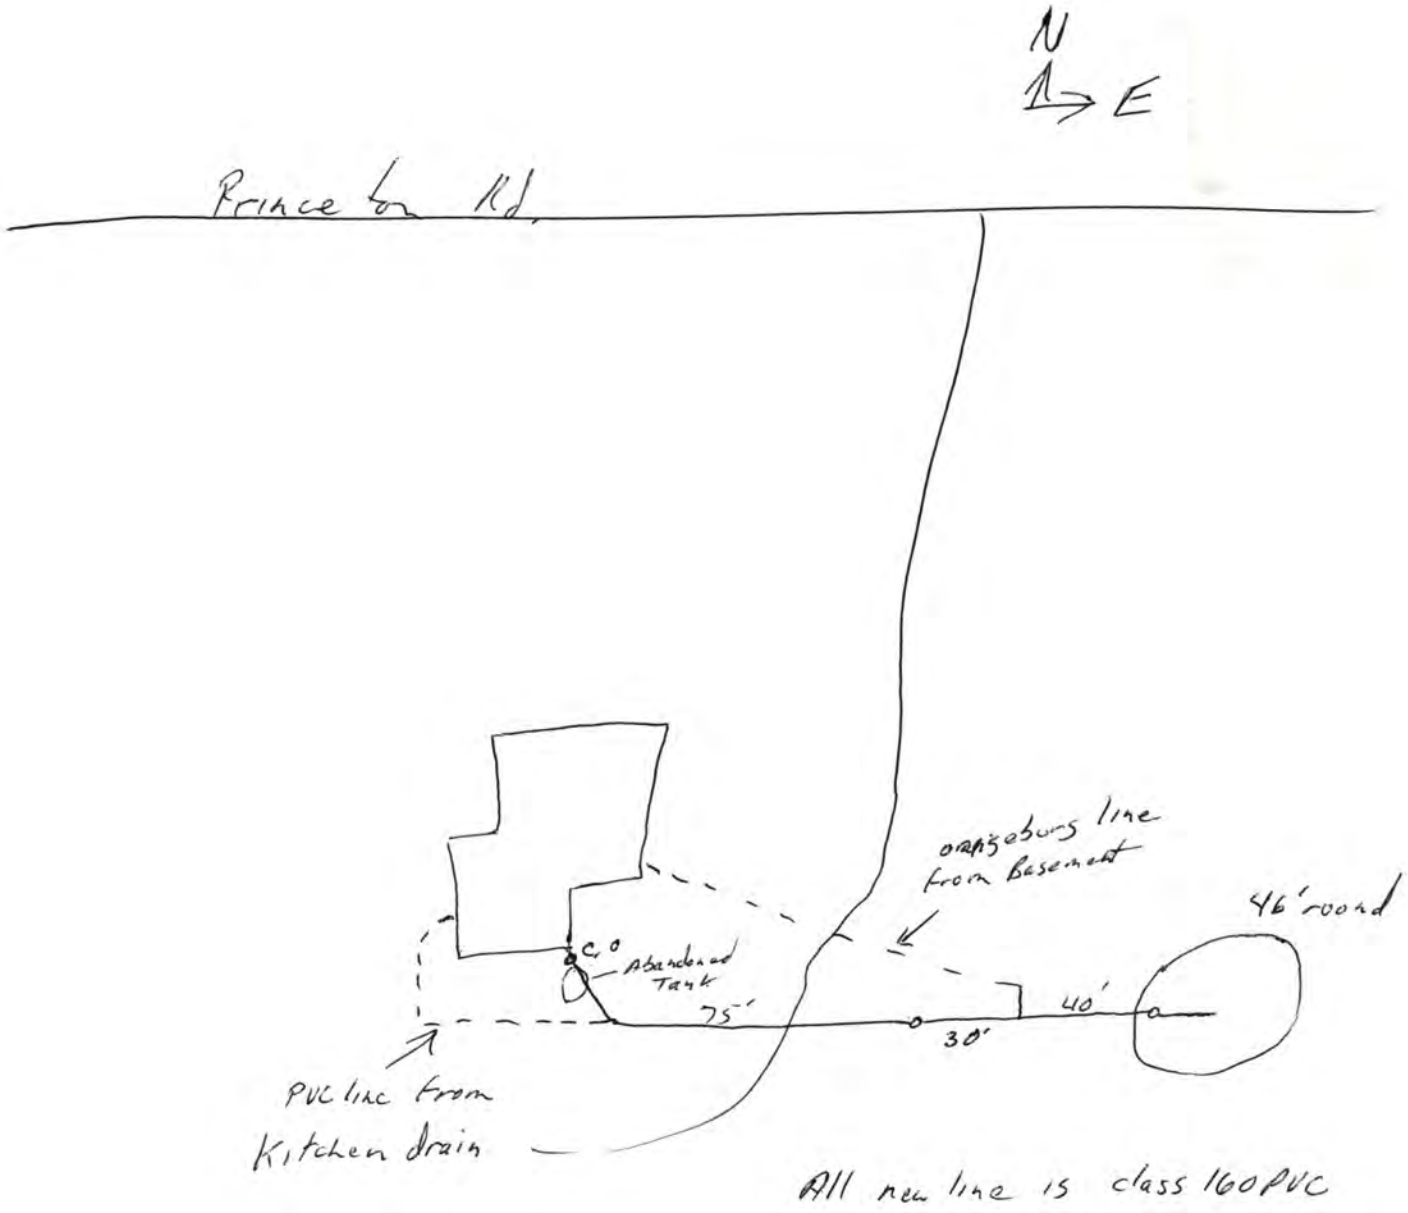
REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ 30.00

2. Site Visits:
Date: 9-19-89 by: rm old, unused well too close to house, need gate, need to cover grass
Date: _____ by: _____
Date: 11/6/91 by: J.C.H.

3. Date: Approved ☒; Disapproved ☐
by: Jerrold C. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 11/6/91 by: J.C. Hood


N
E
Princeton Rd.
overflow line from Basement
46' round
C.O
Abandoned Tank
75'
40'
30'
PVC line from Kitchen drain
All new line is class 160 PVC