LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

FILE NO. 659-C

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF PERMIT

January 18, 1976 — THIS PERMIT EXPIRES

Frank Kriasnicka — ISSUED TO

Firth — ADDRESS

T7N; R7E; Sec. 33 SE¼; ~~LAGOON~~ — LEGAL DESCRIPTION

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 30.00	$	$	$ 30.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624-1535	110.16	148.14	6-2

RECEIPTED BY — DATE — AMOUNT

ISSUING OFFICER

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. 2832

FORM HD-40(73) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐
County Resolution No. 2832 ☑

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 659-C

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 7-1

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 7N; Range 7E; Section 33 SE¼
   Block —; Lot —; Addition —
   Street Address —

2. Property Use: Residential ☑; Commercial ☐
   No. of Bedrooms 3. Describe:
   Other Use ☐
   Describe:

3. Type of Individual Sewage Disposal System: Septic Tank ☐; Other ☑

4. Distance to public sewer: None ft.

X Frank Kwasnicka
Signature of Applicant (Owner or Lessee)

Firth, Neb.
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 7/8/75. Date Frwd. 7/8/75. ACTION: Approved ☑ Disapproved ☐ Signature: Jerrold C. Hood
2. Supt. Bldg. Insp.: Date Rec'd. —. Date Frwd. 7/21/75. ACTION: Approved ☐ Disapproved ☐ Signature:
3. City or County Engineer: Date Rec'd. 7/21/75. Date Frwd. 7/21/75. ACTION: Approved ☒ Disapproved ☐ Signature:

REMARKS OR REASONS FOR DISAPPROVAL

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM HD- 43(73) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 475-6221)

FILE NO. 659-C

PROPERTY WHERE SOIL TESTED:
Location: Township 7 ; Range 7
Section & ¼ Sect. 33 & 34
Property Dimensions: ___ ft. x ___ ft.
Area: 120 acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☐; Sandy Loam ☑
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☑

Owner: Frank E. Knasinka
Address Firth, Nebr

Dates of Tests: 7-9-75 to 7-16-75. Weather: Precip. 0 Temp. 92 F.

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
Hole No.	Hole Depth (in.)	Pre-Saturation Period Start Date (Mo. Day)	Pre-Saturation Period Start Time (Hr. Min.)	Pre-Saturation Period End Date (Mo. Day)	Pre-Saturation Period End Time (Hr. Min.)	Percolation Readings Start Date (Mo. Day)	Percolation Readings Start Time (Hr. Min.)	Percolation Readings Start Water Level (in.)	Percolation Readings End Time (Hr. Min.)	Percolation Readings End Water Level (in.)	Results Elapsed Time (Min.)	Results Water Level Drop (in.)	Results Percolation Rates (Min./inch)
1	32"	7-9	3 PM	7-9	5PM	7-9	5 00 PM	13 7/8"	6 00 PM	17"	90M	3 1/8	
2	32	7-8	3PM	7-9	5PM	7-9	5 00P	23	6:30PM	28"	90M	5	
3	34	7-8	3PM	7-9	5PM	7-9	5 00P	16 3/4	6:30PM	20	90M	3 1/4	
								16 3/4	6:30				
1	32	7-15	6PM	7-16	12:00	7-16	12 noon	12	12:30M	18	30M	6	
2	32	7-15	6PM	7-16	"	"	"	19 3/4	12:30M	24	"	4 1/4	
3	34	7-15	"	7-16	"	"	"	17	12:30PM	21	"	4	
4	36	7-15	"	7-16	"	"	"	14 3/4	"	17 1/4	"	2 1/2	
5	36	7-15	"	7-16	"	"	"	19 3/4	"	23 1/2	"	3 1/2	

Sum of Percolation Rates
Average of Rates:
Mean of Rates:

Edward T. Douglass
Signature of Person Conducting Test

Address Cortland, Neb.
Phone: 798-7680 68331

(Do not write below this line)

REVIEWING ACTION

REMARKS:

Approved Percolation Rate(s)
A. 7 min./inch
B. ___ min./inch
C. ___ min./inch

DATE: July 18, 1975

Jerrold C. Hood
Signature of Reviewing Official

FORM HD- 45(73) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☑

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 659-C

SPECIFICATIONS

DATE: 7-10-75


A. BUILDING SEWER:
1. Material _____; Diameter ____ in.
2. Distance above basement floor ____in.; or below basement floor ____in.
3. Distance between dwelling and septic tank ____ft.
4. Number of clean-outs _____.
5. Distances To:
Well or Suction Line ____ft.;
Stream ____ft.; Pressure Line ____ft.;
Property Line ____ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material Conc; No. of compartments _____.
2. Capacity 1000 gals.; Liquid depth ____in.
3. Factory Built: Yes ☑ (Company Beast)
No ☐
4. Manholes: Over Inlet; diam. 6 in.
Over Outlet; diam. 6 in.
Below Grade 12" in.
5. Inlet: Baffle ☐; or Tee ☑
6. Outlet: Baffle ☐; or Tee ☐
Depth of outlet below inlet 1 in.
7. Depth of top of tank below finished grade 12 in.
8. Distances To:
Well or Suction Line over 100' ft.;
Stream ____ft.; Pressure Line ____ft.;
Property Line ____ft.

C. DISTRICTION BOX
1. Material _____; No. available outlets _____.
2. Factory Built: Yes ☐, (Company _____) No ☐
3. Dimension: Length ____in.; Width ____in. Depth ____in.
4. Distance from Septic Tank ____ft.
5. Serial Distribution: Yes ☐, No ☐
(If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: Pac Cast Semi Circular (hold)
2. Lateral Lines: Depth below grade 16 in.
Number 2; Length of each line 100 ft
Total length of Laterals 144 ft.;
Slope 4 in/100 ft. Diameter of pipe 24 in.; Shape half moon
Material: concrete ☑; fiber asbestos ☐; clay ☐; other _____
Distance between lateral lines ____ft.
3. Trench Dimensions: Depth 36 in.; Width 36 in.
4. Filter Material: gravel.
Depth of material from trench bottom 22 in.
5. Distances To:
Well or Suction Line over 100' ft.;
Stream 600 ft.; Pressure Line 110 ft.
Property Line ____ft.
6. Percolation Rate: _____minutes/inch

TYPICAL SKETCHES

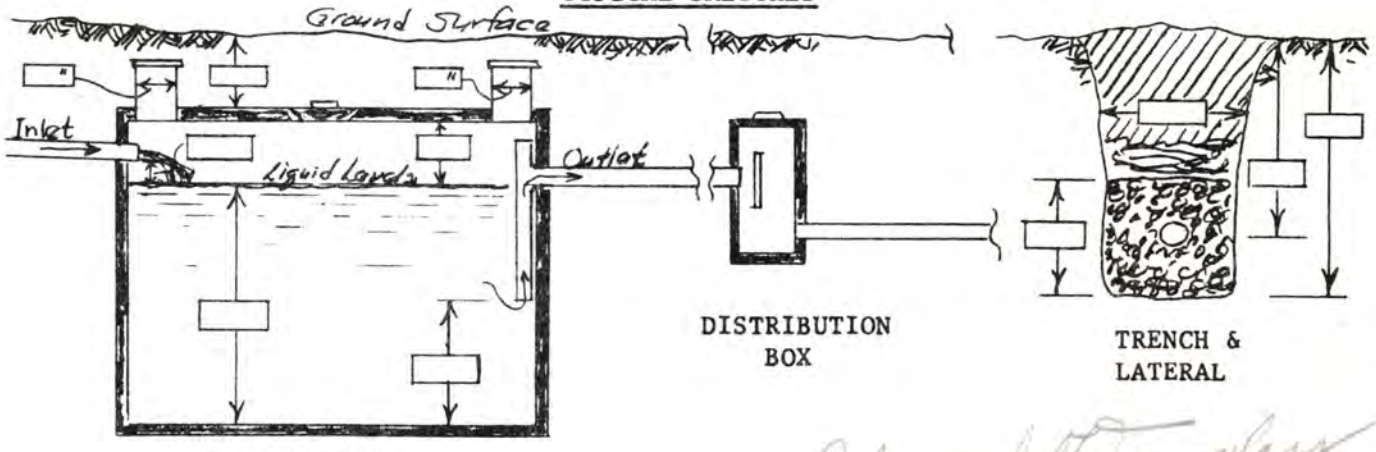

Edward Douglass
Signature of Applicant

FORM HD-42(73) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐
County Resolution No. 2832 ☑

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 659-C

DATE: 7-17-75

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with appropriate Ordinance or Resolution, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 7N ; Range 7E ; Section 33 SE1/4 ; Block ; Lot ; Addition .
Street Address .

2. Property Use: Residential ☑; Commercial ☐
No. of Bedrooms 3
Describe:
Other Use
Describe:

3. Type of Individual Sewage Disposal System: Septic Tank ☑; Other ☐

4. Plans and Specifications of Proposed System. (See FORM HD-45(73) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-43(73) SOIL ABSORPTION TEST DATA REPORT, attached hereto).

X Frank Krawiecka
Signature of Applicant (owner or lessee)

Firth, Neb.
Address

(Do not write below double line)


REVIEWING ACTION

1. Date Rec'd;
Filing Fee: $ 30.00

2. Site Visits:
Date: Aug-11-75 by: ssm
Date: by:
Date: by:

3. Date: Approved ☒; Disapproved ☐ 7/18/75
by: Jerrold E. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: Aug-11-75 by: Ron Maynard

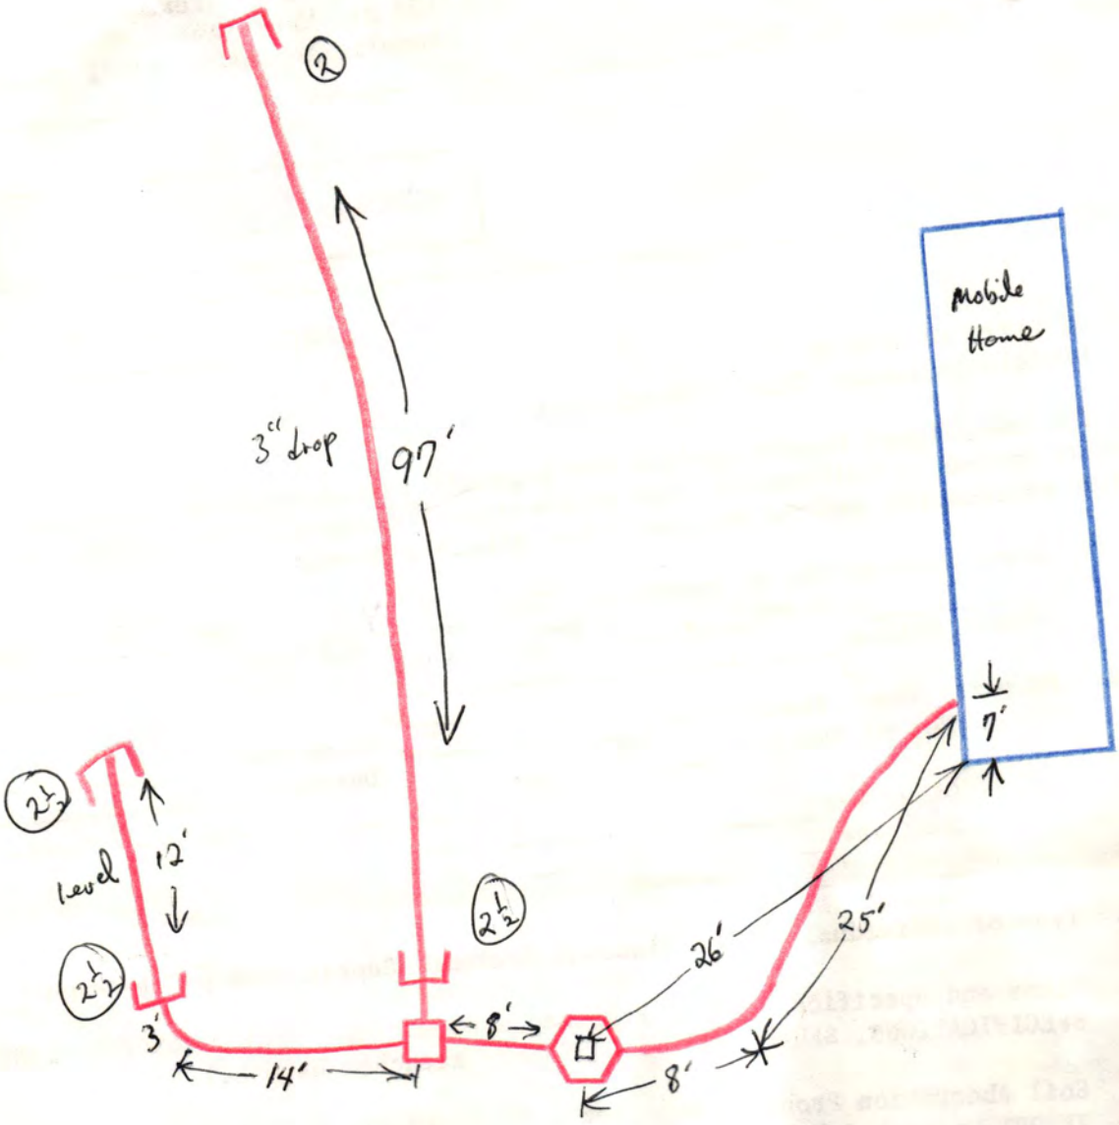

N

Aug-11-75