LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

FILE NO. 1590-C

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF PERMIT

February 27, 1979 — THIS PERMIT EXPIRES

Edward P. Garner (%Paul von Gillern) — ISSUED TO

3308 North Cotner Blvd., Lincoln NE — ADDRESS

T7N; R8E; Section 23 SE¼

LEGAL DESCRIPTION

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 60.00	$	$	$ 60.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
	110.16	148.14	6-2

RECEIPTED BY — DATE — AMOUNT

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

HEALTH

ISSUING OFFICER

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. 2832

20109-0977

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 474-1541

A

FILING FEE: $60.00

FILE NO. 1590-C

DATE: 8-16-79

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 7N ; Range 8E ; Section (23 SE 1/4)
   Block _____ : Lot _____ : Addition 5:1 Acres
   Street Address S½ of W½ W to E 1090' 800'N 300'W 800'S SEE ATTACHED

2. Property Use: Residential ☑ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 3 . Describe _____

3. Type of Individual Sewage Disposal System: Septic Tank ☐ ; Other ☑

4. Distance to public sewer: Miles ft.

Edward P. Garner
Signature of Applicant (Owner or Lessee)
c/o Paul von Gillern
3308 N Cotner Blvd 68507
Address

(Do not write below this double line)

1. Health Department: Date Rec'd. 8/27/79. Date Frwd. 8/27/79. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: or Village Clerk: Date Rec'd. _____. Date Frwd. 8/21/79. ACTION: Approved ☒ Disapproved ☐ Signature: Gary N. Sherwood

3. City or County Engineer: Date Rec'd. 8-27-79. Date Frwd. 8-27-79. ACTION: Approved ☑ Disapproved ☐ Signature: Henry Graff

REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: 11-12-80 by: rm * Need drawing
Date: _____ by: _____
Date: _____ by: _____

INSTALLATION FINAL WRITTEN APPROVAL
Date: _____ By: _____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

* Lagoon is somewhat large & deep.

FORM 20102-0477
PRELIMINARY PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐


LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 474-1541

C

Sketch of property showing Percolation Test hole locations, well, residence, direction and property line.

FILE NO._____

Indicate on sketch if residence and well are exisiting or proposed.

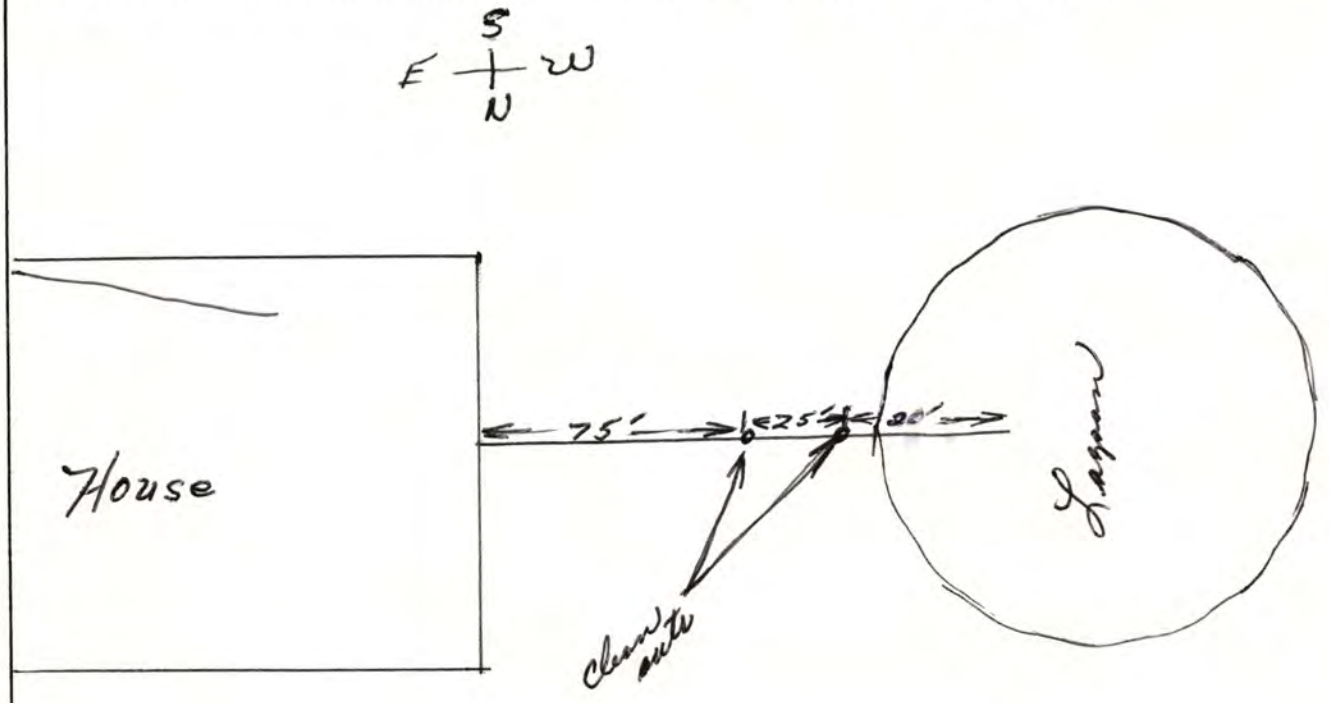

REVIEWING ACTION

Remarks :_____

Date: August 17, 1979

Minimum Design Requirement
1. Capacity of Septic Tank_____gals.
2. Total Length of Laterals_____ft.
3. With a Trench Width of_____in.
4. Total Area of Lateral needed____sq.ft.

Jerrold C. Hood
Signature of Reviewing Official

FORM 20105-047
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 474-1541

B

FILE NO. 1590-C

PROPERTY WHERE SOIL TESTED:

Location: Township 7 ; Range 8 ; Section & ¼ Section 23 + SE ¼
Property Dimensions: 300 ft. x 800 ft. Area: 5.1 acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☐ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ☒ .
Dates of Tests: 10-26-78 to 10-27-78 Weather: Precip. 0 Temp. 60 .

OWNER: Edward B. Garner

Address:

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1	24"	10/26	6:00	10/27	6:00	10/27	6:30	6"	11:10	5 ¼	60	¾	60 ¾
2										5		1	1
3										5 ½		½	½
4										5 ⅛		⅞	⅞ 1/4
5										4 ¾		1 ¼	1/4
6										5 ½		½	½
7										5 ¾		¼	¼
8										5 ¼		¾	¾

Paulson Gillum
Signature of Person Conducting Test

Sum of Percolation Rates:
Average of Rates:
Mean of Rates:

Address 3308 N Cotner Phone 467-4792

(Do not write below this line)

REVIEWING ACTION

Remarks:
Soil Type (SCS): Either Pawnee Clay Loam or Wymore Silty Clay Loam
Date: August 17, 1979

Approved Percolation Rate (a)
A. 60 min./inch
B. min./inch
C. min./inch

Jerrold C. Vool
Signature of Reviewing Official

Beginning at the South ¼ corner of Sec 23 27N, 28E thence east 1190.75' to point of beginning thence north 909.75' thence west 502.62' thence south 475' thence east to point of beginning. includes 5.48 acres ± .38 is county right of way

#1590-C