97 1103008 RGH.

Lincoln-Lancaster County Health Department

3140 "N" Street, Lincoln, Nebraska 68510 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN AP... FORM

FOR PROPERTY IN **LANCASTER CO**

ORIGINAL LOAN APPROVAL FILE
PREVIOUS HISTORY UNKNOWN

This form must be completed and returned with payment to requ...

MAKE CHECK PAYABLE TO: "Lincoln-Lancaster County Health Department" or "LLCHD"

☒ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

Legal Description of Property: Street Address 13707 Firth Road, Firth, NE

CR 3469 Twp 7 N Range 8 E Section 33 1/4 NW 1/4 Block ___ Lot 4 Addition ___

Directions to Property approx 3½ mi. East of FIRTH ON FIRTH RD (just past 134th ST SOUTH SIDE OF Rd. (Mustard yellow color)

Location of Well see attached drawing Tap Location: Inside ☒ Outside ☒

Location of Sewage System " " Year Installed ?? (Please contact Owner for any further information on Fredricks Plumbing '79)

	NAME	ADDRESS	PHONE
YCR 26079 Present Owner:	Agnes & Harold Burton	13707 Firth Rd Firth, NE 68358	791-5551
ACR Tenant/Buyer:	Bruce & Mary Batterson	6531 Walker Ave Lincoln, NE 68507	472-5977
Return to:	State Title Services, Inc. Attn: Shari Hamsa	PO Box 85355 Lincoln, NE 68501	434-5020

Signature of Applicant [signature] Address 348 MANTER HALL Date 10/22/97
LINCOLN, NE 68588-0415

HEALTH DEPARTMENT USE ONLY

RECEIVED
Date 10/24/97
Initials ...
Amount 150 ...
Check No. 2332

DATA ENTRY
Date ___/___/___
Case No. ___
Initials ___

PRELIMINARY STATUS--By Ron Marquart **DATE:** 10/28/97

WATER SYSTEM:	Approved	Disapproved
Construction	☒	☐
Bacteria	☒ 0 /ml	☐ ___ /ml
Nitrate	☒ <0.1 ppm	☐ ___ ppm

SEWAGE SYSTEM	
Approved	☐
Provisional	☑
Disapproved	☐

Additional Site Visits
Date 10/31/97 by RM
Date ___/___/___ by ___
Date ___/___/___ by ___

Comments: Original septic system installation predates County regulations. There is no permit or record of inspection for original construction. Thus a provisional approval. There was no visible malfunction at the time of inspection. Recommend checking to see if septic tank needs pumping. See Attached Letter ☐

FINAL STATUS


WATER SYSTEM: Approved ☒ **SEWAGE DISPOSAL SYSTEM:** Approved ☐ Provisional Approval ☒

Approved by Ron Marquart, R.S. Date 10/31/97

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

White - Applicant after approval Yellow - Environmental Health Pink - Business Office

Revised/Reprint: 10-95

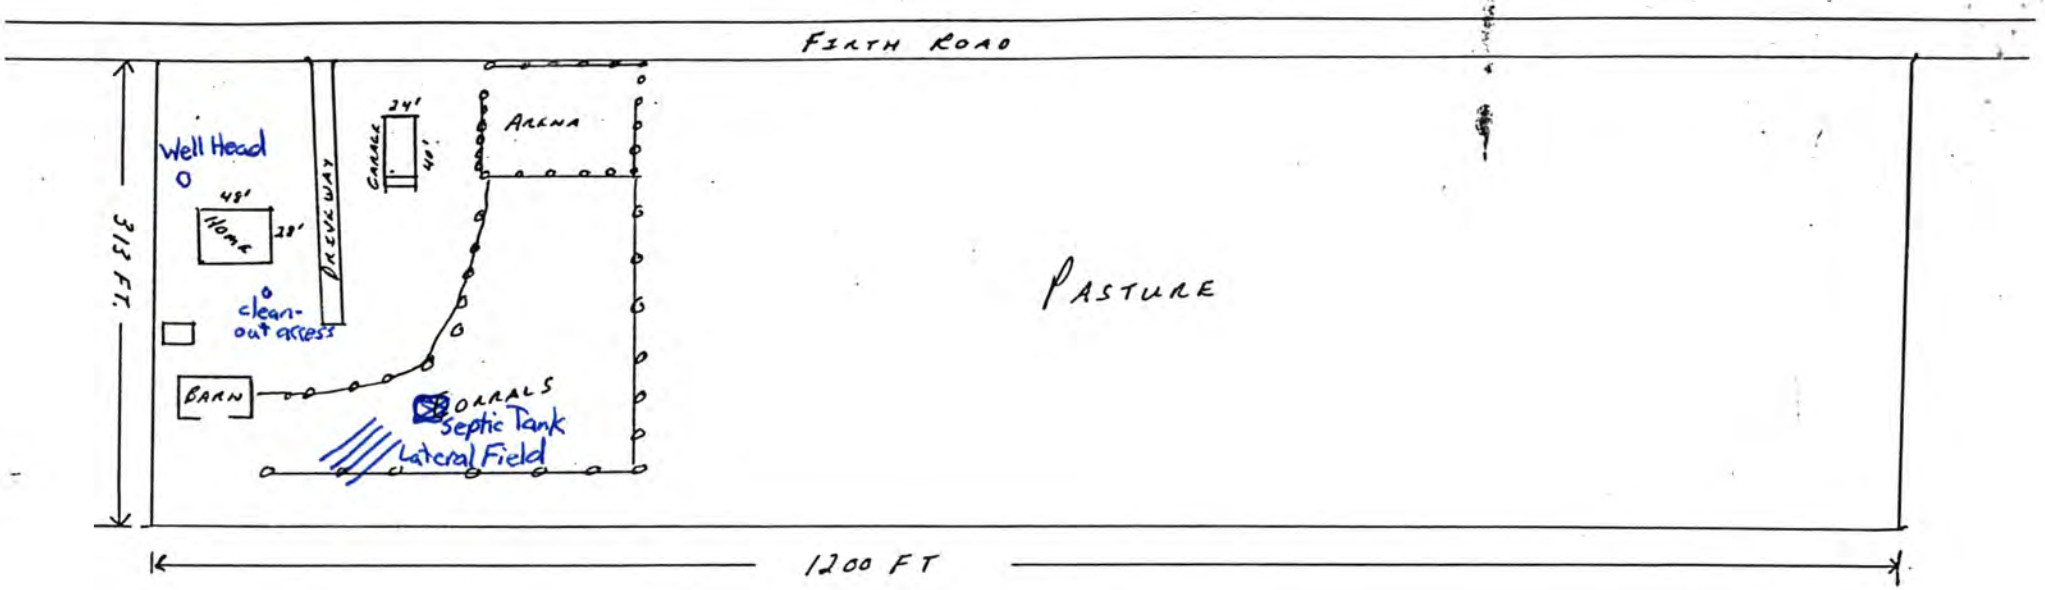

BURTON PLACE

13707 FIFTH ROAD

LANCASTER COUNTY

8.62 ACRES

N

WATER CHEMISTRY

STATE LAB NO. 159108

COMPLETE INFORMATION BELOW

FOR LABORATORY USE ONLY

TEST METHOD: USEPA METHOD 353.2

DATE COLLECTED 10 (MO.) - 28 (DAY) - 97 (YEAR) 1500 (HOUR)

SAMPLE COLLECTED BY R. Maravart

SAMPLE LOCATION Agnes Burton

PROPERTY LEGAL DESCRIPTION: COUNTY Lancaster

QRTR _____ SECT _____ TWNSHP _____ N S RANGE _____ E W

NAME AND ADDRESS OF PERSON TO RECEIVE EXTRA REPORT:

PLEASE PRINT COMPLETE ADDRESS
THIS LAB REPORT IS TO BE MAILED TO:

LLCHD
3140 'N' St
Lincoln, NE

STATE OF NEBRASKA DEPARTMENT OF HEALTH LABORATORIES
3701 SOUTH 14th LINCOLN, NE 68502

NITRATE ANALYSIS FOR DRINKING WATER

NITRATE — N Less than 0.1 mg/l

NOT TESTED BECAUSE OF:
☐ INSUFFICIENT AMOUNT ☐ DAMAGE ☐ IMPROPER CONTAINER

TEST(S) BY

FOR ACCOUNTING USE ONLY

LWN 88

RECEIVED '97 OCT 28 P3:54

REPORTED '97 OCT 29 PM 2 17

RECEIVED
7 OCT 28 P3:54

REPORTED
'97 OCT 29 PM 2 08

COMPLETE INFORMATION BELOW

WATER MICROBIOLOGY

STATE LAB NO 1423575

DATE COLLECTED 10 - 28 - 97 (MO. - DAY - YEAR) 1500 (HOUR)

SAMPLE COLLECTED BY R. Marquart

SAMPLE LOCATION Agnes Burton

PROPERTY LEGAL DESCRIPTION: COUNTY Lancaster

QRTR ____ SECT 33 TWNSHP 7 N S RANGE 8 E W

NAME AND ADDRESS OF PERSON TO RECEIVE EXTRA REPORT:

PLEASE PRINT COMPLETE ADDRESS
THIS LAB REPORT IS TO BE MAILED TO:
LL CHD
3140 'N' St
Lincoln, NE

STATE OF NEBRASKA DEPARTMENT OF HEALTH LABORATORIES
3701 SOUTH 14th LINCOLN, NE 68502

FOR LABORATORY USE ONLY

TEST METHOD: X MEMBRANE FILTER ☐ MPN

COLIFORM PURITY TEST FOR DRINKING WATER

TOTAL COLIFORMS 0 PER 100 ML.

X THE WATER MEETS BACTERIOLOGICAL STANDARD
☐ WATER DOES NOT MEET BACTERIOLOGICAL STANDARD
☐ RESULTS MAY BE INVALID DUE TO EXCESSIVE AGE*
*SAMPLES RECEIVED BETWEEN 30-48 HRS. AFTER COLLECTION

SAMPLE NOT ANALYZED BECAUSE OF:
☐ EXCESSIVE AGE ☐ INSUFFICIENT AMOUNT
☐ DAMAGE ☐ IMPROPER CONTAINER

TEST METHOD NUMBER: NIPDWR 141.27

TEST(S) BY

FOR ACCOUNTING USE ONLY

LWB 91