LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

3140 "N" STREET Lincoln, NE 68510-1514 (402) 441-8000

NON TRANSFERABLE

PERMIT

Permit
SEWAGE INSTALLATION

No. 95380127201

Issued 01/27/95
Expires 07/27/95
Revenue Code 18754

Establishment
PATRICIAN BUILDERS
T8N R5E SEC 25
LOT 5

FEES: $150.00

TOTAL $150.00

Permittee
PATRICIAN BUILDERS
421 S 9 ST
APT 105
LINCOLN NE 68508

Issued By M. Jane Ford
Health Director

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW "POST IN A PROMINENT PLACE"

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 150.00

FILE NO. _____

DATE: 1-26-95

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 8N ; Range 5E ; Section 25 ;
   Block _____ : Lot 5 N.W.1/4 Addition _____
   Street Address 7101 W Imparted

2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 4 . Describe _____

3. Type of Individual Sewage Disposal System: Septic Tank ☐ ; Other ☒

4. Distance to public sewer: N/A ft.

Patrician Builders Jon Carlson President
Signature of Applicant (Owner or Lessee)

421 So. 9th Ste 105 430-3225
Address
Lincoln, NE. 68508

(Do not write below this double line)

1. Health Department: Date Rec'd. 1/26/95 . Date Frwd. 1/27/95 . ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: or Village Clerk: Date Rec'd. 1-27-95 . Date Frwd. 1-27-95 . ACTION: Approved ☒ Disapproved ☐ Signature: [illegible]

3. City or County Engineer: Date Rec'd. 1/27/95 . Date Frwd. _____ . ACTION: Approved ☒ Disapproved ☐ Signature: [illegible]

REMARKS OR REASONS FOR DISAPPROVAL East 300' Appears To be in the 100 Year Flood Plain

Site Visits:
Date: 3-29-95 by: [illegible]
Date: 7/7/95 by: Jerrold C. Hood
Date: _____ by: _____

INSTALLATION/FINAL WRITTEN APPROVAL
Date: 7/7/95 By: Jerrold C. Hood

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 23 43

FORM 20102-0477
PRELIMINARY PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐


LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

C

Sketch of property showing Percolation Test hole locations, well, residence, direction and property line.

FILE NO._____

Indicate on sketch if residence and well are exisiting or proposed.

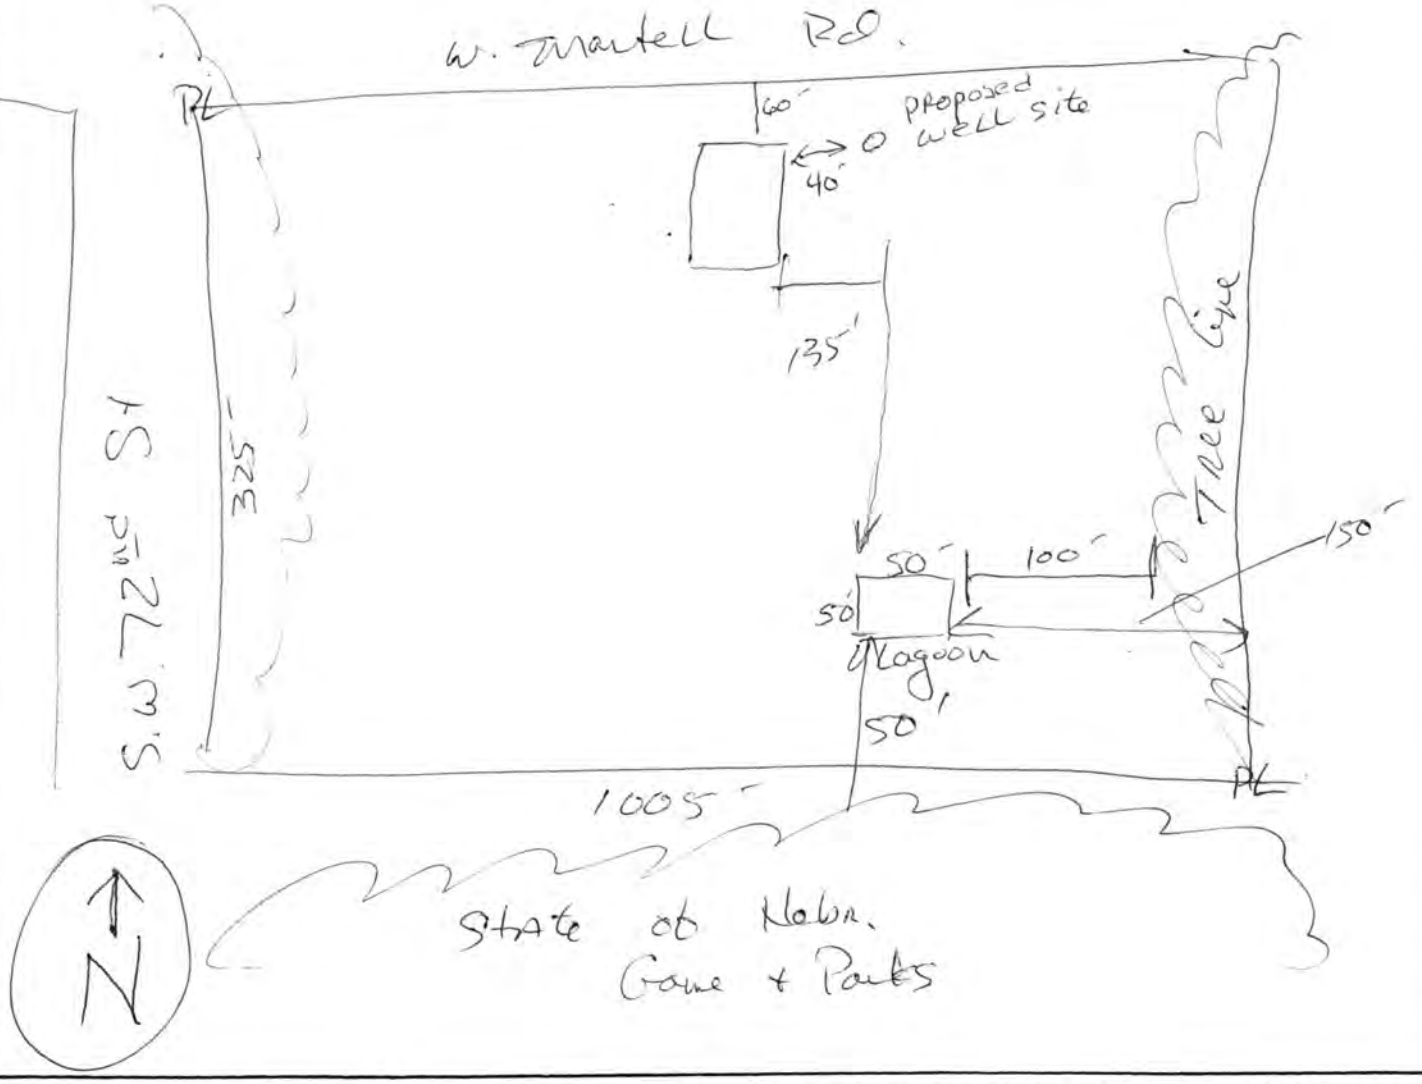

REVIEWING ACTION

Remarks:_____

_____

Date:_____

Minimum Design Requirement
1. Capacity of Septic Tank_____gals.
2. Total Length of Laterals_____ft.
3. With a Trench Width of_____in.
4. Total Area of Lateral needed____sq.ft.

_____
Signature of Reviewing Official

ATTACHMENT C.

SOIL ABSORPTION TEST DATA REPORT

PROPERTY WHERE SOIL TESTED: Owner: _____

Location: Township 8N R5E

Section & 1/4 Sect. NW1/4 Sec 25 Address: _____

Property Dimensions: ≈325 ft. x ≈1000 ft

Area: 7.5 acres. (Attach sketch of property showing hole location).

Soil Type: Silty Clay ___; Silty Clay Loam ___; Sandy Loam ___

Silty Loam ___; Clay Loam X; Sandy Clay ___

Dates of Tests: 11-14-1994 to 11-15-1994. Weather: Precip. none Temp. 50°

PERCOLATION TEST DATA FILE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolat Rates (Min./in
1	26	11-14	16:30	11-15	9:05	11-15	9:05	8.0					
							12:45	8.5	13:15	8.5	250	.5	500
2	23	11-14	16:30	11-15	9:15	11-15	9:15	12.75					
							12:45	13.875	13:15	14.0	240	1.25	192.0
3	24	11-14	16:30	11-15	9:00	11-15	9:00	6.0					
							12:30	6.5	13.00	6.5	240	.5	480
4	26	11-14	16:30	11-15	9:15	11-15	9:15	12.5					
							12:45	15.75	13:15	16.0	240	3.5	68.6
5	25	11-14	16:30	11-15	9:05	11-15	9:05	6.0					
							12:35	6.5	13:05	6.5	240	.5	480
6	32	11-14	16:30	11-15	9:10	11-15	9:10	12.0					
							12:40	15.125	13:10	15.25	240	3.25	73.8

Sum of Percolation Rates 1794.

Average of Rates: 299.


Inches per Minute: .0033

Signature of Person Conducting Test

GSI

Address 4817 N. 56th St Lincoln, NE

Phone (402) 466-8154

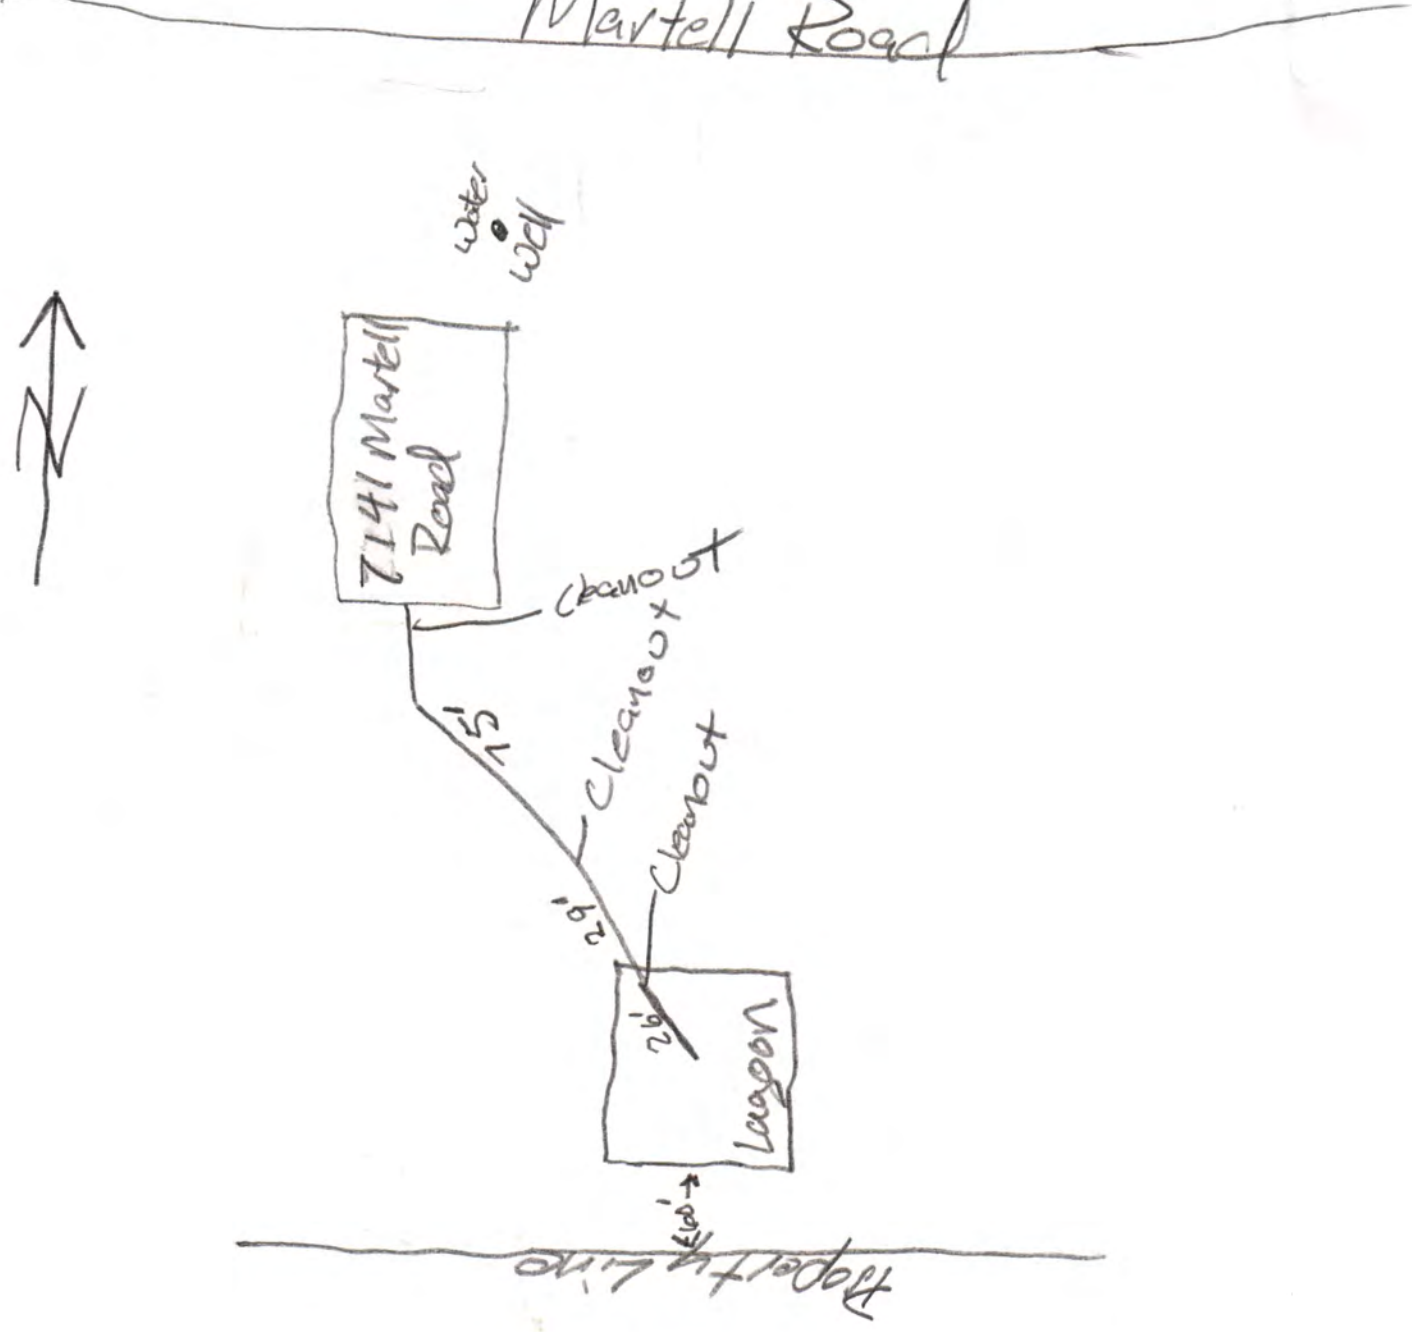
Martell Road
Water Well
7141 Martell Road
Cleanout
Cleanout
Cleanout
15'
26'
26'
Lagoon
Property Line