FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 60.00

FILE NO. 2335-C

DATE: May 27, 1986

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 8N ; Range 6E ; Section 33 ;
~~Block~~ _____ : ~~Lot~~ _____ : ~~Addition~~ E ½ SW ¼ of Section 33
Street Address 2100 W Stagecoach Rd, Martell, Ne 68404

2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
No. of Bedrooms 3 . Describe Farm Home

3. Type of Individual Sewage Disposal System: Septic Tank ☐ ; Other ☒ Lagoon

4. Distance to public sewer: Appx 5000 ft.

W N Buhrmann
Signature of Applicant (Owner or Lessee)

2100 West Stagecoach Rd
Address Martell, Ne 68404

(Do not write below this double line)

1. Health Department: Date Rec'd. 5/28/86. Date Frwd. 5/28/86. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: or Village Clerk Date Rec'd. 5/27/86. Date Frwd. 5/27/86. ACTION: Approved ☒ Disapproved ☐ Signature: Roger Palmer (clerk)

3. City or County Engineer: Date Rec'd. 5/28/86. Date Frwd. 5/28/86. ACTION: Approved ☒ Disapproved ☐ Signature: Harold E Lochner

REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: ~~8-14-86~~ by: ~~JMH~~ (Sewage Covered need drawing) (need fence)
Date: 10-1-86 by: JMH
Date: 2/2/98 by: L.C.H. Fence needs repairing Need Signs locked gate, Covering ~~a~~ gate

INSTALLATION FINAL WRITTEN APPROVAL
Date: 11/30/98 By: Jerrold C. Hood

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 20102-0477
PRELIMINARY PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐


LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

C

Sketch of property showing Percolation Test hole locations, well, residence, direction and property line.

FILE NO. 2335-C

Indicate on sketch if residence and well are exisiting or proposed.

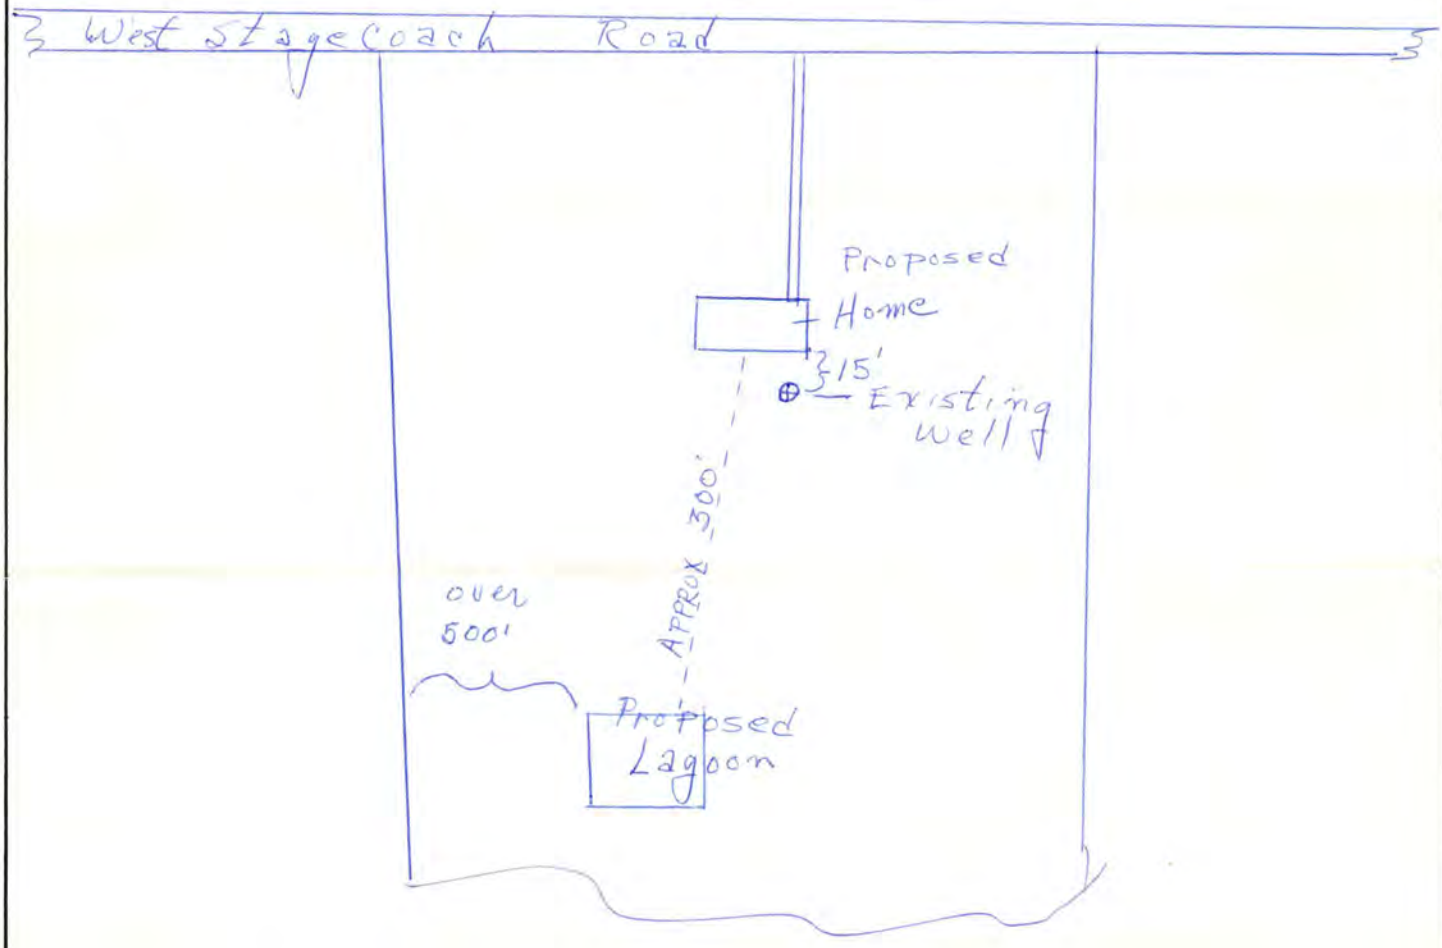

REVIEWING ACTION

Remarks: _____

_____

Date: _____

Minimum Design Requirement
1. Capacity of Septic Tank _____ gals.
2. Total Length of Laterals _____ ft.
3. With a Trench Width of _____ in.
4. Total Area of Lateral needed ____ sq.ft.


_____
Signature of Reviewing Official

RECD SEP 11 19[illegible]

WAYNE BOHRMANN
8-14-1986

Contracted By
BOUMA Trenching
Firth Nebr. 68358
791-5160
Terry Bouma

348 total ft. sewer + drain

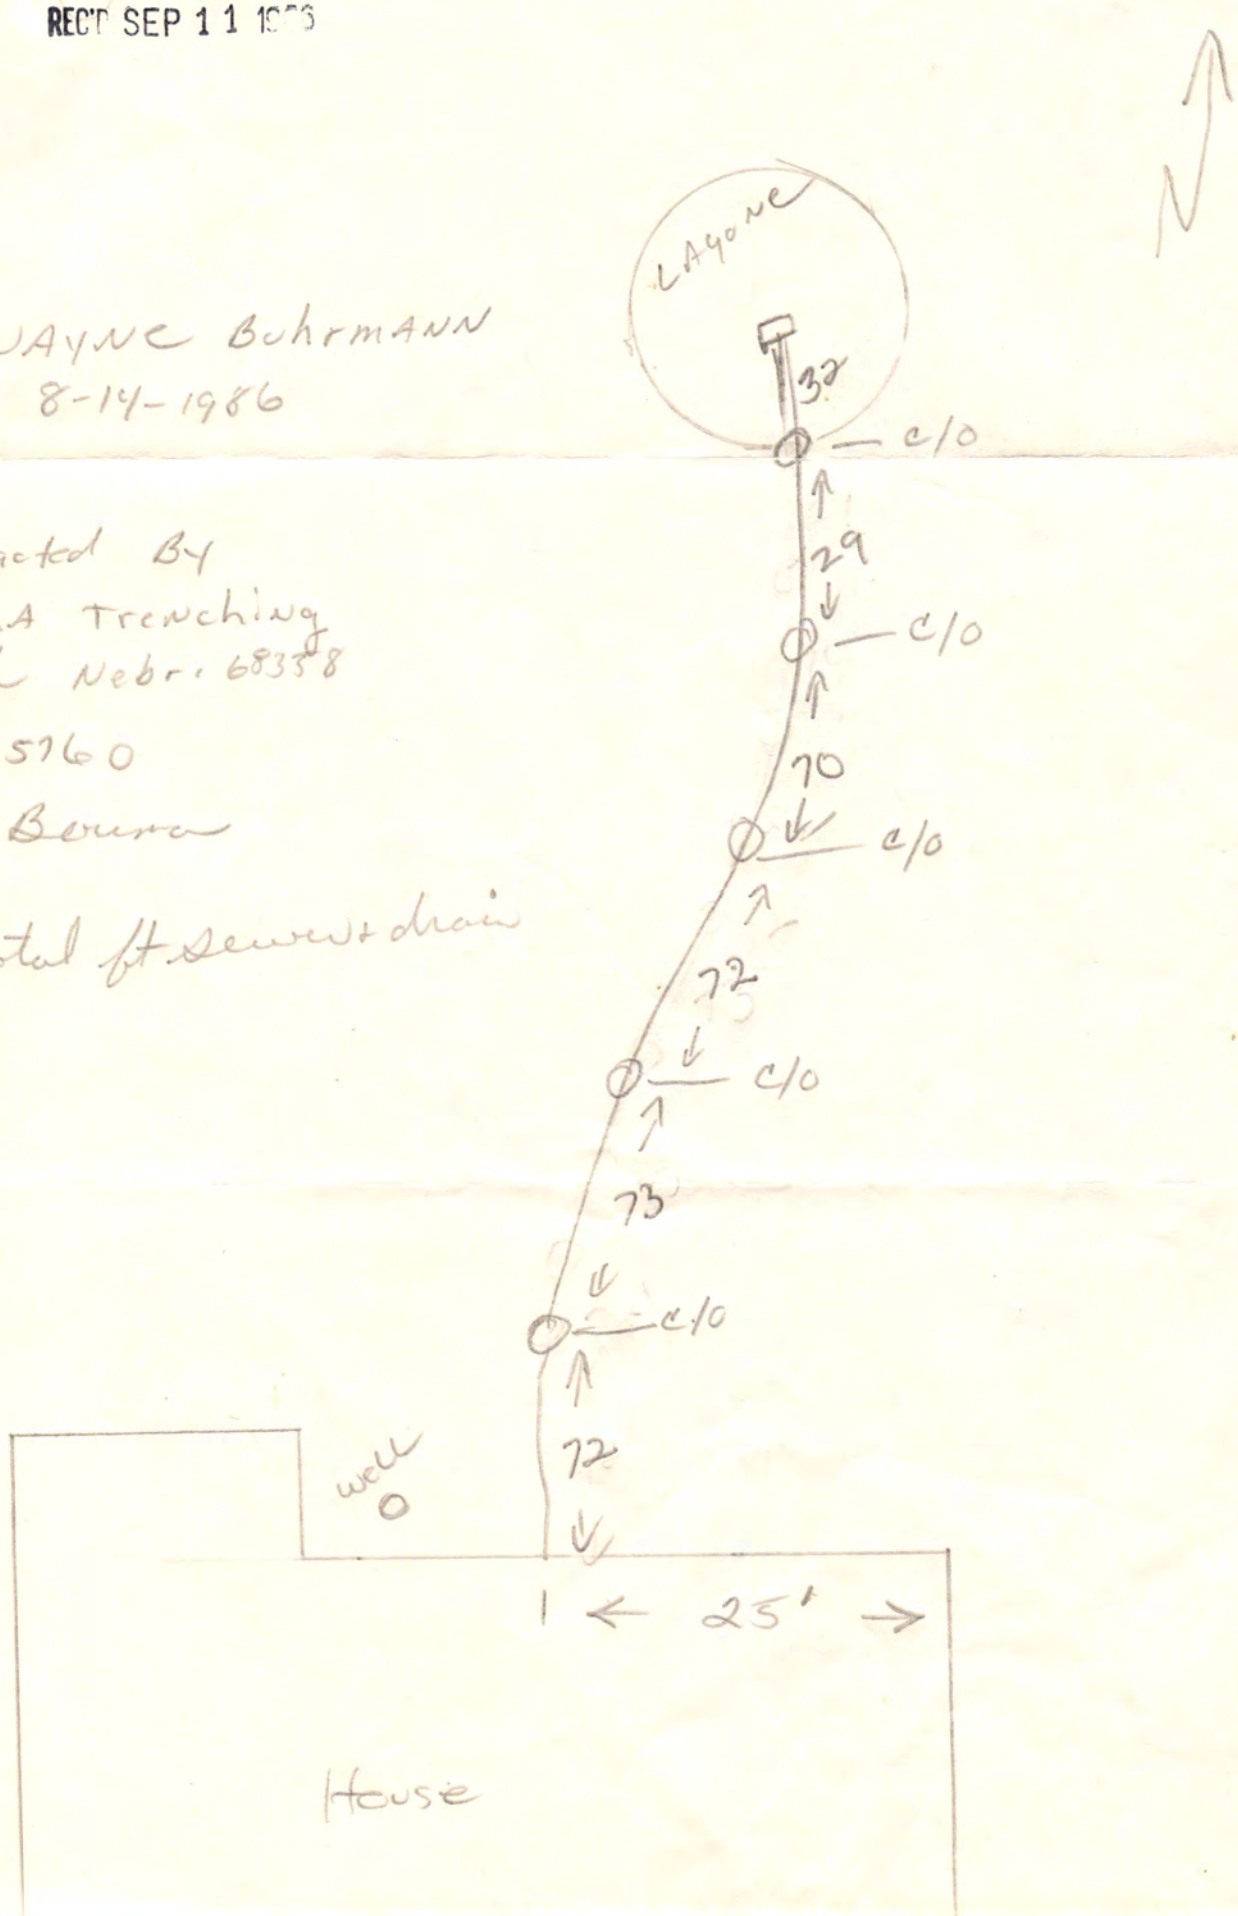

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 ST. MARYS
LINCOLN, NEBRASKA 68502

FILE NO. 2335-C

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF PERMIT

NOVEMBER 28, 1986 — THIS PERMIT EXPIRES

WAYNE BUHRMANN — ISSUED TO

2100 STAGECOACH RD MARTELL, NE 68404 — ADDRESS

T8N; R6E; Sec 33; E½ SW¼; 2100 W. Stagecoach Rd., Martell, NE — LEGAL DESCRIPTION

REMARKS: NON-TRANSFERABLE NEW CONSTRUCTION

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 60.00	$	$	$ 60.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
	110.16	148.14	6-2

RECEIPTED BY: MG — DATE: 5-28-86 — AMOUNT

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

HEALTH
ISSUING OFFICER

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. 2832

20109-0977

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

B

FILE NO. 2335-C

PROPERTY WHERE SOIL TESTED:

Location: Township 8 N ; Range 6 E ; Section & ¼ Section 33 SW¼ (E½).
Property Dimensions: _____ ft. x _____ ft. Area: 80 acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☒ ; Silty Clay Loam ☐ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ☐ .
Dates of Tests: May 6, 1986 to May 7, 1986. Weather: Precip. 0 Temp. 70°F.

OWNER: Wayne H. Buhrmann
Address: 2100 W Stagecoach Rd, Martell 68404

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1	36"	May 6	10:00 AM	May 7	Noon	May 7	7:30 AM	24 1/8	8:55 AM	25 1/4	85	1 1/8	75 1/2 min
2	36"	"	10:05	"	"	"	7:31	26 1/4	8:56	27 1/2	85	1 1/4	68 min
3	36"	"	10:10	"	"	"	7:32	26	8:57	27 1/8	85	1 1/8	75 1/2 min
4	36"	"	10:15	"	"	"	7:33	27 1/8	8:58	28 1/2	85	1 3/8	62 min
5	36"	"	10:20	"	"	"	7:34	24	8:59	26 1/2	85	1 1/2	57 min
6	36"	"	10:25	"	"	"	7:35	26 1/8	9:00	27 1/4	85	1 1/8	75 1/2 min
		Note: All 9" dia holes.											

Sum of Percolation Rates: 413.5 min
Average of Rates: 69 min/in
Mean of Rates: 72 min/in

W H Buhrmann
Signature of Person Conducting Test
Address 2100 W Stagecoach Rd Phone 794 4175

(Do not write below this line)

REVIEWING ACTION

Remarks: Must be sealed.
Soil Type (SCS): Wymore Silty Clay Loam
Date: MAY 28, 1986

Approved Percolation Rate (a)
A. _____ min./inch
B. _____ min./inch
C. _____ min./inch

Gerrold C. Hood
Signature of Reviewing Official