LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

Division of Environmental Health
2200 St. Marys Ave Lincoln, NE 68502 (402) 471-8000

NON TRANSFERABLE

PERMIT

SEWAGE INSTALLATION

No. 91380076101

Issued 10/10/91
Expires 04/10/92

ESTABLISHMENT

BRENDA NEKOLITE
T8N R6E SEC 28
LOT 83

FEES: Permit 018754 $150.00

Total $150.00

PERMITTEE

BRENDA NEKOLITE
RR0001
BOX 00281
MARTELL NE 68404

Issued By COUNTY HEALTH

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

DATE	AMOUNT
10/14/91	PAID

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

RECEIVED SEP 0 6 1991

RECEIVED OCT 0 4 1991

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $_____

FILE NO._____

DATE: 9-4-91

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 8 North, Range 6E ; Section 28 ;
   Block _____ : Lot 83 I.T. : Addition _____
   Street Address D street

2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 3 . Describe _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: 1 mile ft.

Brenda Nekolite
Signature of Applicant (Owner or Lessee)

~~9-4-91~~ RT. #1, BOX 281
Address
MARTELL, NEBR. 68404

(Do not write below this double line)

1. Health Department: Date Rec'd. 9/12/91. Date Frwd. 10/4/9. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: or Village Clerk: Date Rec'd. 9/16/91. Date Frwd. 10/2/91. ACTION: Approved ☒ Disapproved ☐ Signature: Roger Palmer

3. City or County Engineer: Date Rec'd. 10-4-91. Date Frwd. 10-4-91. ACTION: Approved ☒ Disapproved ☐ Signature: [signature]

REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: 11/21/91 by: D.C.H. Used 2 ft wide trench instead of 3 ft. not enough lateral
Date: 12/6/91 by: D.C.H.
Date: _____ by: _____

INSTALLATION FINAL WRITTEN APPROVAL
Date: _____ By: _____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 23-43

RECEIVED OCT 0 4 1991

RECEIVED SEP 0 6 1991

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

B

FILE NO. _____

PROPERTY WHERE SOIL TESTED:

Location: Township 8 North, Range 6 ; Section & ¼ Section 28.
Property Dimensions: _____ ft. x _____ ft. Area: 2.06 acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☐ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ☐
Dates of Tests: 8-3 to 8-4. Weather: Precip. .20 Temp. 75

OWNER: Brenda Nekolite
Address: Martell, NE 68404

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1	36	8-3	2:05	8-3	6:00	8-4	4:00	6	4:30	4 1/2	30	1 1/2	30/1 1/2
2	36	8-3	2:10	8-3	6:05	8-4	4:05	6	4:35	4 2/8	30	1 6/8	30/1 6/8
3	36	8-3	2:15	8-3	6:10	8-4	4:10	6	4:40	5	30	1	30/1
4	36	8-3	2:20	8-3	6:15	8-4	4:15	6	4:45	5 3/8	30	5/8	30/5/8
5	36	8-3	2:25	8-3	6:20	8-4	4:20	6	4:50	3 7/8	30	2 1/8	30/2 1/8
6	36	8-3	2:30	8-3	6:25	8-4	4:25	6	4:55	5 2/8	30	6/8	30/6/8

Sum of Percolation Rates: _____
Average of Rates: _____
Mean of Rates: _____

Brenda Nekolite
Signature of Person Conducting Test

Address Martell Phone 794-0204

(Do not write below this line)

REVIEWING ACTION

Approved Percolation Rate (a)
A. 24 min./inch
B. _____ min./inch
C. _____ min./inch

Remarks: _____
Soil Type (SCS): Wymore Silty Clay Loam
Date: _____

Gerrold C. Hoos
Signature of Reviewing Official

RECEIVED SEP 06 1991

FORM 20102-0477
PRELIMINARY PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒


LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

C

Sketch of property showing Percolation Test hole locations, well, residence, direction and property line.

FILE NO. _____

Indicate on sketch if residence and well are exisiting or proposed.

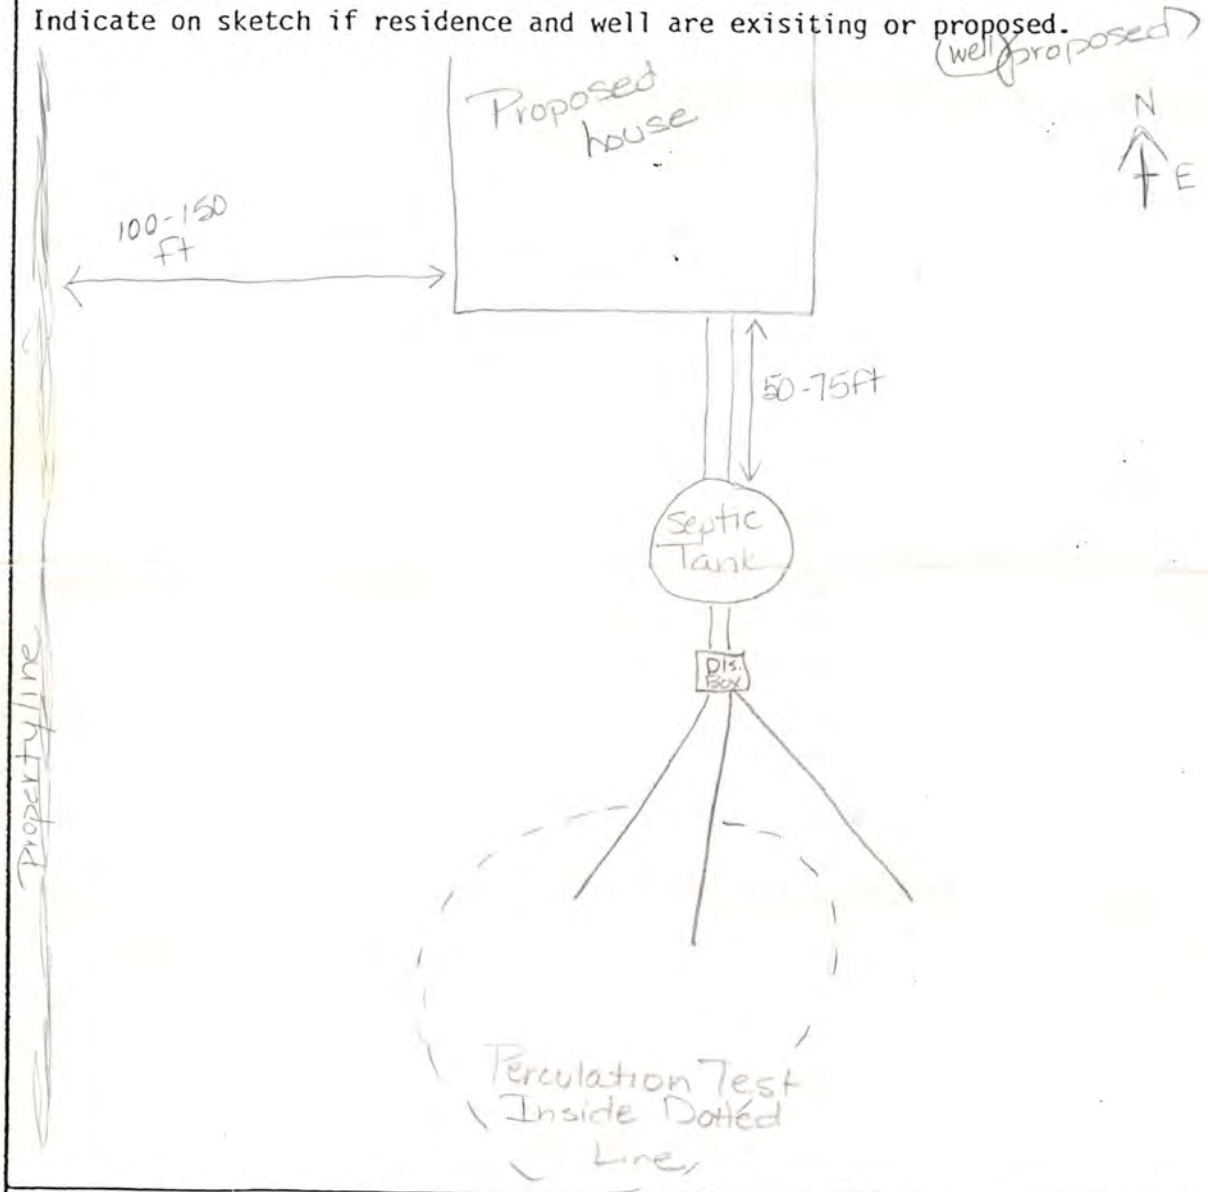

REVIEWING ACTION

Remarks: _____

Date: September 12, 1991

Minimum Design Requirement
1. Capacity of Septic Tank 1000 gals.
2. Total Length of Laterals 226 ft.
3. With a Trench Width of 36 in.
4. Total Area of Lateral needed 677 sq.ft.

Jerrold
Signature of Reviewing Official

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

3140 "N" STREET Lincoln, NE 68510-1514 (402) 441-8000

NON TRANSFERABLE

PERMIT

Permit
SEWAGE INSTALLATION

No. 94380124001

Issued 10/25/94
Expires 04/25/95
Revenue Code 18754

Establishment
ARNOLD BENTZINGER
T8N R6E SEC 28
LOT 83

FEES: $150.00

TOTAL $150.00

Permittee
ARNOLD BENTZINGER
BOX 00046
MARTELL NE 68404

Issued By M. Jane Ford
Health Director

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW "POST IN A PROMINENT PLACE"

RECEIVED OCT 21 1994

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 150.00

FILE NO. _____

DATE: 7-13-94

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 08N ; Range 6E ; Section 28 ;
   Block _____ : Lot 83 I.T. Addition _____
   Street Address _____

2. Property Use: Residential ☐ ; Commercial ☒ Other Use ☐
   No. of Bedrooms _____. Describe FEED MILL 2 EMPLOYEES

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: Not Available 6 ft.

Arnold Bentzinger
Signature of Applicant (Owner or Lessee)

Box 46 Marlow Ok 68404
Address

(Do not write below this double line) 794-5455

1. Health Department: Date Rec'd. 10/6/94. Date Frwd. 10/6/94. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Nood

2. Supt. Bldg. Insp.: or Village Clerk Date Rec'd. 10/19/94. Date Frwd. 10/19/94. ACTION: Approved ☒ Disapproved ☐ Signature: Roger Palmer (Clerk)

3. City or County Engineer: Date Rec'd. 10/24/94. Date Frwd. _____. ACTION: Approved ☒ Disapproved ☐ Signature: [signature]

REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: 10/6/94 by: L.C.H.
Date: _____ by: _____
Date: _____ by: _____

INSTALLATION FINAL WRITTEN APPROVAL
Date: _____ By: _____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 23-43

SURVEYOR'S CERTIFICATE

I, Dennis Zieman, Registered Land Surveyor in the State of Nel have at the request of Richard and Brenda Nekolite, directed and s the survey of a part of Lot 83 I.T., lying wholly in the South hal of the Northwest Quarter of Section 28, Township 8 North, Range 6 East of the 6th. P.M., Lancaster County, Nebraska, more particular described as follows.

Referring to the North 1/16th. corner common to Sections 28 & 29; thence easterly along the said 1/16th. line, on an assumed bea of N88°55'46"E, a distance of 1419.17 ft., to the West line of Lot 83 I.T. of said section; thence southwesterly along said West line of Lot 83, bearing S22°47'45"W, a distance of 137.69 ft., to the Po of Beginning; thence southeasterly and perpendicular to the last de course, bearing S67°12'15"E, a distance of 170.00 ft., to the south line of said Lot 83; thence S22°47'45"W, 200.00 ft. from and parall to the Center line of the abandoned C.R.I. & P. R.R., a distance of 511.89 ft., to the North line of the South half of the South half of the Northwest Quarter; thence westerly along the last described line, bearing S88°53'47"W, a distance of 185.95 ft., to the westerl line of said Lot 83; thence northeasterly along the westerly line of said Lot 83, bearing N22°47'45"E, a distance of 244.64 ft.; then N46°22'19"E, a distance of 50.00 ft., to a point 50.00 ft. from, an measured perpendicular to the center line of said abandoned Rail Ro thence N22°47'45"E, a distance of 80.00 ft.; thence N15°36'54"E, a distance of 160.00 ft. to a point 30.00 ft. from and measured perpe to said abandoned Rail Road; thence N22°47'45"E, along the westerly line of said Lot 83, a distance of 58.00 ft. to the Point of beginn Containing 2.06 Acres more or less.

I certify that the dimension and location shown on the plat ab are true and correct to the best of my knowledge and belief.

I certify that I have executed the above instrument this 21st. day of August, 1991.

NEBRASKA REGISTERED LS-452 LAND SURVEYOR DENNIS D. ZIEMAN

Dennis Zie

Registered Land Survey