LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

2200 St. Marys Ave Lincoln, NE 68502-3785 (402) 441-8000

NON TRANSFERABLE

P E R M I T

Permit
SEWAGE INSTALLATION

No. 93380103501

Issued 07/30/93
Expires 01/30/94
Revenue Code 18754

Establishment
DENNIS FREY
T8N R7E SEC 22
LEISURE LAKES 4TH LOT 3

FEES: $150.00

TOTAL $150.00

Permittee
DENNIS FREY
RR0001
BOX 0088A
HICKMAN NE 68372

Issued By M. Jane Ford
Health Director

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW
"POST IN A PROMINENT PLACE"

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 150.00

FILE NO. _____

DATE: _____

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 8N ; Range 7E ; Section 22 SW/4 ;
   Block _____ : Lot 3 : Addition Leisure Lakes 4th add
   Street Address _____

2. Property Use: Residential ☑ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 4 . Describe _____

3. Type of Individual Sewage Disposal System: Septic Tank ☑ ; Other ☐

4. Distance to public sewer: _____ ft.

Doris Day
Signature of Applicant (Owner or Lessee)

RT 1 / Box 88A Nickman NE (68122)
Address

(Do not write below this double line)

1. Health Department: Date Rec'd. 7/28/93. Date Frwd. 7/28/93. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Rood
2. Supt. Bldg. Insp.: or Village Clerk Date Rec'd. 7/28/93. Date Frwd. 7/28/93. ACTION: Approved ☒ Disapproved ☐ Signature: Gary Spier
3. City or County Engineer: Date Rec'd. 7/28/93. Date Frwd. 7/28/93. ACTION: Approved ☐ Disapproved ☐ Signature: Don Thomas

REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: 11-9-93 by: P.D Need Drawing
Date: _____ by: _____
Date: _____ by: _____

INSTALLATION FINAL WRITTEN APPROVAL
Date: 1-10-96 By: Paul Bohman

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 23-43

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

B

FILE NO. _____

PROPERTY WHERE SOIL TESTED:

Location: Township 8N ; Range 7E ; Section & ¼ Section 22 SW/4.
Property Dimensions: _____ ft. x _____ ft. Area: _____ acres. (Attach Sheet C with sketch of property).
Soil Type: WTC2 Silty Clay ☐ ; Silty Clay Loam ☒ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ☐ .
Dates of Tests: 5-27 to 5-28-93 . Weather: Precip. 0 Temp. 70s.

Leisure Lakes Estates

OWNER: Jim Haire

Address: RFD Hickman, Ne 68372

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1		5/27	5:00	5/28	1:00	5/28	4:30	20½	5:00	21¼	30	¾	
2			P		P		P	19¾	P	20¼		½	
3								26		27		1	
4								22¾		23		¼	
5								22½		23		½	
6								27		28		1	

Brad Southwick
Signature of Person Conducting Test

Address 701 E 4 Hickman Phone 475-2462

Sum of Percolation Rates: 4
Average of Rates: .666
Mean of Rates: _____

(Do not write below this line)

REVIEWING ACTION

Remarks: _____
Soil Type (SCS): Wymore Silty Clay Loam
Date: June 17, 1993

Approved Percolation Rate (a)
A. 4ff min./inch
B. _____ min./inch
C. _____ min./inch

Jerrold C. Hood
Signature of Reviewing Official

FORM 20104-0477
PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

D

DATE: _____

FILE NO: _____


SPECIFICATIONS AS BUILT

A. BUILDING SEWER:
1. Material PVC ; Diameter 4 in.
2. Distance above basement floor ____ in., or below basement floor 18 in.
3. Distance between dwelling and septic tank 30' ft.
4. Number of clean-outs None .
5. Distances to: Well or Suction Line Rural Water ft.; Stream NA ft.; Pressure Line 50+ ft.; Property Line 30+ ft.

B. SEPTIC TANK:
1. Material Concrete ; No. of compartments 1 .
2. Capacity 1500 gals.;
3. Factory Built: Yes ☒ No ☐ (Company American Concrete)
4. Manholes: Over Inlet; diam. 18 in. Over Outlet; diam. 8 in. Riser Above ☐ Below ☐ Grade ___ in.
5. Inlet: Baffle ☒ ; or Tee ☐
6. Outlet: Baffle ☒ ; or Tee ☐
7. Depth of top of tank below finished grade 14 in.
8. Distances to: Well or Suction Line Rural Water ft.; Stream NA ft.; Pressure Line 50+ ft.; Property Line 50+ ft.

C. DISTRIBUTION BOX:
1. Material Concrete ; Number available outlets ____ .
2. Factory Built: Yes ☒ No ☐ (Company American Concrete)
3. Distance from Septic Tank 19 ft.

D. ABSORPTION FIELD: (Provide as built drawings on back of this form)
1. Type: Half Rounds ☒ Perforated Pipe ☐ Diameter of Half Round 20 or Perforated Pipe ____ . Material: fiberglass ☐ ; plastic ☐ ; concrete ☒ ; other ____ .
2. Lateral Lines: Number 3 ; Length of each line 100 , 100 , 100 , ____ , ____ ft.; Total length of laterals 300 ft.; Distance between lateral lines 7 ft.
3. Trench dimensions: Width 4 ft.; Slope 2 in/100 ft.; Average Depth 30 in.
4. Filter Material: Gravel Depth of Material 24 in.
5. Distances to: Well or Suction Line Rural Water ft.; Stream NA ft.; Pressure Line 100+ ft.; Property Line 40+ ft.

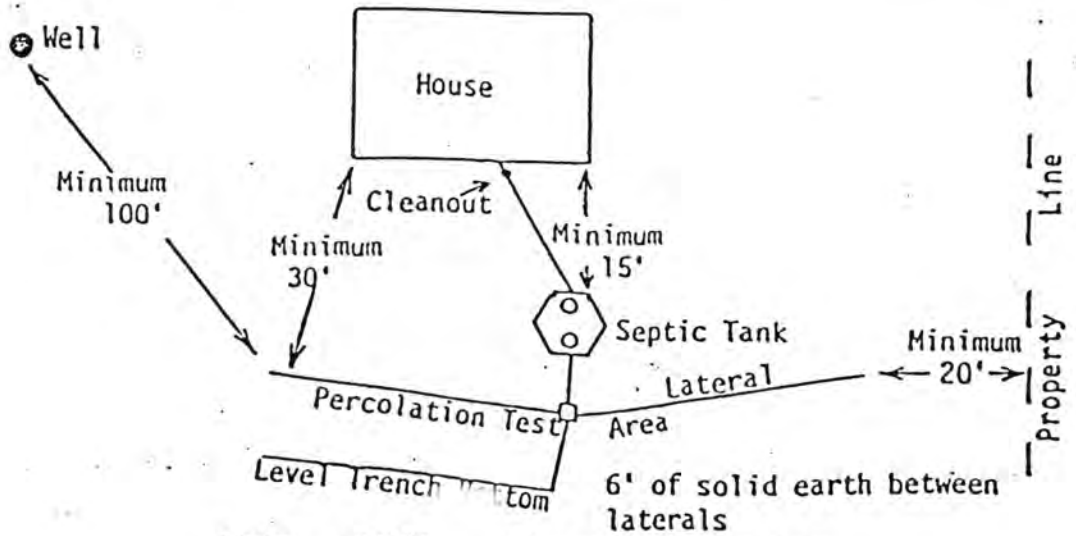

TYPICAL INDIVIDUAL SEWAGE SYSTEM DESIGN

B&F Builders (Dennis Frye)
So. 75th Street Ct

Installed By Vogt T&T
11-9-93

