LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

FILE NO. 606-C

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF PERMIT

October 24, 1975 — THIS PERMIT EXPIRES

Larry Splichal — ISSUED TO

4820 Randolph — ADDRESS

T8N; R7E; Sec. 35; Lot 5; — LEGAL DESCRIPTION

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 30.00	$	$	$ 30.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624-1535	110.16	148.14	6-2

RECEIPTED BY — DATE — AMOUNT

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

ISSUING OFFICER

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. _____

FORM HD-40(73) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 606-C

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 4-20-75

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 8N ; Range 7E ; Section 35
   Block ____; Lot S.T.; Addition ____
   Street Address Rural Hickman

2. Property Use: Residential ____ ☒ ; Commercial ____ ☐
   No. of Bedrooms 3 . Describe: ____
   Other Use ____ ☐
   Describe: ____

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: — ft.

Tony Sutichak
Signature of Applicant (Owner or Lessee)

4820 Randolph
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 4/24/75 . ACTION: Approved ☒ Disapproved ☐
   Date Frwd. 4/24/75 . Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: Date Rec'd. 6-9-75 . ACTION: Approved ☒ Disapproved ☐
   Date Frwd. 6-9-75 . Signature: Williamson

3. City or County Engineer: Date Rec'd. 6-9-75 . ACTION: Approved ☒ Disapproved ☐
   Date Frwd. 6-9-75 . Signature: X

REMARKS OR REASONS FOR DISAPPROVAL ____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM HD-42(73) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [ ]
County Resolution No. 2832 [X]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 606-C

DATE: 4-20-75

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with appropriate Ordinance or Resolution, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 8N ; Range 7E ; Section 35 ; Block ; Lot 5 I.T. ; Addition .
Street Address Rural Hickman .

2. Property Use: Residential [X] ; Commercial [ ]
No. of Bedrooms 3
Other Use
Describe:
Describe:

3. Type of Individual Sewage Disposal System: Septic Tank [V] ; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-45(73) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-43(73) SOIL ABSORPTION TEST DATA REPORT, attached hereto).

Tony Schlichtemeier
Signature of Applicant (owner or lessee)

4920 Randolph
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd;
Filing Fee: $ 30.00

2. Site Visits:
Date: July-18-75 by: sm
Date: by:
Date: by:

3. Date: Approved [X] ; Disapproved [ ] 7/24/75
by: Jerrold C. Hoaf

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: July-18-75 by: Lon Magnuson

FORM HD- 43(73) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 475-6221)

FILE NO. _____

PROPERTY WHERE SOIL TESTED:
Location: Township 8 ; Range 7
Section & ¼ Sect. 35
Property Dimensions: 326 ft. x 680 ft.
Area: 5.1 acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☒; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☐

Owner: Larry Splichal
Address 4820 Randolph (Lin)

Dates of Tests: 4-19-75 to 4-20-75. Weather: Precip. 0 Temp. 50 F.

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	18"	4-19-75	11:00 AM	4-20-75	1:00 PM	4-20-75	2:00 PM	6	2:30 PM	5 1/2	30 min	1/2"	60 min / 1"
2	18"	"	"	"	"	"	"	"		5 5/8	"	3/8"	" / 3/4"
3	18"	"	"	"	"	"	"	"		5 1/2	"	1/2"	" / 1"
4	18"	"	"	"	"	"	"	"		5 3/8	"	5/8"	" / 1 1/4"
5	18"	"	"	"	"	"	"	"		5 1/2	"	1/2"	" / 1"
6	18"	"	"	"	"	"	"	"		5 9/16	"	3/16"	" / 7/8"

Sum of Percolation Rates 5 7/8"
Average of Rates: 60 min / 15/16"
Mean of Rates:

Larry Splichal
Signature of Person Conducting Test

Address 4820 Randolph
Phone: 489-3522

(Do not write below this line)


REVIEWING ACTION

REMARKS: _____

Approved Percolation Rate(s)
A. 60 min./inch
B. _____ min./inch
C. _____ min./inch

DATE: April-24-75

Ron Marquart
Signature of Reviewing Official

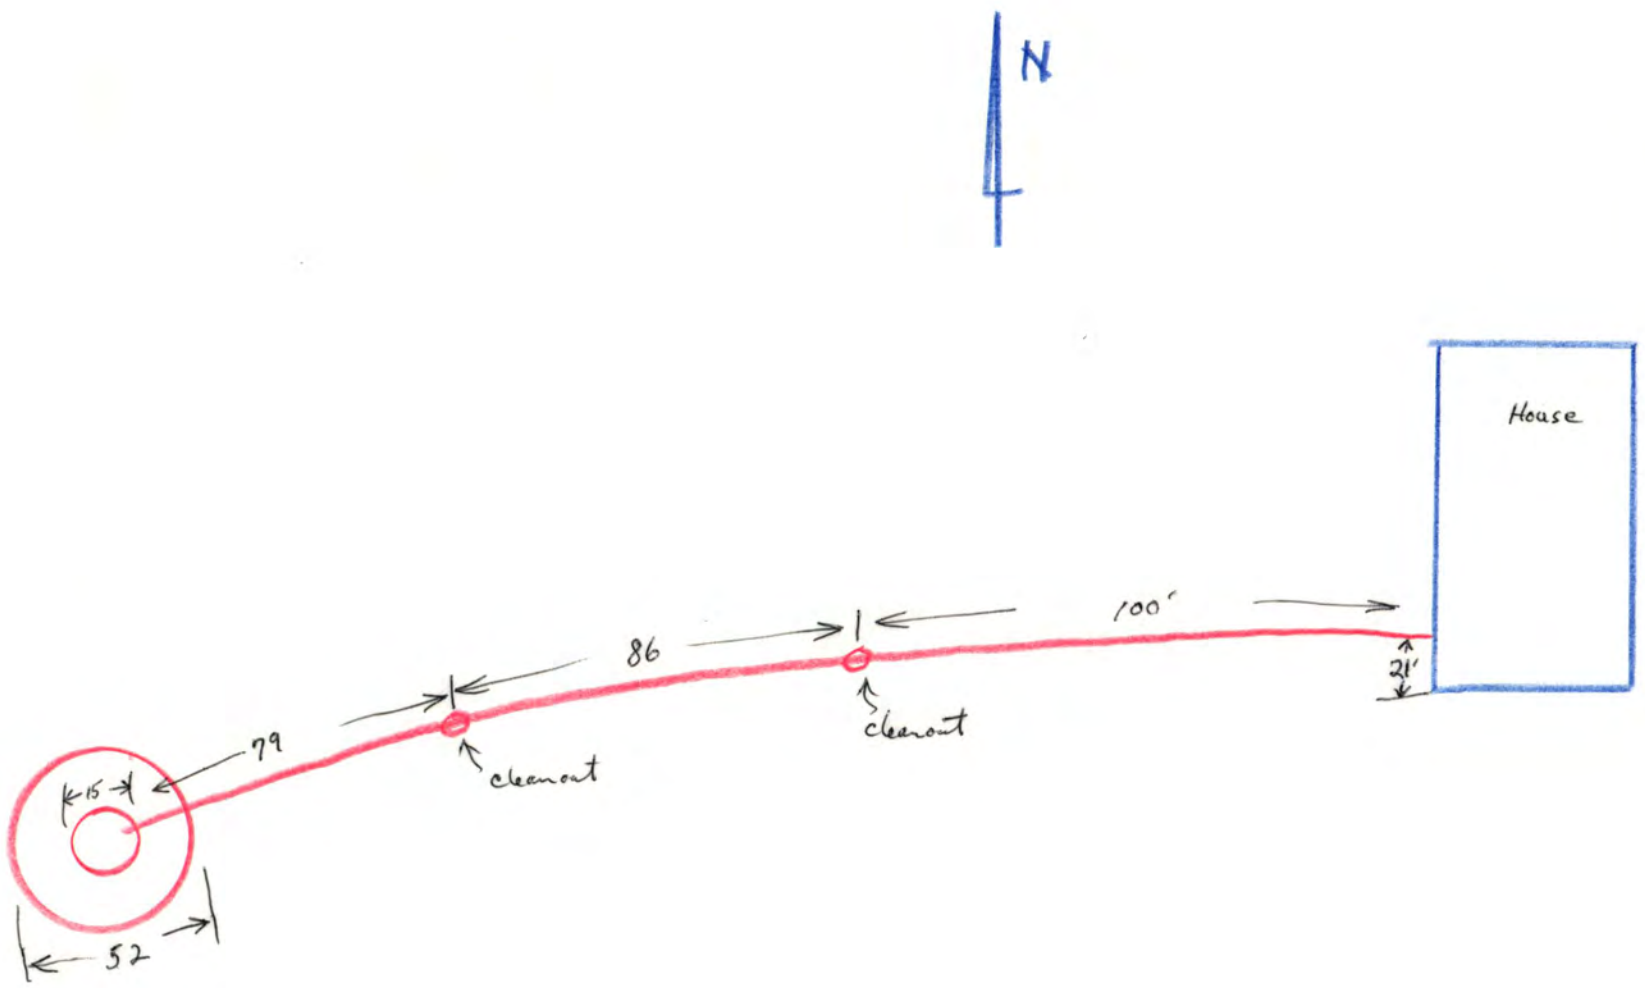

SM
July -08-75