LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 ST. MARYS
LINCOLN, NEBRASKA 68502

FILE NO. 2375-C

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF PERMIT

FEBURARY 12, 1987 — THIS PERMIT EXPIRES

DALLAS D. SVOBODA — ISSUED TO

ROUTE #1, BOX 255-A PALMYRA, NE 68418 — ADDRESS

T8N; R8E; Sec 3 SW; Lot 38 & 45 I.T.

LEGAL DESCRIPTION

REMARKS: NON-TRANSFERABLE NEW CONSTRUCTION

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 60.00	$	$	$ 60.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
	110.16	148.14	6-2

RECEIPTED BY: PB — DATE: 8/13/86 — AMOUNT

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

HEALTH
ISSUING OFFICER

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. 2832

20109-0977

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 60.00

FILE NO. 2375-C

DATE: 8-5-86

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 8N; Range 8E; Section 3-SW; Block —: Lot 38 & 45 I.T. Addition —
   Street Address
2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 3. Describe
3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐
4. Distance to public sewer: — ft. EXPERIMENTAL SYSTEM

Dallas D. Svoboda
Signature of Applicant (Owner or Lessee)

RFD PALMYRA NE 68418
Address

(Do not write below this double line)

1. Health Department: Date Rec'd. 8/12/86. Date Frwd. —. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood
2. Supt. Bldg. Insp.: or Village Clerk: Date Rec'd. 8-6-86. Date Frwd. 8-6-86. ACTION: Approved ☒ Disapproved ☐ Signature: Al Jensen
3. City or County Engineer: Date Rec'd. 8/13/86. Date Frwd. 8/13/86. ACTION: Approved ☐ Disapproved ☐ Signature: Larry V. Worrell

REMARKS OR REASONS FOR DISAPPROVAL

Site Visits:
Date: 9-22-86 by: [illegible] line, tank, & dist Box
Date: 10-16-86 by: [illegible] need drawing
Date: 1-20-92 by: [illegible]

EXPERIMENTAL

INSTALLATION ~~FINAL~~ WRITTEN APPROVAL
Date: 1-20-92 By: Ron Bryant

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

B

FILE NO. 2375-C

PROPERTY WHERE SOIL TESTED:

Location: Township 8N ; Range 8E; Section & ¼ Section 3-SW.
Property Dimensions: _____ ft. x _____ ft. Area: 21 acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☐ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ☐ .
Dates of Tests: Aug 2 to Aug 3, 1986. Weather: Precip. NONE Temp. 80°.

OWNER: DALLAS D. SVOBODA
Address: RFD PALMYRA NE 68418

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1	36"	8-2	1:32	8-2	5:45	1:52	8-3	18½	6:00	15¾	248	2¾	30 - ⅜
2						2:05		16½	6:01	15⅛	236	1⅜	30 - ⅛
3						2:07		17⅜	2:37	17¼	30	⅛	30 - ⅛
4						2:11		14⅝	2:40	14½	29	⅛	29 - ⅛
5						2:20		18¼	2:52	18⅛	32	⅛	32 - ⅛
6						2:00		18	6:00	15¾	240	2¼	30 - ¼
7						2:11		16¼	6:01	13⅝	238	2⅝	30 - ⅜
8						2:09		18⅛	2:39	18	30	⅛	30 - ⅛
9						2:17		17⅜	6:03	14⅛	225	3¼	30 - ⅜
10						2:22		14⅝	6:04	12⅝	222	2	30 - ¼

Dallas D. Svoboda
Signature of Person Conducting Test

Address RFD PALMYRA NE 68418 Phone 780-5863

Sum of Percolation Rates: 301 – 2.25
Average of Rates: 30 – .225
Mean of Rates: _____


(Do not write below this line)

REVIEWING ACTION

Remarks: TOO SLOW FOR CONVENTIONAL
Soil Type (SCS): Kennebec Silt Loam
Date: August 12, 1986

Approved Percolation Rate (a)
A. 120 min./inch
B. _____ min./inch
C. _____ min./inch

Gerrold C. Hoods
Signature of Reviewing Official

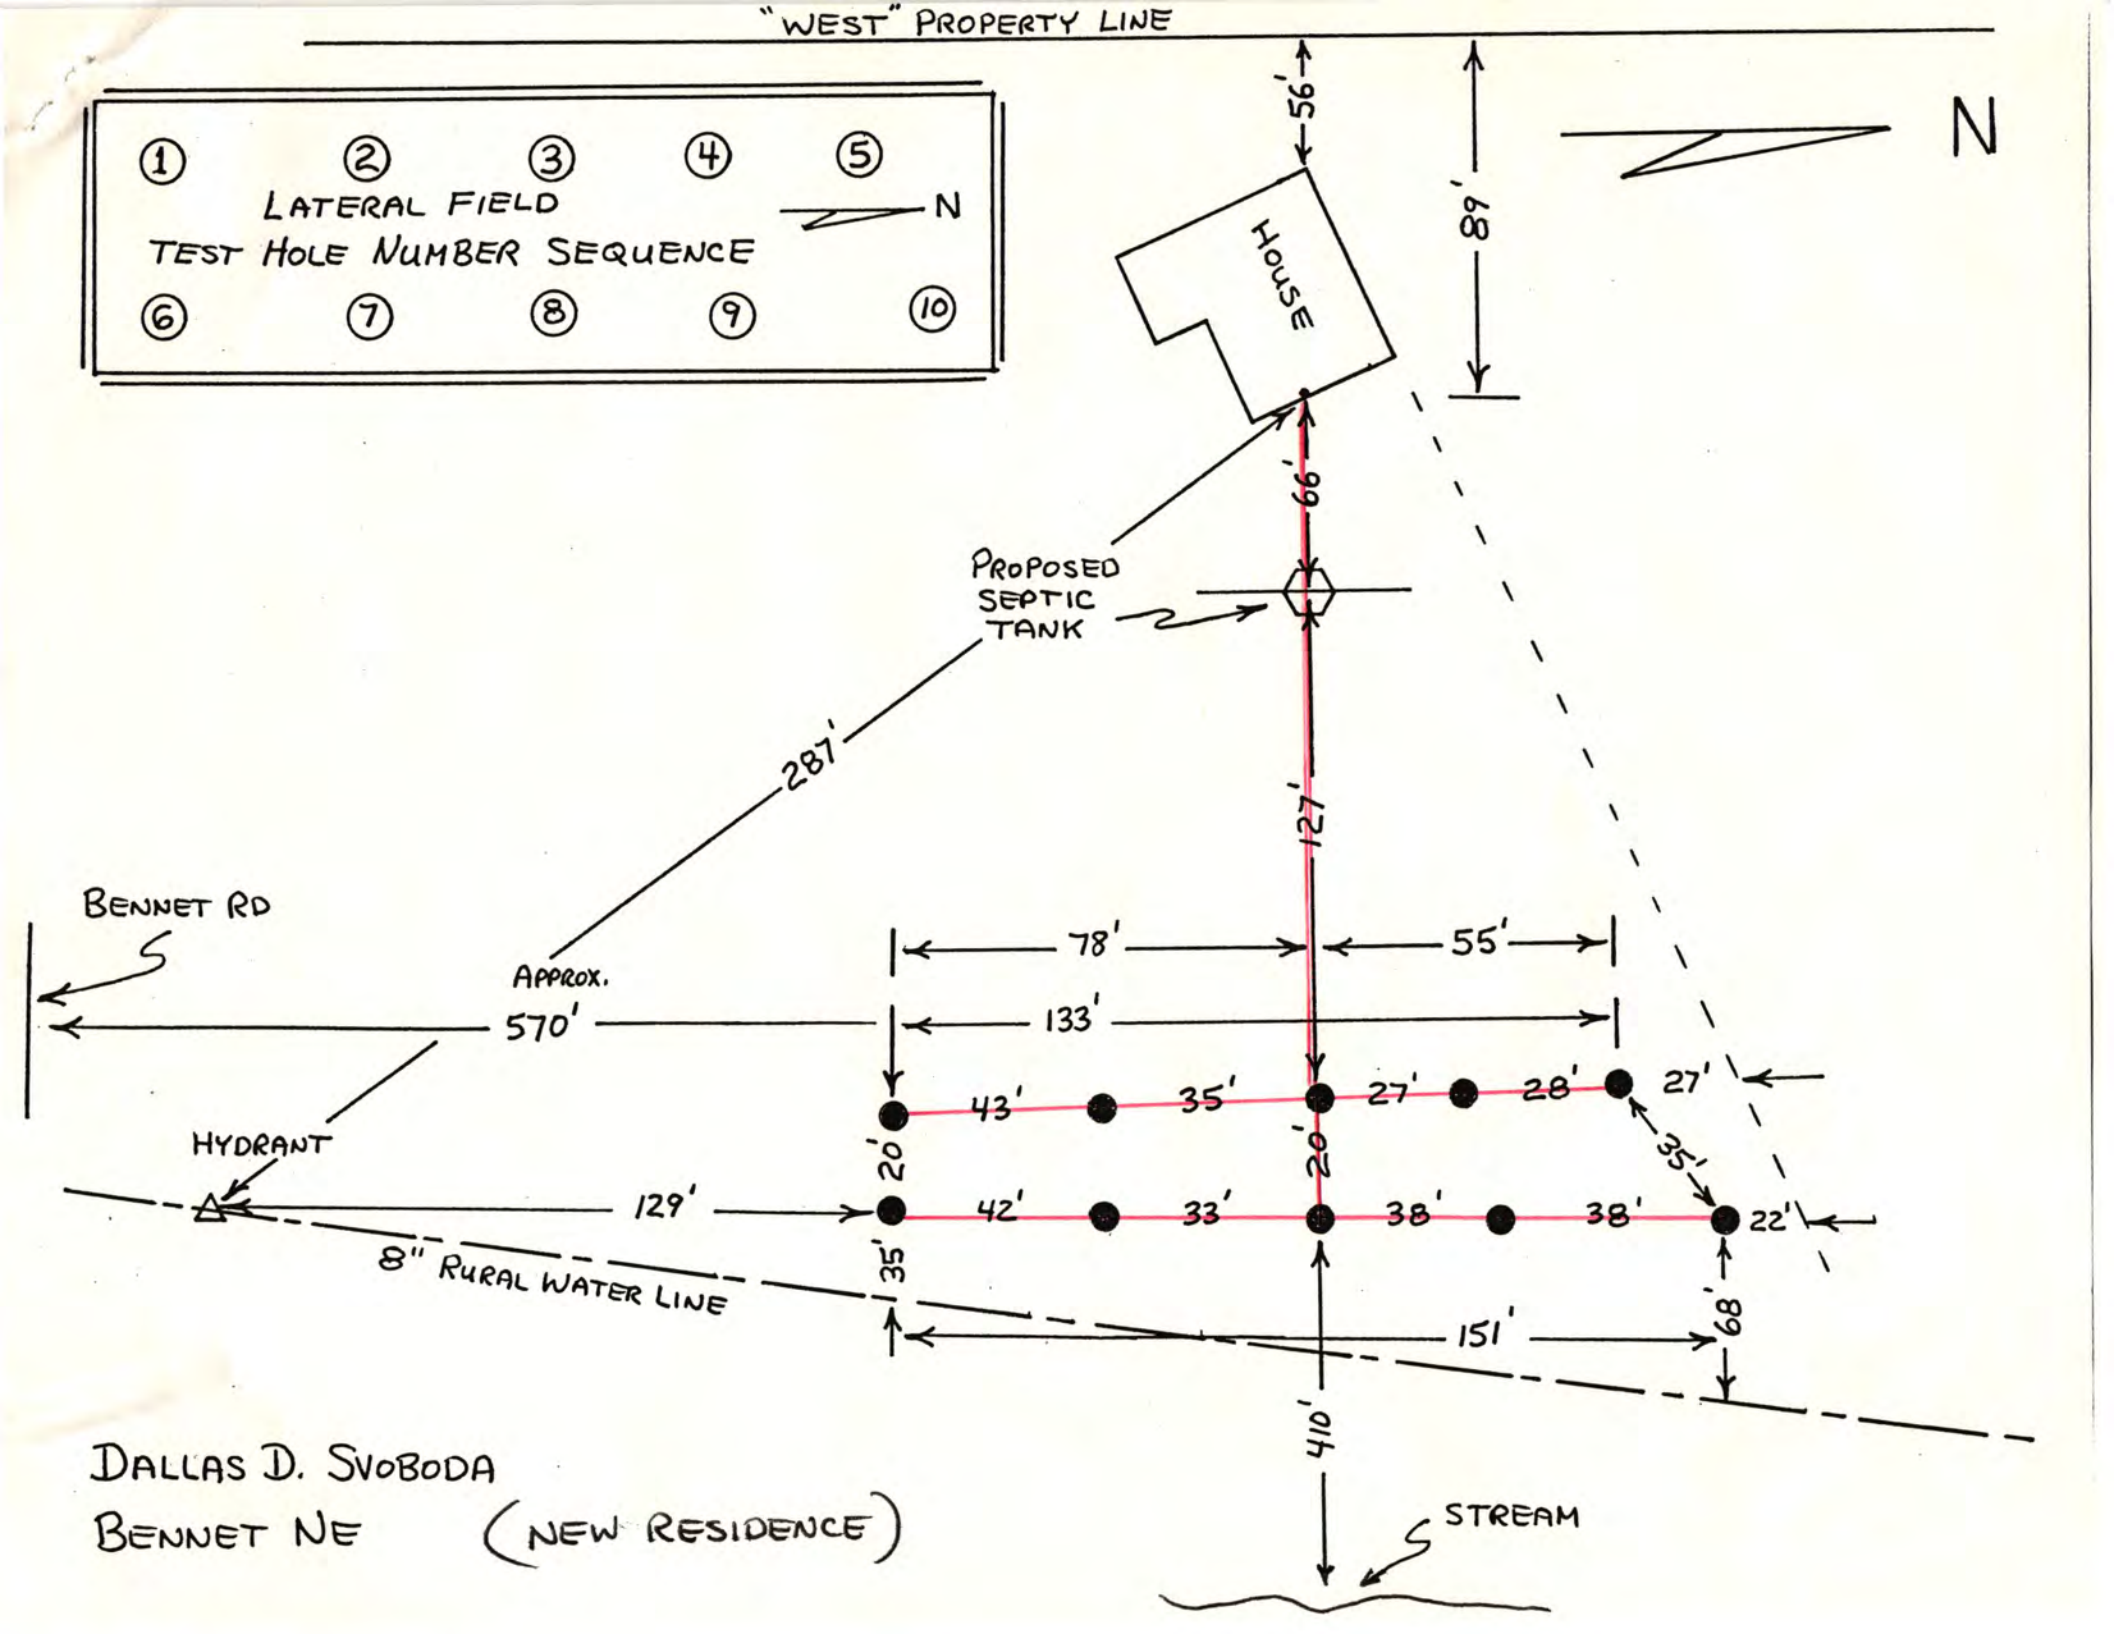

DALLAS D. SVOBODA

BENNET NE (NEW RESIDENCE)

RECEIVED JAN 15 1992

