LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

3140 "N" STREET Lincoln, NE 68510-1514 (402) 441-8000

NON TRANSFERABLE

PERMIT

Permit
SEWAGE SYSTEM REPAIR

No. 95390043801

Issued 03/27/95
Expires 09/27/95
Revenue Code 18754

Establishment
LAURIE DE LA CRUZ
T8N R8E SEC 13
LOT 3
18500 ROCA ROAD

FEES: $50.00

TOTAL $50.00

Permittee
LAURIE DE LA CRUZ
18500 ROCA RD
LINCOLN NE 68317

Issued By M. Jane Ford
Health Director

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW "POST IN A PROMINENT PLACE"

FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Ave.
Lincoln, Nebraska 68502 (Phone: 471-7800)

FILE NO. _____

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 3-24-95

The undersigned hereby applies for a permit to ALTER ☐, EXTEND ☐, or REPAIR ☐ an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. SE 8N; Range 8E; Section 13;
Block _____; Lot 3 IN; Addition _____
Street Address 18500 ROCA RD

2. Property Use: Residential _____ ☑; Commercial _____ ☐
No. Bedrooms 3 Describe _____
Other Use ☐
Describe _____

3. Type of existing Individual Sewage Disposal System: Septic Tank ☑; Other ☐

4. Description of proposed alteration, extension or repair: ADD NEW TANK, DISTRIBUTION BOX & LATERALS

5. Work to be done by: Owner ☐ ; or Contractor ☒, [redacted] EXCAVATING INC.
Contractor's Name

6. Estimated cost of project:

a. Materials	$
b. Labor	$
c. Other	$
TOTAL	$ OVER $1000.00

LAURIE DE LA CRUZ
Signature of Applicant (owner or lessee)

18500 ROCA ROAD, BENNET, NEB
Address

(Do not write below this line)

REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ 50.00

2. Site Visits:
Date: 3/24/95 by: J.C.H.
Date: _____ by: _____
Date: _____ by: _____


3. Date: Approved ☒; Disapproved ☐
by: Jerrold E. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 5/1/95 by: J.C. Hood

Jon Suoboda

L 3 SE 13-8-8

Called Bennett Lancaster
Co. NE - 18500 Roca Rd.

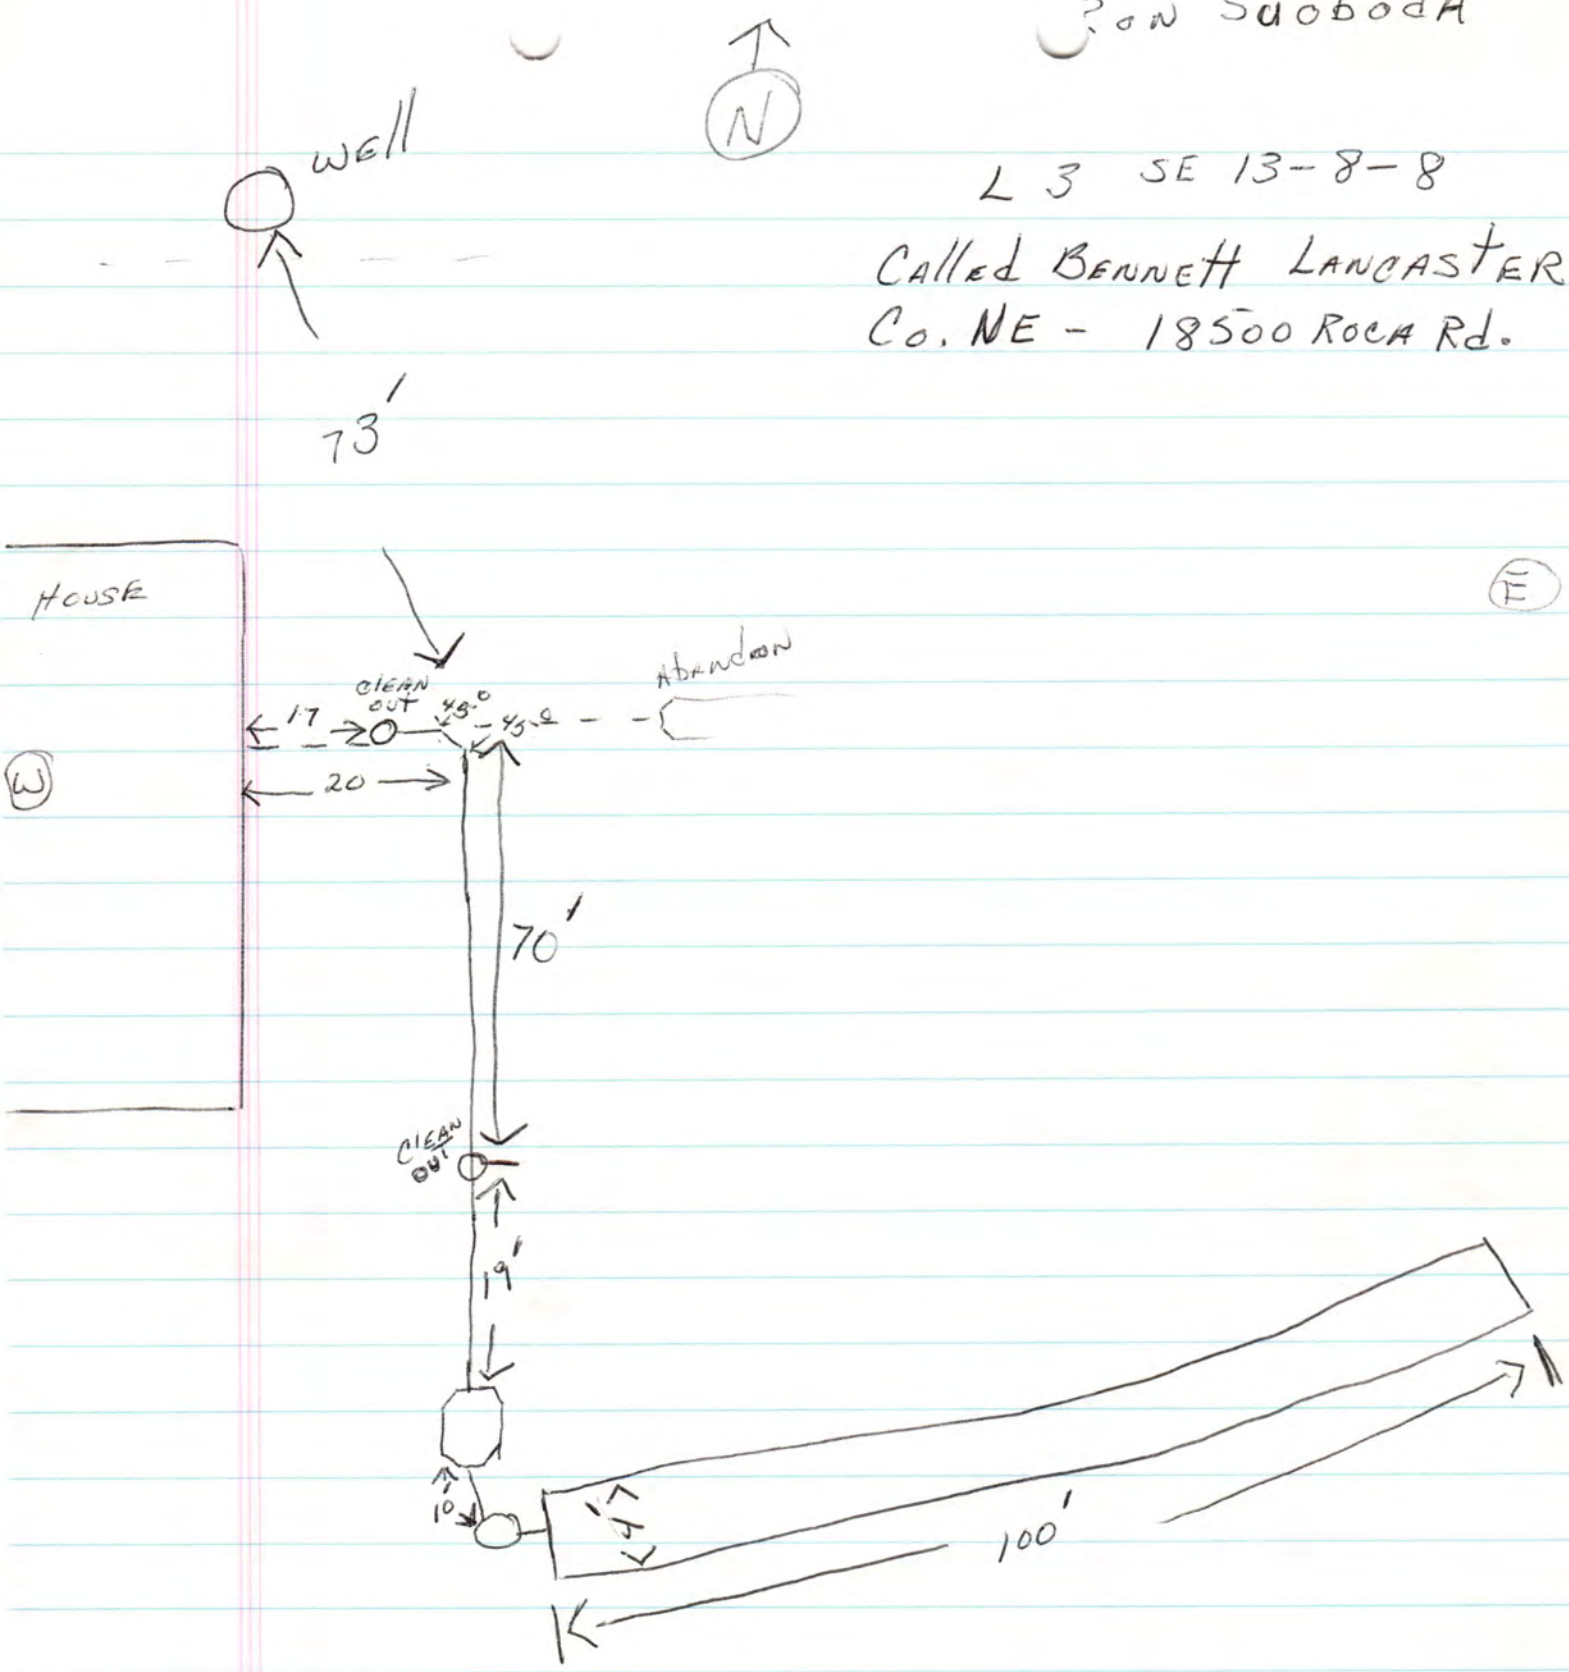

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 St. Marys Avenue Phone (402) 471-7800 Lincoln, Nebraska 68502

REAL ESTATE TRANSFER

This form must be completed and returned to request a real estate transfer inspection.
MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County Health Department.

☐ Evaluation of the Individual Water System Date: _____

☒ Evaluation of the Sewage Disposal System ☐ Enclosed is ~~$45.00~~ $75.00

Legal description of property: TWP. 8N ; RANGE 8E ; SECTION SE¼ 13

BLOCK _____ ; LOT 3 I.T. ; ADDITION _____

Street Address 18500 Roca Road

Directions to Property Roca Road East To 185th

~~Location of Well~~ _____ Tap Location: Inside ☐ Outside ☐

Location of Sewage System East of house Year Installed _____

	NAME	ADDRESS	PHONE
Present Owner:	Opal L. Grossman		
Tenant/Buyer:	Lauric L. De La Cruz	Texas	
Return To:	Gene Carroll Woods Bros Realty	3737 So 27	423-237 Lincoln 476-0828

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant _____ Address _____

HEALTH DEPARTMENT USE ONLY

Date Received NOVEMBER 9, 1987 Received $~~45.00~~ 75.00 Check ☒ Cash ☐

RWD #1 Supply PRELIMINARY STATUS--DATE 11-9-87

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:		SITE VISIT:
Construction	☐	☐	Approved:	☐	Date 11-9-87 by rm
Bacteria	☐	☐	Provisional:	☒	Date _____ by _____
Nitrate	☐	☐	Disapproved:	☐	Date _____ by _____

Comments: Recommend checking to see if septic tank needs pumping. Also recommend proper abandonment of unused well north of house and unused windmill well west of house. See Attached Letter ☐

FINAL STATUS

WATER SYSTEM: Public Supply SEWAGE DISPOSAL SYSTEM:

Approved: ☐ Approved: ☐ Provisionsal Approval: ☒

APPROVED BY Ron Maynard DATE 11-10-87

FN 20215-1079R
FORM 23 9

020

Lincoln-Lancaster County Health Department

2200 St. Mary's Avenue, Lincoln, Nebraska 68502 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

Closing date est. Apr. 10th

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: Lincoln-Lancaster County Health Department or LLCHD

☑ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

☐ Evaluation of the Individual Water System ☑ Evaluation of the Sewage Disposal System

Legal Description of Property: Street Address 18500 Roca Rd. Bennett, Ne

Twp 8N Range 7E Section 13 1/4 ___ 1/4 ___ Block ___ Lot 3 Addition SE

Directions to Property Hiway 2 E to Bennett Corner. So thru Bennett to Roca Rd. East on Roca Rd 2 miles No. side of ~~Home~~ Rd

Location of Well (Rural Water) Tap Location: Inside ☐ Outside ☐

Location of Sewage System East of Home Year Installed ___

	NAME	ADDRESS	PHONE
Present Owner:	Laurie De la Cruz	18500 Roca Rd, Bennett	
Tenant/Buyer:	Dan & Sonja Bartels	720 Skyway Rd	486-3230
Return to:	Mary N. Kuhlmann	7141 A STREET LINCOLN NE 68510	432-0323

Signature of Applicant Sonja L. Bartels Address 720 Skyway Rd Lincoln NE 68505 Date 03/08/95

HEALTH DEPARTMENT USE ONLY

Date Received 3/14/95 Received $150.00 Check ☑ Cash ☐

PRELIMINARY STATUS--By Gerald E. Wood **DATE:** 3/15/95

WATER SYSTEM:	Approved	Disapproved	**SEWAGE SYSTEM**	**Additional Site Visits**
Construction	☐	☐	Approved ☐	Date 3/24/95 by LCH
Bacteria	☐ ____/ml	☐ ____/ml	Provisional ☐	Date 4/21/95 by LCH
Nitrate	☐ ____ppm	☐ ____ppm	Disapproved ☑	Date ___/___/___ by ___

Comments: SEPTIC EFFLUENT IS SURFACING. TANK IS OF INADEQUATE SIZE BY TODAYS STANDARDS. ALL OLD UNUSED WELLS MUST BE PROPERLY ABANDONED. OLD CISTERN NORTH OF HOUSE MUST BE PROPERLY FILLED. ALL JUNK, OLD TIRES AND JUNK LUMBER MUST BE PROPERLY DISPOSED OF! See Attached Letter ☐

FINAL STATUS

WATER SYSTEM: Approved: ☑ Rural Water

SEWAGE DISPOSAL SYSTEM Approved: ☐ Provisional Approval: ☑

Approved by Paul Dugan Date 4/28/95

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

4/21/95 Sewage system finished. Cistern filled. Windmill well abandoned. Still need tires and lumber disposed of. P. Provisional approval on septic system because installation was not based on soil percolation test. LCH