LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 ST. MARYS
LINCOLN, NEBRASKA 68502

FILE NO. 2035-C

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION
TYPE OF PERMIT

FEBRUARY 24, 1984
THIS PERMIT EXPIRES

JIM HOWARD, COUNTRY BIBLE CHURCH, 176 & Hickman Rd, Rt #1, Bennet 68317
ISSUED TO — ADDRESS

T8N; R8E; Sec. 22; Lot 5IT; NW¼ of NW¼, Sec 22, 48th & Roca Rd
LEGAL DESCRIPTION

REMARKS: NONTRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 60.00	$	$	$ 60.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
	110.16	148.14	6-2
RECEIPTED BY	DATE	AMOUNT	

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

HEALTH
ISSUING OFFICER

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. 2832

20109-0977

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 60.00

FILE NO. 2035-C

DATE: Aug 22, 1983

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 8 N ; Range 8 E ; Section 22 ;
   Block _____ : Lot 5 I.T. : Addition NW¼ of NW¼ sec 22.
   Street Address 148th + Roca Rd

2. Property Use: Residential ☐ ; Commercial ☒ Other Use ☐
   No. of Bedrooms _____. Describe CHURCH.

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: _____ ft.

County Bible Church
Signature of Applicant (Owner or Lessee)
17. Jim Wiesel Pres.
176th + Hickman Rd. Bennet Nebr. 68317
Address

(Do not write below this double line)

1. Health Department: Date Rec'd. 8/24/83. Date Frwd. 8/25/83. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: or Village Clerk: Date Rec'd. 8-25-83. Date Frwd. 8-25-83. ACTION: Approved ☒ Disapproved ☐ Signature: [illegible]

3. City or County Engineer: Date Rec'd. 8/25/83. Date Frwd. 8/25/83. ACTION: Approved ☒ Disapproved ☐ Signature: Larry V. Worrell

REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: 7/2/84 by: J.C.H.
Date: _____ by: _____
Date: _____ by: _____

INSTALLATION FINAL WRITTEN APPROVAL
Date: 7/2/84 By: Jerrold C. Hood

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

2035-C

AUG 18.

Park test on lot 5 I. T. of N.W. ¼ of N.W. ¼ sec 22

8:30 A.M. puttin gravel + wate to 12 in.

12:30 P.M. Refilled with wate to 12 in.

HOLE #.

	1	2	3	4	5	6
Refilled to 6 in.						
8:15 AM.	Empty	Empty.	Empty	3 in water.	Empty	Empty
8:45	3 in left.	— 5 in left.	— 2½ in left.	— 3 in left.	— 3½ in left.	— 2¼ in left.
9:15	-5½ "	— 5½ "	— 5 "	— 6 "	— 5¼ "	— 5½ "
9:45	-5½ "	— 5½ "	— 5½ "	— 6 "	— 5¼ "	— 5½ "
10:15	-5¼ "	— 5½ "	— 5 "	— 5¾ "	— 5½ "	— 5¼ "
10:45	-5½ "	— 5¼ "	— 5 "	— 5½ "	— 5¼ "	— 5¼ "
11:15	-5 "	— 5½ "	— 5 "	— 5¾ "	— 5½ "	— 5¼ "
11:45	-5 "	— 5¼ "	— 4¼ "	— 5¾ "	— 5¼ "	— 5¼ "
12:15	-5 "	— 5¼ "	— 4¾ "	— 5¾ "	— 5½ "	— 5¼ "
Aug. 19.		1"	3/4	1 1/4	1/4	1/2 " 3/4 "
TOTAL DROP	7¾"	3¾"	11"	4½"	6	8

53

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

B

FILE NO. 2035-C

PROPERTY WHERE SOIL TESTED:

Location: Township 8 ; Range 8 ; Section & ¼ Section NW¼ of NW¼ sec 22.
Property Dimensions: 476 ft. x ~~476~~ ft. Area: 5.2 acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☒ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ☐ .
Dates of Tests: Aug 18 to Aug 19, 1983. Weather: Precip. 0 Temp. 95°.

OWNER: Country Bible Church.
Address: 176 ~~on~~ & Hickman Rd. Bennet Nebr. 68317

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1	36"	8-18	8:30 AM	8-18	12:30 PM	~~8-18~~ 8-19	8:15 AM	6	12:15 PM				
2	"	"	"	"	"		"	"	"				
3	"	"	"	"	"	"	"	"	"				
4	"	"	"	"	"	"	"	"	"				
5	"	"	"	"	"	"	"	"	"				
6	"	"	"	"	"	"	"	"	"				

Jim Wiesel
Signature of Person Conducting Test
Address Bennet Nebr. 68317 Phone 782-8057

Sum of Percolation Rates: _____
Average of Rates: _____
Mean of Rates: _____

(Do not write below this line)

REVIEWING ACTION

Remarks: _____
Soil Type (SCS): Wymore Silty Clay Loam
Date: _____

Approved Percolation Rate (a)
A. 53 min./inch
B. _____ min./inch
C. _____ min./inch

Jerrold C. Hood
Signature of Reviewing Official

FORM 20102-0477
PRELIMINARY PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐


LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

C

Sketch of property showing Percolation Test hole locations, well, residence, direction and property line.

FILE NO._____

Indicate on sketch if residence and well are exisiting or proposed.

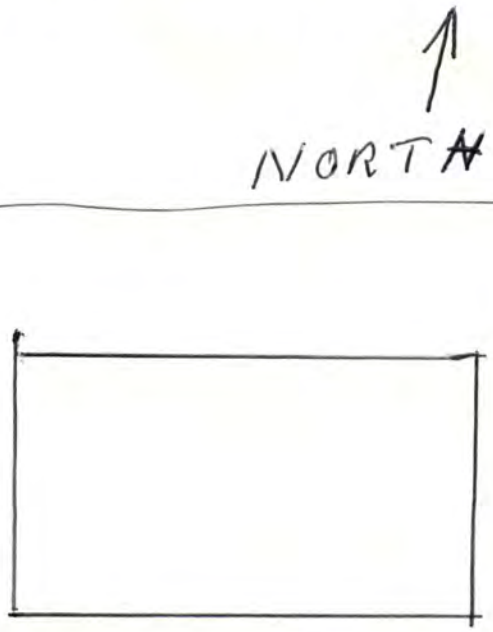


REVIEWING ACTION

Remarks :_____

Date: August 24, 1983

Minimum Design Requirement
1. Capacity of Septic Tank 1000 gals.
2. Total Length of Laterals 148 ft.
3. With a Trench Width of 48 in.
4. Total Area of Lateral needed 590 sq.ft.

Jerrold C. Hood
Signature of Reviewing Official

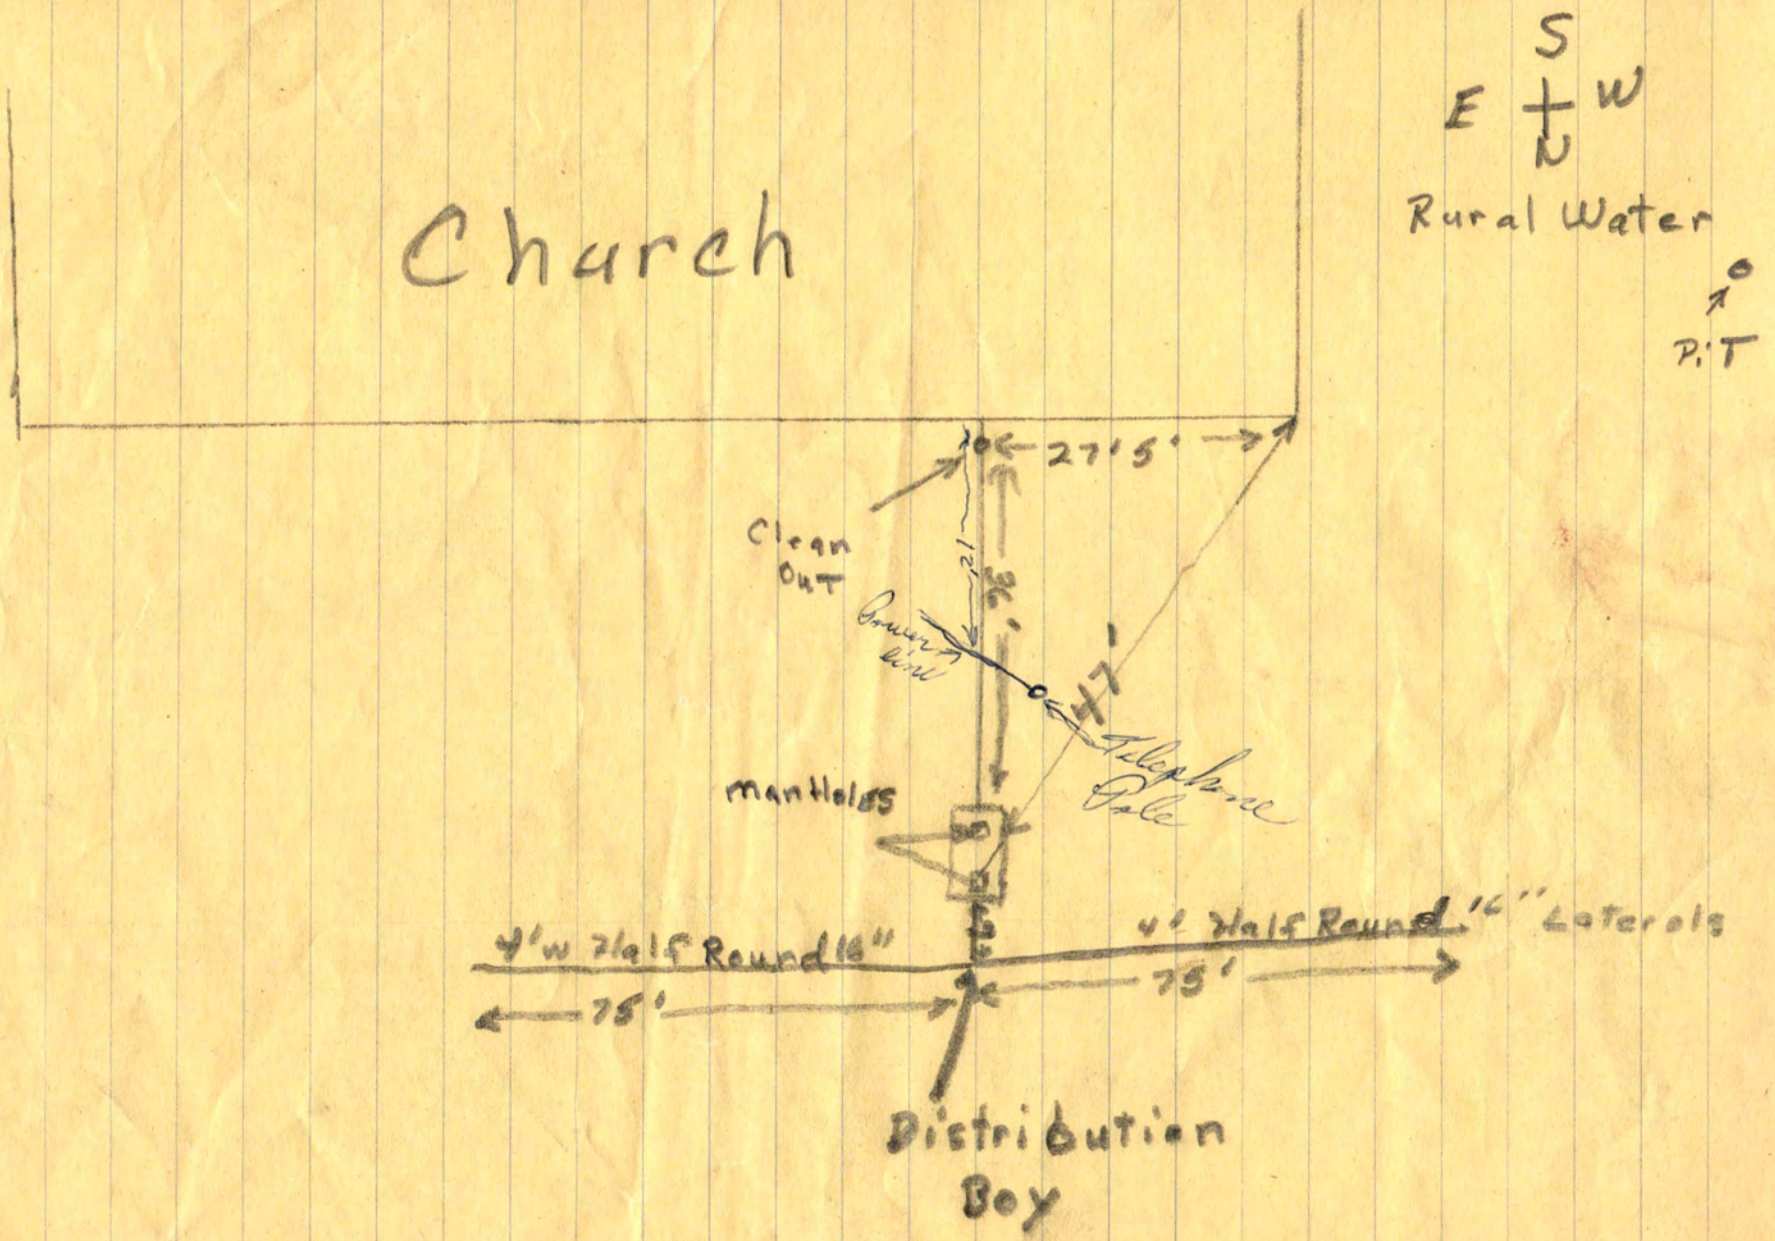
Church
S
E W
N
Rural Water
P.T
27'5'
Clean Out
21'
Sewer line
47'
Telephone Pole
manholes
4" w 7/8 f Round 16"
4" Half Round "C" Laterals
75'
75'
Distribution Box