Lincoln-Lancaster County Health Department

ENVIRONMENTAL HEALTH DIVISION
3140 N STREET · LINCOLN, NE 68510-1514 (402) 441-8000

Permit

SEWAGE INSTALLATION
LAGOON

Permit # 00380220501

Issued 06/28/00
Expires 12/28/00
Revenue Code 3157

Establishment

ASPEN BUILDERS
T9N R5E SEC 2
RIDGE PARK-1ST BLK 4 LOT 3
3033 PHEASANT RIDGE RD

FEES: $150.00

Permitee

ASPEN BUILDERS
4740 LINDEN ST
LINCOLN NE 68516

TOTAL: $150.00

Leon F. Vinci, MPH, Health Director

• POST IN A PROMINENT PLACE • NOT TRANSFERABLE

013386

A JUN 2 7 2000

Lincoln-Lancaster County Health Department
Environmental Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

Permit Number: 003802205

Sewage Disposal System

Request for Site Clearance and Permit

Include Form B, Form C and Applicable Fees with this Application.

☐ Septic System ☒ Lagoon ☐ Other (Refer to Form C)

The undersigned hereby requests site clearance and permit to construct a Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

PLEASE PRINT OR TYPE

A. System Location (Indicate correct number and street)

Address 3033 Pheasant Ridge Rd. (no rural route) City Lincoln NE, Zip 68532

Legal Description: 1/4 2 1/4 Section 9N Township 5E Range Ridge Park Subdivision 1ST Addition 4 Block 3 Lot

Geographical Location (if known): Longitude _____ Latitude _____

☒ Check if system mail address is not the same as the owner's address

B. Owner

Name Aspen Builders Signature _____

Address 4740 Linden City/State/Zip Lincoln, NE 68516

☐ Check if owner designed system Home Phone _____ Work Phone 484-6868

C. Contractor

~~Name~~ Aspen Builders ~~Company~~ Name Bob Beves

Address 4740 Linden City/State/Zip Lincoln, NE 68516

☒ Check if contractor designed system Work Phone 484-6868

D. Engineer/Installer ☐ Check and complete if engineer designed system

Designer Name _____ Firm _____ Work Phone _____

E. This System Will Serve a

☒ Residential Dwelling Number of Bedrooms 3 Is there a Whirlpool Bathtub (YES) NO

☐ Commercial Establishment/Other Facility Specify _____

Design flow in gallons per day _____ Type of Wastewater: ☐ Domestic ☐ Non-Domestic.

DO NOT WRITE BELOW THIS LINE

Approval Process ☒ Municipal Code 24.38 ☐ County Resolution No. 2832

1. **Health Department** Date rec'd 6/27/00 Date frwd 6/28/00 ACTION ☒ Approved ☐ Disapproved Signature Jerrold C. Hood
2. **Supt. Bldg. Insp. or Village Clerk** Date rec'd 6/28/00 Date frwd 6/28/00 ACTION ☒ Approved ☐ Disapproved Signature Chase Baker
3. **City or County Engineer** Date rec'd 6/28/00 Date frwd 6/28/00 ACTION ☒ Approved ☐ Disapproved Signature _____

12/5/00 Lagoon + line approved – fence needed

Installation Final Written Approval

By Doug Amack

Date 1/10/2001

Business Office Use Only

Date Rec'd 06/27/00

Amt Paid 150.00

Rec'd By LS ~~Cash~~/Check No. 2792

FORM 23-100 10-96 White - Health Dept. Yellow - Engineer Pink - Bldg. Inspector

JUN 27 2000


C

Lincoln-Lancaster County Health Department
Environmental Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

Permit Number: 0038022 05

Sewage Disposal System
Preliminary Plan Specifications

Draw a plot plan showing system location, lines, distribution box, tank and laterals, percolation test hole locations, well, residence. compass direction and property lines. Indicate on drawing if residence and well are exist

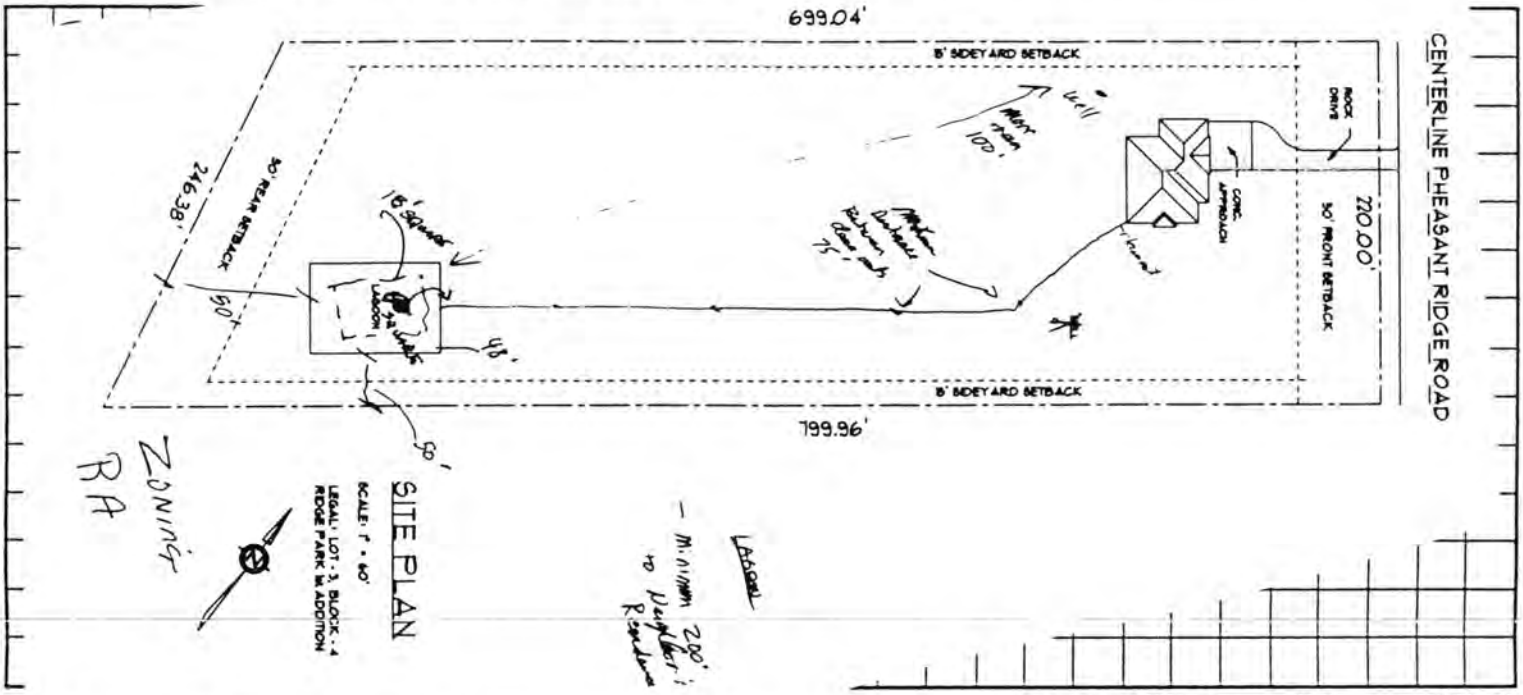

Approximate Scale: _____ ft. = _____ grid line/s

A. System Location (Indicate correct number and street)

Address (no rural route) 3033 Pheasant Ridge Rd City Lincoln NE, Zip 68532

B. Proposed Septic Tank/s

Tank Material: ☐ Concrete ☐ Plastic ☐ Other _____

C. Proposed Absorption System (See Form B for Percolation Information)

Percolation Rate NOT NEEDED (min. per inch) Soil Type: _____ Land Slope: _____ %

Type of Absorption System: ☐ Trench ☐ Bed ☐ Other _____

Total Square Feet of Field Required: _____ sq. ft.

Type of Lateral: ☐ Half-Moon ☐ Perforated Pipe ☐ Other Lateral Material: _____

Capacity of Septic Tank _____ gals Number of Absorption Beds: _____ Number of Distribution Laterals per Bed _____

Total Length of Laterals _____ ft. Number of Trenches _____ Trench Width _____

D. Setbacks Check the Boxes Below if the Required Setback has been Satisfied

Distance From	Private Well	Public Well	Surface Water	Gound Water	Pressure Water Lines	Property Lines	Foundations Yours	Foundations Neighbors	All Other Setbacks
Tank (ft)	50 ☐	500 ☐	50 ☐	NA ☐	25 ☐	20 ☐	15 ☐	25 ☐	☐
Field (ft)	100 ☐	500 ☐	50 ☐	4 ☐	30 ☐	20 ☐	30 ☐	40 ☐	☐
Lagoon (ft)	100 ☒	500 ☒	50 ☒	N/A ☐	30 ☒	50 ☒	100 ☒	200 ☒	☒

E. Required Signatures

Home Building Contractor Bob Brown Date 6-22-00

Installer Bob Brown Date 6-22-00

9/6/00


As Built Drawing

Indicate North with Arrow

53' x 53' at five foot 18' bottom 9/6/00

9/6/00 Size needed 59' – Informed site Manager. He stated that he would contact Appa. Builder

9/8/00 Spoke w/ project manager. Lagoon to be re-sized when a machine is available. DS.

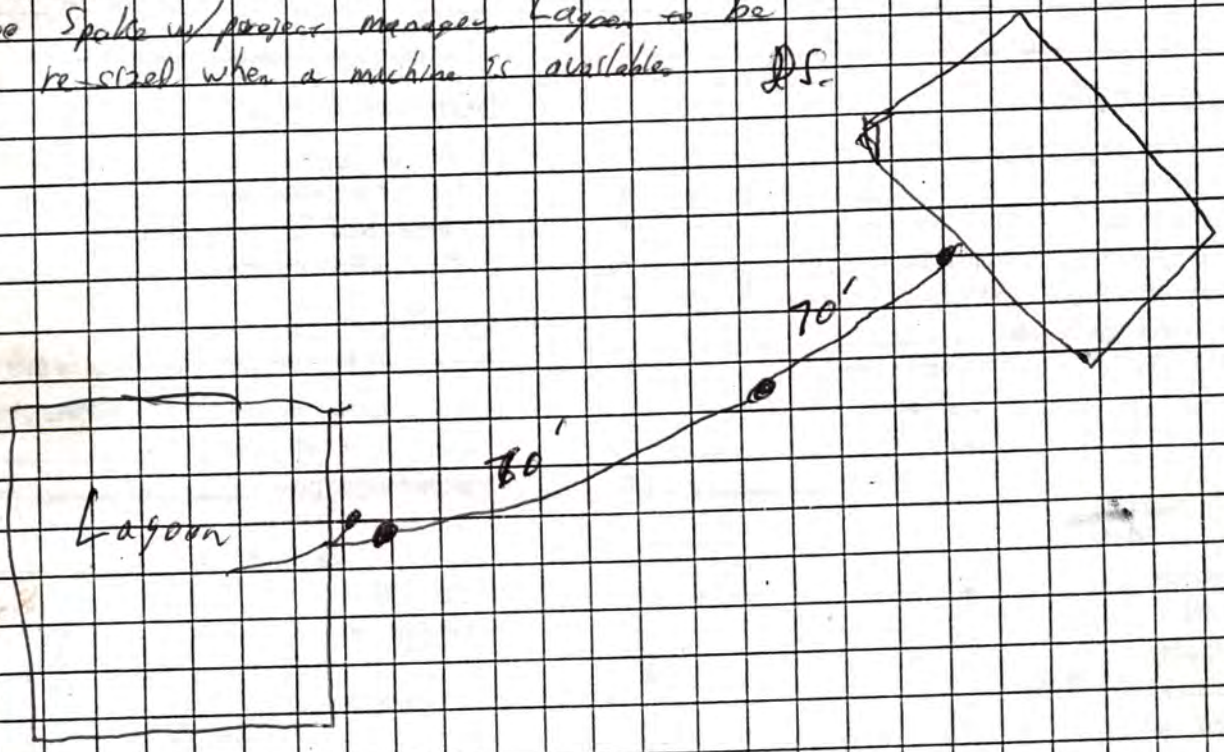

12/5/00

Lagoon enlarged as required — fence needed — owner to install as per Mitch Myers D.C.

Approximate Scale: _____ ft. = _____ grid line/s

9/6/00.


As Built Drawing

Indicate North with Arrow

53' x 53' at five foot 18' bottom 9/6/00

9/6/00 Size needed 59' – Informed site manager. He stated that he would contact Agri Builder

9/8/00 Spoke w/ project manager. Lagoon to be re-sized when a machine is available.

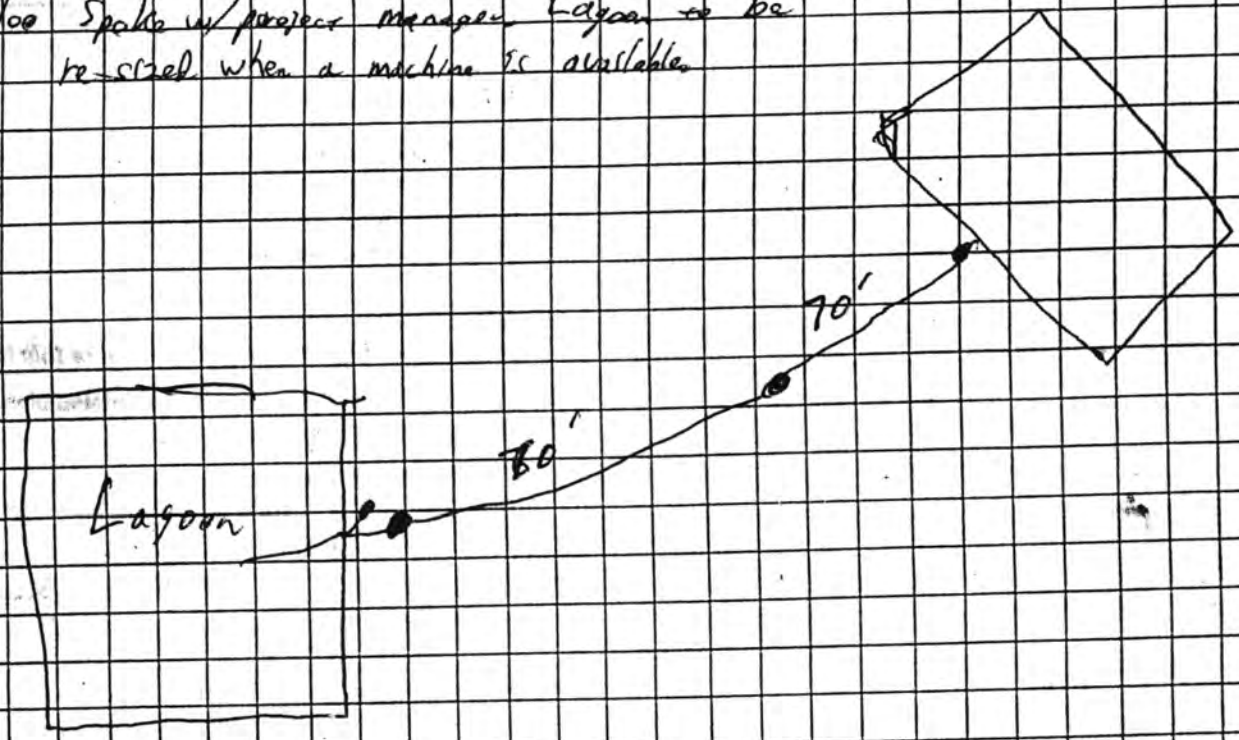

Approximate Scale: _____ ft. = _____ grid lines

Lincoln-Lancaster County Health Department

ENVIRONMENTAL HEALTH DIVISION
3140 N STREET · LINCOLN, NE 68510-1514 (402) 441-8000

Permit

WATER WELL
NEW WATER WELL CONSTRUCTION

Permit # 00400089501

Issued 07/07/00
Expires 01/07/01
Revenue Code 3162

Establishment

ASPEN BUILDERS
T9N R5E SEC 2
RIDGE PARK-1ST BLK 4 LOT 3
3033 PHEASANT RIDGE RD

FEES: $75.00

Permitee

ASPEN BUILDERS
4740 LINDEN ST
LINCOLN NE 68516

TOTAL: $75.00

Leon F. Vinci, MPH, Health Director

• POST IN A PROMINENT PLACE • NOT TRANSFERABLE

013473

JUL 6 2000

Lincoln-Lancaster County Health Department
Environmental Health Division
3140 "N" Street ● Lincoln, NE 68510-1514
Phone: 402-441-8022

Permit No. 004000895

PID #03-02-210-003-000
entered 1-16-01

Request for Site Clearance and Permit for Individual Water Well

The undersigned hereby requests:

- ☒ Site Clearance and Permit to construct a new individual water well - $75.00
- ☐ Annual Permit for an existing well - $50.00
- ☐ Permit to repair or alter existing well involving opening of well - $25.00

1. Well Site Address 3033 Pheasant Ridge Rd City Lincoln, NE Zip 68532
(No Rural Route Please)

Legal description of property:
Twp 9N; Range 5E; Section 2; Block 4; Lot 3; Addition Ridgestock 1st Addn

2. Well use: ☒ Residential; ☐ Commercial; ☐ Other; Describe: _____

3. Distance to Public Water Supply _____ feet.

Signature of Owner _____

Print Name _____
Current Address _____
_____
Current Home Phone _____
Work Phone _____

Signature of Contractor _____
Bob Benes

Print Name ASPEN Builders Inc.
Address 4740 Linden
Lincoln NE 68516
Home Phone _____
Work Phone 484-6868
Cellular Phone 730-6868

Sewage Permit Applied for: ☒ Yes ☐ No ☐ Not applicable

Please Submit Permit Fee with This Request
Please Do Not Write Below This Line

Approval Process: Lincoln Municipal Code 8.44

1.	Health Department	Date received 7/6/00 Date forwarded 7/7/00	ACTION ☒ Approved ☐ Disapproved Signature: Donald C. Hood	
2.	Building & Safety	Date received 7/7/00 Date forwarded 7/7/00	ACTION ☒ Approved ☐ Disapproved Signature:	
3.	City Engineer	Date received 7/7/00 Date forwarded 7/7/00	ACTION ☒ Approved ☐ Disapproved Signature:	

REMARKS OR REASONS FOR DISAPPROVAL: _____

Site Visits:
Date: ____/____/____ By _____
Date: ____/____/____ By _____
Date: ____/____/____ By _____

Installation Final Written Approval
By: Doug Smith
Date: 01/16/2001

Distribution:
White - Health Dept. Lt. Green - Engineer Lt. Blue - Bldg Inspector

Nitrate Level 0.8 mg/L
Chloride Level — mg/L
Bacteriological Analysis Satisfactory
Yes X No ____
Other _____

Business Office Use Only
Date Rec'd: 07/06/00
Amt Paid: $ 75.00
Rec'd By LS Cash/Check No. 7852