001

Lincoln-Lancaster County Health Department

2200 St. Mary's Avenue, Lincoln, Nebraska

ORIGINAL LOAN APPROVAL FILE
PREVIOUS HISTORY UNKNOWN

REAL ESTATE TRANSFER/LOAN

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: Lincoln-Lancaster County Health Department or LLCHD

☒ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

☒ Evaluation of the Individual Water System ☐ Evaluation of the Sewage Disposal System

Legal Description of Property: Street Address 3800 South FOLSOM LINCOLN, NE

Twp 9 Range 6 Section 3 1/4 SE 1/4 ___ Block ___ Lot 154 Addition IRReg. Tracts

Directions to Property WELL IS LOCATED IN FRONT OF HOUSE INSIDE the WISHING WELL. See Attached MAP

Location of Well Front of house Tap Location: Inside ☐ Outside ☒

Location of Sewage System NONE ON CITY Year Installed 1960 House built

	NAME	ADDRESS	PHONE
Present Owner:	DONALD + MARY HILL	3800 S FOLSOM LINCOLN, NE 68503	483-3795
Tenant/Buyer:	RONALD + JOANNE WILLEM	5230 La Salle St LINCOLN, NE 68516	488-2933
Return to:	COLDWELL BANKER CENTURY REALTY c/o JIM THOMAS	4444 O St LINCOLN, NE 68510	475-4444

Signature of Applicant Ronald W Willem Address 5230 La Salle St Lincoln, NE 68516 Date ___/___/___

HEALTH DEPARTMENT USE ONLY

Date Received 12/22/93 Received $150.00 Check ☒ CK # 2114 Cash ☐

PRELIMINARY STATUS--By Paul D Thomas **DATE:** 12/22/93

WATER SYSTEM:	Approved	Disapproved
Construction	☒	☐
Bacteria	☒ 0 /ml	☐ ___ /ml
Nitrate	☒ 0.6 ppm (1-20-94)	☐ 19.3 ppm

SEWAGE SYSTEM ON CITY SYSTEM

Approved	☒
Provisional	☐
Disapproved	☐

Additional Site Visits

Date 1/4/94 by PD
Date 1/14/94 by PD
Date ___/___/___ by ___

Comments: Well behind garage needs to be properly abandoned
12-30-93 Letter received of buyers intent to use old well for irrigation which would be acceptable
1-4-94 Results for nitrates 1-14-94 Water Treatment unit installed See Attached Letter ☐

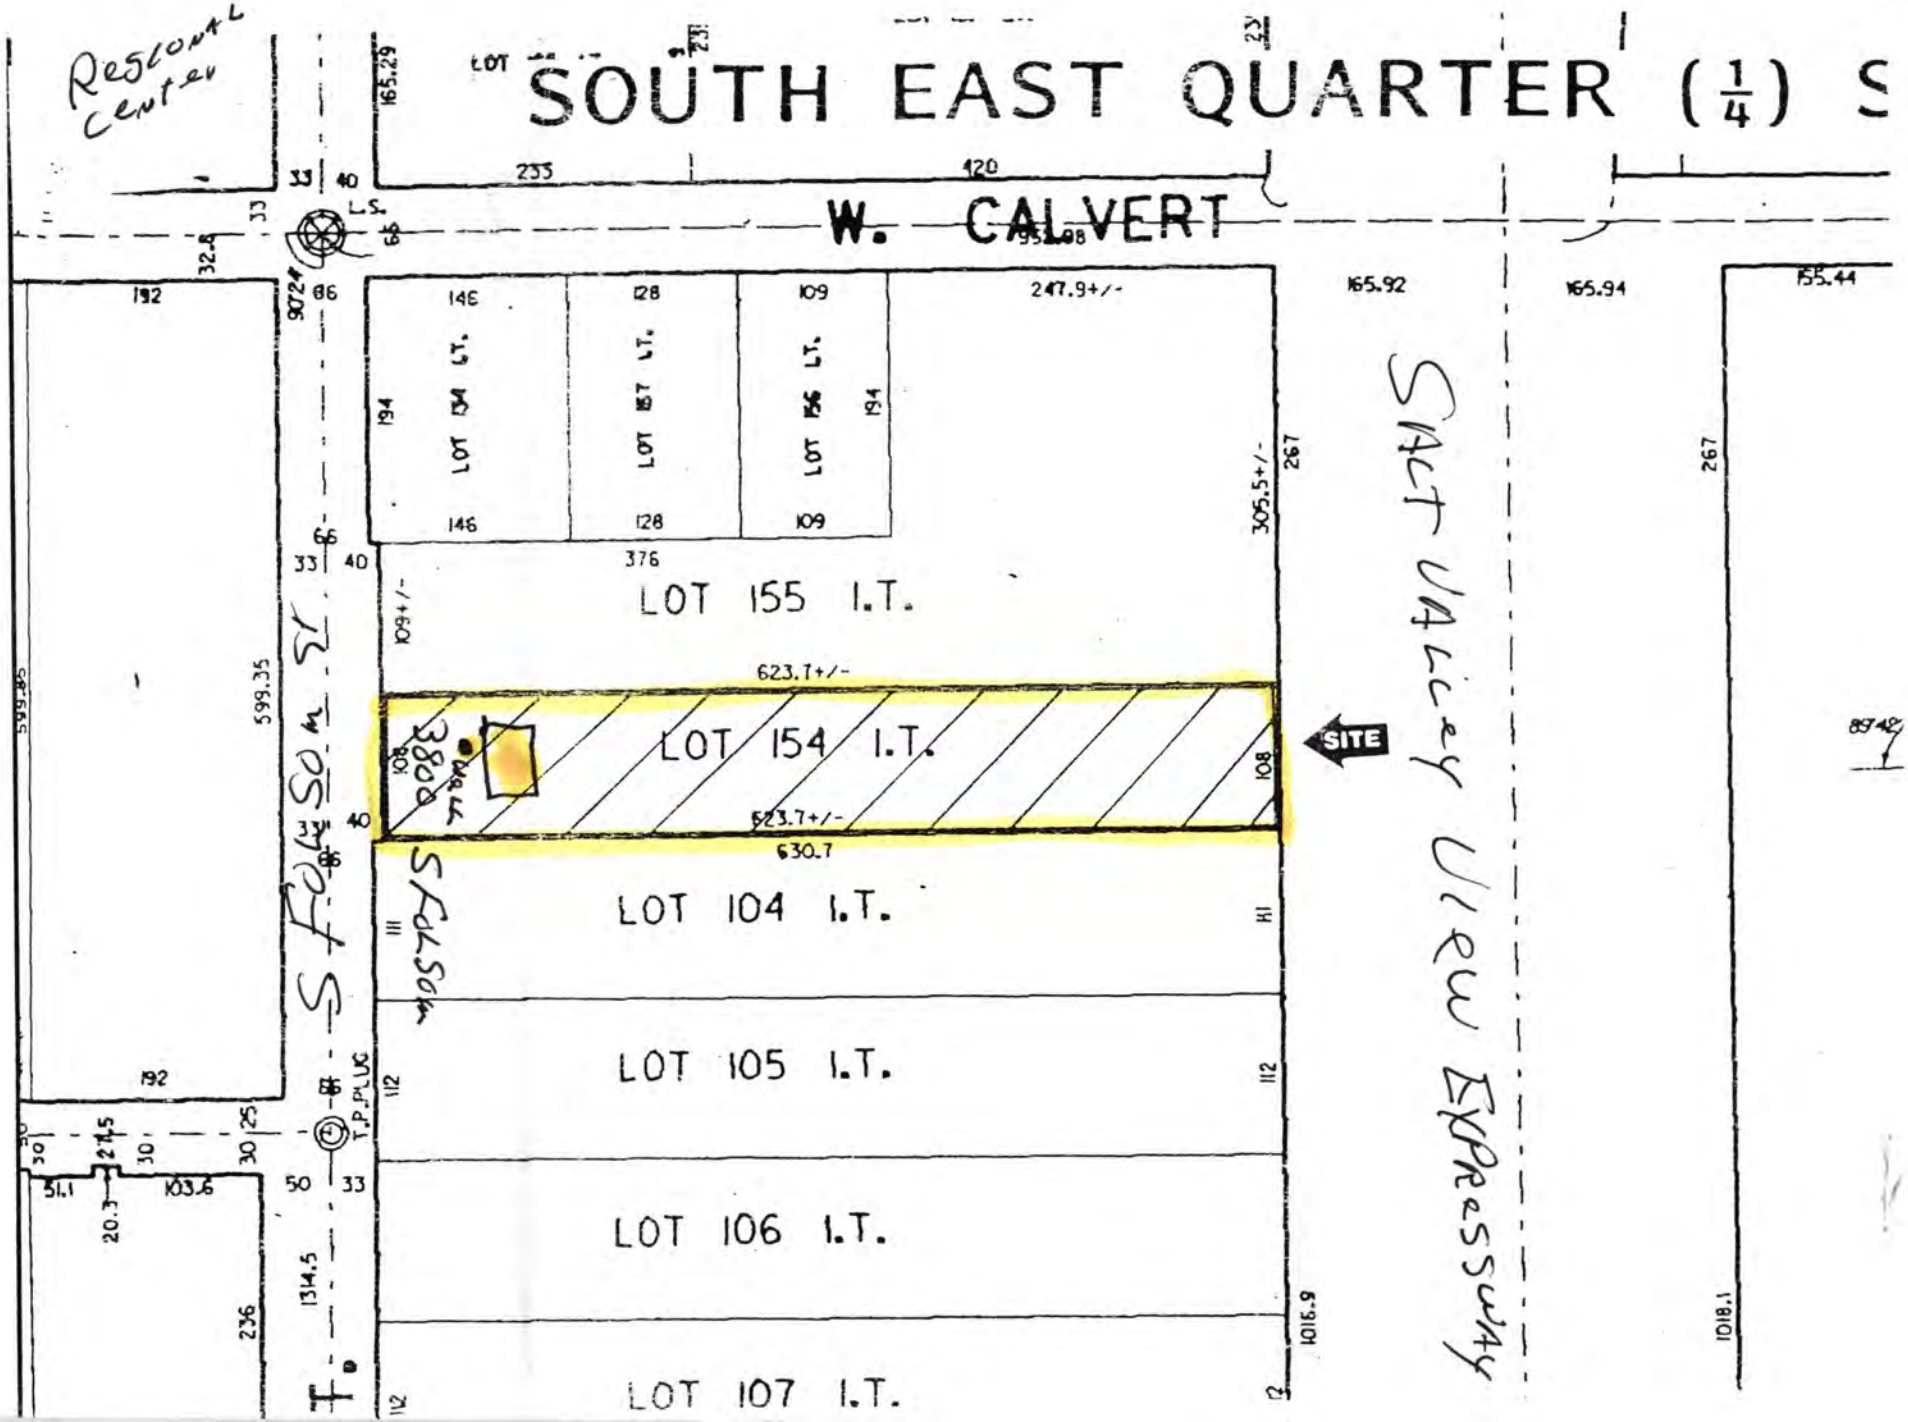
FINAL STATUS

WATER SYSTEM: Approved: ☒ **SEWAGE DISPOSAL SYSTEM** Approved: ☒ CITY SYSTEM Provisional Approval: ☐

Approved by Paul D Thomas Date 1/20/94

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

094


SOUTH EAST QUARTER (1/4) S
W. CALVERT
Regional Center
LOT 155 I.T.
LOT 154 I.T.
LOT 104 I.T.
LOT 105 I.T.
LOT 106 I.T.
LOT 107 I.T.
SITE
SALT VALLEY VIEW EXPRESSWAY
S. 5th St.
S. 4th St.
T.P.P.L.U.C.
165.92
165.94
155.44
247.9+/-
305.5+/-
623.7+/-
523.7+/-
630.7
599.35
1016.9
1018.1
1314.5