CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

FILE NO. 37

INDIVIDUAL SEWAGE DISPOSAL SYSTEM — TYPE OF LICENSE OR PERMIT

July 30, 1968 — THIS LICENSE OR PERMIT EXPIRES

Yankee Hill Brick Mfg. Co. — LICENSEE OR PERMITTEE

Rt. 1, Lincoln — ADDRESS

NAME OF ESTABLISHMENT, IF ANY

T 9N; R 6E; Sect. 4 NE 1/4 SW 1/4 (South Coddington) — ADDRESS

REMARKS: Non-Transferable

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
143-1535	10.0116	24.0114	6-2

SERIAL NO.	DATE	AMOUNT
12780	APR 1 68	30.00

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-30(67) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 338

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. T9N; Range R6E; Section 4;
Block ____; Lot ____; Addition ____;
Street Address 3705 So Coddington

2. Property Use: Residential ____ ☐; Commercial ____ ☒
No. of Bedrooms ____.
Other Use ____ ☐
Describe: ____
Describe: To construct sump, pump system, pipeline and absorption field for disposal of liquid from present septic tank.

3. Type of Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Distance to public sewer: 3200 ft.

Yankee Hill Brick Mfg Co.
H E Petty pres.
Signature of Applicant (owner or lessee)

3705 So Coddington
Address Lincoln NE 68502

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 7/2/73. Date Frwd. 7/2/73. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: Date Rec'd. 7-2-73. Date Frwd. 7-2-73. ACTION: Approved ☒ Disapproved ☐ Signature: Charles By BK

3. City Engineer: Date Rec'd. 7-2-73. Date Frwd. same. ACTION: Approved ☒ Disapproved ☐ Signature: Alex Smith

REMARKS OR REASONS FOR DISAPPROVAL ____

FINAL ACTION ON SITE CLEARANCE: Approved ☐ Disapproved ☐

Date Applicant Notified: ____ Signature ____

FORM HD-32(67) APPLICATION FOR PERMIT
TO CONSTRUCT INDIVIDUAL SEWAGE
DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 338

DATE: 7-2-73

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. T 9 N; Range R6E; Section 4;
Block _____; Lot _____; Addition _____;
Street Address _____.

2. Property Use: Residential _____ ☐; Commercial _____ ☒
No. of Bed Rooms _____ Describe: To construct sump, pump system pipeline and absorption field for present septic tank.

Other Use _____ ☐
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

Yankee Hill Brick Mfg Co.
H.E. Petty, Pres
Signature of Applicant (owner or lessee)

R-1 Lincoln NE 68502
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ 30.00

2. Date Site Clearance _____

3. Site Visits:
Date: _____ by: _____
Date: _____ by: _____
Date: _____ by: _____

4. Date: Approved ☒; Disapproved ☐: 7/2/73
by: Jerrold C. Hood R.S.

5. BUREAU OF LICENSES & PERMITS
Date Notified: _____
Date Issued: 7-2-73 Serial 28702

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: _____ by: _____

FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

FILE NO. 338

PROPERTY WHERE SOIL TESTED:
Location: Township T-9-N R6E
Section & ¼ Sect. N½ SW¼ SECT 4
Property Dimensions: ____ ft. x ____ ft.
Area: 65 acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☐; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☒

Owner: YANKEE HILL BRICK MFG Co.
Address R-1 LINCOLN NE. 68502

Dates of Tests: 6-27-73 to 6-29-73. Weather: Precip. 0 Temp. 80°F

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	35	6-27	1PM	6-29	7A	6-29	12:00	22.0	12:30	23.75	30	1.75	17.1
2	33	6-27	1P	6-27	2P	6-27	4:50	26.0	5:00	28.5	10	2.5	4.0
3	36	6-27	1P	6-29	7A	6-29	1200	20.5	12:30	21	30	0.5	60.0
4	33	6-27	1P	6-27	2P	6:27	4:54	26.5	5:04	28	10	1.5	6.7
5	32	6-27	1P	6-29	7A	6-29	1200	23.0	12:30	24.5	30	1.5	20.0
6	33	6-27	1P	6-29	7A	6-29	12 00	24.25	12:30	25.5	30	1.25	24.0
7	39	6-27	1P	6-29	7A	6-29	12 00	27.0	12:30	28.5	30	1.5	20.0
8	36	6-27	1P	6-29	7A	6-29	12 00	23.75	12:30	24.75	30	1.0	30.0

Sum of Percolation Rates 181.8
Average of Rates: 22.7
Mean of Rates: 20

H E Petty
Signature of Person Conducting Test

Address ~~H E Petty~~ R-1
Phone: 432-6661

(Do not write below this line)

REVIEWING ACTION

REMARKS: _____

Approved Percolation Rate(s)
A. 22.7 min./inch
B. _____ min./inch
C. _____ min./inch

DATE: July 2, 1973

Jerrold C. Wood R.S
Signature of Reviewing Official

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 338

SPECIFICATIONS

DATE: July 2-73

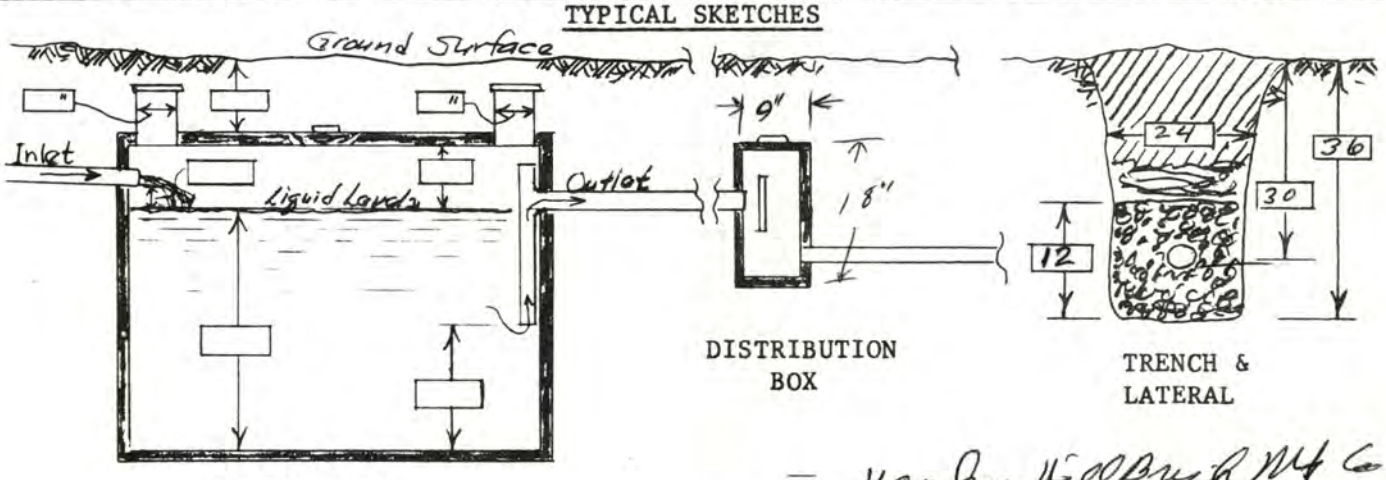
A. BUILDING SEWER:
1. Material _____; Diameter ____ in.
2. Distance above basement floor ____in.; or below basement floor ____in.
3. Distance between dwelling and septic tank ____ft.
4. Number of clean-outs _____.
5. Distances To:
Well or Suction Line ____ft.;
Stream ____ft.; Pressure Line ____ft.;
Property Line ____ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material _____; No. of compartments _____.
2. Capacity _____gals.; Liquid depth ____in.
3. Factory Built: Yes ☐ (Company _____)
No ☐
4. Manholes: Over Inlet; diam. ____in.
Over Outlet; diam. ____in.
Below Grade _____in.
5. Inlet: Baffle ☐; or Tee ☐
6. Outlet: Baffle ☐; or Tee ☐
Depth of outlet below inlet ____in.
7. Depth of top of tank below finished grade ____in.
8. Distances To:
Well or Suction Line ____ft.;
Stream ____ft.; Pressure Line ____ft.;
Property Line ____ft.

C. DISTRIBUTION BOX
1. Material CONCRETE; No. available outlets 5.
2. Factory Built: Yes ☑, (Company PRECAST STEP) No ☐
3. Dimension: Length 24 in.; Width 9 in. Depth 18 in.
4. Distance from Septic Tank 800 ft.
5. Serial Distribution: Yes ☐, No ☒ (If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: ABSORPTION TRENCH
2. Lateral Lines: Depth below grade 30 in. Number 5; Length of each line 100 ft Total length of Laterals 500 ft.; Slope 3" in/100 ft. Diameter of pipe 4 in.; Shape ROUND Material: concrete ☐; fiber asbestos ☐; clay ☒; other _____ Distance between lateral lines 15 ft.
3. Trench Dimensions: Depth 36 in.; Width 24 in.
4. Filter Material: WASHED GRAVEL. Depth of material from trench bottom 12 in.
5. Distances To:
Well or Suction Line ____ft.;
Stream 825 ft.; Pressure Line 220 ft.
Property Line 200 ft.
6. Percolation Rate: 22.7 minutes/inch

TYPICAL SKETCHES

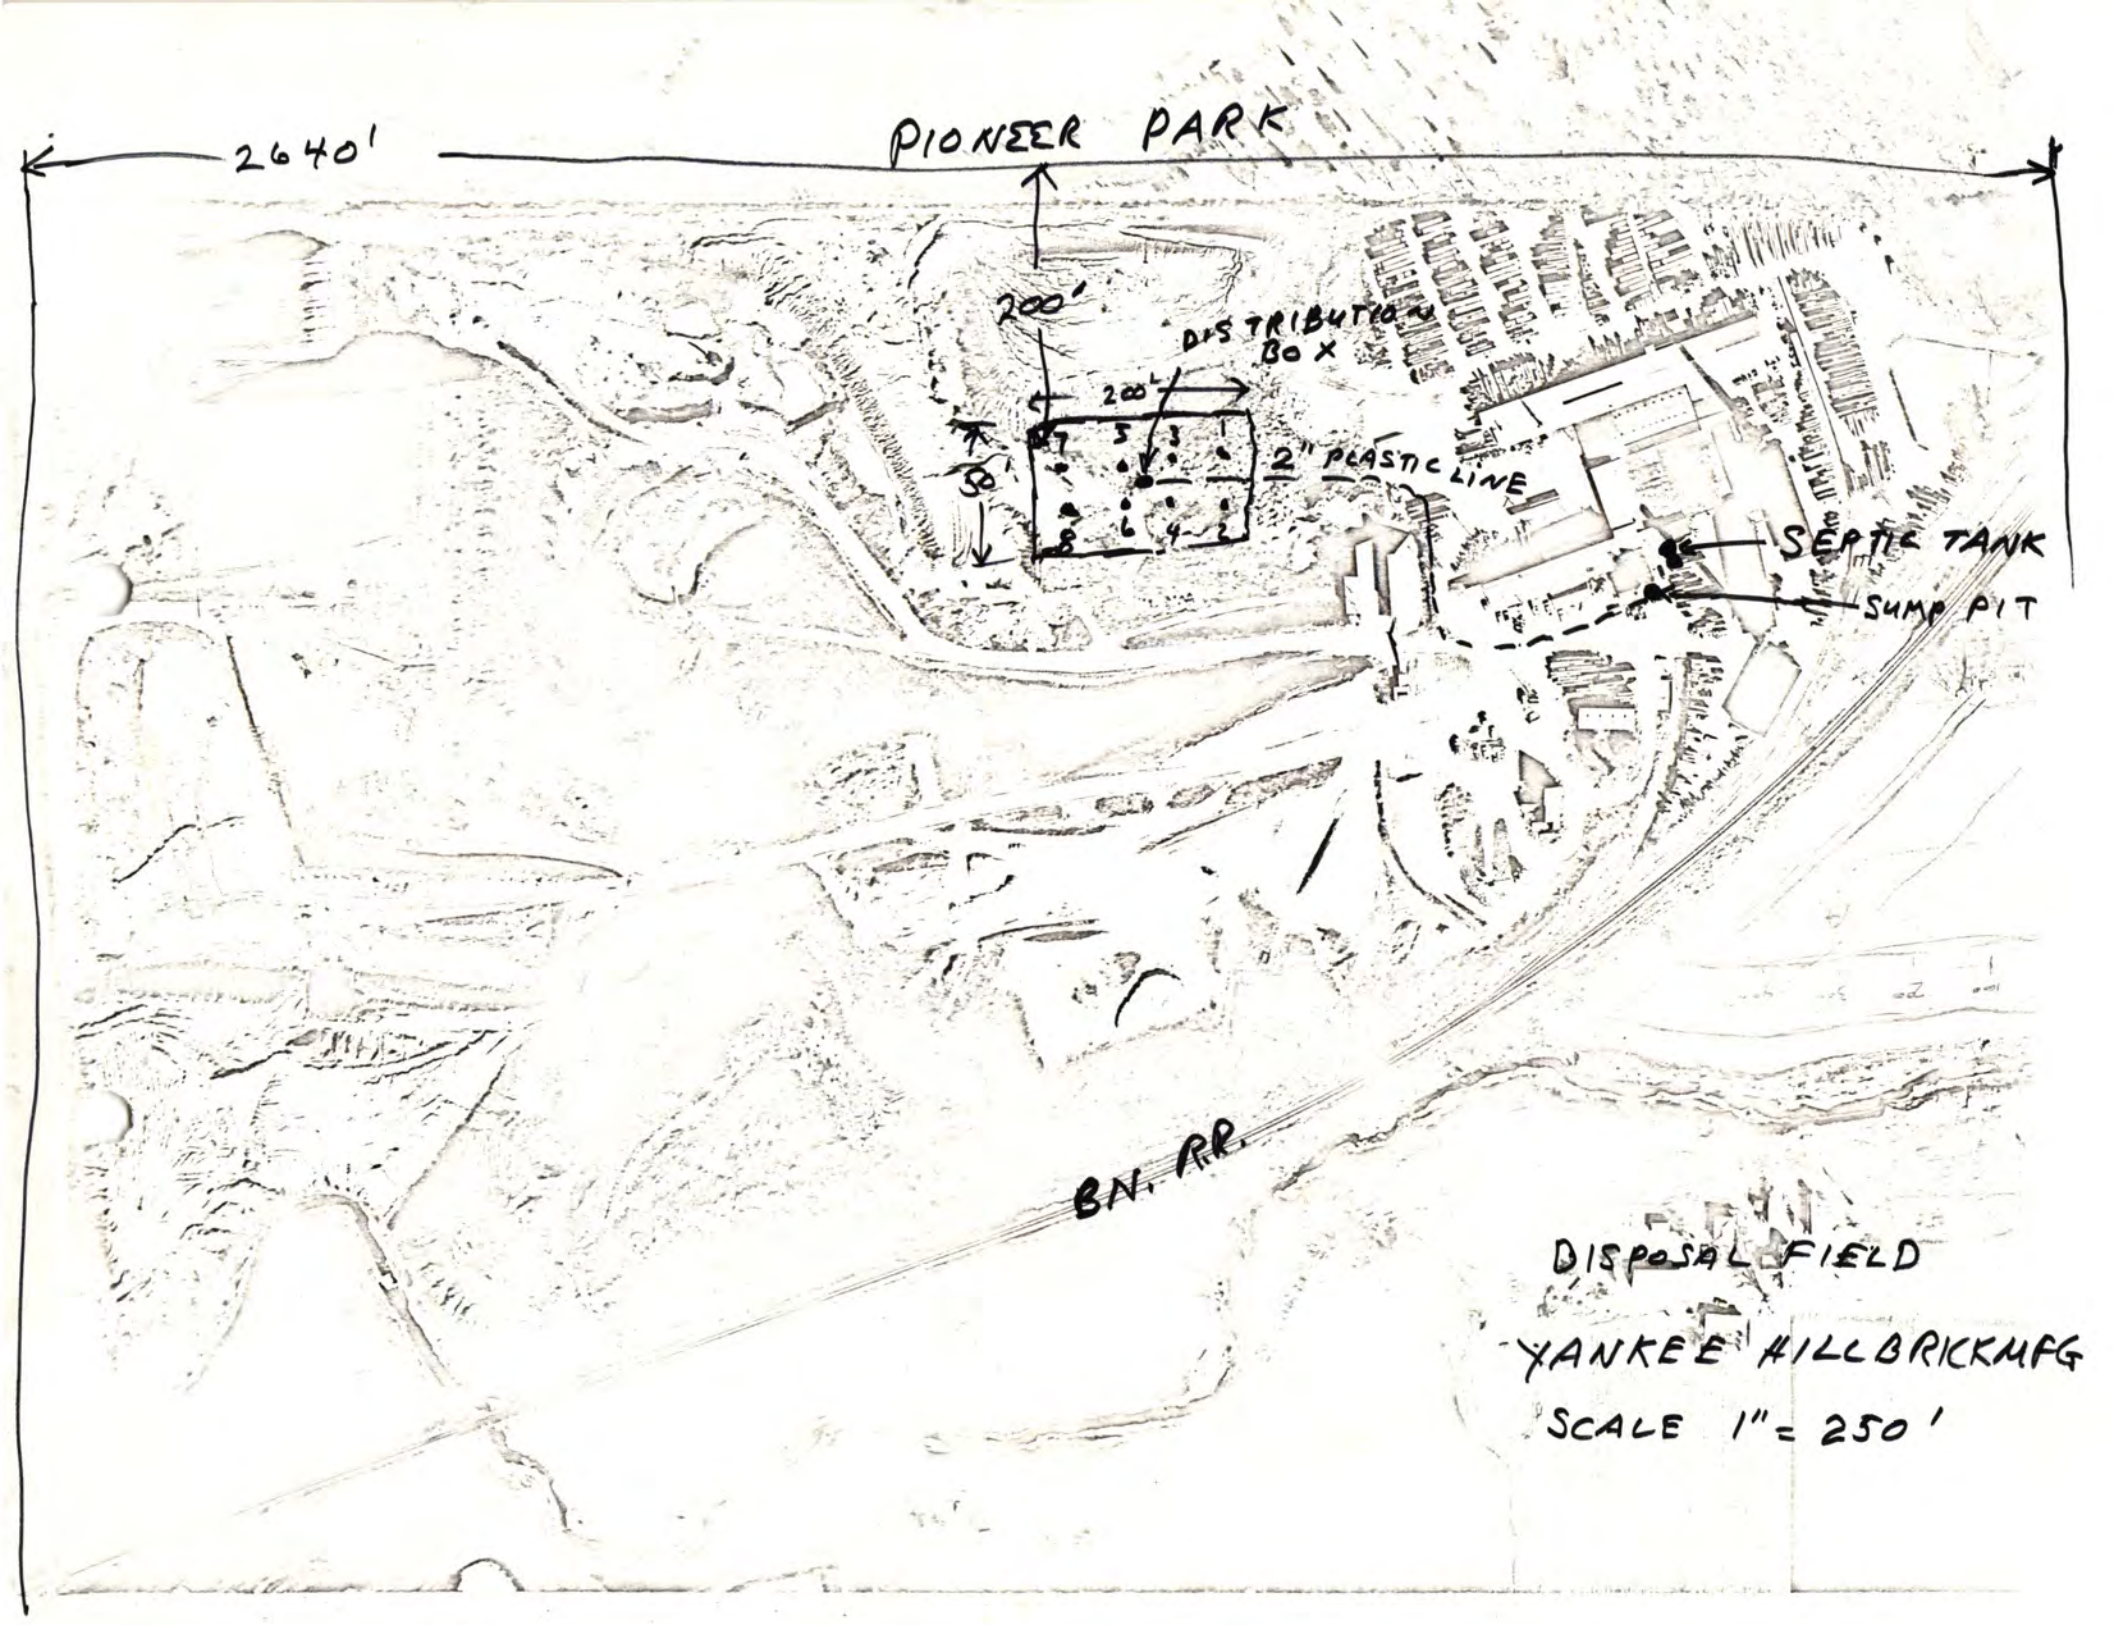


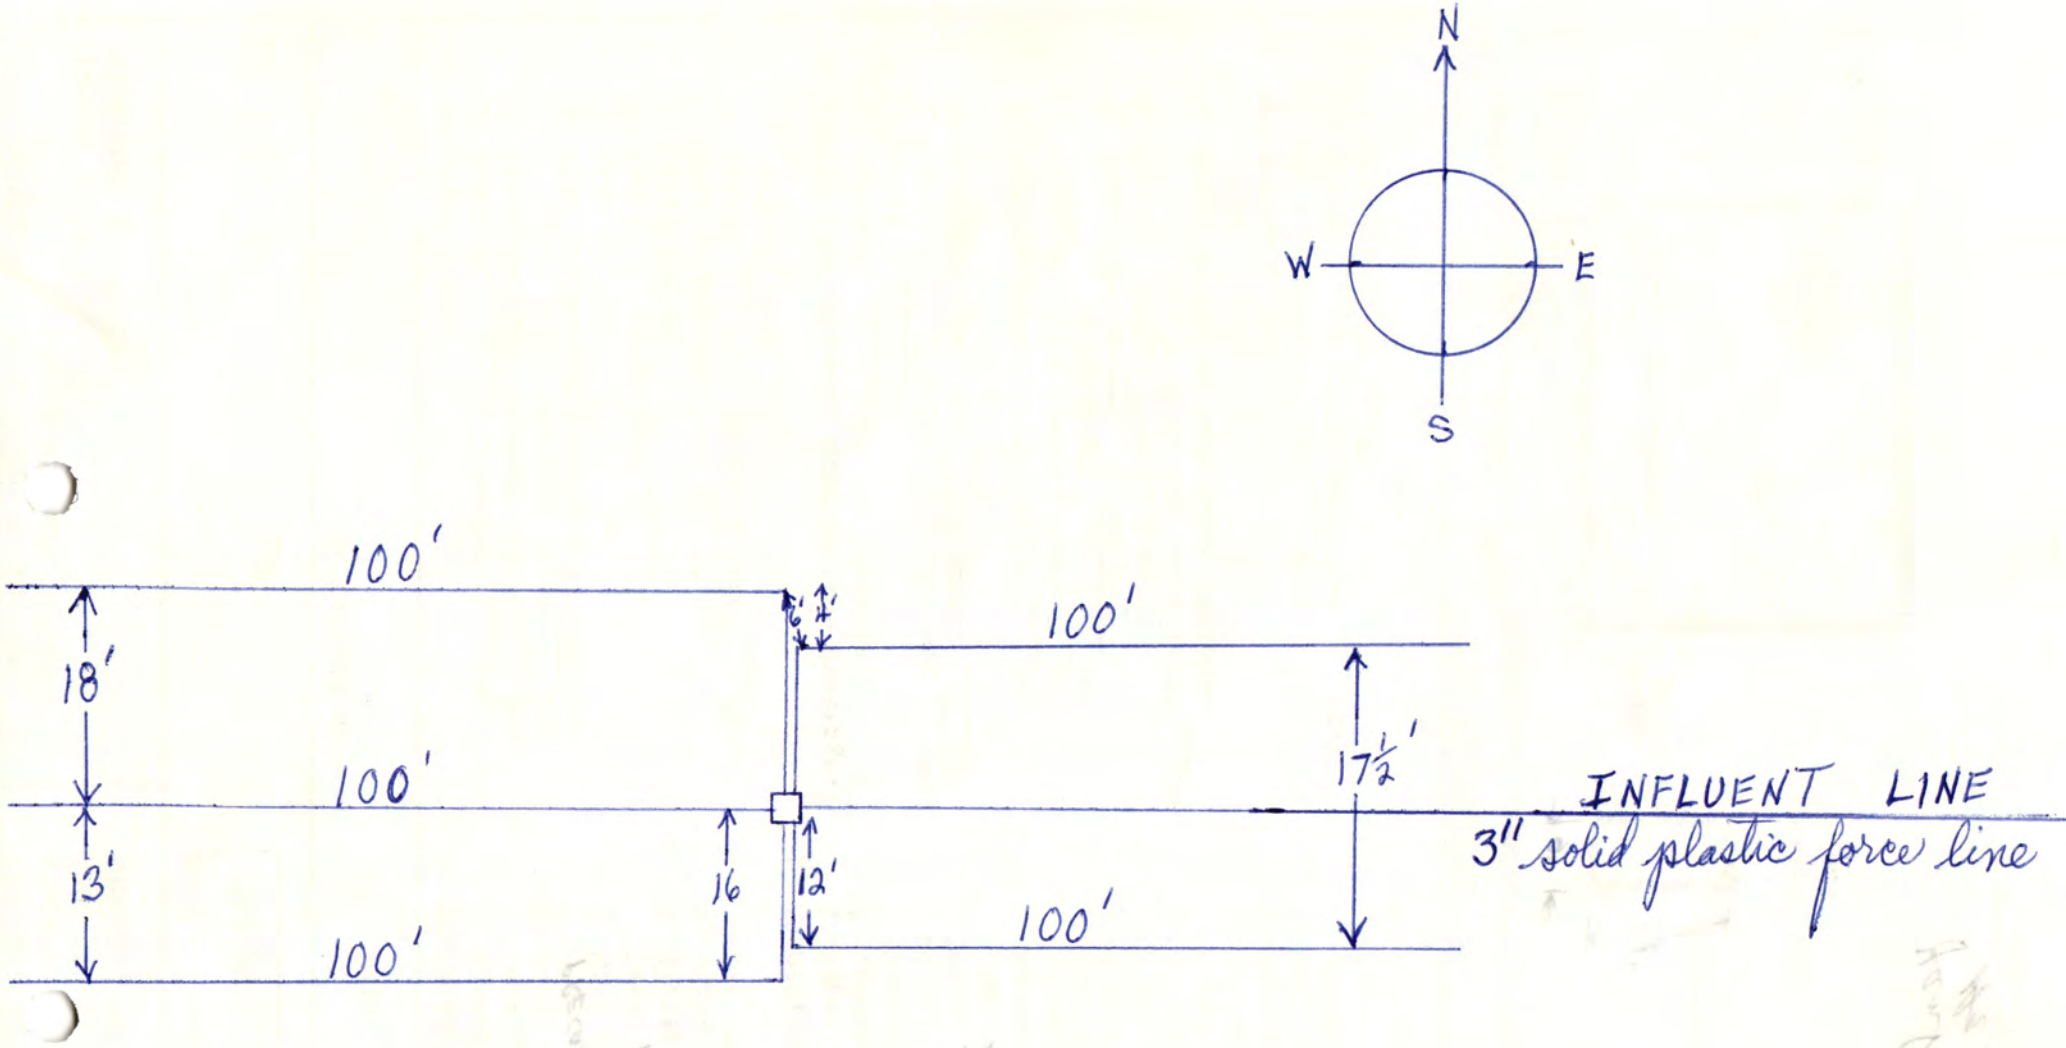
SEPTIC TANK

DISTRIBUTION BOX

TRENCH & LATERAL

Van Doe Hill Brick Mfg Co
H. Pettit Pres.
Signature of Applicant


2640'
PIONEER PARK
200'
DISTRIBUTION BOX
200'
50'
2" PLASTIC LINE
SEPTIC TANK
SUMP PIT
BN. RR.
DISPOSAL FIELD
YANKEE HILL BRICK MFG
SCALE 1" = 250'


N
W
E
S
100'
18'
100'
13'
100'
16
12'
100'
100'
17½'
INFLUENT LINE
3" solid plastic force line

FILE NO. 338

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

January 2, 1974 — THIS LICENSE OR PERMIT EXPIRES

(Alteration costing more than $200)

Yankee Hill Brick Manufacturing Co. — LICENSEE OR PERMITTEE

Rt. 1, Lincoln — ADDRESS

T9N; R6E; Section 4

NAME OF ESTABLISHMENT, IF ANY — LEGAL DESCRIPTION — ADDRESS

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624-110.15	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW