FILE NO. 321

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

August 23, 1973 — THIS LICENSE OR PERMIT EXPIRES

Sharon Meints — LICENSEE OR PERMITTEE

4000 Cornhusker Highway — ADDRESS

T9N; R6E; Sec. 4; Lot 20; Stockwell Add. — NAME OF ESTABLISHMENT, IF ANY

LEGAL DESCRIPTION — ADDRESS

REMARKS: NON-Transferable

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624 10.15	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-30(67) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 321

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. 9N; Range 6E; Section 4;
Block ___; Lot 20; Addition STOCKWELL ADDITION
Street Address EAST 150' OF N 440' LOT 20

2. Property Use: Residential ☒; Commercial ☐
No. of Bedrooms 3. Describe: ___
Other Use ☐
Describe: ___

3. Type of Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Distance to public sewer: ___ ft.

Sharon Mentz
Signature of Applicant (owner or lessee)

4000 Cornhusker Lot 12A
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 2/23/73. Date Frwd. 2/23/73.
ACTION: Approved ☐ Disapproved ☒
Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: Date Rec'd. 2-23-73. Date Frwd. 2-23-73.
ACTION: Approved ☐ Disapproved ☒
Signature: Chas Seals by BS

3. City Engineer: Date Rec'd. 2-23-73. Date Frwd. same.
ACTION: Approved ☐ Disapproved ☒
Signature: H. Rex Smith

REMARKS OR REASONS FOR DISAPPROVAL ___

FINAL ACTION ON SITE CLEARANCE: Approved ☐ Disapproved ☐

Date Applicant Notified: ___ Signature ___

FORM HD-32(67) APPLICATION FOR PERMIT
TO CONSTRUCT INDIVIDUAL SEWAGE
DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 321

DATE: _____

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 9N; Range 6E; Section 4;
Block _____; Lot 20; Addition STOCKWELL
Street Address EAST 150' OF N 440' LOT 20.

2. Property Use: Residential _____ ☒; Commercial _____ ☐
No. of Bed Rooms 3 Describe: _____

Other Use _____ ☐
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

Sharon Meints
Signature of Applicant (owner or lessee)

4000 Cornhusker Lot 12A
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ 30.00

2. Date Site Clearance _____

3. Site Visits:
Date: 5/14/73 by: J.C.H.
Date: _____ by: _____
Date: _____ by: _____

4. Date: Approved ☒; Disapproved ☐: 2/23/73
by: Jerrold C. Hood

5. BUREAU OF LICENSES & PERMITS
Date Notified: _____
Date Issued: _____ Serial _____

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: 5/14/73 by: Jerrold C. Hood

FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

FILE NO. 321

PROPERTY WHERE SOIL TESTED:
Location: Township _____
Section & ¼ Sect. _____
Property Dimensions: ____ft. x ____ ft.
Area: _____acres. (Attach sketch of property showing hole location).

Owner: Rolland D Starr
Address 4200 S 37th

Soil Type: Silty Clay ☐; Silty Clay Loam ☐; Sandy Loam ☐
Silty Loam ☒; Clay Loam ☐; Sandy Clay ☐

Dates of Tests: 4/22/72 to 4/23/72. Weather: Precip. Fair Temp. 55F.

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	36	4/22	11 AM	4/23	11 AM	4/23	11 AM	12	5 11/16	6 1/4	60	1/4	
2		"	"	"	"	"				6 1/8		1/8	
3		"	"	"	"	"				6			
4		"	"	"	"	"				5 15/16		1/16	
5		"	"	"	"	"				5 7/8		1/16	
6		"	"	"	"	"				5 13/16		1/16	

Sum of Percolation Rates _____
Average of Rates: _____
Mean of Rates: _____

Signature of Person Conducting Test

Address _____
Phone: _____

(Do not write below this line)

REVIEWING ACTION

REMARKS: _____

Approved Percolation Rate(s)
A. 29 min./inch
B. _____ min./inch
C. _____ min./inch

DATE: April 24, 1972

Carroll C. Hood
Signature of Reviewing Official

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 321

SPECIFICATIONS

DATE: _____


A. BUILDING SEWER:
1. Material PLASTIC; Diameter 4 in.
2. Distance above basement floor ____in.; or below basement floor ____in.
3. Distance between dwelling and septic tank 27 ft.
4. Number of clean-outs 1.
5. Distances To:
Well or Suction Line ____ft.;
Stream — ft.; Pressure Line ____ft.;
Property Line ____ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material CON; No. of compartments 1.
2. Capacity 1000 gals.; Liquid depth ____in.
3. Factory Built: Yes ☒ (Company PRE-CAST STEP
No ☐
4. Manholes: Over Inlet; diam. 6 in.
Over Outlet; diam. 6 in.
Below Grade ____in.
5. Inlet: Baffle ☐; or Tee ☐
6. Outlet: Baffle ☐; or Tee ☒
Depth of outlet below inlet ___in.
7. Depth of top of tank below finished grade ____in.
8. Distances To:
Well or Suction Line ____ft.;
Stream — ft.; Pressure Line ____ft.;
Property Line ____ft.


C. DISTRIBUTION BOX
1. Material CON; No. available outlets 5.
2. Factory Built: Yes ☒, (Company PRE CAST STEP No ☐
3. Dimension: Length ____in.; Width ___in. Depth ____in.
4. Distance from Septic Tank 9½ ft.
5. Serial Distribution: Yes ☐, No ☒ (If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: HALF ROUND
2. Lateral Lines: Depth below grade ___in. Number 2; Length of each line 90 ft Total length of Laterals 184 ft.; Slope 4 in/100 ft. Diameter of pipe 4 in.; Shape ○
Material: concrete ☒; fiber asbestos ☐; clay ☐; other ____
Distance between lateral lines 11 ft.
3. Trench Dimensions: Depth 40 in.; Width 48 in.
4. Filter Material: GRAVEL.
Depth of material from trench bottom ____in.
5. Distances To:
Well or Suction Line ____ft.;
Stream — ft.; Pressure Line ____ft.
Property Line ____ft.
6. Percolation Rate: 29 minutes/inch

TYPICAL SKETCHES

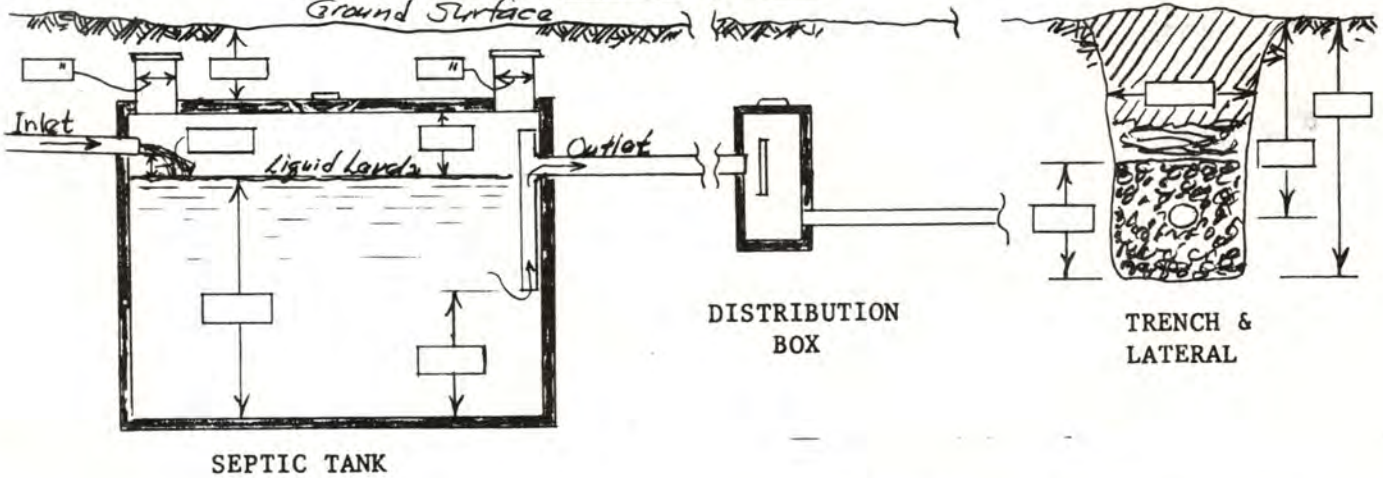

Signature of Applicant

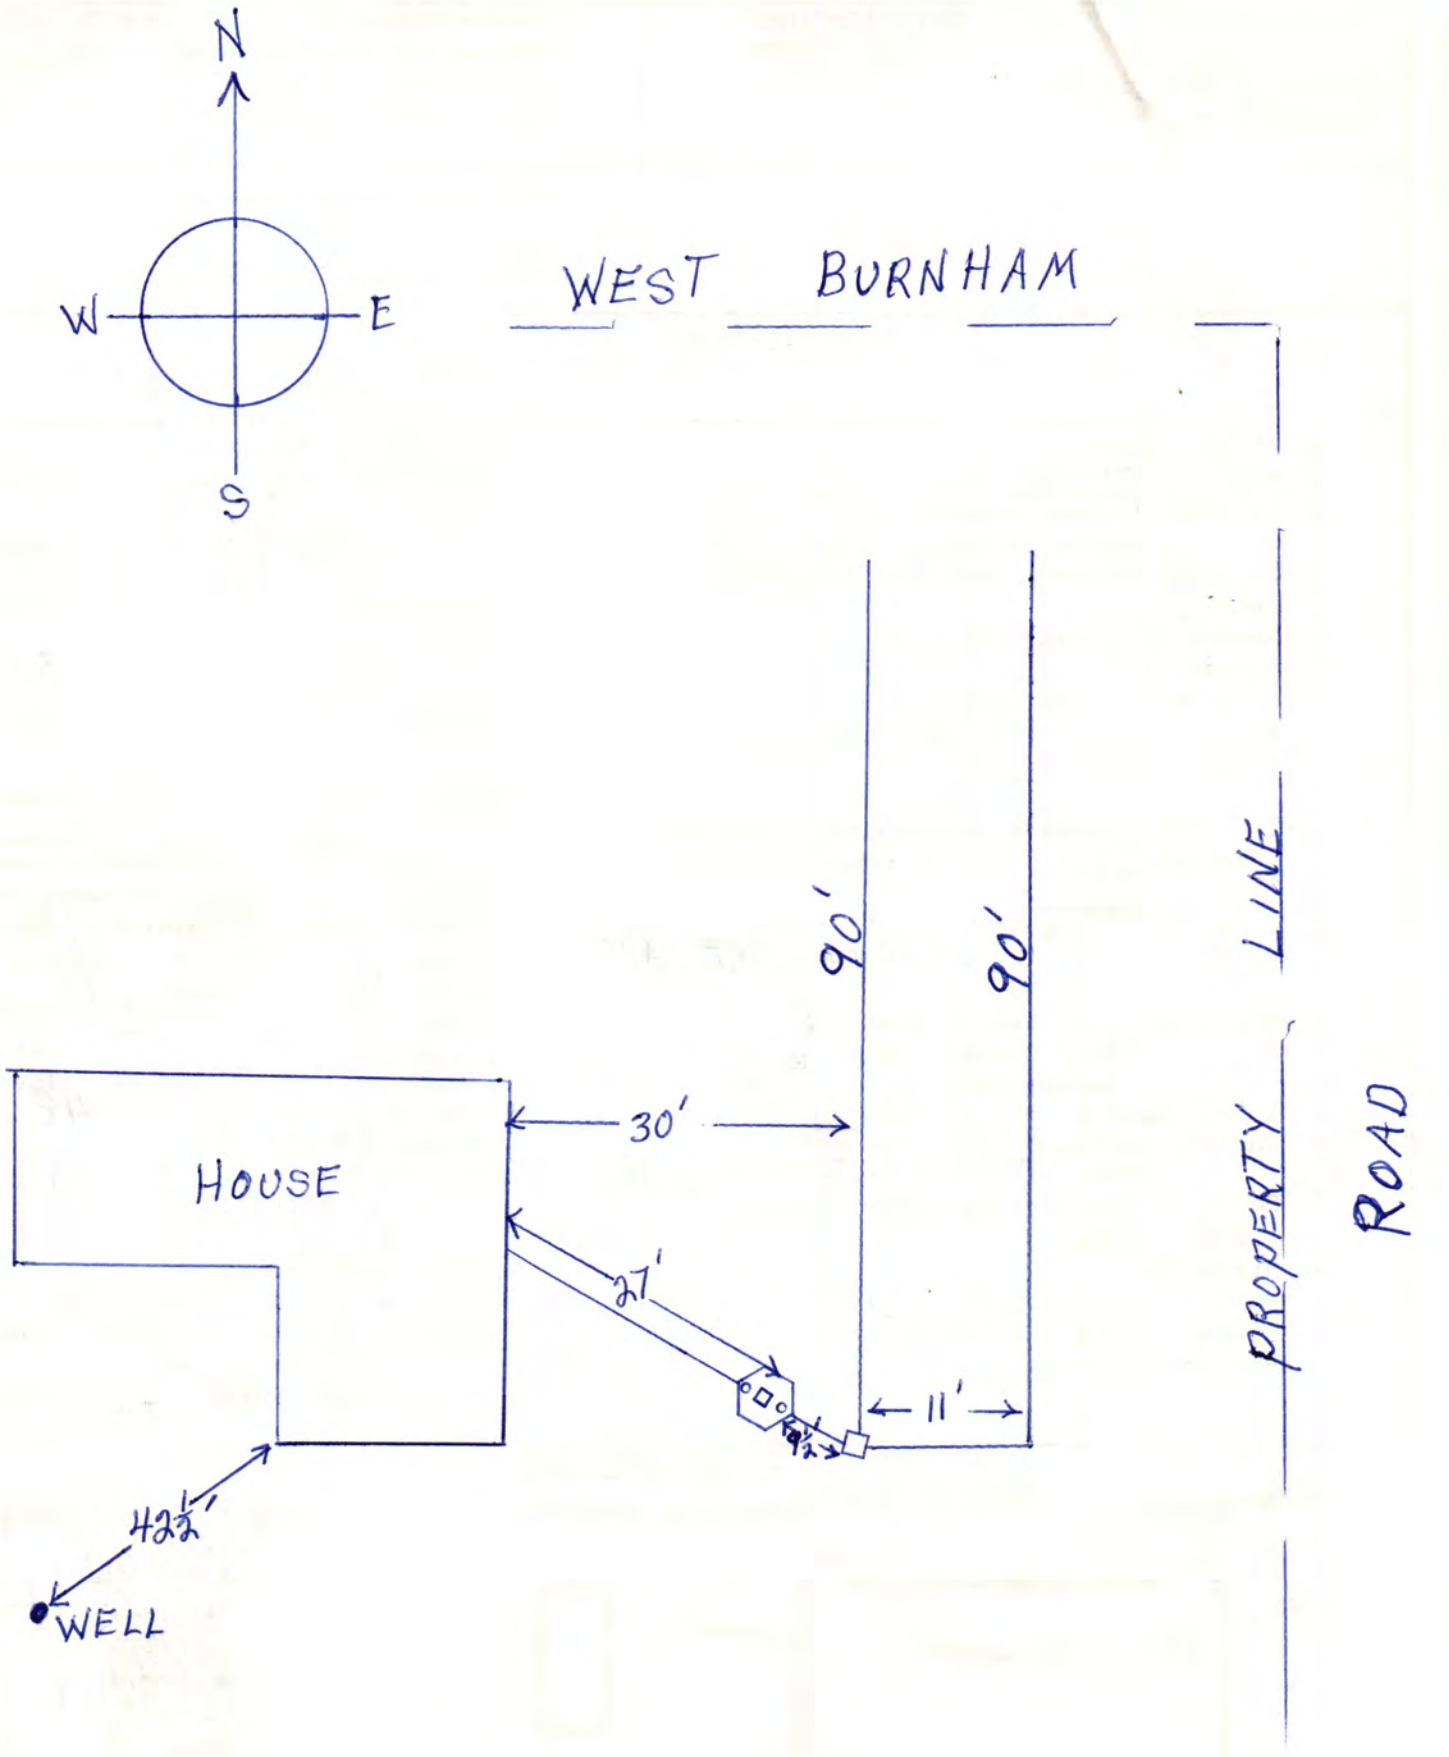
N
W
E
S
WEST BURNHAM
90'
90'
30'
HOUSE
27'
11'
9½'
42½'
WELL
PROPERTY LINE
ROAD

e16

Lincoln-Lancaster County Health Department

2200 St. Mary's Avenue, Lincoln, Nebraska 68502 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: Lincoln-Lancaster County Health Department or LLCHD

☒ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

☐ Evaluation of the Individual Water System ☒ Evaluation of the Sewage Disposal System

Legal Description of Property: Street Address 1201 W. Burnham

Twp 9N Range 6E Section 4 1/4 ___ 1/4 ___ Block ___ Lot 20 Addition ___

Directions to Property Stockwell SE 4-9-6 E 150' N 440'

Location of Well 50' S. of House ? Tap Location: Inside ☐ Outside ☐

Location of Sewage System 50' E. of House - Laterals run N. Year Installed 1973

	NAME	ADDRESS	PHONE
Present Owner:	Leroy Meints	1201 W. Burnham Lincoln Ne 68522	423-5294
Tenant/Buyer:	Tony R. Ahrens	1508 W. Rose Lincoln Ne 68522	438-2365
Return to:	Columbus Federal attn. Karen Hart	Suite 125 770 N. Cotner Blvd Lincoln Ne 68505	464-4444

Signature of Applicant Tony R. Ahrens Address 1508 W Rose Lincoln, Ne. 68522 Date 7/20/94

HEALTH DEPARTMENT USE ONLY

Date Received 7/21/94 Received $150.00 Check ☒ Cash ☐

PRELIMINARY STATUS--By Gerald C. Hood **DATE:** 7/22/94

WATER SYSTEM:	Approved	Disapproved	**SEWAGE SYSTEM**	**Additional Site Visits**
Construction	☒	☐	Approved ☒	Date 7/27/94 by JCK
Bacteria	☒ 0 /ml	☐ ___ /ml	Provisional ☐	Date 7/28/94 by JCK
Nitrate	☒ 2.5 ppm	☐ ___ ppm	Disapproved ☐	Date ___/___/___ by ___

Comments: SEPTIC TANK SHOULD BE CHECKED TO SEE IF IT NEEDS PUMPING.

See Attached Letter ☐

FINAL STATUS

WATER SYSTEM: Approved: ☒ **SEWAGE DISPOSAL SYSTEM** Approved: ☒ Provisional Approval: ☐

Approved by Gerald C. Hood R.E.H.S. Date 7/29/94

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.