FILE NO. 352

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

February 20, 1974 — THIS LICENSE OR PERMIT EXPIRES

City Parks Department — LICENSEE OR PERMITTEE

2740 A Street — ADDRESS

T9N; R6E; Section 5; — NAME OF ESTABLISHMENT, IF ANY

LEGAL DESCRIPTION — ADDRESS

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ No fee	$	$	$	$ No fee

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624-1535 110.15	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT
	2/20/73	

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-30(67) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

PIONEER PARK RESTROOM

FILE NO. 352

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. 9N; Range 6E; Section 5;
Block ____; Lot ____; Addition ____;
Street Address So. CODDINGTON & CALVERT

2. Property Use: Residential ____ ☐; Commercial ____ ☐
No. of Bedrooms ____. Describe: ____

Other Use ____ ☒
Describe: PUBLIC PARK USE

3. Type of Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Distance to public sewer: 8000 ft.

John H Schweers
Signature of Applicant (owner or lessee)

2740 'A' ST.
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 8/17/73. Date Frwd. 8/20/73.
ACTION: Approved ____ ☒ Disapproved ☐
Signature: Jerrold C. Hoak

2. Supt. Bldg. Insp.: Date Rec'd. 8/20/73. Date Frwd. ____.
ACTION: Approved ____ ☒ Disapproved ☐
Signature: Charles Seale By R.A.

3. City ~~Engineer~~: Date Rec'd. 8/20/73 Date Frwd. ____.
ACTION: Approved ____ ☒ Disapproved ☐
Signature: [illegible]

REMARKS OR REASONS FOR DISAPPROVAL ____

FINAL ACTION ON SITE CLEARANCE: Approved ☒ Disapproved ☐

Date Applicant Notified: 4-12-74 Signature James Weverka

FORM HD-32(67) APPLICATION FOR PERMIT
TO CONSTRUCT INDIVIDUAL SEWAGE
DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

PIONEER PARK RESTROOM

FILE NO. 352

DATE: August 13, 1973

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 9 N ; Range 6E ; Section 5 ;
Block _____; Lot _____; Addition _____;
Street Address So. CODDINGTON & CALVERT

2. Property Use: Residential _____ ☐; Commercial _____ ☐
No. of Bed Rooms _____ Describe: _____

Other Use _____ ☒
Describe: PUBLIC PARK USE

3. Type of Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

John H Schweers
Signature of Applicant (owner or lessee)

2740 "A" ST. - LINCOLN
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ No Fee

2. Date Site Clearance 4-12-74

3. Site Visits:
Date: 4-12-74 by: jw
Date: _____ by: _____
Date: _____ by: _____

4. Date: Approved ☒; Disapproved ☐: 8/20/73
by: Jerrold C. Hood

5. BUREAU OF LICENSES & PERMITS
Date Notified: _____
Date Issued: _____ Serial _____

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: 4-12-74 by: James Wewerka

FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

PIONEER PARK RESTROOM

FILE NO. 352

PROPERTY WHERE SOIL TESTED:
Location: Township 9N
Section & ¼ Sect. 5
Property Dimensions: ____ ft. x ____ ft.
TOTAL Area: 610 acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☐; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☒ WITH SOME CINDERS

Owner: LINCOLN PARKS & RECREATION DEPT.
Address 2740 "A" ST. - LINCOLN

Dates of Tests: 12/22/72 to 12/22/72. Weather: Precip. 0 Temp. 49°F

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	24	12/21	2:00	12/22	10:45	12/22	11:40	27 3/4	11:50	28 5/8	10	7/8	11.4
2	20	12/21	2:00	12/22	10:47	12/22	11:41	26 7/8	11:51	27 1/4	10	3/8	26.7
3	18	12/21	2:00	12/22	10:49	12/22	11:42	23 1/8	11:50	23 7/8	8	3/4	10.7
4	15	12/21	2:00	12/22	10:50	12/22	11:43	23 1/2	11:48	24 3/8	5	7/8	5.7

Sum of Percolation Rates 54.5
Average of Rates: 13.625
Mean of Rates: 16.2

John H Schweers
Signature of Person Conducting Test

Address 2740 'A' ST. - LINCOLN
Phone: 475-6734 EXT. 35

(Do not write below this line)

REVIEWING ACTION

REMARKS: _____

DATE: _____

Approved Percolation Rate(s)
A. _____ min./inch
B. _____ min./inch
C. _____ min./inch

_____
Signature of Reviewing Official

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

Pioneers Park

FILE NO. 352

SPECIFICATIONS

DATE: 7/17/73


A. BUILDING SEWER:
1. Material Cast Iron; Diameter 4 in.
2. Distance above basement floor ___ in.; or below ~~basement~~ Finished floor ~~30~~ 36 in.
3. Distance between dwelling and septic tank 30 ft.
4. Number of clean-outs 1.
5. Distances To:
Well or Suction Line — ft.;
Stream 550 ft.; Pressure Line 350 ft.;
Property Line 550 ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material Conc.; No. of compartments 1.
2. Capacity 1,500 gals.; Liquid depth 71 in.
3. Factory Built: Yes ☒ (Company ____)
No ☐
4. Manholes: Over Inlet; diam. 9 in.
Over Outlet; diam. 9 in.
Below Grade 12 in.
5. Inlet: Baffle ☐; or Tee ☒
6. Outlet: Baffle ☐; or Tee ☒
Depth of outlet below inlet 1 in.
7. Depth of top of tank below finished grade 12 in.
8. Distances To:
Well or Suction Line ~~300~~ 320 ft.;
Stream 600 ft.; Pressure Line 320 ft.;
Property Line 600 ft.

C. DISTRIBUTION BOX
1. Material Conc.; No. available outlets 2.
2. Factory Built: Yes ☐, (Company ____) No ☒
3. Dimension: Length ___ in.; Width ___ in. Depth ___ in. as Req'd
4. Distance from Septic Tank 5 ft.
5. Serial Distribution: Yes ☐, No ☒ (If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: Horizontal
2. Lateral Lines: Depth below grade ~~24~~ 42 in. Number 2; Length of each line 100 ft Total length of Laterals 200 ft.; Slope 4 in/100 ft. Diameter of pipe 24 in.; Shape Half-round Material: concrete ☒; fiber asbestos ☐; clay ☐; other ____ Distance between lateral lines 8 ft.
3. Trench Dimensions: Depth 34 in.; Width ~~42~~ 48 in.
4. Filter Material: ½" to 1½" Sq'd. Depth of material from trench bottom 22 in.
5. Distances To:
Well or Suction Line — ft.;
Stream 600 ft.; Pressure Line ___ ft.
Property Line 600 ft.
6. Percolation Rate: 136 minutes/inch Ave.

TYPICAL SKETCHES

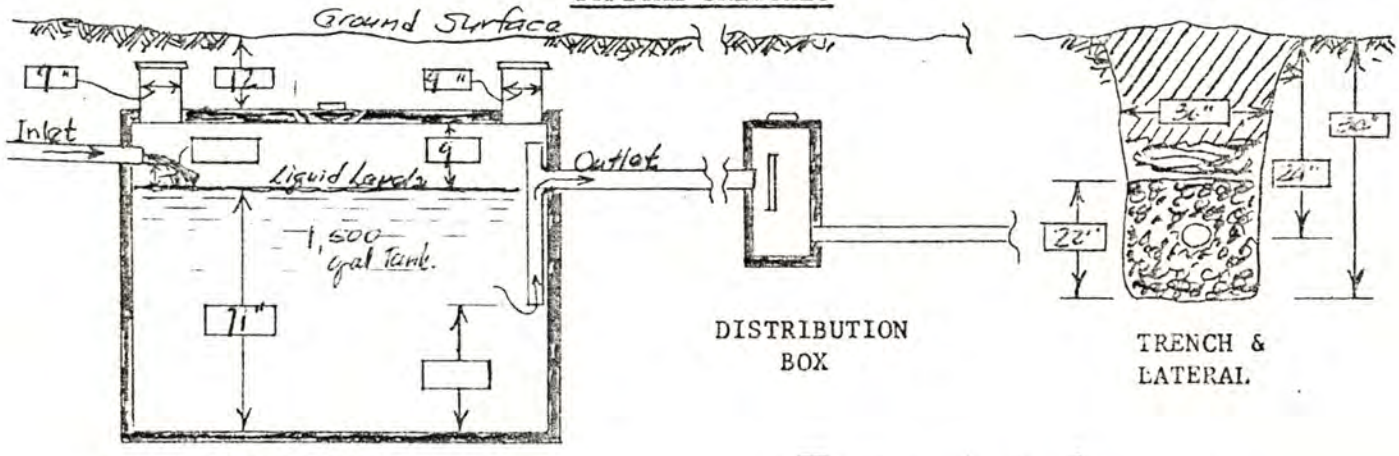


SEPTIC TANK

DISTRIBUTION BOX

TRENCH & LATERAL

Robert H. DeWeese
Signature of Applicant

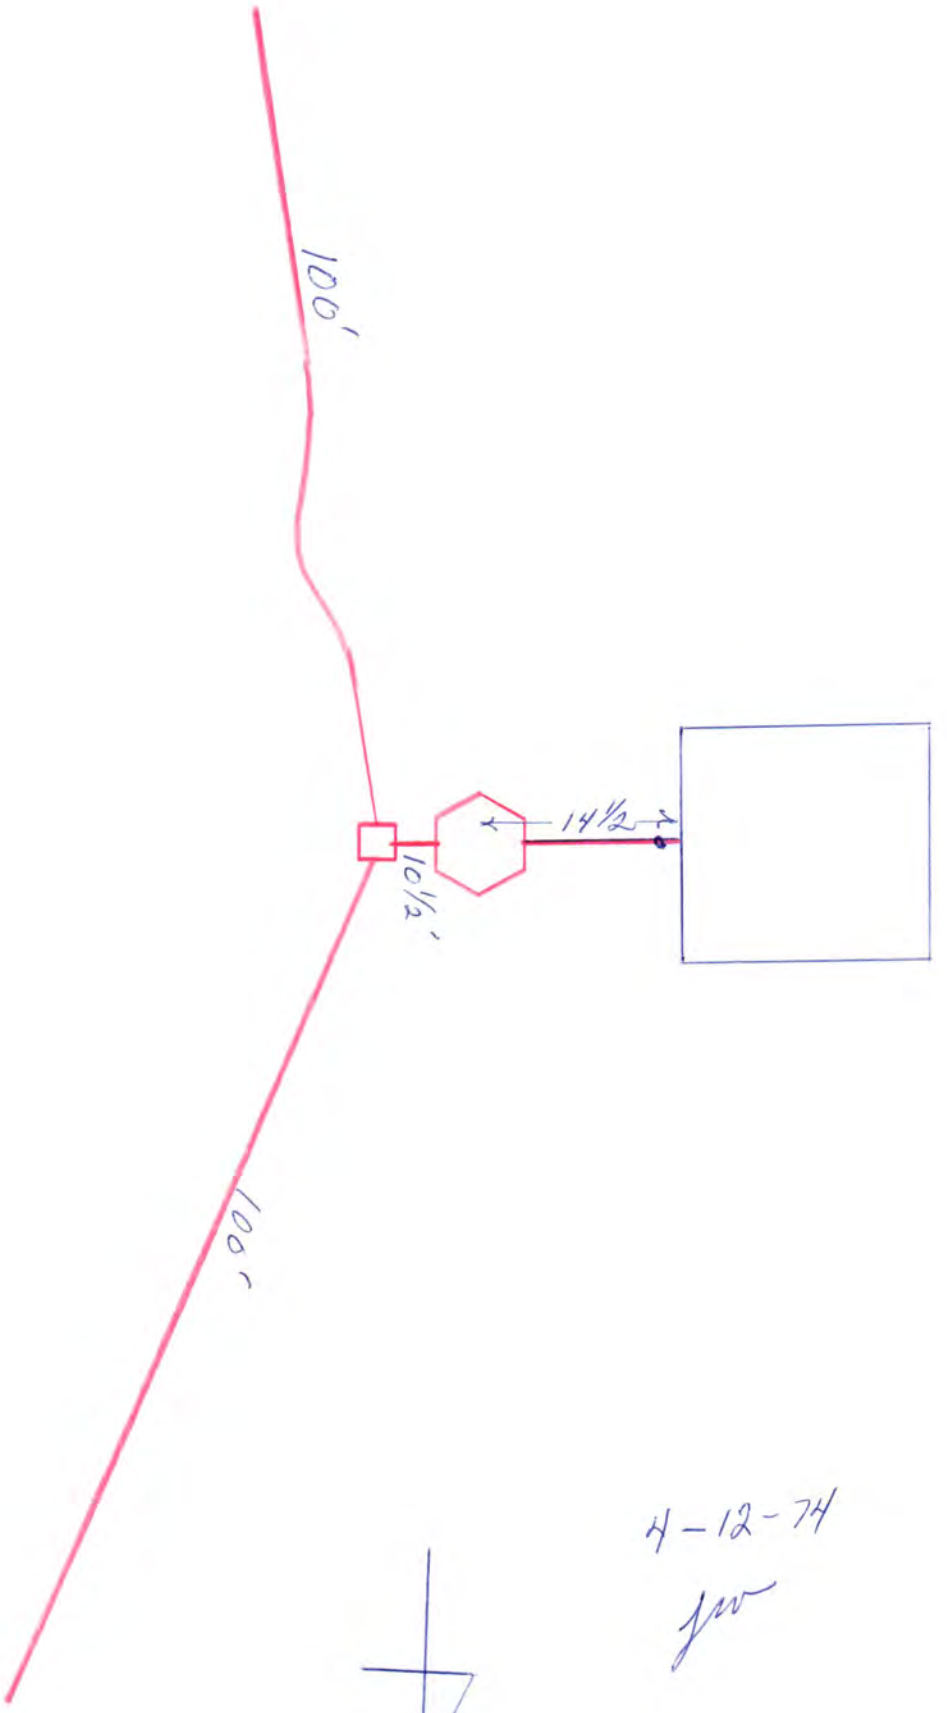

4-12-74