LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

3140 "N" STREET Lincoln, NE 68510-1514 (402) 441-8000

NON TRANSFERABLE

PERMIT

Permit
SEWAGE SYSTEM REPAIR
SEWAGE REPAIR

No. 98390058801

Issued 07/10/98
Expires 01/10/99
Revenue Code 3157

PAID

FEES: $50.00

Establishment
LARRY GEIGER
T9N R6E SEC 16 QTR SW
LOT 24IT
2251 W PLEASANT HILL RD

Permittee
LARRY GEIGER
2251 W PLEASANT HILL RD
LINCOLN NE 68523-9237

TOTAL $50.00

Issued By Health Director
Lincoln-Lancaster County Health Department

007820

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW "POST IN A PROMINENT PLACE"

Individual Sewage Disposal System
Application to Alter, Extend or Repair

❒Municipal Code 24.38 ❒County Resolution Number 2832

Date: 7/7/98	File No.:

The undersigned hereby applies for a permit to: ❒ **ALTER** ☒ **EXTEND** ❒ **REPAIR** an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. **Legal description of property:**
   Township 7N Range 6E Section 16E 1/4 Section SW
   Block _____ Lot 24 I.T. Addition _____
   Street Address 2251 W. PLEASANT HILL RD.

2. **Property use:** ☒ residential ❒ commercial ❒ other use
   Number of bedrooms 4 Describe 2 STORY HOME

3. **Type of Present Individual Disposal System:** ☒ septic tank ❒ lagoon ❒ other

4. **Description of proposed alteration, extension or repair:** REPLACE TANK & EXTEND LATERIALS 250'

5. **Work to be done by:** ❒ owner ☒ contractor's name DIRTWORKS PLUS

6. **Estimated project:** a. Repair, replace or minor extension with a cost of less than $400.00 (no fee required).
   b. Total cost is greater than $400.00 (Return fee with this application).
   c. A "construction permit" is required if the use, operation, location, or type of the system is being changed.

Print Name LARRY GEIGER Address 2251 W. PLEASANT HILL Phone 423-7057
Applicant Signature (owner or lessee) Larry Geiger

Please include the permit fee ($50.00) with this application

(Please do not write below this line)

Date rec'd 7/7/98 REVIEW: ☒ approved ❒ disapproved By: Jerrold Hood

Site visits:
Date 7/7/98 By J.C.H.
Date 7/7/98 By J.C.H.
Date _____ By _____

Installation final written approval
Date 7/15/98 By Jerrold Hood

Return to: Lincoln-Lancaster County Health Department - Environmental Health Division
3140 "N" Street, Lincoln, NE. 68510
441-8022

ck 1128
7/7/98
$50.00
cw

White - EH Pink - Business Office Revised 1/98

JUL 15 1998

D

Lincoln-Lancaster County Health Department
Environmental Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

Permit Number:

Sewage Disposal System

As Built Plans & Specifications

Date 7-13-98 Larry Geiger

System Location (Indicate correct number and street)

Address 2251 W. Pleasant Hill (no rural route) City LNK NE NE, Zip 68523

A. Building Sewer

1. Material: _____
   Diameter: _____ in.
2. Distance above basement floor: _____ in.
   or distance below basement floor: _____ in.
3. Distance between dwelling and septic tank: _____ ft.
4. Number of clean-outs: _____
5. Distances to: well or suction line _____ ft.
   stream _____ ft.
   pressure line _____ ft.
   property line _____ ft.

B. Septic Tank

1. Material: Conc.
   Number of compartments: 2
2. Capacity: 1000 gal.
3. Factory built: ☑ Yes ☐ No
4. Manholes: Over inlet, diameter _____ in.
   Over outlet, diameter _____ in.
   Riser: ☑ above ☐ below grade 24 in.
5. Inlet: ☑ baffle ☐ tee
6. Outlet: ☑ baffle ☐ tee
7. Depth to top of tank, below unfinished grade: 18 in.
8. Distances to: Well or suction line 75 ft.
   Stream NA ft.
   Pressure line NA ft.
   Property line 100+ ft.

C. Distribution Box

1. Material: Conc
   Number available outlets: _____
2. Factory built: ☑ Yes ☐ No
3. Distance from septic tank: 34 ft.

D. Absorption Field


(Provide as-built drawings on back of this form)

1. Type: ☐ Half rounds ☐ Perforated pipe
   Diameter of half round: Inf. Tractor
   or perforated pipe: _____
   Material: ☐ fiberglass ☑ plastic ☐ concrete
   ☐ other _____
2. Lateral lines: Number 2551
   Length of each line: 68 ft. 59.5 ft.
   68 ft. 59.5 ft., _____ ft.
3. Trench dimensions: Width 4 ft.
   Slope 2" in/100 ft.
   Average depth 30 in
4. Filter material: Gravel
   Depth of material 18 in.
5. Distances to: Well or suction line 100+ ft.
   Stream 100+ ft.
   Pressure line 100+ ft.
   Property line 20 ft.


Indicate North with Arrow

Complete "As Built" drawing on back of this form.

Individual Sewage System Design (Example)

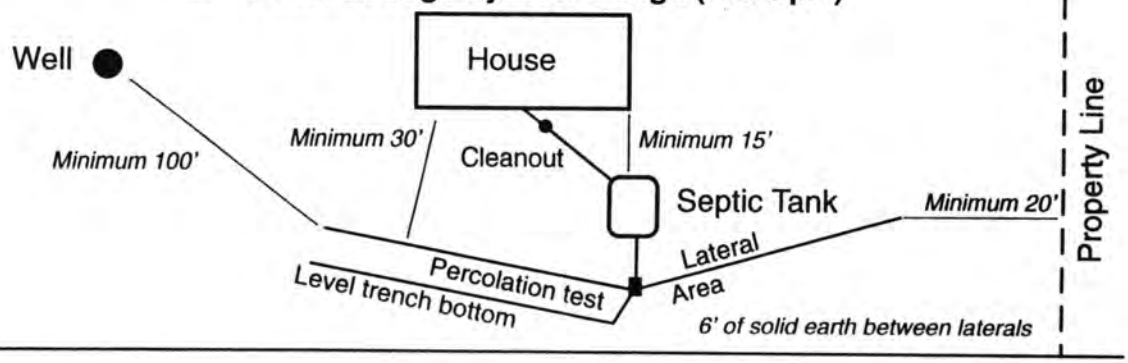

FORM 23-103 10-96

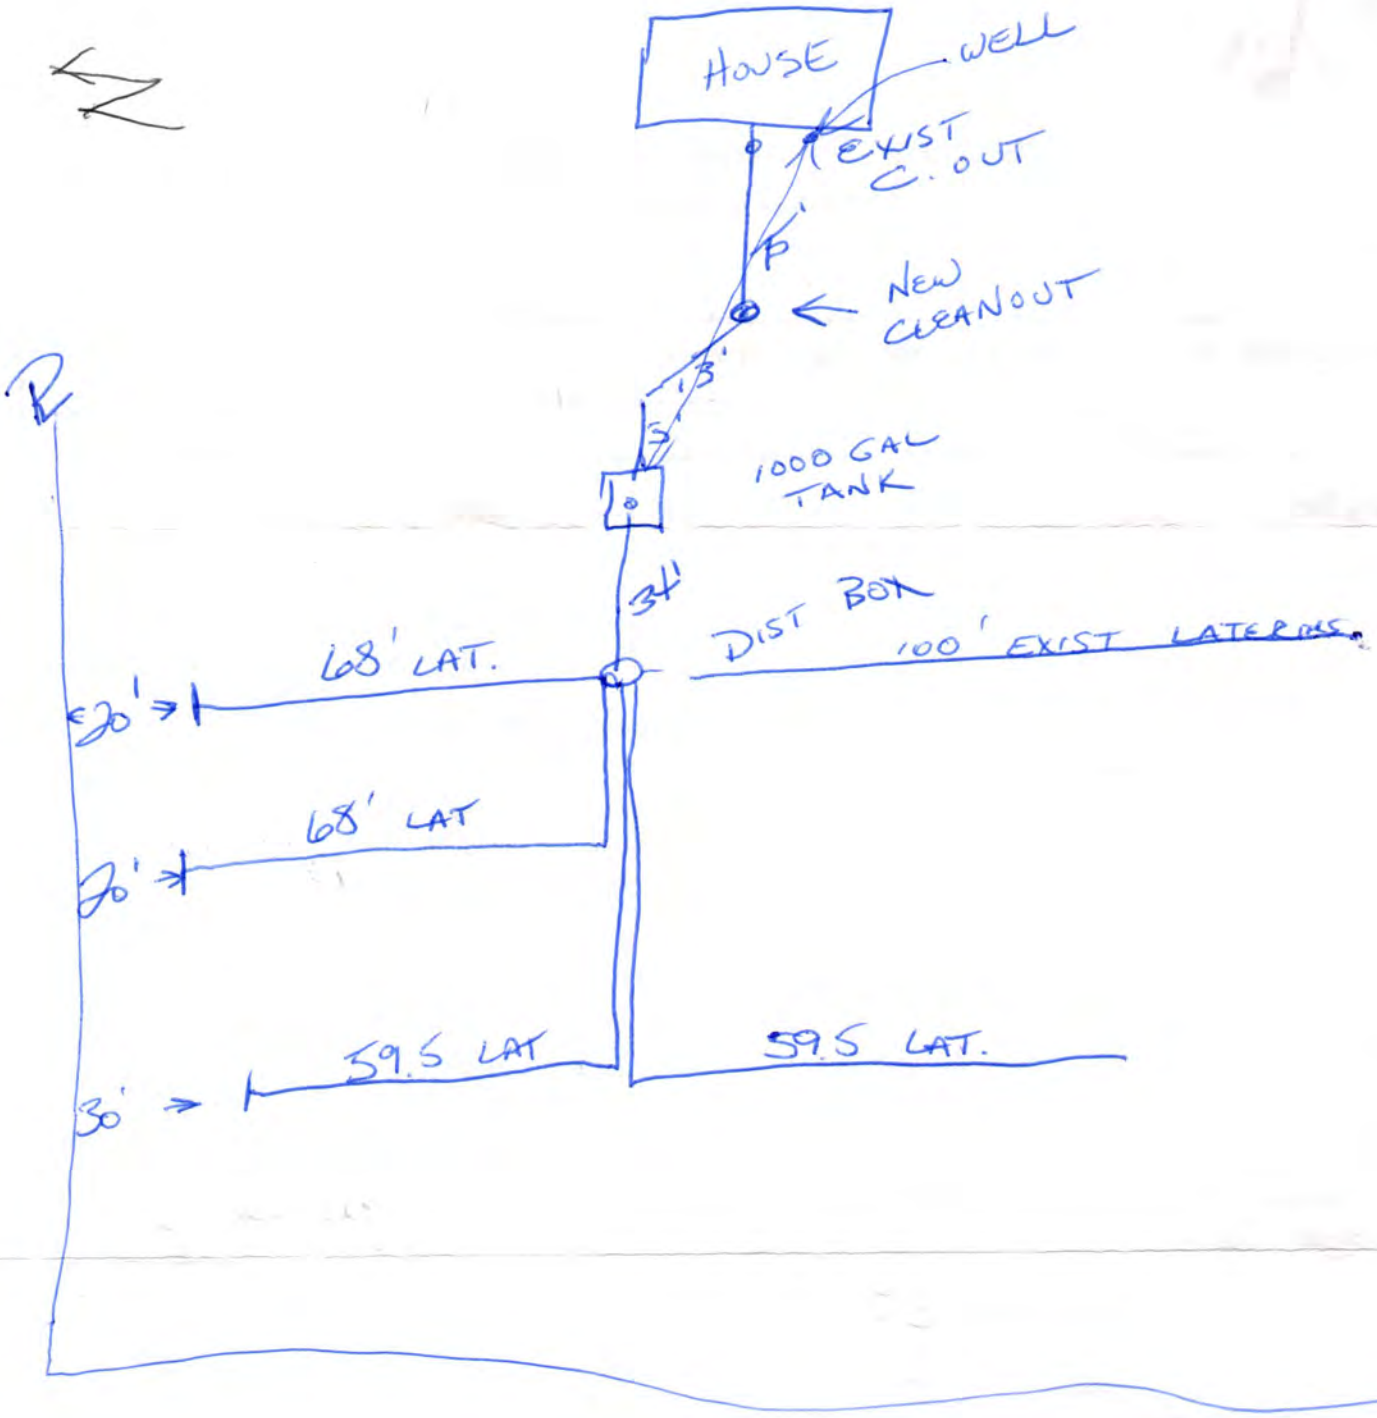
HOUSE
WELL
EXIST C. OUT
P
NEW CLEANOUT
1.3'
5'
1000 GAL TANK
3+'
DIST BOX
100' EXIST LATERALS
68' LAT.
30'
68' LAT
30'
59.5 LAT
59.5 LAT.
30'