FILE NO. 1871

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION
TYPE OF LICENSE OR PERMIT

NOVEMBER 5, 1982
THIS LICENSE OR PERMIT EXPIRES

Mark J. Southwick Rural Route #2 Lincoln NE
LICENSEE OR PERMITTEE ADDRESS

T9N, R6E, Section 16, Addition Gateway Western Estates
NAME OF ESTABLISHMENT, IF ANY ADDRESS

REMARKS: NONTRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE	
018754	110.16	148.14	6-2	

SERIAL NO. DATE AMOUNT

60390 MN 5-82 30.00 -

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

HEALTH APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [X]
County Resolution No. 2832 [ ]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Ave.
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 1871

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: May 4, 1982

The undersigned hereby applies for a permit to ALTER [ ], EXTEND [X], or REPAIR [ ] an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 9N ; Range 6E ; Section 16 ;
Block 1 ; Lot 1 ; Addition Gateway Western Estates
Street Address Del Mohrhoff

2. Property Use: Residential 2 [ ]; Commercial [ ]
No. Bedrooms 4
Describe
Other Use [ ]
Describe

3. Type of existing Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Description of proposed alteration, extension or repair: Added 100' 6" wide material field.

5. Work to be done by: Owner [ ] ; or Contractor [ ], Friesen Exc.
Contractor's Name

6. Estimated cost of project:

Del Mohrhoff
owner

a. Materials	$	Greater than $400.00
b. Labor	$	
c. Other	$	
TOTAL	$	

Mark Southwick
Signature of Applicant (owner or lessee)

R.R. # 2 Lincoln, Nebr.
Address

(Do not write below this line)

REVIEWING ACTION

1. Date Rec'd: 5-4-82
Filing Fee: $ 30.00

2. Site Visits:
Date: 5-4-82 by: mm
Date: by:
Date: by:

3. EXPERIMENTAL
Date: Approved [ ]; Disapproved [ ]
by: Ron Maynard

4. EXPERIMENTAL
INSTALLATION ~~PERMIT~~ WRITTEN APPROVAL
Date: 5-4-82 by: Ron Maynard

PLEASE RUSH
BY NEXT WED IF POSSIBLE. JM

Lincoln-Lancaster County Health Department

3140 "N" Street, Lincoln, Nebraska 68510 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: Lincoln-Lancaster County Health Department or LLCHD

☑ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

☑ Evaluation of the Individual Water System ☑ Evaluation of the Sewage Disposal System

Legal Description of Property: Street Address 1801 W. Pleasant Hill Rd.
Twp 9N Range 6E Section 16 1/4 ___ 1/4 ___ Block 1 Lot 1 Addition Gateway Western Estates
Directions to Property W. Pioneers Blvd curves and becomes S.W 12th St. Pleasant Hill Rd goes West off SW 12th 1 mile No of W. Denton Rd.
Location of Well Between House & Garage In front of Evergreens Tap Location: Inside ☑ Outside ☑
Location of Sewage System East of House Year Installed ?

	NAME	ADDRESS	PHONE
Present Owner:	Michael & Judy Mulnix	1801 W. Pleasant Hill Rd	423-3250
~~Tenant~~/Buyer:	Vadim & Helen Gladyshev	1025 N 63rd St #F6 Lincoln NE 68505	464-2161
Return to:	Judy Holstein 1801 W. Pleasant Hill Rd Lincoln NE 68523		

Signature of Applicant Vadim Gladyshev Helen N. Gladysheva Address 1025 N 63rd St #F6 Lincoln NE 68505 Date 6/8/98

HEALTH DEPARTMENT USE ONLY

Date Received 6/12/98 Received $150.00 Check ☒ (ck. # 124) Cash ☐

PRELIMINARY STATUS--By Jerrold C. Hood **DATE:** 6/12/98

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM	Additional Site Visits
Construction	6/15/98 ☑	☒	Approved ☐	Date __/__/__ by __
Bacteria	☒ 0 /ml	☐ ____ /ml	Provisional ☒	Date __/__/__ by __
Nitrate	☒ 2.4 ppm	☐ ____ ppm	Disapproved ☐	Date __/__/__ by __

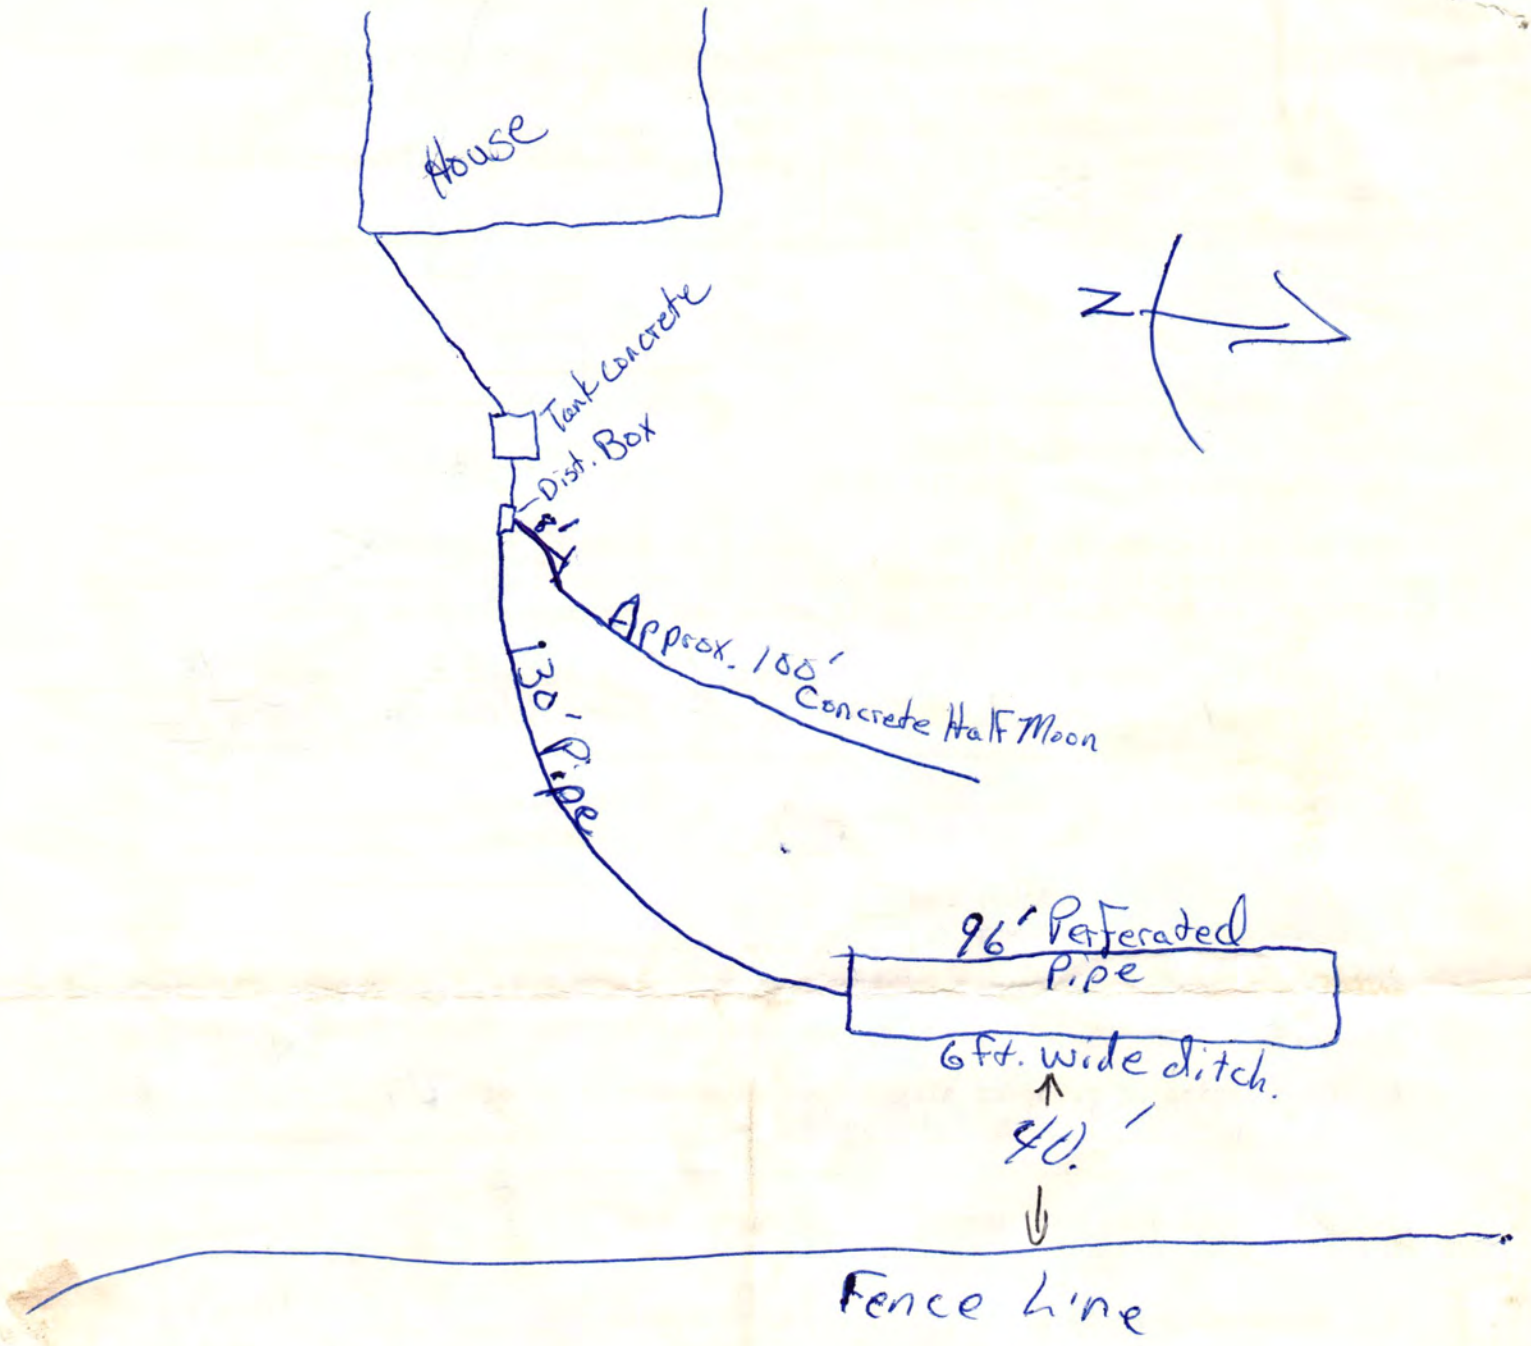
Comments: WELL CAP IS UNBOLTED. SCREW MISSING OUT OF ELECTRIAL CONDUIT PLATE. MOST OF SEPTIC SYSTEM INSTALLED PRIOR TO REGULATIONS ADDITION MADE IN 1982 WAS OF EXPERIMENTAL VARIETY. HENCE APPROVAL IS PROVISIONAL. NO EVIDENCE OF MALFUNCTION. See Attached Letter ☐

FINAL STATUS ~~Deficient~~ Well cap is bolted, 6-15-98

WATER SYSTEM: Approved: ☒ **SEWAGE DISPOSAL SYSTEM** Approved: ☐ Provisional Approval: ☒

Approved by Jerrold C. Hood R.E.H.S. Date 6/18/98

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.


House
Tank Concrete
Dist. Box
8'
Approx. 100' Concrete Half Moon
130' Pipe
96' Perforated Pipe
6 ft. wide ditch.
40'
Fence Line