FILE #2086

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

NOVEMBER 11, 1984 — THIS LICENSE OR PERMIT EXPIRES

DONALD E. JEWELL — LICENSEE OR PERMITTEE

2300 STIRRUP LANE LINCOLN, NE 68523 — ADDRESS

T9N; R6E; Sec 16; Bk 4; Lot 2; Equestrian Estates — NAME OF ESTABLISHMENT, IF ANY

ADDRESS

REMARKS: NON TRANSFERABLE NEW CONSTRUCTION

PERMIT	ACCOUNTING NUMBER	TOTAL
$ 60.00	018754	$ 60.00

Valid Receipt Only if Machine Receipted In This Space

Serial No. Date and Amount

APPLICATION

HEALTH

ISSUING OFFICER OR DEPARTMENT

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 60.00

FILE NO. 2086

DATE: 5-11-84

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 9N ; Range 6E ; Section 16 ;
   Block 4 : Lot 2 : Addition Equestrian Estates
   Street Address _____

2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 3 . Describe _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: _____ ft.

Donald F Jewell
Signature of Applicant (Owner or Lessee)

2300 Stirrup Lane - Lincoln
Address

(Do not write below this double line)

1. Health Department: Date Rec'd. 5/11/84. Date Frwd. 5/11/84. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold E. Hood

2. Supt. Bldg. Insp.: or Village Clerk Date Rec'd. 5/14/84. Date Frwd. 5/14/84. ACTION: Approved ☐ Disapproved ☒ Signature: Gary N. Stewart

3. City ~~or County~~ Engineer: Date Rec'd. 5-14-84. Date Frwd. 5-14-84. ACTION: Approved ☒ Disapproved ☐ Signature: M. Long

REMARKS OR REASONS FOR DISAPPROVAL Existing well 4 years old.

Site Visits:
Date: Sept-5-84 by: mm
Date: _____ by: _____
Date: _____ by: _____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

INSTALLATION FINAL WRITTEN APPROVAL
Date: Sept-5-84 By: Ron Maynard

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

B

FILE NO. 2086

PROPERTY WHERE SOIL TESTED:

Location: Township_____; Range_____; Section & ¼ Section_____.
Property Dimensions: 425 ft. x 270 ft. Area: 3.15 acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☐ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ☐ .
Dates of Tests: 5-9-84 to 5-10-84 Weather: Precip. 0 Temp. 70.

OWNER: Donald F. Jewell

Address: 866 South 35th St

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1	36	5/9/84	7:30 PM	5/10/84	8:15 AM	5/10	12:45	6¼	1:15	5½	30	1¼	
2	"	"	"	"	"	"	12:47	7½	1:17	4⅞	"	2⅝	
3	"	"	"	"	"	"	12:49	6⅝	1:19	5"	"	1⅝	
4	"	"	"	"	"	"	12:51	7	1:21	5⅛	"	1⅞	
5	"	"	"	"	"	"	12:53	6½	1:23	3¾	"	2¾	
6	"	"	"	"	"	"	12:55	6	1:25	5½	"	½	

Donald F Jewell
Signature of Person Conducting Test

Sum of Percolation Rates: _____
Average of Rates: _____
Mean of Rates: _____

Address 866 South 35th Lincoln Phone 483-7861

(Do not write below this line)

REVIEWING ACTION

Remarks: _____
Soil Type (SCS): Wymore Silty Clay Loam very close to Sharpsburg Silty Clay Loam
Date: May 11, 1984

Approved Percolation Rate (a)
A. 17 min./inch
B. _____ min./inch
C. _____ min./inch

Jerrold C. Hood
Signature of Reviewing Official

FORM 20102-0477
PRELIMINARY PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐


LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

C

Sketch of property showing Percolation Test hole locations, well, residence, direction and property line.

FILE NO. 2086

Indicate on sketch if residence and well are exisiting or proposed.

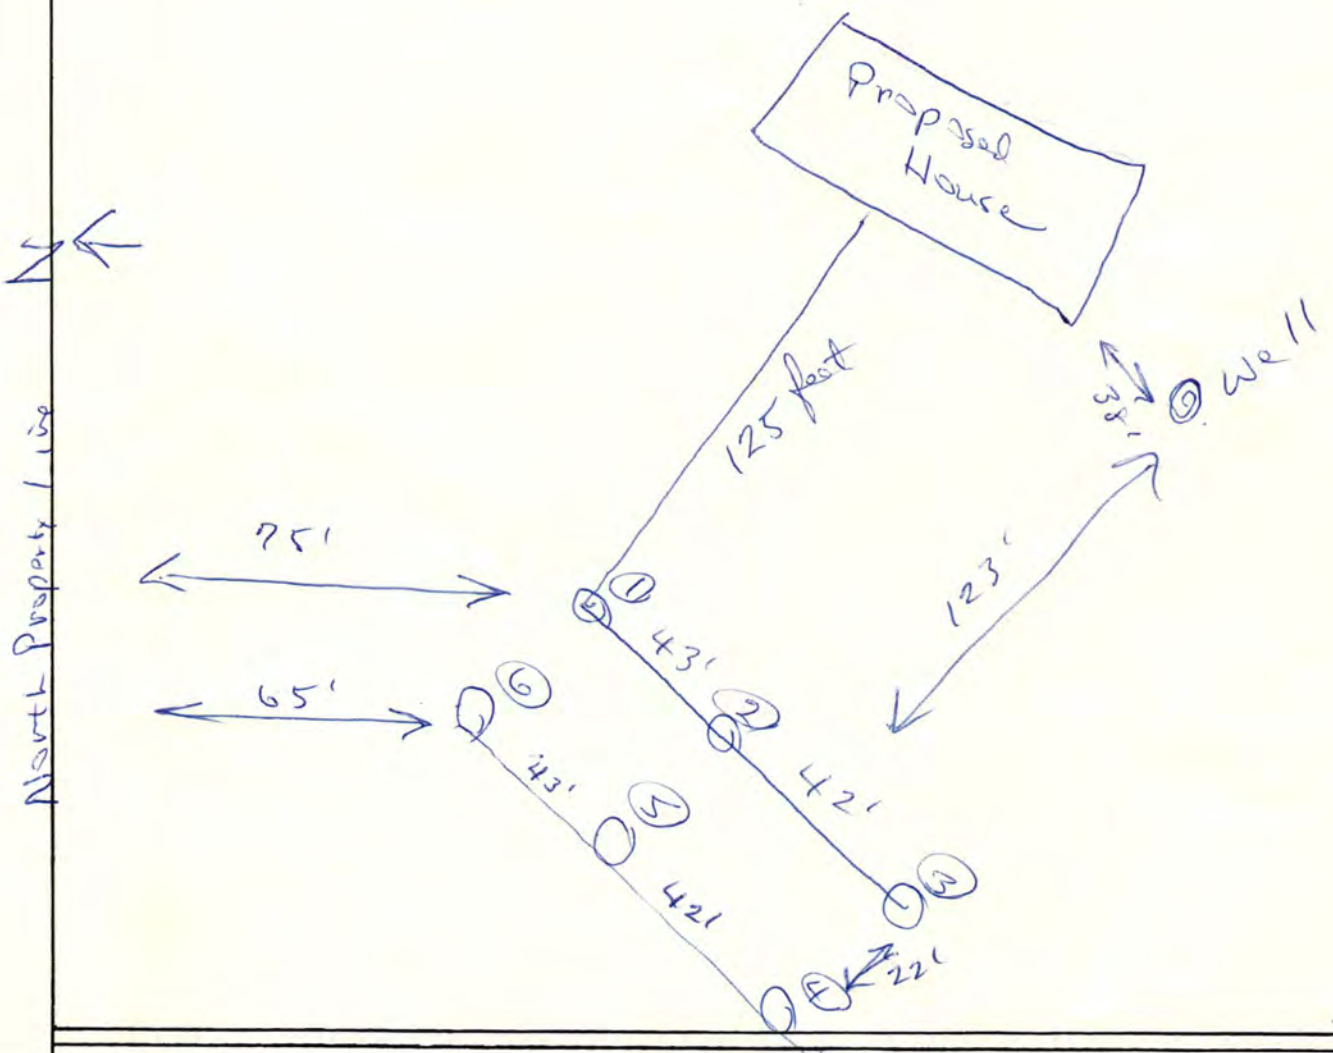

REVIEWING ACTION

Remarks: _____


Date: May 11, 1984

Minimum Design Requirement
1. Capacity of Septic Tank 1000 gals.
2. Total Length of Laterals _____ ft.
3. With a Trench Width of _____ in.
4. Total Area of Lateral needed 595 sq.ft.

Jerrold C. Hoel
Signature of Reviewing Official

Final Drawing

Friesen Exc.

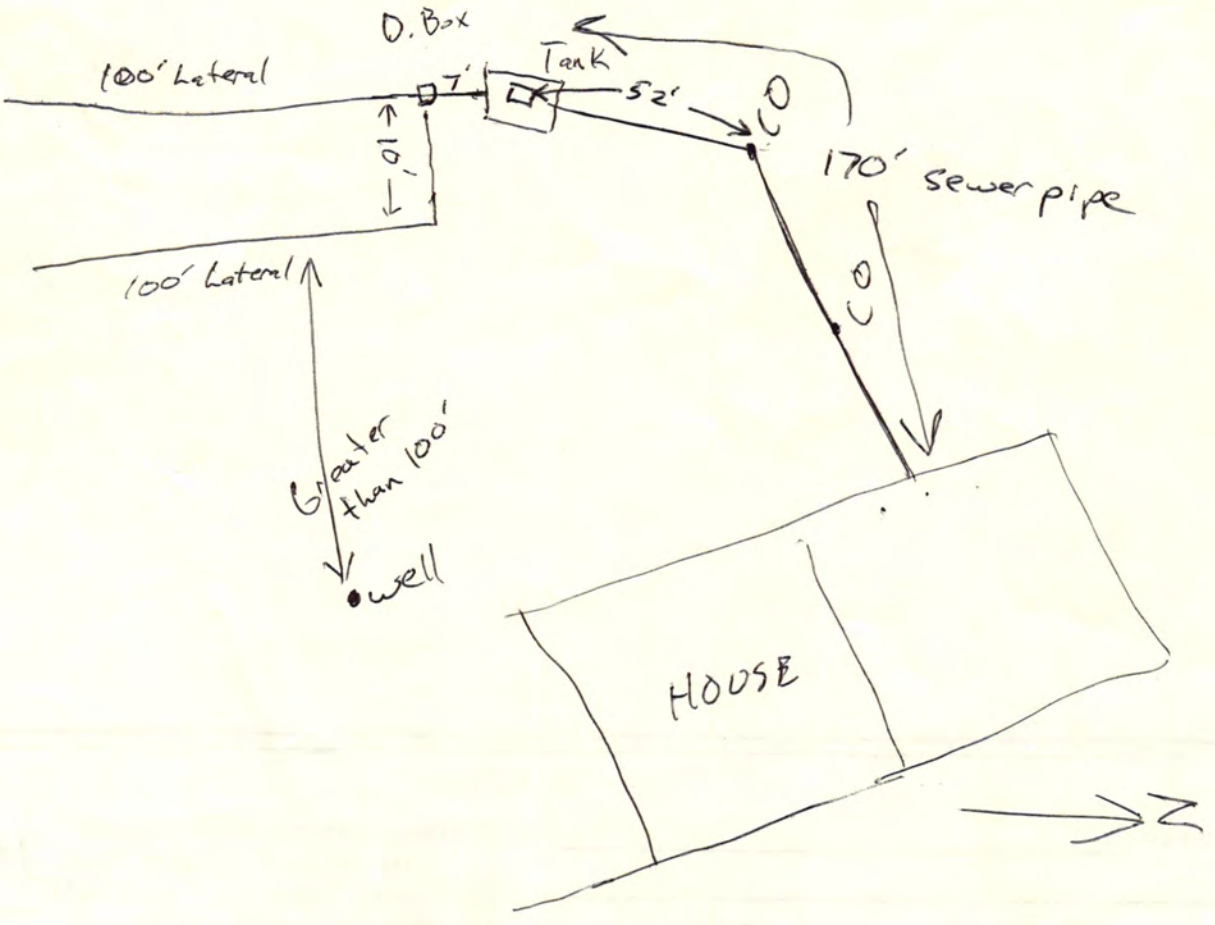

035

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 St Marys Avenue Phone (402) 471-7800 471-8022 Lincoln, Nebraska 68502

REAL ESTATE TRANSFER / LOAN APPROVAL

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County Health Department.

[X] Evaluation of the Individual Water System Date: 5-4-93

[X] Evaluation of the Sewage Disposal System [X] Enclosed is $150.00

Legal Description of Property: TWP. 9N ; RANGE 6E ; SECTION 16 ; BLOCK 4

LOT 2 ; ADDITION Equestrian Estates Street Address 2300 W Stirrup Road

Directions to Property W Van Dorn St. to Coddington Blvd., (Lee's Chicken on corner) 2 miles S on Coddington to West Arabian Dr. 3 blocks to Equestrian Dr. North to Stirrup Dr East 1st house on Stirrup Rd

Location of Well Just Outside of Chain Link Fence Northwest of the House Tap Location: Inside [X] Outside [X] On W side of Road.

Location of Sewage System Northwest of The House Year Installed 1984 2 Story Tutor House

	NAME	ADDRESS	PHONE
Present Owner:	Donald & Diane Jewell	2300 W Stirrup Dr, Lincoln, NE	423-6061
Tenant/Buyer:	Judith Bothern	5921 Kenwood Circle, Lincoln, NE	489-8077
Return to:	Sheryl Pflug c/o ATI	3883 Normal Blvd,.Lincoln, NE	434-3712

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant Sheryl L. Pflug ATI Title Co. Address 3883 Normal Blvd, Lincoln NE 68506

==========

HEALTH DEPARTMENT USE ONLY

Date Received MAY 4, 1993 Received $150.00 Check [X] Cash [ ]

PRELIMINARY STATUS--DATE MAY 5, 1993

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:		SITE VISIT:
Construction	[X]	[ ]	Approved:	[X]	Date 5/5/93 by J.C.H.
Bacteria	[X]	[ ]	Provisional:	[ ]	Date _____ by ____
Nitrate 1.3 PPM	[X]	[ ]	Disapproved:	[ ]	Date _____ by ____

Comments: ANY LOW PLACE IN THE SEPTIC LATERAL FIELD SHOULD BE FILLED IN SO SURFACE WATER CANNOT STAND ON THE FIELD. IF THE SEPTIC TANK HAS NOT BEEN PUMPED RECENTLY THEN IT SHOULD BE CHECKED TO SEE IF IS NEEDED. See Attached Letter [ ]

FINAL STATUS

	WATER SYSTEM:	SEWAGE DISPOSAL SYSTEM:	
	Approved: [X]	Approved: [X]	Provisional Approval: [ ]

APPROVED BY Jerrold C. Hood R.E.H.S. DATE MAY 7, 1993

Approval or disapproval is based on written standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operation. WELLS - Nebraska Safe Drinking Water Act,
- Standards for A Private Well in Nebraska

FG.4120 INDIVIDUAL SEWAGE SYSTEMS - County Resolution #2832

074