LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

Division of Environmental Health
2200 St. Marys Ave Lincoln, NE 68502 (402) 471-8000

NON TRANSFERABLE

PERMIT

SEWAGE INSTALLATION

No. 92380082601

Issued 04/21/92
Expires 10/21/92

ESTABLISHMENT

AMY CHANDLER
T9N R6E SEC 16
PESTER RIDGE ESTATES BLK 2 LOT 1

FEES: Permit 018754 $150.00

Total $150.00

PERMITTEE

AMY CHANDLER
500 S 29 ST
LINCOLN NE 68510

Issued By COUNTY HEALTH

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE	
DATE	AMOUNT
4/22/92	PAID

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

RECEIVED APR 20 1992

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 150.00

FILE NO. _____

DATE: 4-20-92

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 9N ; Range R6E ; Section 16 ;
   Block 2 : Lot 1 : Addition Pester Ridge Estates
   Street Address 6400 S.W. 25th

2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 3 . Describe _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: _____ ft.

Amy L Chandler
Signature of Applicant (Owner or Lessee)

500 South 29th
Address

(Do not write below this double line)

1. Health Department: Date Rec'd. 4/20/92. Date Frwd. 4/21/92. ACTION: Approved ☒ Disapproved ☐ Signature: Gerald C. Hoof

2. Supt. Bldg. Insp.: or Village Clerk Date Rec'd. 4/21/92. Date Frwd. 4/21/92. ACTION: Approved ☐ Disapproved ☐ Signature: _____

3. City or County Engineer: Date Rec'd. 4-21-92. Date Frwd. 4-21-92. ACTION: Approved ☒ Disapproved ☐ Signature: K D Mahrens

REMARKS OR REASONS FOR DISAPPROVAL HAS WELL PERMIT

Site Visits:
Date: 8-20-92 by: P.D.
Date: 8-21-92 by: P.D.
Date: _____ by: _____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

INSTALLATION FINAL WRITTEN APPROVAL
Date: 9-8-92 By: Paul Dyer

FORM 23-43

FORM 20104-0477
PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

D

DATE: 8-17-92 Amy
6400 SW 29 Chandler

FILE NO. _____


SPECIFICATIONS AS BUILT

A. BUILDING SEWER: Sch 40
1. Material PVC ; Diameter 4" in.
2. Distance above basement floor ____ in., or below basement floor 42 in.
3. Distance between dwelling and septic tank 74 ft.
4. Number of clean-outs 1 .
5. Distances to:
Well or Suction Line ____ ft.; Stream ____ ft.; Pressure Line ____ ft.; Property Line ____ ft.


B. SEPTIC TANK:
1. Material C-Crete ; No. of compartments 1 .
2. Capacity 1,000 gals.;
3. Factory Built: Yes ☒ No ☐
(Company Pre Cast)
4. Manholes: Over Inlet; diam. 12 in.
Over Outlet; diam. 12 in.
Riser Above ☐ Below ☒ Grade 11 in.
5. Inlet: Baffle ☒ ; or Tee ☐
6. Outlet: Baffle ☒ ; or Tee ☐
7. Depth of top of tank below finished grade 35 in.
8. Distances to:
Well or Suction Line NA ft.; Stream NA ft.; Pressure Line NA ft.; Property Line >20 ft.

C. DISTRIBUTION BOX:
1. Material Resin ; Number - available outlets 5 .
2. Factory Built: Yes ☒ No ☐
(Company ____)
3. Distance from Septic Tank 20 ft.

D. ABSORPTION FIELD: (Provide as built drawings on back of this form)
1. Type: Half Rounds ☐ Perforated Pipe ☒
Diameter of Half Round ____ or Perforated Pipe 4" .
Material: fiberglass ☐ ; plastic ☒ ; concrete ☐ ; other ____ .
2. Lateral Lines:
Number 3 ; Length of each line 90 , 74 , 70 , ____ , ____ ft.;
Total length of laterals 234 ft.;
Distance between lateral lines 8 ft.
3. Trench dimensions: Width 3 ft.;
Slope 2.6 in/100 ft.; Average Depth 38 in.
4. Filter Material: Road Gravel
Depth of Material 14 in.
5. Distances to:
Well or Suction Line NA ft.; Stream NA ft.; Pressure Line NA ft.; Property Line >20 ft.

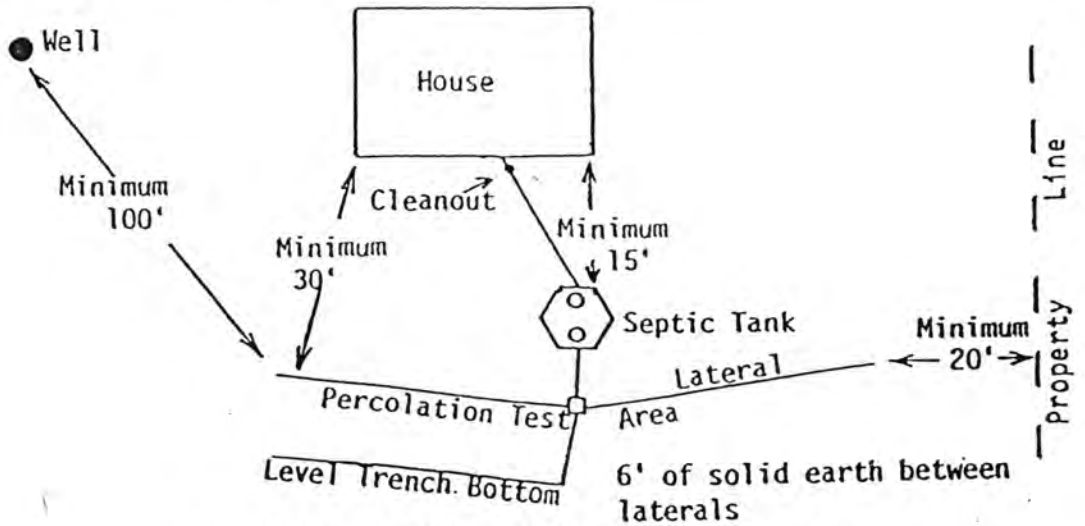

TYPICAL INDIVIDUAL SEWAGE SYSTEM DESIGN

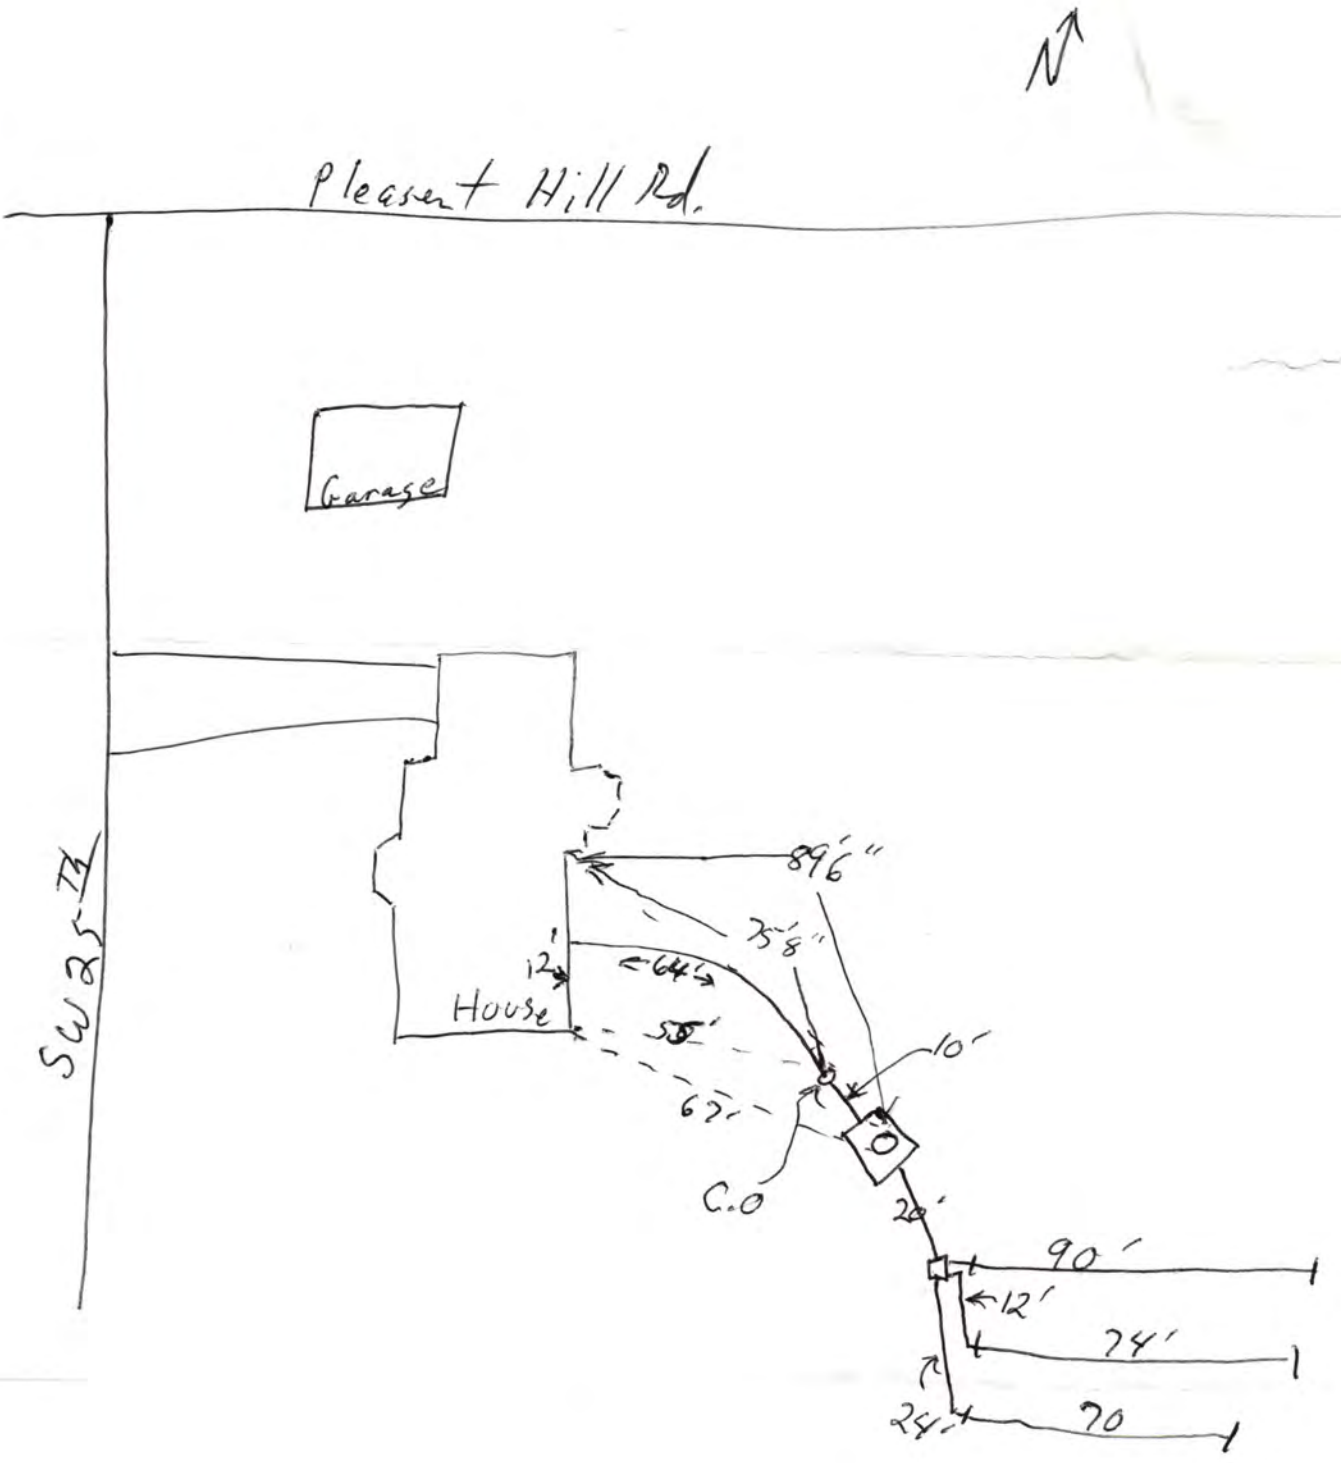
N
Pleasent Hill Rd.
Garage
House
SW 25-74
89'6"
75'8"
64'
58'
67'
12'
10'
C.O
20'
90'
12'
74'
24'
70