FILE #2255

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION	MARCH 10, 1986
TYPE OF LICENSE OR PERMIT	THIS LICENSE OR PERMIT EXPIRES
KEVIN WOLFE — 930 RUTLAND, #404	LINCOLN, NE 68512
LICENSEE OR PERMITTEE	ADDRESS
TON: R6E: Sec 21: Bk 6: Lot 2: Ridgewood Estates	
NAME OF ESTABLISHMENT, IF ANY	ADDRESS

REMARKS: NON TRANSFERABLE NEW CONSTRUCTION

PERMIT	ACCOUNTING NUMBER	TOTAL
$ 60.00	018754	$ 60.00

Valid Receipt Only if Machine Receipted In This Space

Serial No. — Date and Amount

APPLICATION

HEALTH

ISSUING OFFICER OR DEPARTMENT

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

REC'D SEP 10 1985

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 474-1541

A

FILING FEE: $ 60.00

FILE NO. 2255

DATE: 9-9-85

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 9N ; Range 6E ; Section 21 ;
   Block 6 : Lot 2 : Addition RIDGE WOOD ESTATES
   Street Address _____

2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 3 . Describe _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: NA ft.

Brad Southwick for Kevin Wolfe
Signature of Applicant (Owner or Lessee)

930 Rutland #404
701 E. 4 Hickman Lincoln, Ne 68512
Address

(Do not write below this double line)

1. Health Department: Date Rec'd. 9/10/85 . Date Frwd. 9/10/85 . ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: or Village Clerk Date Rec'd. 9/10/85 . Date Frwd. 9/10/85 . ACTION: Approved ☒ Disapproved ☐ Signature: _____

3. City or County Engineer : Date Rec'd. 9-10-85 . Date Frwd. 9-10-85 . ACTION: Approved ☒ Disapproved ☐ Signature: Dennis Bartels

REMARKS OR REASONS FOR DISAPPROVAL NO WELL PERMIT YET.

Site Visits:
Date: 8-13-85 by: _____
Date: _____ by: _____
Date: _____ by: _____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

EXPERIMENTAL

INSTALLATION FINAL WRITTEN APPROVAL
Date: 9-13-85 By: Ron Morgan

FORM 20104-0477
PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

D

DATE: 8-10-85

FILE NO. 2255


WOLFE - RIDGWOOD ESTATES SPECIFICATIONS AS BUILT

A. BUILDING SEWER:
1. Material _____; Diameter _____ in.
2. Distance above basement floor _____ in., or below basement floor _____ in.
3. Distance between dwelling and septic tank _____ ft.
4. Number of clean-outs _____.
5. Distances to:
Well or Suction Line _____ ft.; Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.

B. SEPTIC TANK:
1. Material FIBERGLASS; No. of compartments 1.
2. Capacity 1,000 gals.;
3. Factory Built: Yes ☒ No ☐
(Company CORRAGLAS)
4. Manholes: Over Inlet; diam. 12 in.
Over Outlet; diam. _____ in.
Riser Above ☒ Below ☐ Grade _____ in.
5. Inlet: Baffle ☒ ; or Tee ☐
6. Outlet: Baffle ☐ ; or Tee ☒
7. Depth of top of tank below finished grade 42 in.
8. Distances to:
Well or Suction Line over 100 ft.; Stream 100 ft.; Pressure Line _____ ft.; Property Line 100 ft.

C. DISTRIBUTION BOX:
1. Material PLASTIC; Number - available outlets 7.
2. Factory Built: Yes ☒ No ☐
(Company _____)
3. Distance from Septic Tank 12 ft.

D. ABSORPTION FIELD: (Provide as built drawings on back of this form)
1. Type: Half Rounds ☐ Perforated Pipe ☒
Diameter of Half Round _____ or Perforated Pipe 4".
Material: fiberglass ☐ ; plastic ☒ ; concrete ☐ ; other _____.
2. Lateral Lines:
Number 2; Length of each line 100, 100, _____, _____, _____ ft.;
Total length of laterals 200 ft.;
Distance between lateral lines 10 ft.
3. Trench dimensions: Width 8-9 ft.;
Slope 4 in/100 ft.; Average Depth 40 in.
4. Filter Material: ROAD GRAVEL
Depth of Material 20 in.
5. Distances to:
Well or Suction Line over 100 ft.; Stream 60 ft.; Pressure Line NA ft.; Property Line 34 ft.

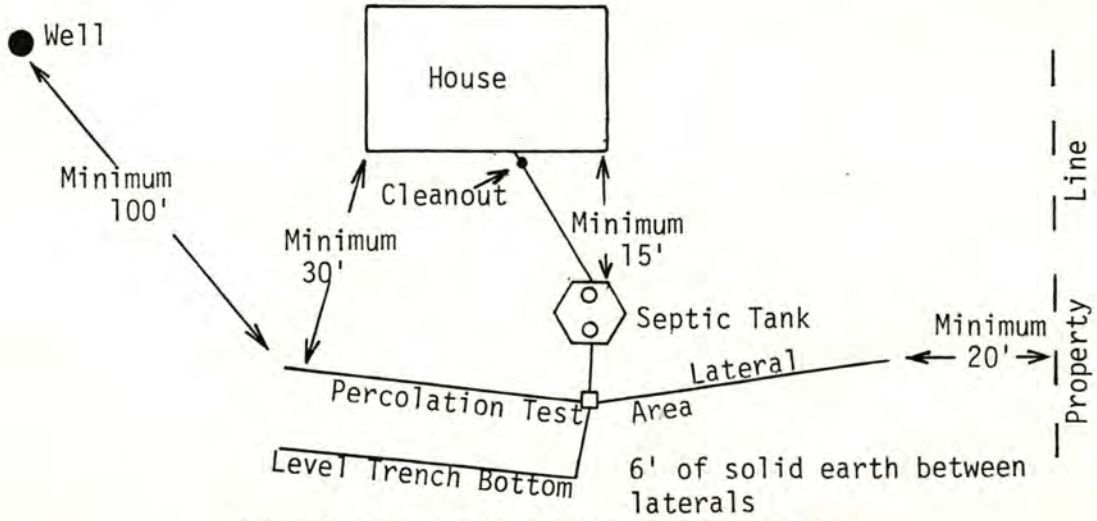

TYPICAL INDIVIDUAL SEWAGE SYSTEM DESIGN

008

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 St Marys Avenue Phone (402) 471-7800 Lincoln, Nebraska 68502

REAL ESTATE TRANSFER / LOAN APPROVAL

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County Health Department.

☒ Evaluation of the Individual Water System Date: 7/20/92

☒ Evaluation of the Sewage Disposal System ☒ Enclosed is $150.00

Legal Description of Property: TWP. 9N; RANGE 6E; SECTION 21; BLOCK Le

LOT 2; ADDITION Rickenwood; Street Address 8100 Woodbury Dr.

Directions to Property _____

Contact Owner

Location of Well Contact Owner Tap Location: Inside ☐ Outside ☒

Location of Sewage System Contact Owner Year Installed 1985

	NAME	ADDRESS	PHONE
Present Owner:	Dan Hultz & Johnson	5621 Briar Rose (Dan)	423-5266 (Dan)
Tenant/Buyer:	Durbin Pamela Lowery	5520 Thistle Circle	421-1701
Return to:	Crowne Closing Attn Nancy	6940 'O' St. #312	464-1200

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant _____ Address _____

==========

HEALTH DEPARTMENT USE ONLY

Date Received JULY 20, 1992 Received $150.00 Check ☒ Cash ☐

PRELIMINARY STATUS--DATE JULY 21, 1992

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:	SITE VISIT:
Construction	☒	☐	Approved: ☐	Date 7/21/92 by L.C.H.
Bacteria	☒ 7-27-92 PO	☐	Provisional: ☒	Date _____ by _____
Nitrate	☒ 7-27-92	☐	Disapproved: ☐	Date _____ by _____

Comments: SEWAGE SYSTEM IS CONSIDERED EXPERIMENTAL HENCE APPROVAL IS PROVISIONAL. NO EVIDENCE OF MALFUNCTION. SEPTIC TANK SHOULD BE CHECKED TO SEE IF IT IS IN NEED OF PUMPING. SHOULD DROP A SPADE FULL OF DIRT ON NORTH SIDE OF WELL. See Attached Letter ☐

FINAL STATUS

WATER SYSTEM:	SEWAGE DISPOSAL SYSTEM:	
Approved: ☒	Approved: ☐	Provisional Approval: ☒

APPROVED BY Paul Dyer DATE 7-27-92

Approval or disapproval is based on written standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operation. WELLS - Nebraska Safe Drinking Water Act,
- Standards for A Private Well in Nebraska

FG.4120 INDIVIDUAL SEWAGE SYSTEMS - County Resolution #2832

002

Lincoln-Lancaster County Health Department

2200 St. Mary's Avenue, Lincoln, Nebraska 68502 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: Lincoln-Lancaster County Health Department or LLCHD

☐ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

☐ Evaluation of the Individual Water System ☐ Evaluation of the Sewage Disposal System

Legal Description of Property: Street Address 8100 SW Woodberry Dr., Lincoln, NE 68523

Twp 9N Range 6E Section 11 1/4 ____ 1/4 ____ Block 6 Lot 2 Addition Ridgewood

Directions to Property take west Denton road to SW 27th, turn left (south) and go 3/4 of a mile to Ridgewood.

Location of Well North side of the house Tap Location: Inside ☐ Outside ☐

Location of Sewage System South side of the our building Year Installed 1986

	NAME	ADDRESS	PHONE
Present Owner:	Dirk & Pamela Lowrey	8100 SW Woodberry Dr. Lincoln, NE 68523	437-6247 (wk) 421-1706 (hm)
Tenant/Buyer:			
Return to:	Lincoln Bank South Attention: Carla Sherwood Lincoln Bank South	4100 south 27th Street Lincoln, NE 68502	423-2361

Signature of Applicant By: Carla H. Sherwood Address 4100 South 27th St. Lincoln, NE 68502 Date 10/08-93

HEALTH DEPARTMENT USE ONLY

Date Received 10/12/93 NP Received $150.00 M.O. Check ☐ Cash ☐ H75358

PRELIMINARY STATUS--By Jerrold C. Hood **DATE:** 10/13/93

WATER SYSTEM:	Approved	Disapproved
Construction	☐	☐
Bacteria	☒ 0 /ml	☐ ____ /ml
Nitrate	☒ <0.1 ppm	☐ ____ ppm

SEWAGE SYSTEM		Additional Site Visits
Approved	☐	Date ___/___/___ by ____
Provisional	☒	Date ___/___/___ by ____
Disapproved	☐	Date ___/___/___ by ____

Comments: SEWERAGE SYSTEM IS AN EXPERIMENTAL SYSTEM HENCE APPROVAL IS PROVISIONAL. NO EVIDENCE OF MALFUNCTION. IF THE SEPTIC TANK HAS NOT BEEN PUMPED RECENTLY IT SHOULD BE CHECKED TO SEE IF IT IS NEEDED. See Attached Letter ☐

FINAL STATUS

WATER SYSTEM: Approved: ☐ **SEWAGE DISPOSAL SYSTEM** Approved: ☐ Provisional Approval: ☒


Approved by Jerrold C. Hood R.E.H.D. Date 10/18/93

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

081

AS BUILT DRAWING OF SYSTEM

DATE 8/13/85 INSTALLER Southwick Sewer & Drain

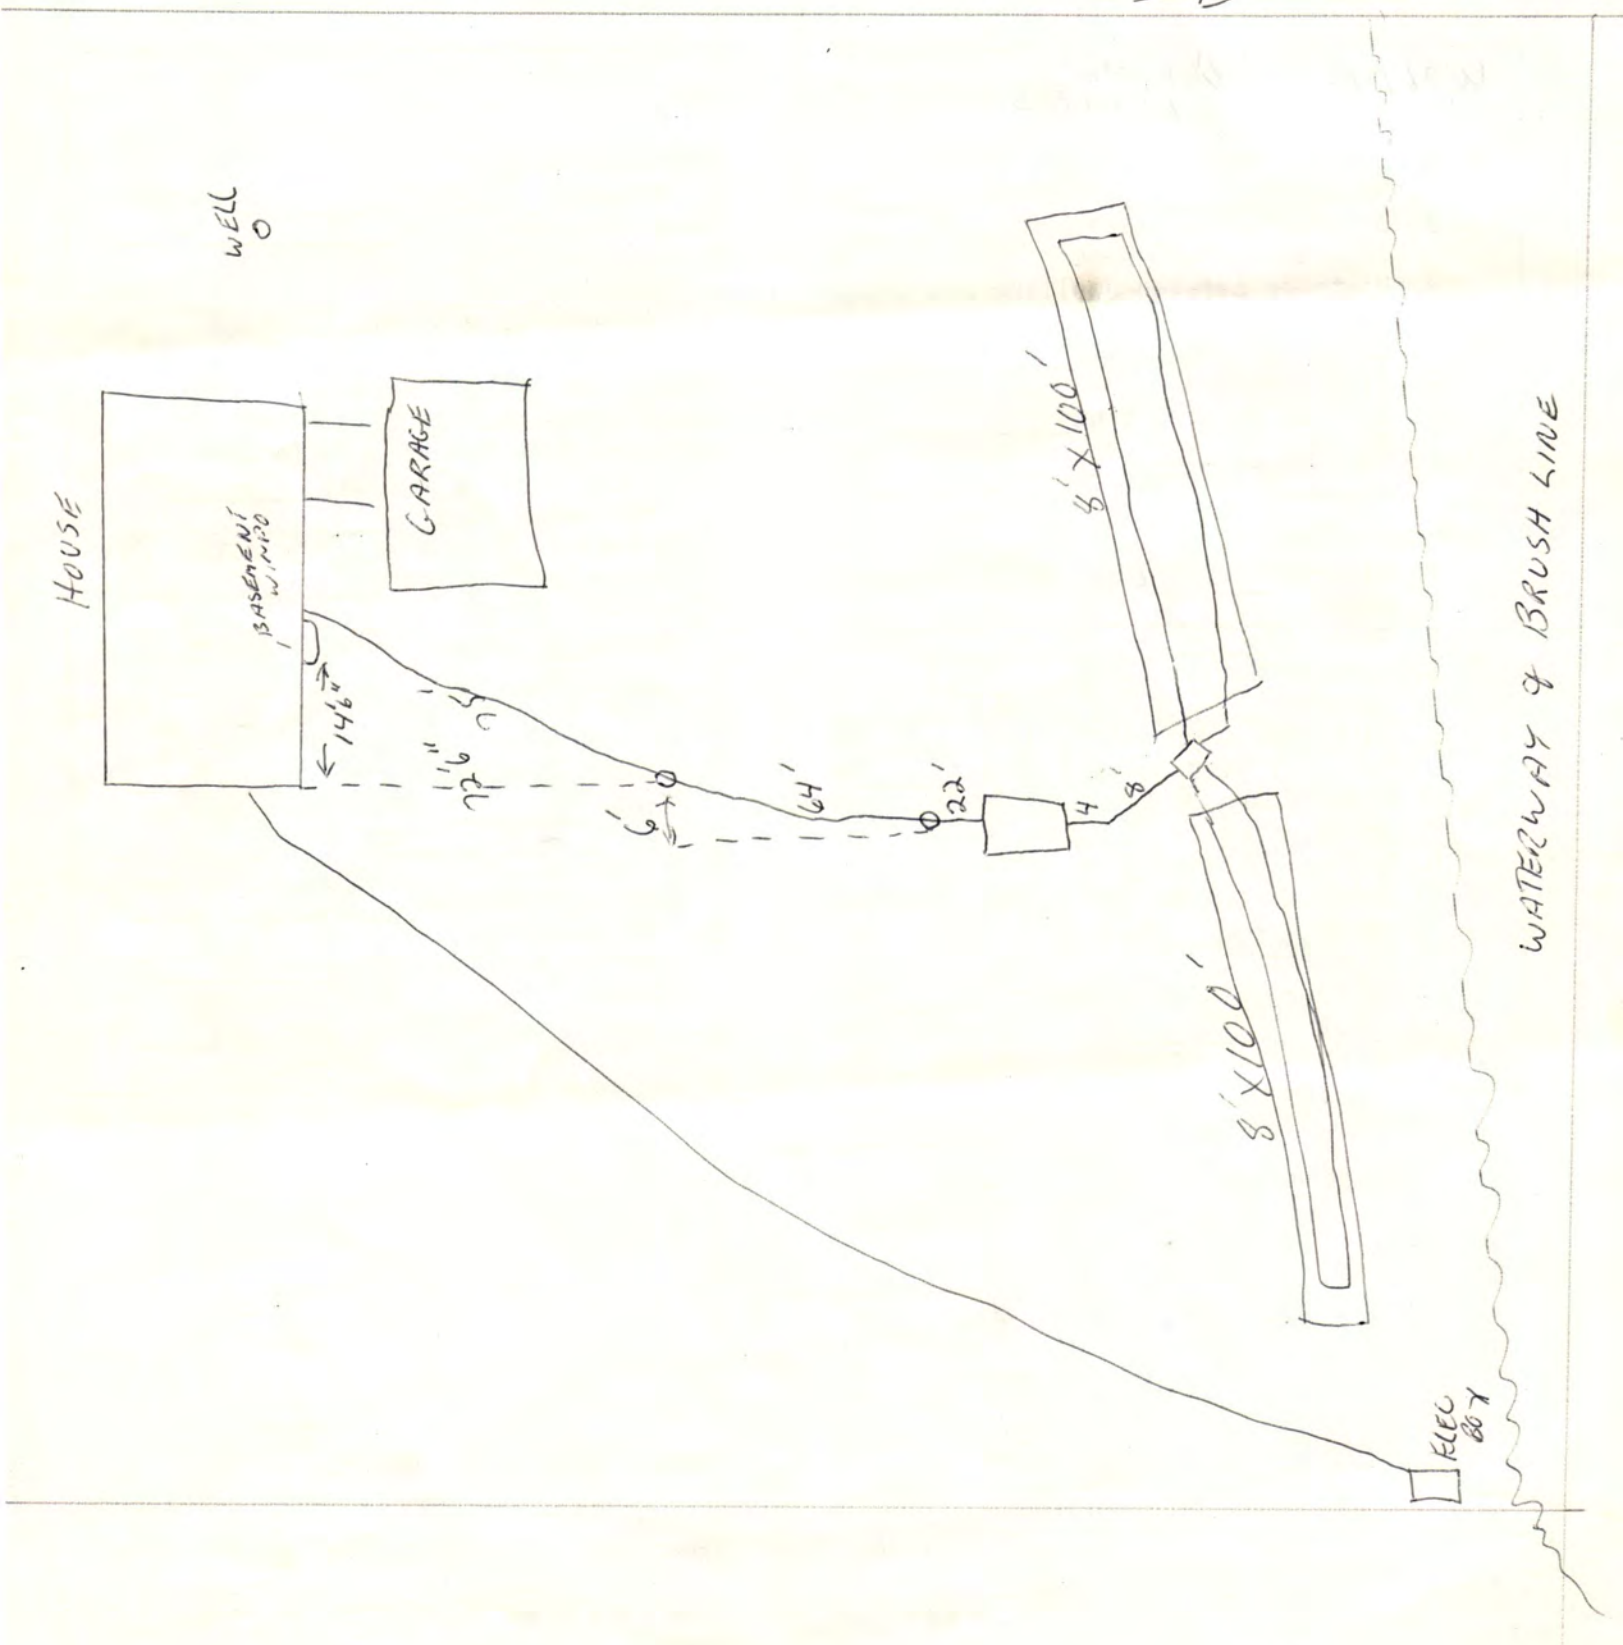

FILE #W-130

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL WATER WELL CONSTRUCTION — TYPE OF LICENSE OR PERMIT

MAY 14, 1986 — THIS LICENSE OR PERMIT EXPIRES

KEVIN WOLFE CONSTRUCTION ACCOUNT 930 RUTLAND DR. LINCOLN, NE 68502

LICENSEE OR PERMITTEE — ADDRESS

T9N; R6E; Sec 21; Bk 6; Lot 2; Ridgewood

NAME OF ESTABLISHMENT, IF ANY — ADDRESS

REMARKS: NON TRANSFERABLE NEW CONSTRUCTION

PERMIT	ACCOUNTING NUMBER	TOTAL
$ 45.00	019851	$ 45.00

Valid Receipt Only if Machine Receipted In This Space

Serial No. Date and Amount

APPLICATION

HEALTH

ISSUING OFFICER OR DEPARTMENT

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

REC'D NOV 13 1985

FORM: 20222-0483
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL WATER WELL

LINCOLN LANCASTER COUNTY HEALTH DEPARTMENT
DIVISION OF ENVIRONMENTAL HEALTH
2200 ST. MARYS AVENUE
LINCOLN, NEBRASKA 68502
PHONE: 471-7800

FILING FEE $45.00

FILE NO. W-130

DATE: 11-10-85

The undersigned hereby requests: Site Clearance and Permit to construct a new individual water well ☒ ; Permit existing well ☐ ; well repair or alteration involving opening of well ☐ ; in conformance with appropriate ordinance, as described herein:

1. Legal description of property: Twp. 9N : Range 6E : Section 21
   Block 6 : Lot 2 : Addition RIDGEWOOD
2. Well use: Residential ☒ ; Commerical ☐ ; Other Use ☐
   Describe
3. Distance to Public Water Supply: ____ Ft.
4. Intended use of well RESIDENTIAL WATER SUPPLY

Kevin Wolf
Signature of Applicant (owner or lessee)

930 Rutland Drive
Address

Sewage Permit Applied For Yes ☒ No ☐ Not Applicable ☐

1. Health Department: Date Rec'd 11/13/85. Date Frwd. 11/14/85. Action: Approved ☒ Disapproved ☐ Signature: Gerald C. Hood
2. Supt. Bldg. Insp.: Date Rec'd 11/14/85. Date Frwd. 11/14/85. Action: Approved ☒ Disapproved ☐ Signature: Gary Sherwood
3. City or County Engineers: Date Rec'd 11/14/85. Date Frwd. 11/14/85. Action: Approved ☒ Disapproved ☐ Signature: Rick Peterson

REMARKS OR REASONS FOR DISAPPROVAL

Site Visits:
Date: 9/9/85 by J.C.H.
Date: / / by
Date: / / by

Nitrate Level <0.1 PPM
Bacteriological Analysis Satisfactory
Yes ☒ No ☐

INSTALLATION FINAL WRITTEN APPROVAL
Date: 11/14/85 By: J. C. Hood

Health Department copy: White
Engineers Copy: Light Green
Building Inspectors Copy: Light Blue

FORM 23-13

FORM: 20223-0483
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL WATER WELL
CITY ORDINANCE NO. 13558
FILE NO. W-130

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
DIVISION OF ENVIRONMENTAL HEALTH
2200 ST. MARYS AVENUE
LINCOLN NE 68502
Phone: 471-7800

DATA SHEET FOR WATER WELLS

Legal Description: Sec. 21 T. 9N R. 6E Block 6 Lot 2 Addition RIDGEWOOD ESTATES
Owner Kevin Wolfe Address Ridgewood Estates

LOG OF WELL	
	Description
Depth Ft. to	
0-10	tan c.
10-15	dk. brn. c.
15-35	yell. c.
35-40	yell. c. & fine yell. ss.
40-65	yell c. & sh.
65-95	blue c.
95-120	sandy shale & sandy blue c
120-140	blue c.
140-155	fine ss
155-168	coarse ss. light yell.
168-170	blue sh.
170-180	coarse ss & sh. layers

WELL COMPLETION RECORD

Drilling Method: Rot. circ.
Depth (from ground level), Ft. 168
Date Completed 6-28-85

Casing: Length, Ft. 158 ; Dia. In. 4"
Wall Thickness, Inc. ~~.188~~ ; type PVC

Screen: Length, Ft. 10 Dia. In. 4"
Type Keyst. wire wrap slot Size .025

Drop Pipe: Length, Ft. ____ Dia. In. ____

Water Level, Surface to top of water, Ft.:
Static 75', Pumping ____

Yield: 80 gpm, Measured ☐ , Est. ☐
Chlorination Completed Yes ☑ No ☐

The above information including "Log of Well" is a true record of the job performed by me.

Driller Bill Moser (Signed)

REMARKS NITRATE NITROGEN < 0.1 p.p.m. BACTERIOLOGICAL O.K.

Address ____

Date 8-22-85

DO NOT WRITE BELOW THIS DOUBLE LINE

Health Department forwarded copy of record to Nebraska Conservation and Survey Department for Scientific Record ☒

FORM 23-4

AS BUILT DRAWING OF INSTALLATION IN RELATION TO BUILDINGS, PROPERTY LINES, OTHER WELLS, AND SOURCES OF CONTAMINATION. INDICATE NORTH.

