LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

Division of Environmental Health
2200 St. Marys Ave Lincoln, NE 68502 (402) 471-8000

NON TRANSFERABLE

PERMIT

SEWAGE INSTALLATION

No. 91380073101

Issued 07/24/91
Expires 01/24/92

ESTABLISHMENT

TERRY ERNISSE
T9N R6E SEC 22
DEB'S HI VU ACRES LOT 2
8241 S 1 STREET

FEES: Permit 018754 $150.00

Total $150.00

PERMITTEE

TERRY ERNISSE
1029 M ST
LINCOLN NE 68508

Issued By COUNTY HEALTH

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE	
DATE	AMOUNT
7/25/91	PAID

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 150

FILE NO. _____

DATE: 7-12-91

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

X 1. Legal description of property: Township 9 No Range 6 East The 6 Twp. 9N ; Range 6E ; Section 22 ;
Block _____ : Lot 2 : Addition Deb's Hi Vu Acres SE ¼ Section 22
Street Address 8241 So 1st

2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
No. of Bedrooms 3 . Describe _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: _____ ft.

X Duwayne Emmis
Signature of Applicant (Owner or Lessee)

1029 M st Lincoln Nebr 68508
Address

(Do not write below this double line)

1. Health Department:	Date Rec'd. 7/15/91 . Date Frwd. 7/15/91 .	ACTION: Approved ☒ Disapproved ☐ Signature:	Jerrold C. Hoos
2. Supt. Bldg. Insp.: or Village Clerk	Date Rec'd. 7/15/91 Date Frwd. 7/15/91	ACTION: Approved ☐ Disapproved ☒ Signature:	Mel Hoddard
3. City or County Engineer :	Date Rec'd. 7-15-91 . Date Frwd. 7-15-91 .	ACTION: Approved ☒ Disapproved ☐ Signature:	[illegible]

REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: 7/15/91 by: L.C.H
Date: _____ by: _____
Date: _____ by: _____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

INSTALLATION FINAL WRITTEN APPROVAL
Date: 7/25/91 By: Jerrold C. Hoos

FORM 23-43

FORM 20104-0477
PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

D

DATE: _____

FILE NO. _____


SPECIFICATIONS AS BUILT

A. BUILDING SEWER:
1. Material Class 160; Diameter 4 in.
2. Distance above basement floor ____ in., or below basement floor 12 in.
3. Distance between dwelling and septic tank 120' ft.
4. Number of clean-outs 1.
5. Distances to:
Well or Suction Line ____ ft.; Stream ____ ft.; Pressure Line ____ ft.; Property Line ____ ft.

B. SEPTIC TANK:
1. Material Precast; No. of compartments ____.
2. Capacity 1000 gals.;
3. Factory Built: Yes ☒ No ☐
(Company ____)
4. Manholes: Over Inlet; diam. ____ in.
Over Outlet; diam. ____ in.
Riser Above ☐ Below ☐ Grade ____ in.
5. Inlet: Baffle ☐ ; or Tee ☐
6. Outlet: Baffle ☐ ; or Tee ☐
7. Depth of top of tank below finished grade 15" in.
8. Distances to:
Well or Suction Line 85' ft.; Stream ____ ft.; Pressure Line ____ ft.; Property Line ____ ft.

C. DISTRIBUTION BOX:
1. Material Precast; Number - available outlets ____.
2. Factory Built: Yes ☒ No ☐
(Company ____)
3. Distance from Septic Tank 10 ft.

D. ABSORPTION FIELD: (Provide as built drawings on back of this form)
1. Type: Half Rounds ☐ Perforated Pipe ☒
Diameter of Half Round ____ or Perforated Pipe X 4" .
Material: fiberglass ☐ ; plastic ☒ ; concrete ☐ ; other ____.
2. Lateral Lines:
Number 5 ; Length of each line 90, 85, 50, 50, 30 ft.;
Total length of laterals 305' ft.;
Distance between lateral lines 6 ft.
3. Trench dimensions: Width 3 ft.;
Slope 4" in/100 ft.; Average Depth 32" - 4' in.
4. Filter Material: Roadgravel
Depth of Material 16" in.
5. Distances to:
Well or Suction Line 100' ft.; Stream ____ ft.; Pressure Line ____ ft.; Property Line ____ ft.

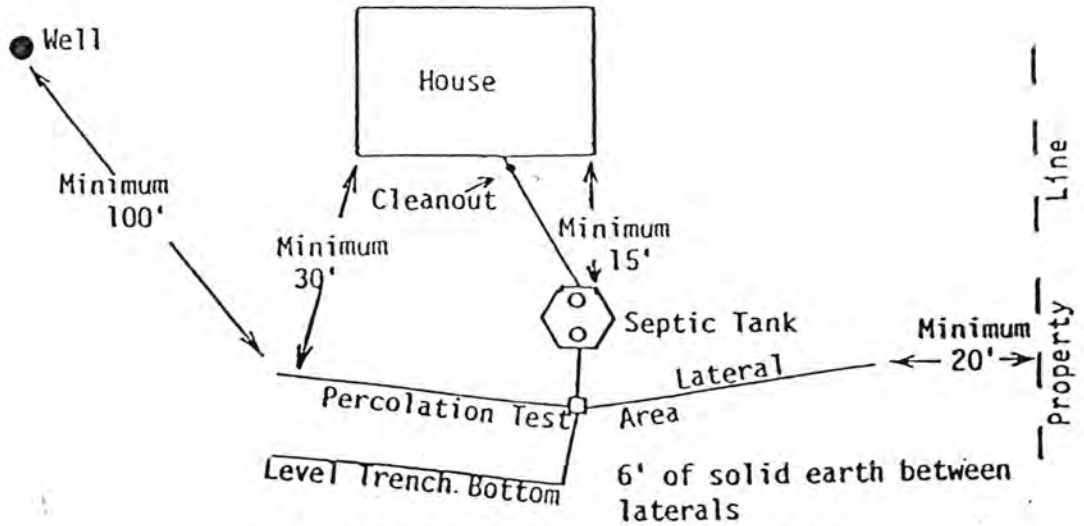

TYPICAL INDIVIDUAL SEWAGE SYSTEM DESIGN

Larry Schwarck

7-16-91

