LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

3140 "N" STREET
NON TRANSFERABLE

ENVIRONMENTAL HEALTH DIVISION
Lincoln, NE 68510-1514

(402) 441-8000

PERMIT

Permit
SEWAGE INSTALLATION

No. 96380145401

Issued 07/24/96
Expires 01/24/97
Revenue Code 18754

Establishment
DAVID ALLDER
T9N R6E SEC 24
LOT 12
2000 YANKEE HILL ROAD

FEES: $150.00

Permittee
DAVID ALLDER
3725 GARFIELD ST
LINCOLN NE 68506

TOTAL $150.00

Issued By M. Jane Ford
Health Director

2387

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW
"POST IN A PROMINENT PLACE"

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
3140 N Street
Lincoln NE 68510
(402)-441-8022

A

FILING FEE: $ 150.00

FILE NO. _____

DATE: _____

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 9N ; Range 6E ; Section 24 S.W. 1/4;
   Block _____ : Lot 12 I.T. : Addition _____
   Street Address 2000 Yankee Hill Rd.

2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 3 . Describe 2 story home w/ basement & attached garage.

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: 1 mile ~~ft.~~

David Allen
Signature of Applicant (Owner or Lessee)

3725 Garfield Lincoln Ne. 68506
Address

(Do not write below this double line)

1. Health Department: Date Rec'd. 7/22/96. Date Frwd. 7/23/96. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: or Village Clerk Date Rec'd. 7/23/96. Date Frwd. 7/23/96. ACTION: Approved ☒ Disapproved ☐ Signature: _____

3. City or County Engineer : Date Rec'd. 7.23.96. Date Frwd. 7.23.96. ACTION: Approved ☒ Disapproved ☐ Signature: _____

REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: 11-8-96 by: P.D
Date: 11-9-96 by: P.D.
Date: ~~12-30-96~~ by: P.

INSTALLATION FINAL WRITTEN APPROVAL
Date: 12-30-96 By: _____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 23-43

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
3140 N Street
Lincoln NE 68510
(402)-441-8022

B

FILE NO. _____

24, T9N, R63 Lot 12

PROPERTY WHERE SOIL TESTED:

Location: Township 9N ; Range 6E ; Section & ¼ Section 24 SW 1/4
Property Dimensions: 300 ft. x 544 ft. Area: 3.75 acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☐ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ☐ .
Dates of Tests: 6-22-96 to 6-23-96. Weather: Precip. 0 Temp. @92°.

OWNER: Dave & Nancy Allder
Address: 3725 Garfield / Lincoln Ne. 68506-1028

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1	34"	6-22	2:45pm	6-23	11:00a.m	6-23	11:00am	6"	11:30 6-23	5 1/4"	30min.	3/4"	30/3/4" 40
2	34"	6-22	2:45pm	6-23	11:00	6-23	11:00	6"	11:30 6-23	5 1/2"	30min	1/2"	30/1/2" 60
3	34"	6-22	14:45	6-23	11:00	6-23	11:00	6"	11:30 6-23	5 1/4	30min	3/4"	30/3/4" 40
4	34"	6-22	14:45	6-23	11:00	6-23	11:00	6"	11:30 6-23	5 7/8	30min	3/8"	30/3/8" 80
5	34"	6-22	14:45	6-23	11:00	6-23	11:00	6"	11:30 6-23	5 3/8"	30mi	5/8"	30/5/8" 48
6	34"	6-22	14:45	6-23	11:00	6-23	11:00	6"	11:30 6-23	5 1/2"	30min	1/2"	30/1/2" 60
7	34"	6-22	14:45	6-23	11:00	6-23	11:00	6"	11:30 6-23	5 1/4	30min	3/4"	30/3/4" 40

Sum of Percolation Rates: _____
Average of Rates: _____
Mean of Rates: _____

Signature of Person Conducting Test
wk. 441-7891
Address 3725 Garfield - Lincoln Ne. 68506 Phone Hm. 489-2949

(Do not write below this line)

REVIEWING ACTION

Remarks: SLOW FOR JUDSON SILT LOAM
Soil Type (SCS): JUDSON SILT LOAM
Date: _____

Approved Percolation Rate (a)
A. 48 min./inch
B. _____ min./inch
C. _____ min./inch

Jerrold C. Hood
Signature of Reviewing Official

FORM 20102-0477
PRELIMINARY PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐


LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
3140 N Street
Lincoln NE 68510
(402)-441-8022

C

Sketch of property showing Percolation Test hole locations, well, residence, direction and property line.

FILE NO. _____

Indicate on sketch if residence and well are exisiting or proposed.

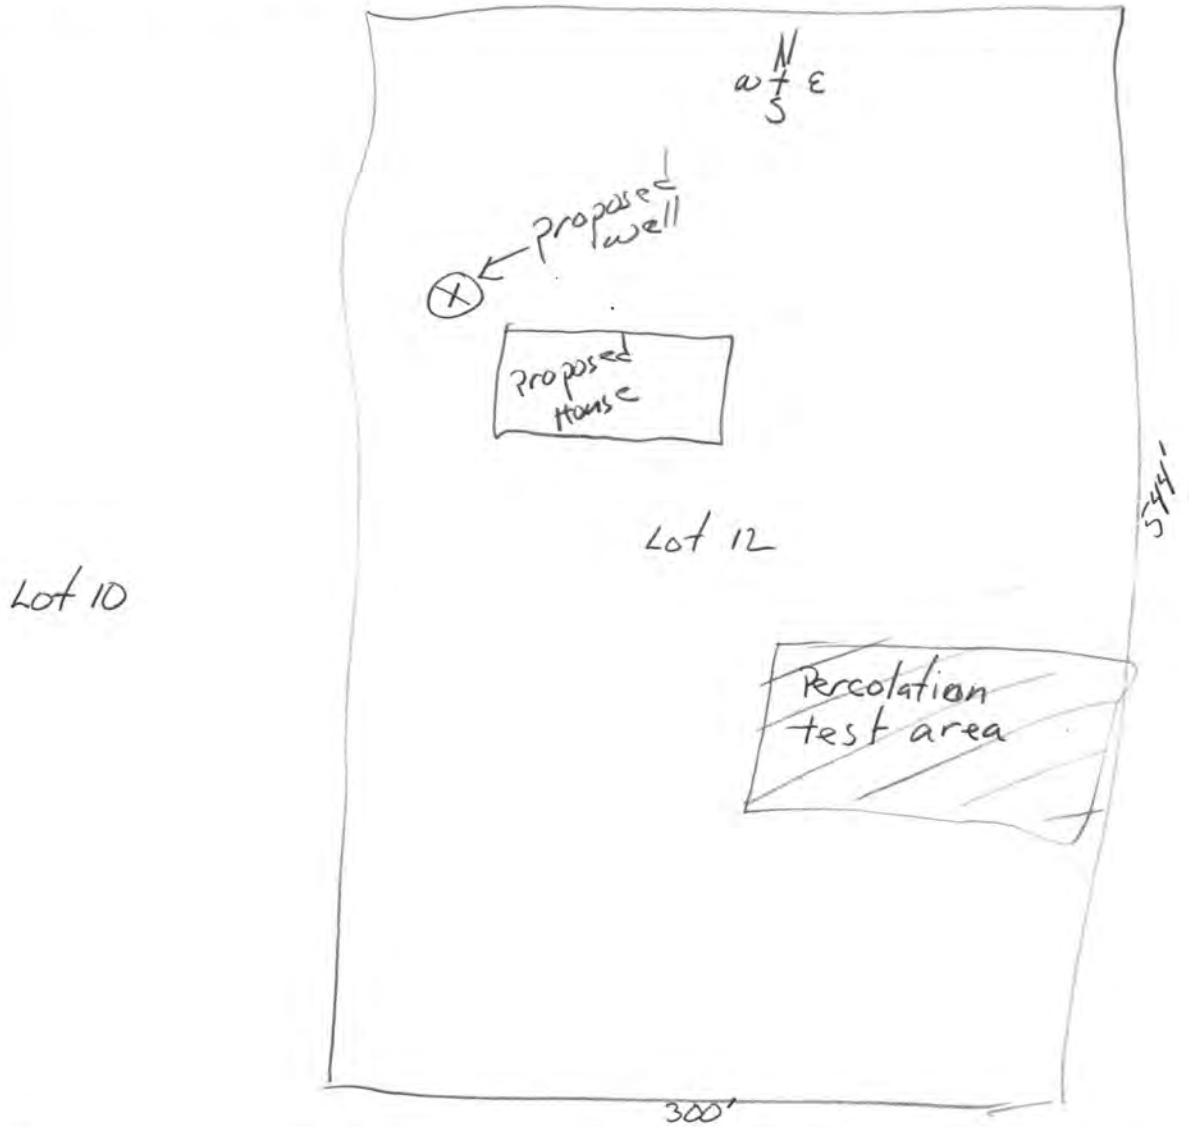

REVIEWING ACTION


Remarks : _____

_____

Date: _____

Minimum Design Requirement
1. Capacity of Septic Tank 1000 gals.
2. Total Length of Laterals _____ ft.
3. With a Trench Width of _____ in.
4. Total Area of Lateral needed 916 sq.ft.

Jerrold C. Hood
Signature of Reviewing Official

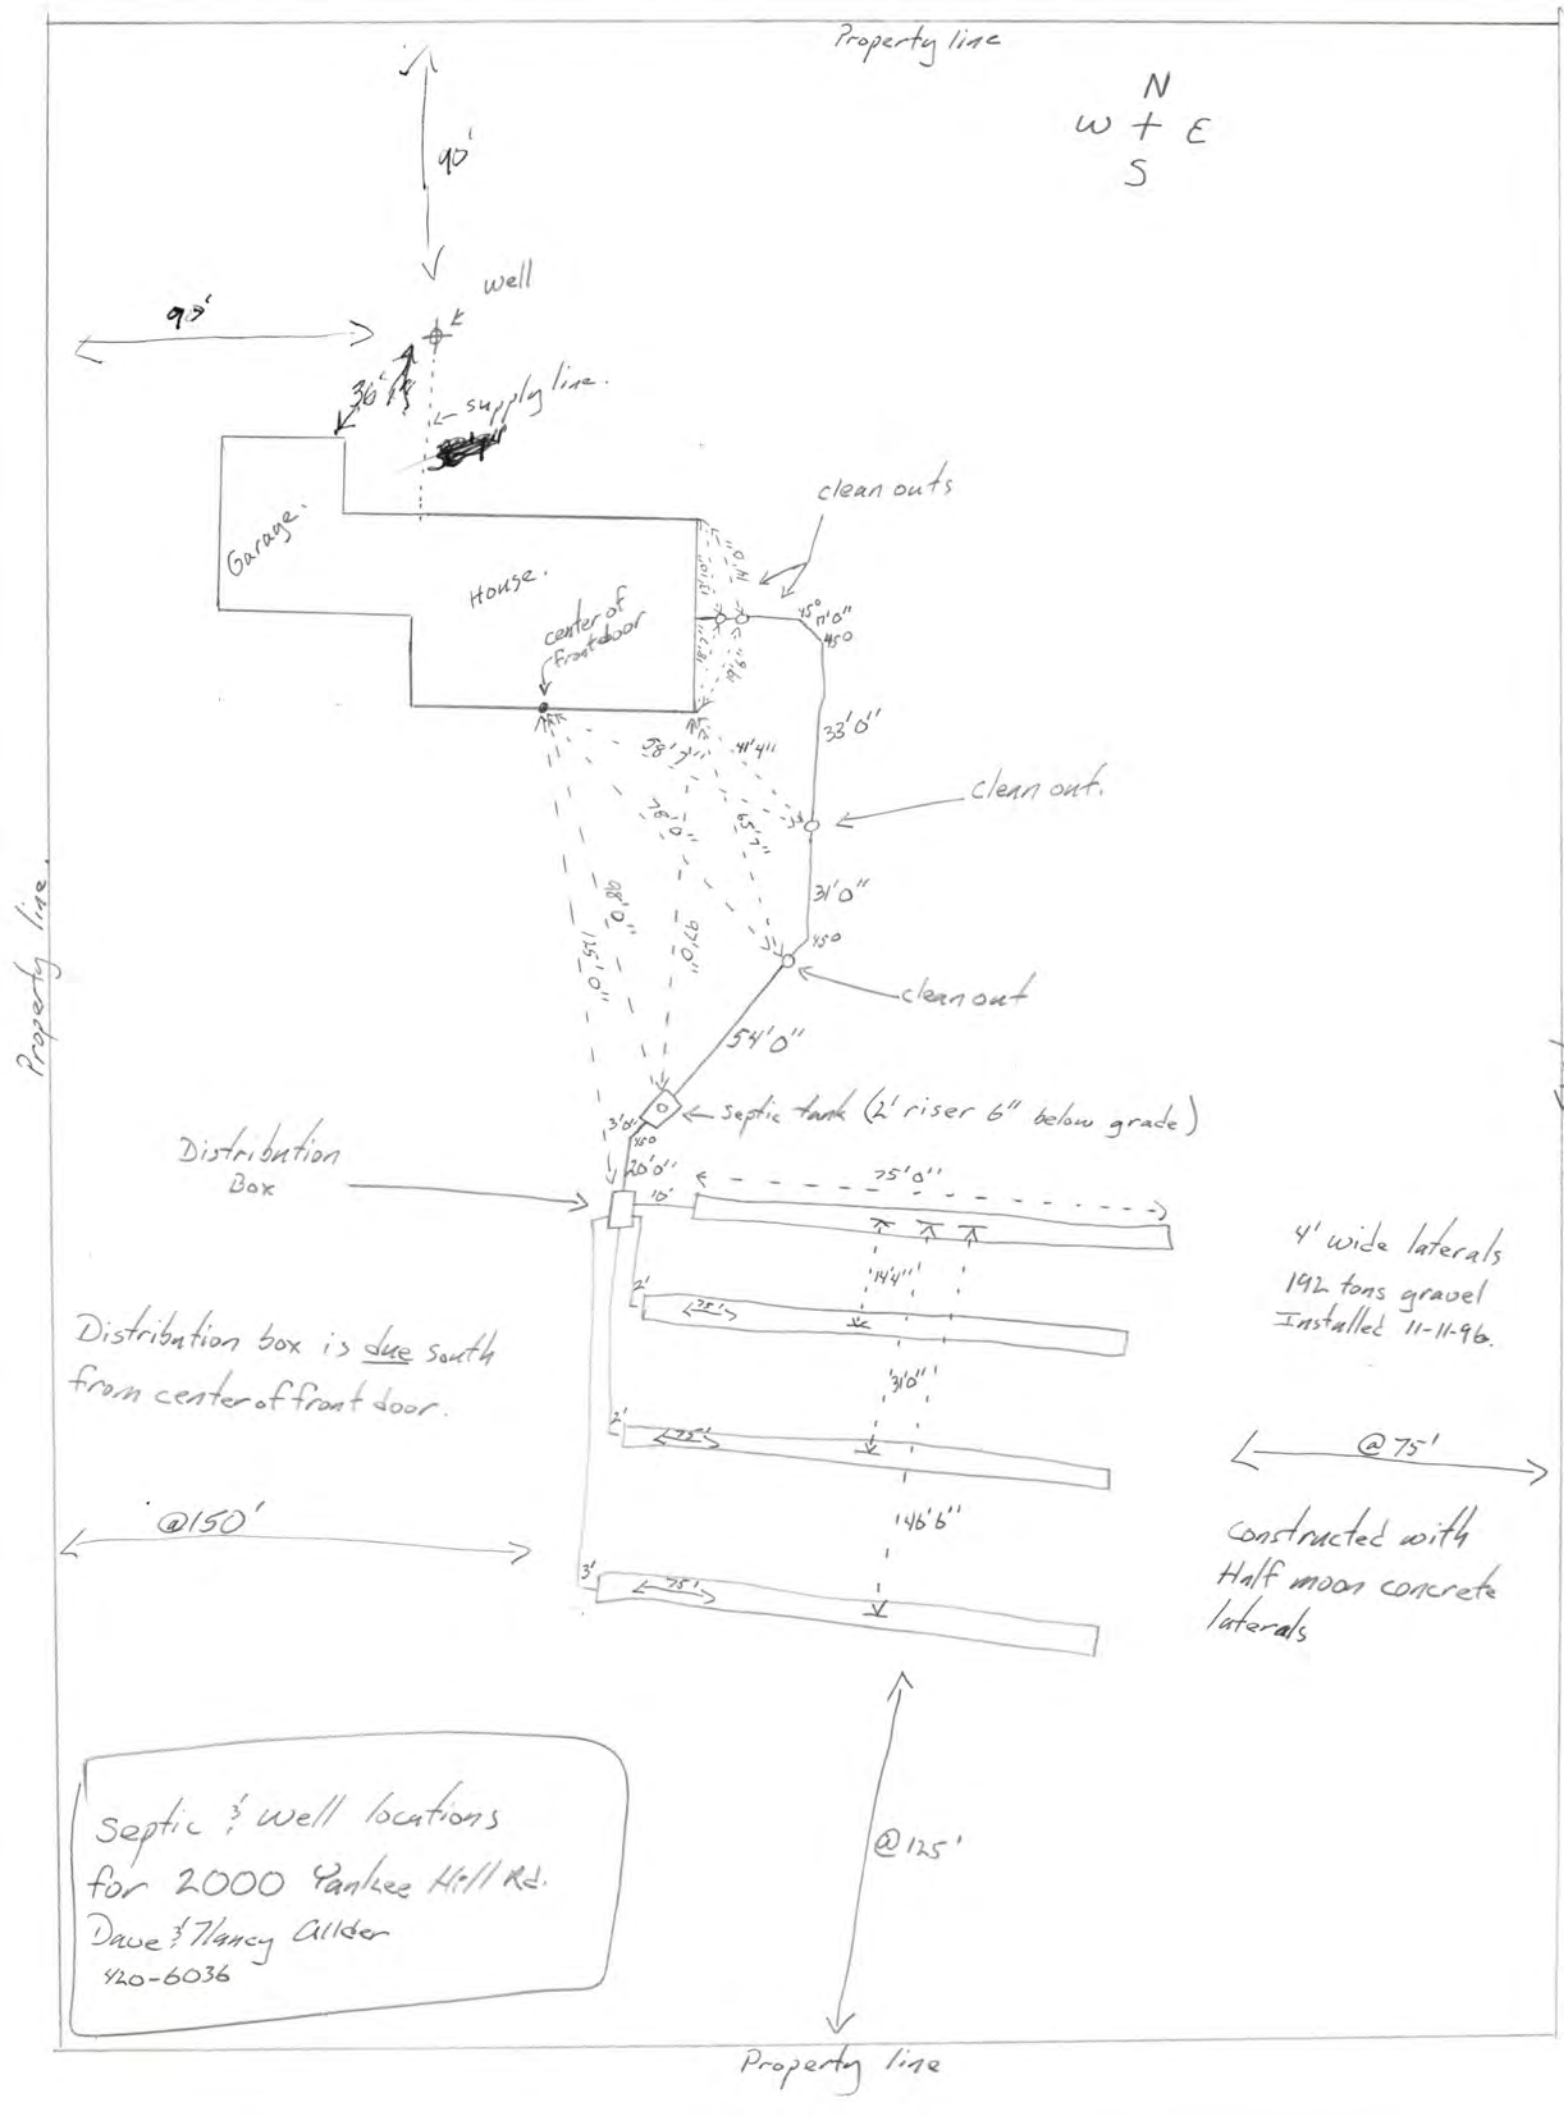
Property line
N
W + E
S
90'
well
95'
36'
supply line.
Garage.
House.
clean outs
center of front door
45° 1'0"
45°
33'0"
clean out.
31'0"
45°
clean out
54'0"
septic tank (2' riser 6" below grade)
3'0"
45°
Distribution Box
20'0"
75'0"
10'
14'4"
2'
35'
3'0"
2'
35'
146'6"
3'
75'
@150'
@75'
@125'
Property line
Property line
Property line
Distribution box is due south from center of front door.
4' wide laterals
192 tons gravel
Installed 11-11-96.
Constructed with Half moon concrete laterals
Septic & well locations for 2000 Yankee Hill Rd.
Dave & Nancy Allder
420-6036


R6
NOT TO SCALE
Lancaster Co. 1987 Photo G12
T-9-N R-6-E 80 Sec. 24
(Part)
24
25
S. 14TH
S. 27TH
2772
T3487
3.1 HEL/NW
HEL/NW
2
7.5
7.2 HEL/NW
4102
MT9976
T8973
MT8973
T8974
4102
T8975
3.2
HEL/NW
4.4
HEL/NW
HEL/NW
1st Lt.
Well location
3
53.4
NHEL/NW
5
37.0
HEL/NW
6
3.6
HEL/NW
3
78.0
HEL/NW
4
10.8 HEL/NW
2734
T3454
2154
T3170
3278
T930
20.1
HEL/NW
2
28.7
NHEL/NW
57.3
HEL/NW
19.7
2747
T3464
19.0
NHEL/NW
3
48.8
HEL/NW
2925
T3759
18.8
2
109.0