FILE NO. 85

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION
TYPE OF LICENSE OR PERMIT

May 18, 1969
THIS LICENSE OR PERMIT EXPIRES

Donald Magee for Gateway Wester Realty — 6331 Burlington
LICENSEE OR PERMITTEE — ADDRESS

T 9N; R 6E; Sec. 16; No. of Blk. 1; Lot 5; E. of Lot 1,; Blk. 1;
Gateway Western Estates
NAME OF ESTABLISHMENT, IF ANY — ADDRESS

REMARKS: Non-Transferable

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
143 ~~110.15~~35	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT
14592	NOV 18 '68	30.00

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-30(67) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 85

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

T9N, R6E, SEC. 16

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Approx 5 acres N of Block 1 Lot 5 Gateway Western Estates
Twp. ____; Range Lot 1; ~~Section~~ Block 1;
Block ____; Lot 19; Addition ____;
Street Address ____.

2. Property Use: Residential ____ ☑; Commercial ____ ☐
No. of Bedrooms 3. Describe: ____
Other Use ____ ☐
Describe: ____

3. Type of Individual Sewage Disposal System: Septic Tank ☑; Other ☐

4. Distance to public sewer: ____ ft.

Gateway
Donald Mayer for Western Estates
Signature of Applicant (owner or lessee)

6331 Burlington
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 11/18/68. Date Frwd. ____.
ACTION: Approved ____ ☒ Disapproved ☐
Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: Date Rec'd. 11/18/68. Date Frwd. ____.
ACTION: Approved ____ ☒ Disapproved ☐
Signature: Chas Seals by Bob Skinner

3. City Engineer: Date Rec'd. 11-18-68. Date Frwd. ____.
ACTION: Approved ____ ☒ Disapproved ☐
Signature: J. L. Blessing

REMARKS OR REASONS FOR DISAPPROVAL ____

FINAL ACTION ON SITE CLEARANCE: Approved ☐ Disapproved ☐

Date Applicant Notified: ____ Signature ____

FORM HD-32(67) APPLICATION FOR PERMIT
TO CONSTRUCT INDIVIDUAL SEWAGE
DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 85

DATE: 14 Nov 68

TO: Director of Health
Lincoln-Lancaster County Health Dept.

T 9N, R6E, SEC. 16

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Approx 5 acres N of Block 1 Lot 5 Gateway Western Estates
Twp. E of Lot; Range Block; Section ;
Block ; Lot ; Addition ;
Street Address .

2. Property Use: Residential [X]; Commercial [ ]
No. of Bed Rooms 3 Describe:

Other Use [ ]
Describe:

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

Donald Mayer for Gateway Realty
Signature of Applicant (owner or lessee)

6331 Burlington
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd:
Filing Fee: $.

2. Date Site Clearance

3. Site Visits:
Date: by:
Date: by:
Date: by:

4. Date: Approved [X]; Disapproved [ ]: 11/18/68
by: Jerrold C. Hood

5. BUREAU OF LICENSES & PERMITS
Date Notified:
Date Issued: Serial

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: 4/22/69 by: Jerrold C. Hood

FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

FILE NO. 85

PROPERTY WHERE SOIL TESTED: Approx 5 acres N of Block 1 Lot 5 E of Lot 1 Block 1 Owner: Gateway Realty
Location: Township _____
Section & ¼ Sect. Gateway Western Estates Address _____
Property Dimensions: ____ ft. x ____ ft.
Area: _____ acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☐; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☐

Dates of Tests: 12/11/68 to 12/11/68. Weather: Precip. None Temp. 35 F.

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	36	12/11/68	630	12/11/68	1230	12/11/68	1230	30	1247	29	17	1	17/1
2	36	12/11/68	630	12/11/68	1230	12/11/68	1230	30	1249	29	19	1	19/1

Donald Moya
Signature of Person Conducting Test

Address 6331 Burlington
Phone: 488-8099

Sum of Percolation Rates 18/1
Average of Rates:
Mean of Rates:

(Do not write below this line)

REVIEWING ACTION

REMARKS: _____

Approved Percolation Rate(s)
A. 18 min./inch
B. _____ min./inch
C. _____ min./inch

DATE: November 18, 1968

Gerald C. Hood
Signature of Reviewing Official

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 85

SPECIFICATIONS

DATE: 14 Nov 68


A. BUILDING SEWER:
1. Material Clay tile; Diameter 4 in.
2. Distance above basement floor ___ in.; or below basement floor 18 in.
3. Distance between dwelling and septic tank 90 ft.
4. Number of clean-outs ___.
5. Distances To:
Well or Suction Line ~~100~~ 16 ft.;
Stream ___ ft.; Pressure Line ___ ft.;
Property Line 200 ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material Fiber; No. of compartments 1.
2. Capacity 1000 gals.; Liquid depth 48 in.
3. Factory Built: Yes ☑ (Company Concrete)
No ☐
4. Manholes: Over Inlet; diam. 16 in.
Over Outlet; diam. ___ in.
Below Grade ___ in.
5. Inlet: Baffle ☑; or Tee ☐
6. Outlet: Baffle ☐; or Tee ☑
Depth of outlet below inlet 2 in.
7. Depth of top of tank below finished grade 18 in.
8. Distances To:
Well or Suction Line ~~200~~ 100 ft.;
Stream ___ ft.; Pressure Line ___ ft.;
Property Line 200 ft.


C. DISTRICTION BOX
1. Material Concrete; No. available outlets 5.
2. Factory Built: Yes ☑, (Company Concrete)
No ☐
3. Dimension: Length 13 in.; Width 11 in.
Depth 8 in.
4. Distance from Septic Tank 7 ft.
5. Serial Distribution: Yes ☑, No ☐
(If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: Half Moon
2. Lateral Lines: Depth below grade 18 in.
Number 2; Length of each line 90 ft
Total length of Laterals 180 ft.;
Slope 4 in/100 ft. Diameter of pipe 6 in.; Shape Half Moon
Material: concrete ☐; fiber asbestos ☐; clay ☐; other ___
Distance between lateral lines 20 ft.
3. Trench Dimensions: Depth 40 in.;
Width 48 in.
4. Filter Material: Gravel.
Depth of material from trench bottom 18 in.
5. Distances To:
Well or Suction Line 100 ft.;
Stream ___ ft.; Pressure Line ___ ft.
Property Line 200 ft.
6. Percolation Rate: 18 minutes/inch

TYPICAL SKETCHES

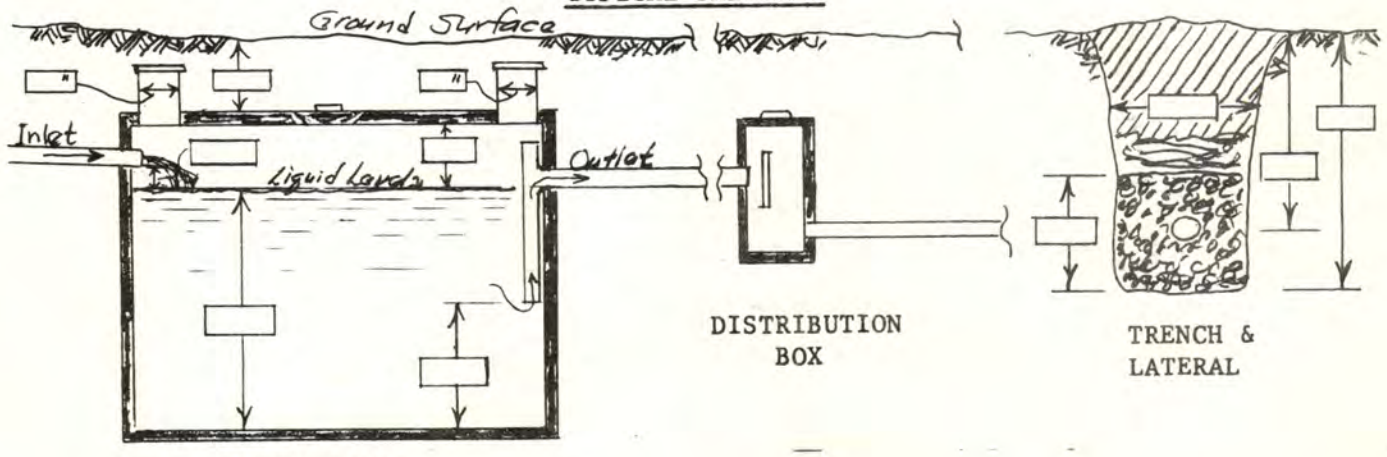

Signature of Applicant

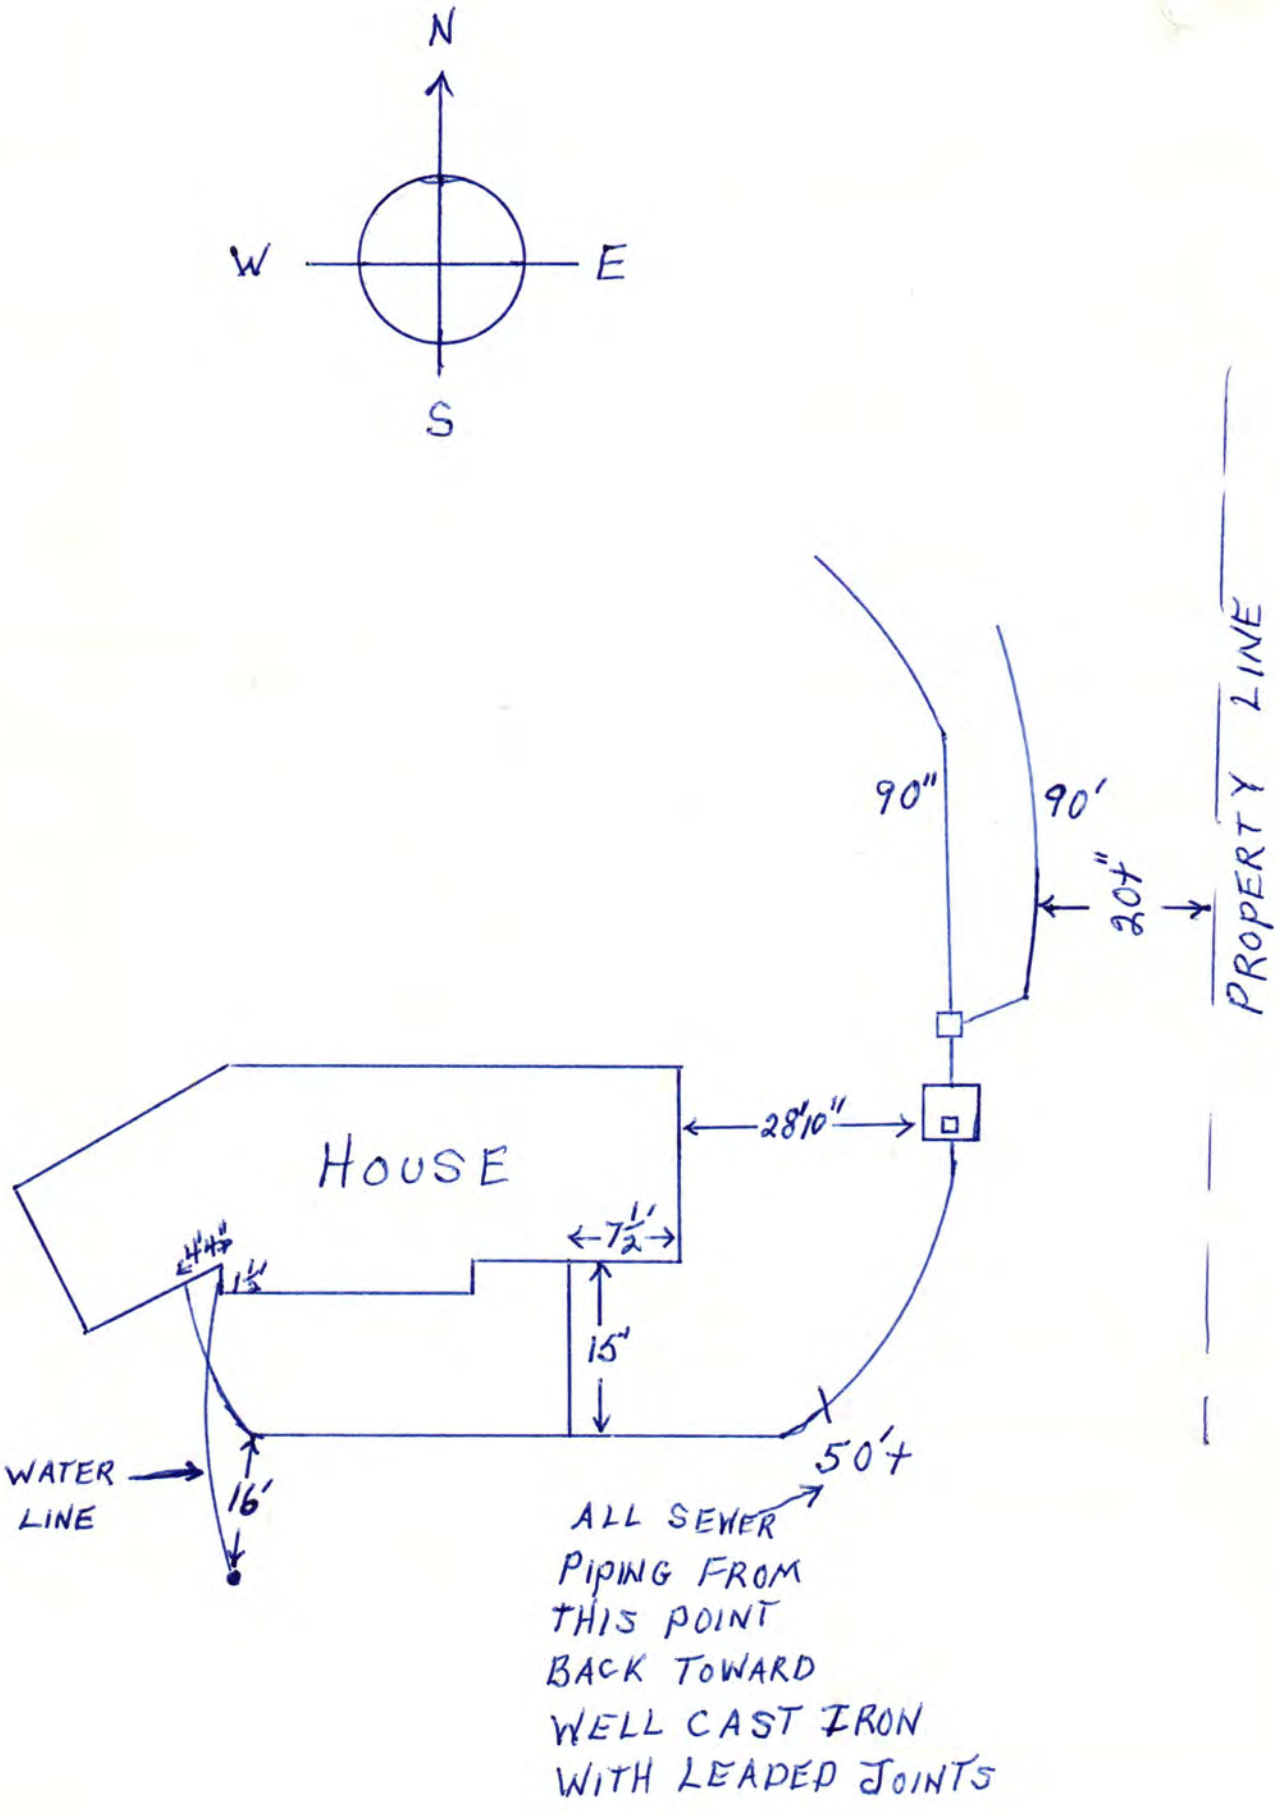
N
W
E
S
90"
90'
20'+
PROPERTY LINE
HOUSE
28'10"
7½'
15'
WATER LINE
16'
50'+
ALL SEWER PIPING FROM THIS POINT BACK TOWARD WELL CAST IRON WITH LEADED JOINTS