FILE NO. 196

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

November 28, 1971 — THIS LICENSE OR PERMIT EXPIRES

Deon Bahr — LICENSEE OR PERMITTEE

5628 M Street, Lincoln, Nebraska — ADDRESS

T9N; Range 7; Section SW1/4 of 2; Lot 6; Ikiru East Addition — NAME OF ESTABLISHMENT, IF ANY

ADDRESS

Non-Transferable

REMARKS:

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE	
624-1535	110.16	148.14	6-2	

SERIAL NO.	DATE	AMOUNT

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-30(67) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 196

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. 9; Range 7; Section SW¼ OF ?
Block NA; Lot 6; Addition IKIRU EAST
Street Address 4144 So 88th ½ BLOCK N. OF 88 PIONEER.

2. Property Use: Residential ____ ▨; Commercial ____ ☐
No. of Bedrooms 3. Describe: ____
Other Use ____ ☐
Describe: ____

3. Type of Individual Sewage Disposal System: Septic Tank ▨; Other ☐

4. Distance to public sewer: NOT KNOWN ft.

Leon Bahr
Signature of Applicant (owner or lessee)

5628 M LINCOLN 68510
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 5/25/71. ACTION: Approved ☒ Disapproved ☐
Date Frwd. 5/28/71. Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: Date Rec'd. 5/28/71. ACTION: Approved ☐ Disapproved ☑
Date Frwd. ____. Signature: Charles Seale By RS

3. City Engineer: Date Rec'd. ____. ACTION: Approved ☐ Disapproved ☑
Date Frwd. 5-28-71. Signature: [illegible]

REMARKS OR REASONS FOR DISAPPROVAL ____

FINAL ACTION ON SITE CLEARANCE: Approved ☐ Disapproved ☐

Date Applicant Notified: ____ Signature ____

FORM HD-32(67) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 196

DATE: 21 MAY 1971

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 9 ; Range 7 ; Section SW¼ of 2
Block NA ; Lot 6 ; Addition IKIRU; EAST
Street Address 4144 so 88 .

2. Property Use: Residential ____ [■]; Commercial ____ [ ]
No. of Bed Rooms 3 Describe: ____
Other Use ____ [ ]
Describe: ____

3. Type of Individual Sewage Disposal System: Septic Tank [■]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

Leon Bahr
Signature of Applicant (owner or lessee)

5628 M Lincoln Nebr 68510
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: ____
Filing Fee: $30.00 .

2. Date Site Clearance ____

3. Site Visits:
Date: 5/28/71 by: L.C.H.
Date: 10/14/71 by: L.C.H.
Date: ____ by: ____

4. Date: Approved X; Disapproved ___: 5/28/71
by: Jerrold C. Hood

5. BUREAU OF LICENSES & PERMITS
Date Notified: ____
Date Issued: ____ Serial ____

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: 10/14/71 by: Jerrold C. Hood

FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

FILE NO. 196

PROPERTY WHERE SOIL TESTED:
Location: Township NINE
Section & ¼ Sect. SW¼ OF 2
Property Dimensions: 178 ft. x 460 ft.
Area: 1.78 acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☐; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☐

Owner: DEON BAHR
Address 5628 M LINCOLN NEBR.

Dates of Tests: _____ to _____. Weather: Precip. ____ Temp. ___F.

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	28	5/22	11:30AM	5/23	9:00am	5/23	9:22	24	10:26	11	62	13	4.75
2	29	5/22	11:30AM	5/23	9:00am	5/23	9:20	26	10:27	15	67	11	6.1
3	27	5/22	11:30AM	5/23	9:00am	5/23	9:18	23.3	4:55	18	457	7.3	62.5
4	29	5/22	11:30AM	5/23	900am	5/23	9:26	24	10:03	8	37	16	2.5
5	32	5/22	11:30Am	5/23	900am	5/23	9:28	27	4:55	14	447	13	34.0
6	30	5/22	11:30AM	5/23	900am	5/23	9:16	27.5	4:55	18	459	9.5	48.3

Sum of Percolation Rates 158.2
Average of Rates: 26.3
Mean of Rates:

Deon Bahr
Signature of Person Conducting Test

Address 5628 M
Phone: 477-4555

(Do not write below this line)

REVIEWING ACTION

REMARKS: System to be installed as away from clay soil as indicated by hole #3 & 6. A made an onsite visit

DATE: May 28, 1971

Approved Percolation Rate(s)
A. 11.84 min./inch
B. _____ min./inch
C. _____ min./inch

Jerrold C. Hood R.S.
Signature of Reviewing Official

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 196

SPECIFICATIONS

DATE: 21 MAY 1971


A. BUILDING SEWER:
1. Material CAST I. ; Diameter 4 in.
2. Distance above basement floor NA. in.; or below basement floor 8 in.
3. Distance between dwelling and septic tank 120 ft.
4. Number of clean-outs NONE .
5. Distances To: Well or Suction Line 750 ft. (COMMUNITY WELL); Stream NONE ft.; Pressure Line 25 ft.; Property Line 75 ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material FIBERGLASS; No. of compartments ONE .
2. Capacity 1000 gals.; Liquid depth 48 in.
3. Factory Built: Yes [X] (Company CORRAGATED FIBERGLASS) No [ ]
4. Manholes: Over Inlet; diam. 16 in. Over Outlet; diam. NONE in. Below Grade 8" in.
5. Inlet: Baffle [X]; or Tee [ ]
6. Outlet: Baffle [ ]; or Tee [X] Depth of outlet below inlet 3 in.
7. Depth of top of tank below finished grade 36 in.
8. Distances To: Well or Suction Line 750 ft.; Stream NONE ft.; Pressure Line 60 ft.; Property Line 75 ft.

C. DISTRIBUTION BOX
1. Material CONCRETE No. available outlets 5 .
2. Factory Built: Yes [X], (Company PRECAST) No [ ]
3. Dimension: Length 13 in.; Width 11 in. Depth 12 in.
4. Distance from Septic Tank 6 ft.
5. Serial Distribution: Yes [X], No [ ] (If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: DISPOSAL TRENCH
2. Lateral Lines: Depth below grade 24 in. 36" Number 2 ; Length of each line 75 ft Total length of Laterals 150 132 ft.; Slope 4 in/100 ft. Diameter of pipe 16 in.; Shape HALF MOON TILE Material: concrete [ ]; fiber asbestos [ ]; clay [ ]; other FIBERGLASS Distance between lateral lines ___ ft.
3. Trench Dimensions: Depth 24 in.; Width 48 in.
4. Filter Material: WASHED GRAVEL . Depth of material from trench bottom 18 in.
5. Distances To: Well or Suction Line 750 ft.; Stream NONE ft.; Pressure Line 30 ft. Property Line 30 ft.
6. Percolation Rate: 26.3 minutes/inch

TYPICAL SKETCHES

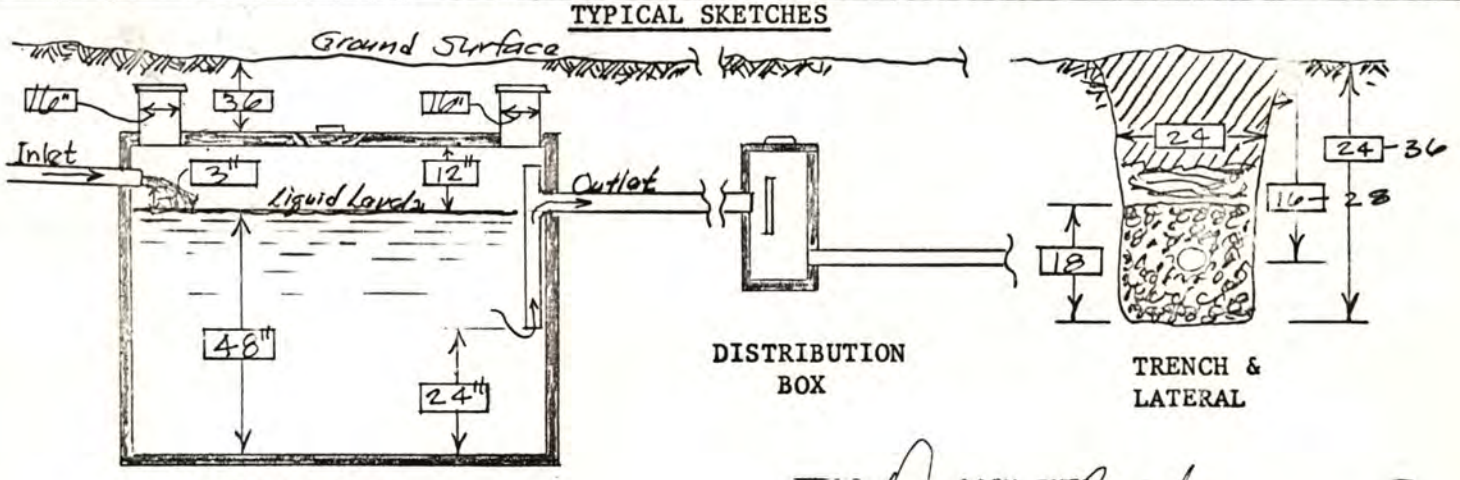


SEPTIC TANK

DISTRIBUTION BOX

TRENCH & LATERAL

Signature of Applicant

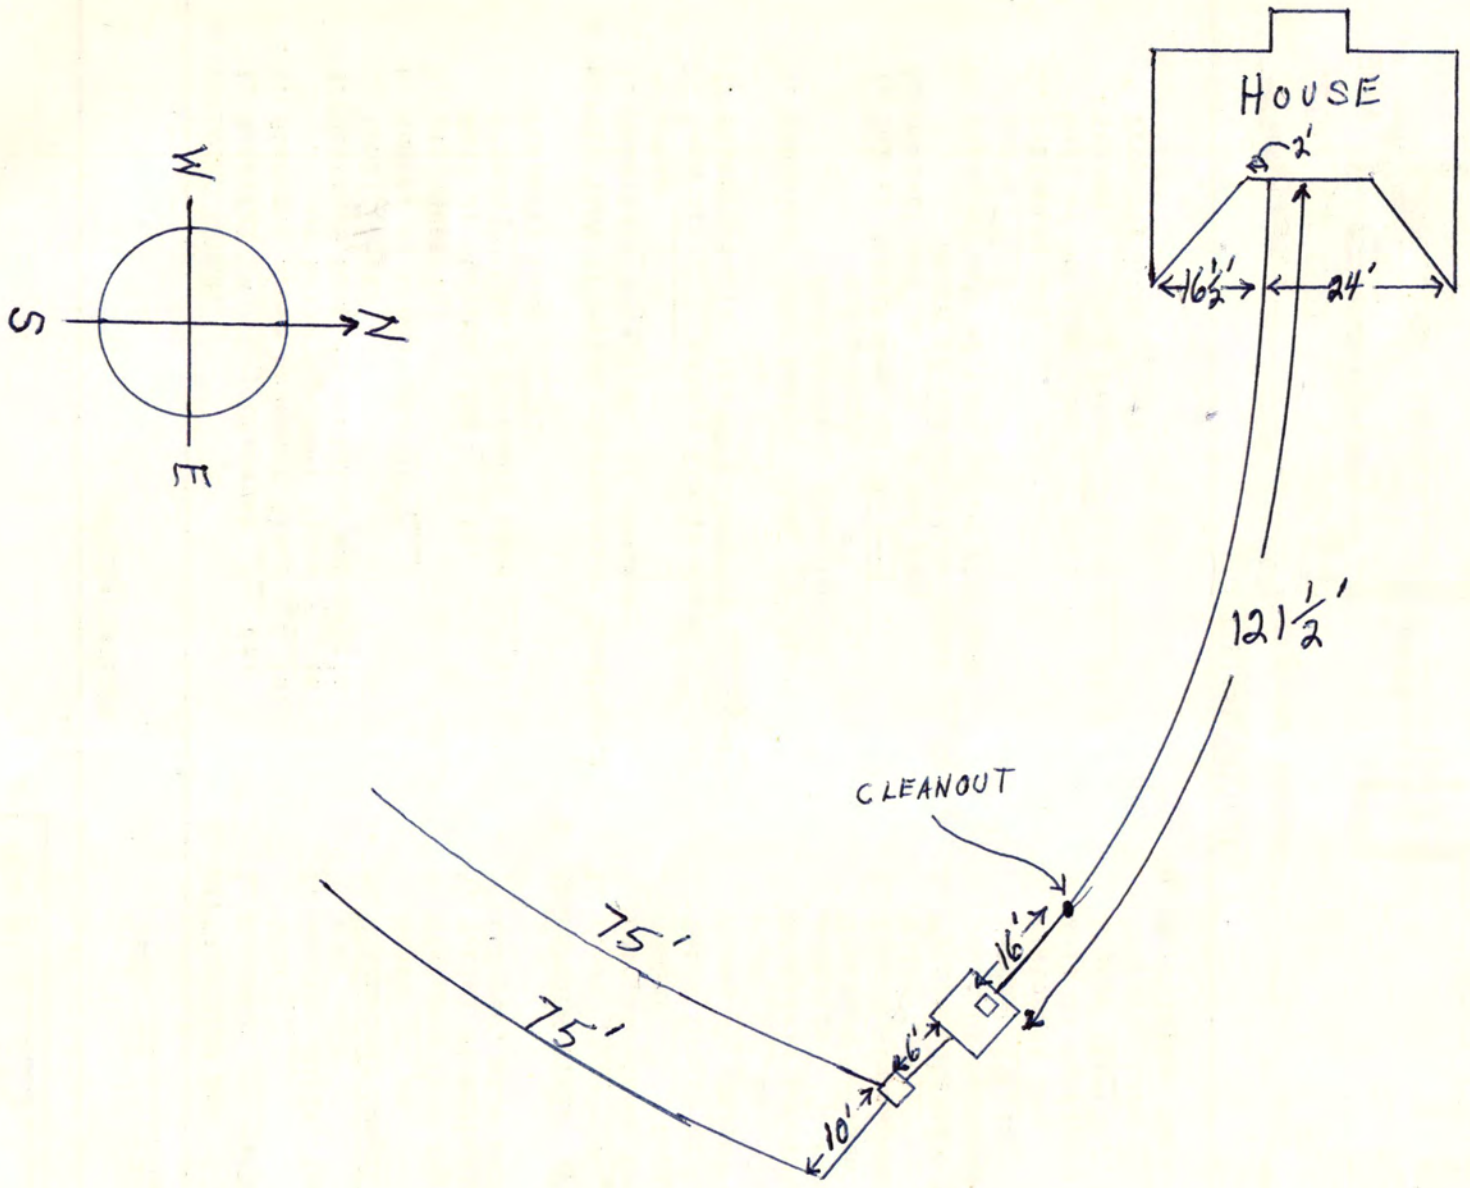
HOUSE
2'
16½'
24'
121½'
CLEANOUT
75'
75'
16'
6'
10'
W
S
N
E