CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

FILE NO. 199

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — December 26, 1971

TYPE OF LICENSE OR PERMIT — THIS LICENSE OR PERMIT EXPIRES

Frank Hartwig — 4820 Mandarin Circle

LICENSEE OR PERMITTEE — ADDRESS

9 — T11N; Range 7E; Section 10; Block 1; Lot 2; Pioneer Heights Addition EXTEND

NAME OF ESTABLISHMENT, IF ANY — ADDRESS

REMARKS: Non-Transferable

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624 110.15 1535	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-31(67) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

FILE NO. 199

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 6-28-71

The undersigned hereby applies for a permit to ALTER ☐, EXTEND ☒, or REPAIR ☐ an existing Individual Sewage Disposal System, in conformance with Lincoln City Ordinance No. 9150, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 9N; Range 7E; Section 10; Block 1; Lot 2; Addition PIONEER HEIGHTS
Street Address 4820 Mandrau Ct.

2. Property Use: Residential ☒; No. Bedrooms 3
Commercial ☐; Describe
Other Use ☐; Describe

3. Type of existing Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Description of proposed alteration, extension or repair: Box & 20' lateral 32' sewer line

5. Work to be done by: Owner ☐; or Contractor ☒, SINTEK SERVICE
Contractor's Name

6. Estimated cost of project:

a. Materials	$	
b. Labor	$	
c. Other	$	
TOTAL	$	355 95

Frank Harlwig
Signature of Applicant (owner ~~or lessee~~)

4820 Mandrau Ct.
Address

(Do not write below this line)

REVIEWING ACTION

1. Date Rec'd:
Filing Fee: $ 30.00

2. Date Site Clearance:

3. Site Visits:
Date: by: L.C.H.
Date: by:
Date: by:

4. Date: Approved ☒; Disapproved ☐
by: Jerrold C. Hood R.S.

5. BUREAU OF LICENSES & PERMITS
Date Notified:
Date Issued: Serial

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: 6/28/71 by: L.C.H.

Lincoln-Lancaster County Health Department

3140 "N" Street, Lincoln, Nebraska 68510 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: Lincoln-Lancaster County Health Department or LLCHD

☒ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

☒ Evaluation of the Individual Water System ☒ Evaluation of the Sewage Disposal System

Legal Description of Property: Street Address 4820 MANDARIN Cr.
Twp 9N Range 7E Section 10 1/4 ___ 1/4 ___ Block 1 Lot 2 Addition Pioneer Heights
Directions to Property 2 Blocks So of 84th + Pioneers - Turn West - 2nd House on North Side of Street
Location of Well SE corner outside of garage Tap Location: Inside ☐ Outside ☒
Location of Sewage System behind house ? (ask present owner) Year Installed ? 1965 ?

	NAME	ADDRESS	PHONE
Present Owner:	Frank + Nelda Hartwig	4820 Mandarin Cr. Lincoln, Ne 68516	489-2065
Tenant/Buyer:	Gary + Joyce Kunert	8231 East Avon Lane Lincoln, Ne 68505	489-5769
Return to:	Gary Kunert	8231 East Avon Lane Lincoln Ne 68505	489-5769

Signature of Applicant Gary Kunert Address 8231 East Avon Lane Lincoln, Ne 68505 Date 02/04/95

HEALTH DEPARTMENT USE ONLY

Date Received 02/06/95 Received $150.00 ✓ Check ☑ #6194 Cash ☐

PRELIMINARY STATUS--By Jerrold C. Hood **DATE:** 2/7/95

WATER SYSTEM:	Approved	Disapproved
Construction	☒	☐
Bacteria	☒ 0 /ml	☐ ___ /ml
Nitrate	☒ 0.1 ppm	☐ ___ ppm

SEWAGE SYSTEM	
Approved	☐
Provisional	☒
Disapproved	☐

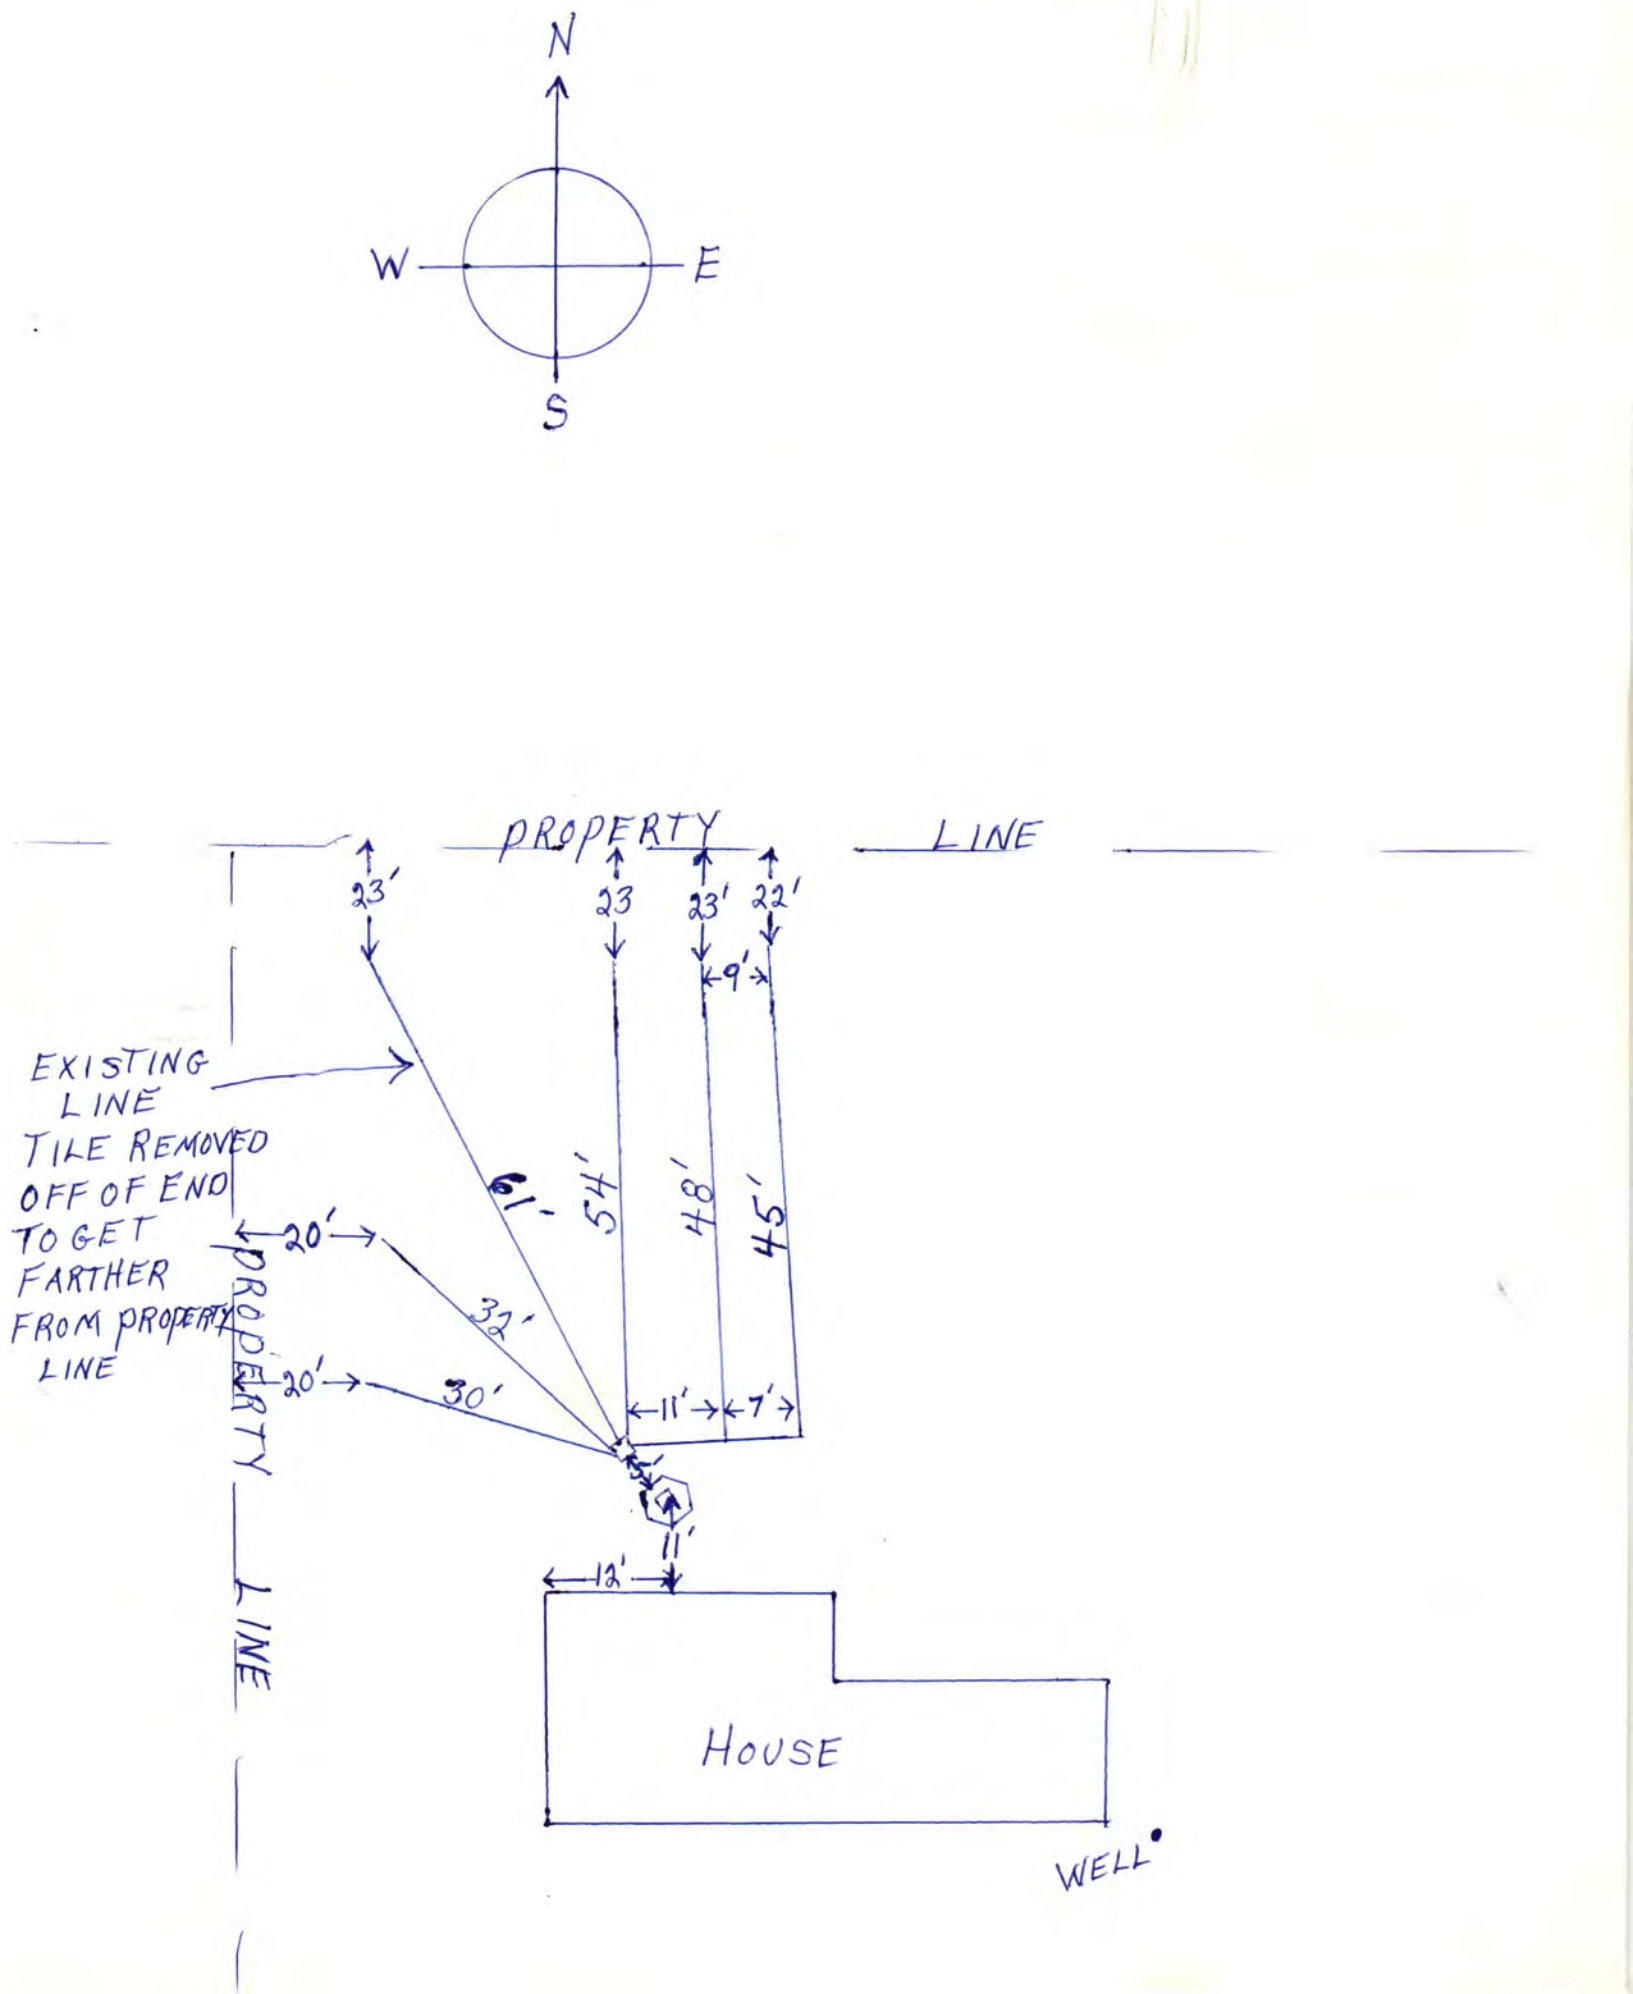
Additional Site Visits
Date ___/___/___ by ___
Date ___/___/___ by ___
Date ___/___/___ by ___

Comments: SEPTIC SYSTEM PREDATES REGULATIONS, FOUND NO RECORDS ON SYSTEM, HENCE APPROVAL IS PROVISIONAL. NO EVIDENCE OF MALFUNCTION. IF SEPTIC SYSTEM HAS NOT BEEN PUMPED RECENTLY IT SHOULD BE CHECKED TO SEE IF IT IS NEEDED. LOT IS RATHER SMALL TO SUPPORT BOTH A WELL + SEPTIC SYSTEM. See Attached Letter ☐

FINAL STATUS
WATER SYSTEM: Approved: ☒ **SEWAGE DISPOSAL SYSTEM** Approved: ☐ Provisional Approval: ☒

Approved by Jerrold C. Hood R.E.H.S. Date 2/9/95

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.


N
W
E
S
PROPERTY LINE
23'
23
23'
22'
9'
EXISTING LINE
TILE REMOVED OFF OF END TO GET FARTHER FROM PROPERTY LINE
20'
61'
54'
48'
45'
32'
20'
30'
11'
7'
11'
12'
PROPERTY LINE
HOUSE
WELL