LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

Division of Environmental Health
2200 St. Marys Ave Lincoln, NE 68502 (402) 471-8000

NON TRANSFERABLE

PERMIT

SEWAGE INSTALLATION

No. 91380069101

Issued 04/19/91
Expires 10/19/91

ESTABLISHMENT

CHRIS GRABENSTEIN
T9N R7E SEC 13
HIDDEN VALLEY ACRES BLK 2 LOT 3

FEES: Permit 018754 $150.00

Total $150.00

PERMITTEE

CHRIS GRABENSTEIN
4630 ANTELOPE RD
LINCOLN NE 68506

Issued By COUNTY HEALTH

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE	
DATE	AMOUNT
4/25/91	PAID

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 150.00

FILE NO. _____

DATE: April 19, 1991

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 9N ; Range 7E ; Section 13 ;
   Block 2 : Lot 3 : Addition HIDDEN VALLEY ACRES
   Street Address _____

2. Property Use: Residential ☑ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 3 . Describe _____

3. Type of Individual Sewage Disposal System: Septic Tank ☐ ; Other ☑

4. Distance to public sewer: DNA ft.

Chris E Gluckman GK
Signature of Applicant (Owner or Lessee)

4630 SUTELOPE CIR
Address

(Do not write below this double line)

1. Health Department: Date Rec'd. 4/19/91. Date Frwd. 4/19/91. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: or Village Clerk Date Rec'd. 4/19/91 Date Frwd. 4/19/91 ACTION: Approved ☑ Disapproved ☐ Signature: Mel Goddard

3. City or County Engineer: Date Rec'd. 4-19-91. Date Frwd. 4-19-91. ACTION: Approved ☒ Disapproved ☐ Signature: Dennis Bartels

REMARKS OR REASONS FOR DISAPPROVAL RURAL WATER DISTRICT WATER

Site Visits:
Date: 6/4/91 by: J.C.H.
Date: _____ by: _____
Date: _____ by: _____

INSTALLATION FINAL WRITTEN APPROVAL
Date: 6/4/91 By: Jerrold Hood

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 23-43

ATTACHMENT C.

SOIL ABSORPTION TEST DATA REPORT

PROPERTY WHERE SOIL TESTED: **Owner:** Chris Grabenstein

Location: Township _____

Section & 1/4 Sect. _____ **Address:** LOT 3 B-2 HIDDEN VALLEY

Property Dimensions: _____ ft. x _____ ft

Area: _____ acres. (Attach sketch of property showing hole location).

Soil Type: Silty Clay X; Silty Clay Loam ___; Sandy Loam ___

Silty Loam ___; Clay Loam ___: Sandy Clay ___

Dates of Tests: 4-20-91 to 4-21-91. **Weather: Precip.** Trace. **Temp.** 65°

PERCOLATION TEST DATA FILE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolat Rates (Min./in
1	36	4-20	1430	4-21	1200	4-21	1200	34"	1600		30 min	1¾"	
2	36	"	"	"	"	"	"	"	"		"	3¼"	
3	"	"	"	"	"	"	"	"	"		"	4"	
4	"	"	"	"	"	"	"	"	"		"	1½"	
5	"	"	"	"	"	"	"	"	"		"	1¾"	
6	"	"	"	"	"	"	"	"	"		"	4¼	
7	"	"	"	"	"	"	"	"	"		"	5"	

Sum of Percolation Rates ____

Average of Rates: ____

Inches per Minute: 10

Signature of Person Conducting Test

Address 3925 Touzalin AVE.

Phone 464 0638 days 464 3947 eves.

Judson Silt Loam

6/17/91 It was not. Looked more like Sharpsburg Silty Clay Loam. 10 min/in. Might have been a bit optimistic.

016

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 St Marys Avenue Phone (402) 471-7800 Lincoln, Nebraska 68502

REAL ESTATE TRANSFER / LOAN APPROVAL

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County Health Department.

☐ Evaluation of the Individual Water System Date: Sept. 8, 1992

☒ Evaluation of the Sewage Disposal System ☒ Enclosed is $150.00

Legal Description of Property: TWP. 9N ; RANGE 7E ; SECTION 13 ; BLOCK 2

LOT 3 ; ADDITION Hidden Valley Acres ; Street Address 6521 Prairie Rim Road

Directions to Property Go East on Pine Lake Road at 84th Street. Hidden Valley Acres is directly North of Hidden Valley Golf Course

Location of Well _____ Tap Location: Inside ☐ Outside ☐

Location of Sewage System Behind House Year Installed 1991

	NAME	ADDRESS	PHONE
Present Owner:	Judy Reiners	6521 Prairie Rim Rd.	489-8892 474-4909
Tenant/Buyer:			
Return to:	Judy Reiners	6521 Prairie Rim Rd. Lincoln Ne. 68526	

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant Judy Reiners Address 6521 Prairie Rim Rd Lincoln, Ne 68526

==========

HEALTH DEPARTMENT USE ONLY

Date Received SEPTEMBER 10, 1992 Received $150.00 Check ☑ Cash ☑

PRELIMINARY STATUS--DATE 9-10-92

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:		SITE VISIT:
Construction	☐	☐	Approved:	☐	Date 9-10-92 by PD
Bacteria	☐	☐	Provisional:	☐	Date _____ by ____
Nitrate	☐	☐	Disapproved:	☐	Date _____ by ____

Comments: ON Rural Water

See Attached Letter ☐

FINAL STATUS


WATER SYSTEM: Approved: ☑

SEWAGE DISPOSAL SYSTEM: Approved: ☑ Provisional Approval: ☐


APPROVED BY Paul Dyk DATE 9-11-92

Approval or disapproval is based on written standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operation. WELLS - Nebraska Safe Drinking Water Act,
- Standards for A Private Well in Nebraska

FG.4120 INDIVIDUAL SEWAGE SYSTEMS - County Resolution #2832

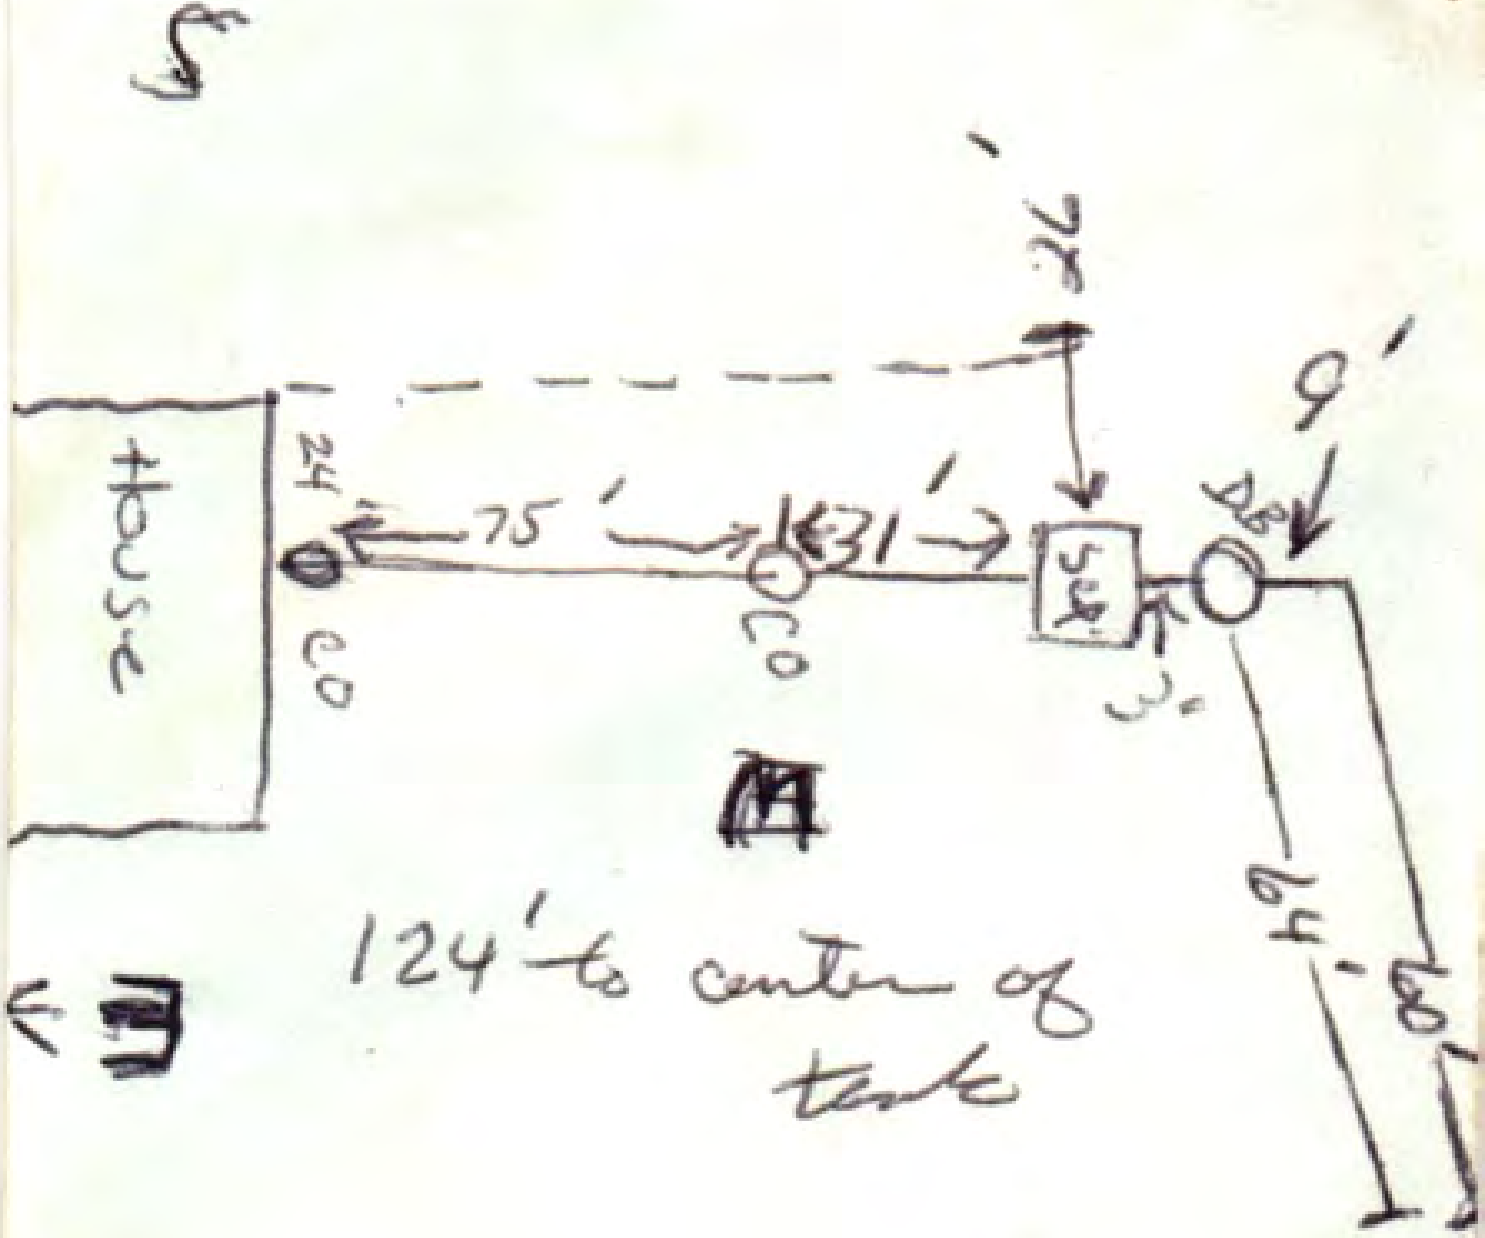

124' to center of tank

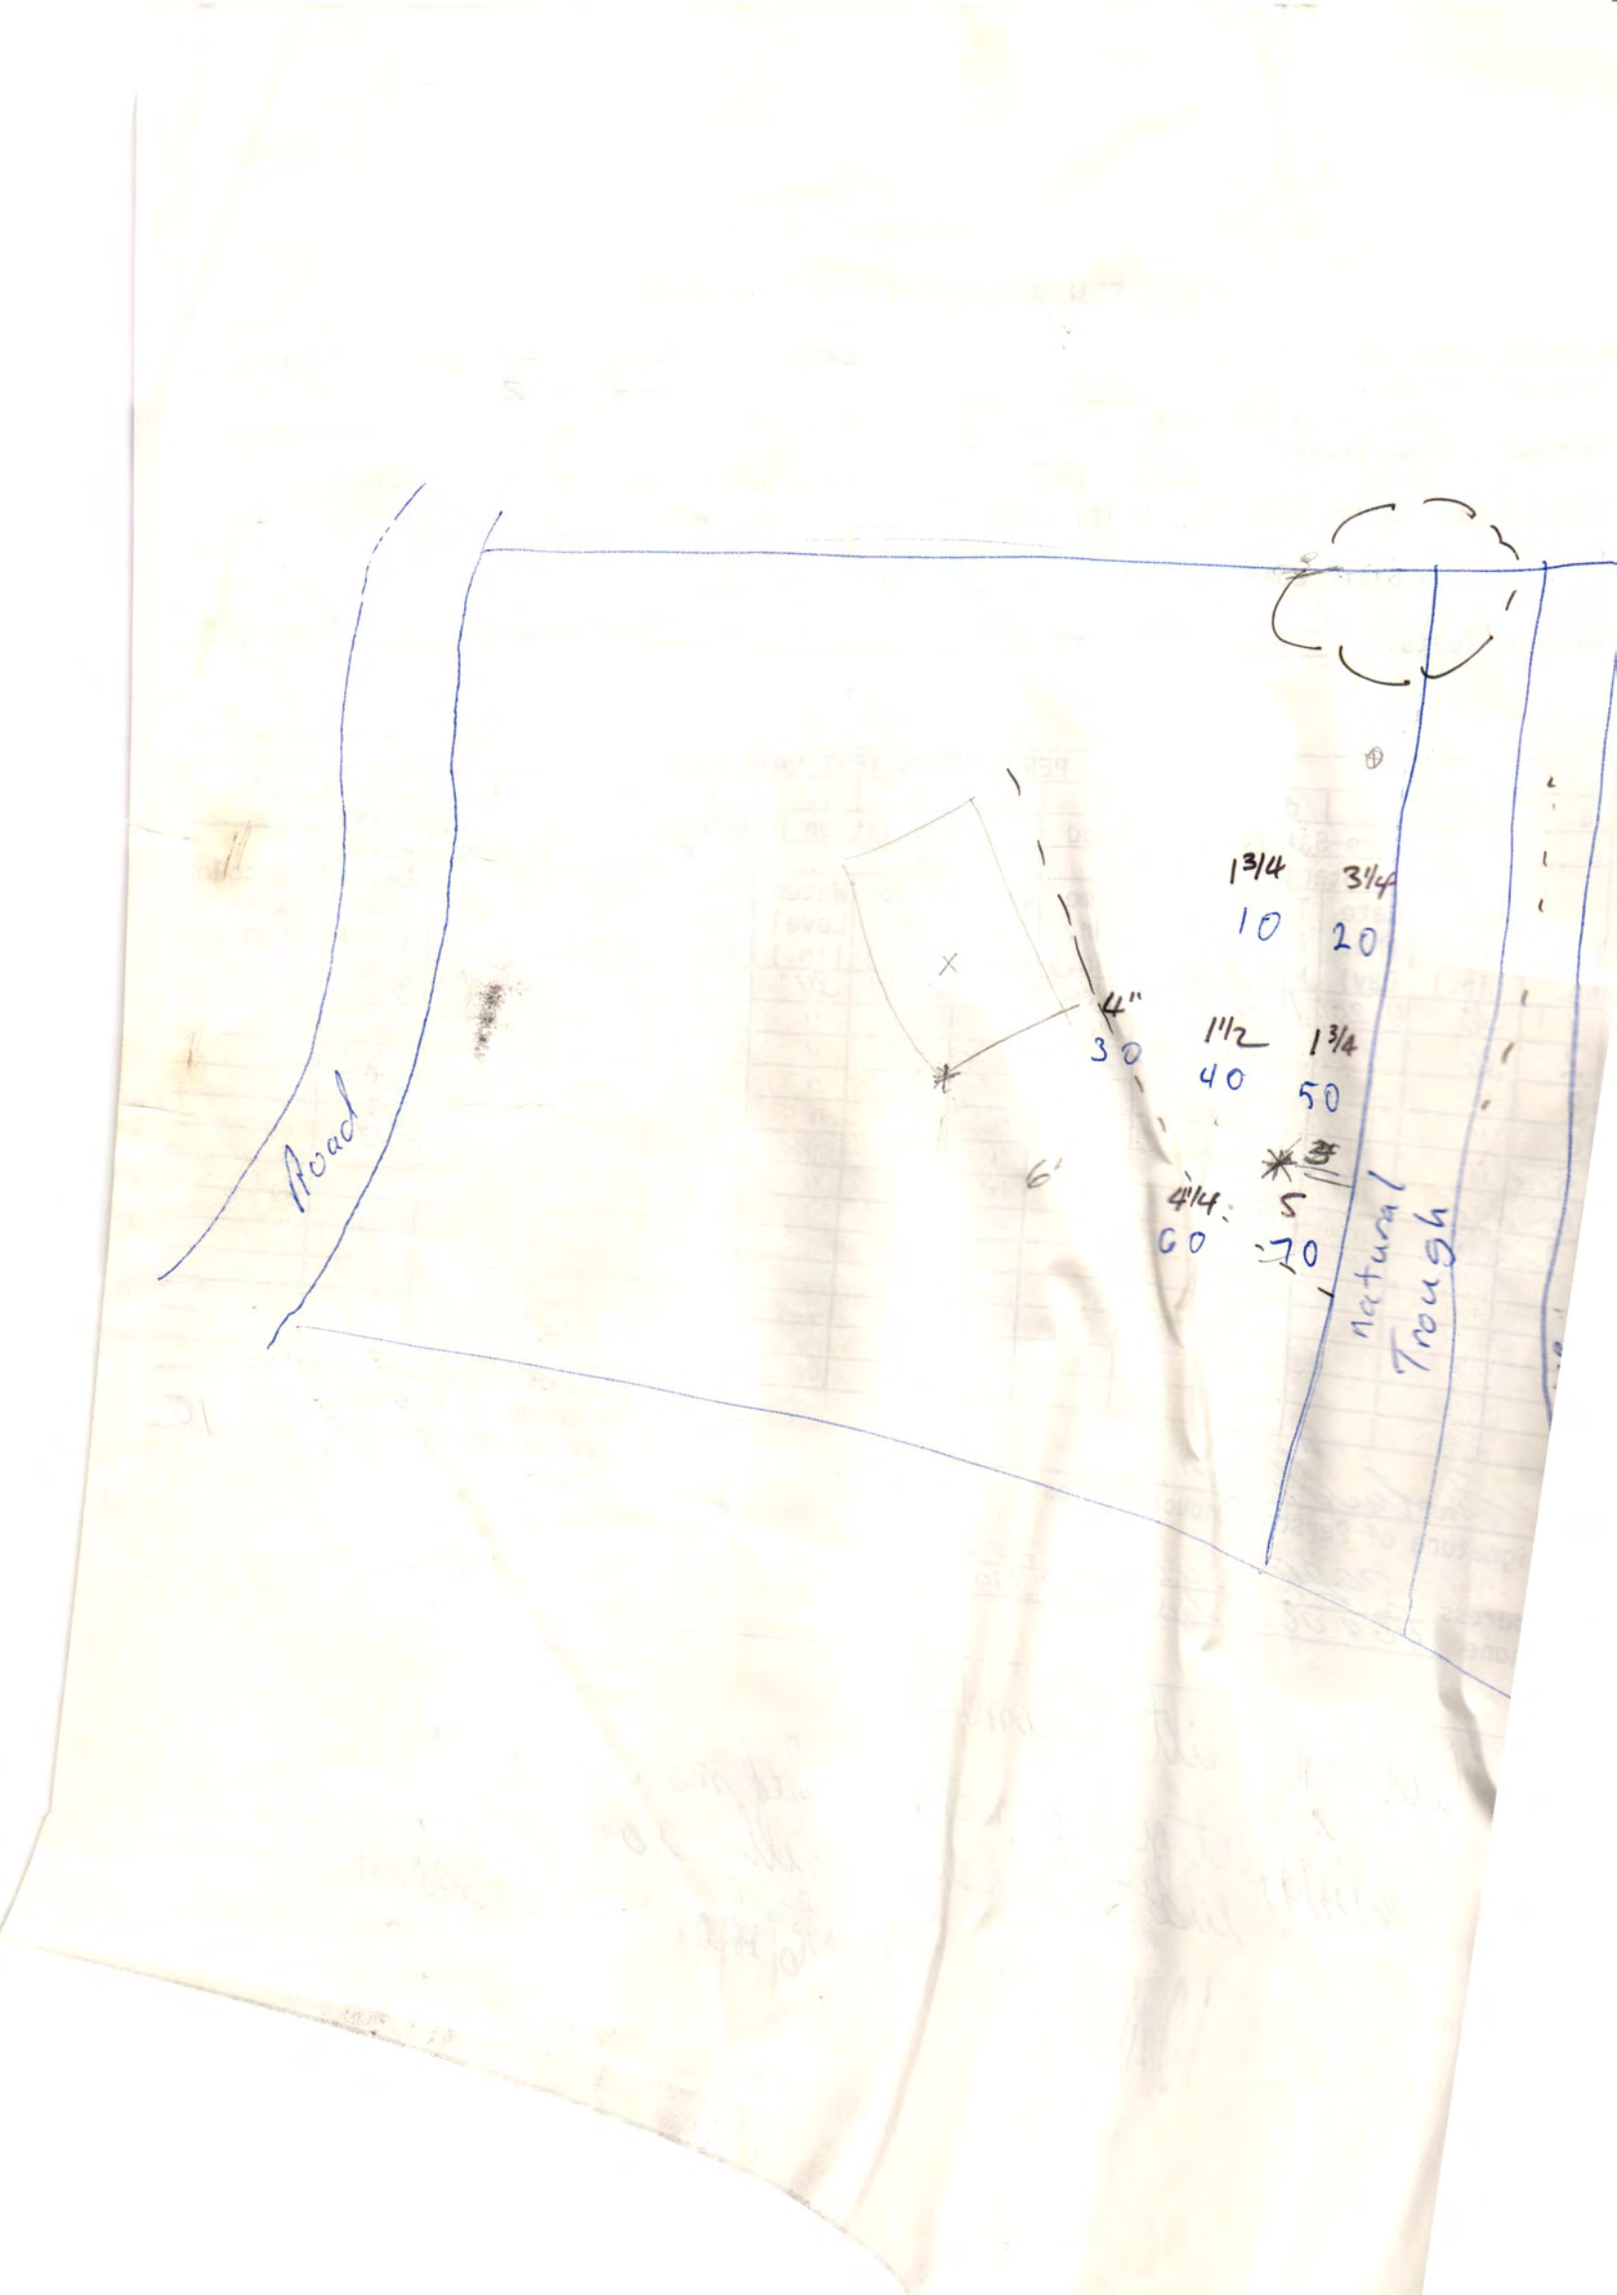
Road
1 3/4
3/4
10
20
4"
1 1/2
1 3/4
30
40
50
6'
4 1/4
5
60
70
natural
Trough